



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH4900012 CAMP WISSALOHICAN WATER SYSTEM

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955921	Facility Name: WISSALOHICAN CAMP	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018

OH4900012 CAMP WISSALOHICAN WATER SYSTEM

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: WISSALOHICAN/ASSOC WELL DISTRIBUTION
	SMP ID: DS000	

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018 and 1/31/2018
	1 Sample(s) Required between	2/1/2018 and 2/28/2018
	1 Sample(s) Required between	3/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 4/30/2018
	1 Sample(s) Required between	5/1/2018 and 5/31/2018
	1 Sample(s) Required between	6/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 7/31/2018
	1 Sample(s) Required between	8/1/2018 and 8/31/2018
	1 Sample(s) Required between	9/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 10/31/2018
	1 Sample(s) Required between	11/1/2018 and 11/30/2018
	1 Sample(s) Required between	12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2018 and 1/31/2018
	1 Sample(s) Required between	2/1/2018 and 2/28/2018
	1 Sample(s) Required between	3/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 4/30/2018
	1 Sample(s) Required between	5/1/2018 and 5/31/2018
	1 Sample(s) Required between	6/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 7/31/2018
	1 Sample(s) Required between	8/1/2018 and 8/31/2018
	1 Sample(s) Required between	9/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 10/31/2018
	1 Sample(s) Required between	11/1/2018 and 11/30/2018
	1 Sample(s) Required between	12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: WISSALOHICAN/ASSOC WELL DISTRIBUTION
	SMP ID: DS201	9549 HIGH FREE PIKE

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2018 and 9/30/2018 at: DS201
-------------------------	------------------------------	----------------------------------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 05/25/2018

2018 DISTRIBUTION SCHEDULE

OH4900012 CAMP WISSALOHICAN WATER SYSTEM

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: WISSALOHICAN/ASSOC WELL DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH4900112 CANAAN COMMUNITY MHP

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955922 SMP ID: EP001	Facility Name: CANAAN COMMUNITY MHP Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 7/1/2018 and 9/30/2018



OH4900112 CANAAN COMMUNITY MHP

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: CANAAN COMMUNITY MHP DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018 and 1/31/2018
	1 Sample(s) Required between	2/1/2018 and 2/28/2018
	1 Sample(s) Required between	3/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 4/30/2018
	1 Sample(s) Required between	5/1/2018 and 5/31/2018
	1 Sample(s) Required between	6/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 7/31/2018
	1 Sample(s) Required between	8/1/2018 and 8/31/2018
	1 Sample(s) Required between	9/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 10/31/2018
	1 Sample(s) Required between	11/1/2018 and 11/30/2018
	1 Sample(s) Required between	12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2018 and 1/31/2018
	1 Sample(s) Required between	2/1/2018 and 2/28/2018
	1 Sample(s) Required between	3/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 4/30/2018
	1 Sample(s) Required between	5/1/2018 and 5/31/2018
	1 Sample(s) Required between	6/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 7/31/2018
	1 Sample(s) Required between	8/1/2018 and 8/31/2018
	1 Sample(s) Required between	9/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 10/31/2018
	1 Sample(s) Required between	11/1/2018 and 11/30/2018
	1 Sample(s) Required between	12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: CANAAN COMMUNITY MHP DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2018 and 9/30/2018 at: DS201
-------------------------	------------------------------	----------------------------------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH4900112 CANAAN COMMUNITY MHP

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: CANAAN COMMUNITY MHP DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: CANAAN COMMUNITY MHP DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH4900212 CHOCTAW UTILITIES, INC.

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955923	Facility Name: CHOCTAW UTILITIES INC	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	1 Sample(s) Required between 10/1/2018 and 12/31/2018
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH4900212 CHOCTAW UTILITIES, INC.

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: CHOCTAW UTILITIES,INC. DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between	1/1/2018 and 1/31/2018
	2 Sample(s) Required between	2/1/2018 and 2/28/2018
	2 Sample(s) Required between	3/1/2018 and 3/31/2018
	2 Sample(s) Required between	4/1/2018 and 4/30/2018
	2 Sample(s) Required between	5/1/2018 and 5/31/2018
	2 Sample(s) Required between	6/1/2018 and 6/30/2018
	2 Sample(s) Required between	7/1/2018 and 7/31/2018
	2 Sample(s) Required between	8/1/2018 and 8/31/2018
	2 Sample(s) Required between	9/1/2018 and 9/30/2018
	2 Sample(s) Required between	10/1/2018 and 10/31/2018
	2 Sample(s) Required between	11/1/2018 and 11/30/2018
	2 Sample(s) Required between	12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	2 Sample(s) Required between	1/1/2018 and 1/31/2018
	2 Sample(s) Required between	2/1/2018 and 2/28/2018
	2 Sample(s) Required between	3/1/2018 and 3/31/2018
	2 Sample(s) Required between	4/1/2018 and 4/30/2018
	2 Sample(s) Required between	5/1/2018 and 5/31/2018
	2 Sample(s) Required between	6/1/2018 and 6/30/2018
	2 Sample(s) Required between	7/1/2018 and 7/31/2018
	2 Sample(s) Required between	8/1/2018 and 8/31/2018
	2 Sample(s) Required between	9/1/2018 and 9/30/2018
	2 Sample(s) Required between	10/1/2018 and 10/31/2018
	2 Sample(s) Required between	11/1/2018 and 11/30/2018
	2 Sample(s) Required between	12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: CHOCTAW UTILITIES,INC. DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH4900212 CHOCTAW UTILITIES, INC.

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: CHOCTAW UTILITIES,INC. DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: CHOCTAW UTILITIES,INC. DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH4900312 CORDLES MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955924	Facility Name: CORDLES MHP	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals	Monitoring Requirements	
ARSENIC - 1005	1 Sample(s) Required between	1/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 12/31/2018
INORGANICS	1 Sample(s) Required between	6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024		
FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	6/1/2018 and 10/31/2018
RADIOLOGICALS	1 Sample(s) Required between	6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002 RADIUM-228 - 4030		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	6/1/2018 and 10/31/2018



OH4900312 CORDLES MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: DS1 SMP ID: DS000 Facility Name: CORDLES MOBILE HOME PARK DISTRIBUTIOI Facility Class: CLASS 1

Chemicals Monitoring Requirements

Table with 3 columns: Chemicals, Monitoring Requirements, and dates. Includes TOTAL COLIFORM (TCR) - 3100 with 12 sampling requirements from 1/1/2018 to 12/31/2018.

Table with 3 columns: Chemicals, Monitoring Requirements, and dates. Includes TOTAL CHLORINE - 1000 with 12 sampling requirements from 1/1/2018 to 12/31/2018.

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: DS1 SMP ID: DS201 Facility Name: CORDLES MOBILE HOME PARK DISTRIBUTIOI Facility Class: CLASS 1 ADDRESS NOT KNOWN

Chemicals Monitoring Requirements

Table with 3 columns: Chemicals, Monitoring Requirements, and dates. Includes DISINFECTION BYPRODUCTS with 1 sampling requirement from 7/1/2018 to 9/30/2018.

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



OH4900512 GREENTREE MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955926 SMP ID: EP001	Facility Name: GREEN TREE MHP Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH4900512 GREENTREE MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: GREENTREE MOBILE HOME PK DISTRIBUTIOI	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: GREENTREE MOBILE HOME PK DISTRIBUTIOI ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2018

2018 DISTRIBUTION SCHEDULE

OH4900512 GREENTREE MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: GREENTREE MOBILE HOME PK DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs	

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022

Not Required



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH4900612 JEFFERSON LODGE MOBILE HOME

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955927 SMP ID: EP001	Facility Name: JEFFERSON LD & TRAIL CT INC Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH4900612 JEFFERSON LODGE MOBILE HOME

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: JEFFERSON LODGE MOBILE H DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018 and 1/31/2018
	1 Sample(s) Required between	2/1/2018 and 2/28/2018
	1 Sample(s) Required between	3/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 4/30/2018
	1 Sample(s) Required between	5/1/2018 and 5/31/2018
	1 Sample(s) Required between	6/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 7/31/2018
	1 Sample(s) Required between	8/1/2018 and 8/31/2018
	1 Sample(s) Required between	9/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 10/31/2018
	1 Sample(s) Required between	11/1/2018 and 11/30/2018
	1 Sample(s) Required between	12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2018 and 1/31/2018
	1 Sample(s) Required between	2/1/2018 and 2/28/2018
	1 Sample(s) Required between	3/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 4/30/2018
	1 Sample(s) Required between	5/1/2018 and 5/31/2018
	1 Sample(s) Required between	6/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 7/31/2018
	1 Sample(s) Required between	8/1/2018 and 8/31/2018
	1 Sample(s) Required between	9/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 10/31/2018
	1 Sample(s) Required between	11/1/2018 and 11/30/2018
	1 Sample(s) Required between	12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: JEFFERSON LODGE MOBILE H DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2018 and 9/30/2018 at: DS201
-------------------------	------------------------------	----------------------------------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH4900712 LONDON CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955928	Facility Name: LONDON WTP	Facility Class: CLASS 2
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018

OH4900712 LONDON CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: LONDON, CITY OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	10 Sample(s) Required between 1/1/2018 and 1/31/2018
	10 Sample(s) Required between 2/1/2018 and 2/28/2018
	10 Sample(s) Required between 3/1/2018 and 3/31/2018
	10 Sample(s) Required between 4/1/2018 and 4/30/2018
	10 Sample(s) Required between 5/1/2018 and 5/31/2018
	10 Sample(s) Required between 6/1/2018 and 6/30/2018
	10 Sample(s) Required between 7/1/2018 and 7/31/2018
	10 Sample(s) Required between 8/1/2018 and 8/31/2018
	10 Sample(s) Required between 9/1/2018 and 9/30/2018
	10 Sample(s) Required between 10/1/2018 and 10/31/2018
	10 Sample(s) Required between 11/1/2018 and 11/30/2018
	10 Sample(s) Required between 12/1/2018 and 12/31/2018

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: LONDON, CITY OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: LONDON, CITY OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: LONDON, CITY OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required



OH4900812 MOUNT STERLING VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4962434 SMP ID: EP002	Facility Name: MOUNT STERLING TREATMENT PLANT 2 Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	1 Sample(s) Required between	6/1/2018 and 10/31/2018
NITRATE - 1040	1 Sample(s) Required between	6/1/2018 and 10/31/2018
RADIOLOGICALS	1 Sample(s) Required between	1/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 12/31/2018
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002 RADIUM-228 - 4030		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 12/31/2018

OH4900812 MOUNT STERLING VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MOUNT STERLING, VLG. OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between	1/1/2018 and 1/31/2018
	2 Sample(s) Required between	2/1/2018 and 2/28/2018
	2 Sample(s) Required between	3/1/2018 and 3/31/2018
	2 Sample(s) Required between	4/1/2018 and 4/30/2018
	2 Sample(s) Required between	5/1/2018 and 5/31/2018
	2 Sample(s) Required between	6/1/2018 and 6/30/2018
	2 Sample(s) Required between	7/1/2018 and 7/31/2018
	2 Sample(s) Required between	8/1/2018 and 8/31/2018
	2 Sample(s) Required between	9/1/2018 and 9/30/2018
	2 Sample(s) Required between	10/1/2018 and 10/31/2018
	2 Sample(s) Required between	11/1/2018 and 11/30/2018
	2 Sample(s) Required between	12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	2 Sample(s) Required between	1/1/2018 and 1/31/2018
	2 Sample(s) Required between	2/1/2018 and 2/28/2018
	2 Sample(s) Required between	3/1/2018 and 3/31/2018
	2 Sample(s) Required between	4/1/2018 and 4/30/2018
	2 Sample(s) Required between	5/1/2018 and 5/31/2018
	2 Sample(s) Required between	6/1/2018 and 6/30/2018
	2 Sample(s) Required between	7/1/2018 and 7/31/2018
	2 Sample(s) Required between	8/1/2018 and 8/31/2018
	2 Sample(s) Required between	9/1/2018 and 9/30/2018
	2 Sample(s) Required between	10/1/2018 and 10/31/2018
	2 Sample(s) Required between	11/1/2018 and 11/30/2018
	2 Sample(s) Required between	12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MOUNT STERLING, VLG. OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH4900812 MOUNT STERLING VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: MOUNT STERLING, VLG. OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: MOUNT STERLING, VLG. OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022

20 Sample(s) Required between 1/1/2018 and 6/30/2018

20 Sample(s) Required between 7/1/2018 and 12/31/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH4901012 ODRC-LONDON CORRECTIONAL

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955931	Facility Name: ODRC LONDON CORRECTIONAL INSTITUTION	Facility Class: CLASS 2
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018

OH4901012 ODRC-LONDON CORRECTIONAL

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: ODRC-LONDON CORRECTIONAL DISTRIBUTIC	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	6 Sample(s) Required between 1/1/2018 and 1/31/2018
	6 Sample(s) Required between 2/1/2018 and 2/28/2018
	6 Sample(s) Required between 3/1/2018 and 3/31/2018
	6 Sample(s) Required between 4/1/2018 and 4/30/2018
	6 Sample(s) Required between 5/1/2018 and 5/31/2018
	6 Sample(s) Required between 6/1/2018 and 6/30/2018
	6 Sample(s) Required between 7/1/2018 and 7/31/2018
	6 Sample(s) Required between 8/1/2018 and 8/31/2018
	6 Sample(s) Required between 9/1/2018 and 9/30/2018
	6 Sample(s) Required between 10/1/2018 and 10/31/2018
	6 Sample(s) Required between 11/1/2018 and 11/30/2018
	6 Sample(s) Required between 12/1/2018 and 12/31/2018
TOTAL CHLORINE - 1000	6 Sample(s) Required between 1/1/2018 and 1/31/2018
	6 Sample(s) Required between 2/1/2018 and 2/28/2018
	6 Sample(s) Required between 3/1/2018 and 3/31/2018
	6 Sample(s) Required between 4/1/2018 and 4/30/2018
	6 Sample(s) Required between 5/1/2018 and 5/31/2018
	6 Sample(s) Required between 6/1/2018 and 6/30/2018
	6 Sample(s) Required between 7/1/2018 and 7/31/2018
	6 Sample(s) Required between 8/1/2018 and 8/31/2018
	6 Sample(s) Required between 9/1/2018 and 9/30/2018
	6 Sample(s) Required between 10/1/2018 and 10/31/2018
	6 Sample(s) Required between 11/1/2018 and 11/30/2018
	6 Sample(s) Required between 12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: ODRC-LONDON CORRECTIONAL DISTRIBUTIC	Facility Class: CLASS 1
SEWAGE TREATMENT PLAN, SEWAGE PLANT R			

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH4901012 ODRC-LONDON CORRECTIONAL

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: ODRC-LONDON CORRECTIONAL DISTRIBUTUTIC	Facility Class: CLASS 1
	SMP ID: DS202	DAIRY BARN, DAIRY BARN RD. (LOCI)	

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1	Facility Name: ODRC-LONDON CORRECTIONAL DISTRIBUTUTIC	Facility Class: CLASS 1
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs	

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 20 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH4901112 PLAIN CITY VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955932	Facility Name: PLAIN CITY PWS	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018

OH4901112 PLAIN CITY VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: PLAIN CITY, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
ASBESTOS - 1094	Not Required
TOTAL COLIFORM (TCR) - 3100	5 Sample(s) Required between 10/1/2018 and 10/31/2018 5 Sample(s) Required between 11/1/2018 and 11/30/2018 5 Sample(s) Required between 12/1/2018 and 12/31/2018
TOTAL CHLORINE - 1000	5 Sample(s) Required between 10/1/2018 and 10/31/2018 5 Sample(s) Required between 11/1/2018 and 11/30/2018 5 Sample(s) Required between 12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: PLAIN CITY, VILLAGE OF DISTRIBUTION 650 WEST MAIN STREET	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: PLAIN CITY, VILLAGE OF DISTRIBUTION 500 SOUTH CHILLICOTHE STREET	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: PLAIN CITY, VILLAGE OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH4901212 PLUMWOOD MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955933 SMP ID: EP001	Facility Name: PLUMWOOD MHP Facility Source: Ground Water	Facility Class: CLASS A
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 4/1/2018 and 6/30/2018



OH4901212 PLUMWOOD MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: PLUMWOOD MOBILE HOME PK. DISTRIBUTIO
Location SMP ID: DS000

Chemicals

Monitoring Requirements

Table with 3 columns: Chemicals, Monitoring Requirements, and Dates. Includes entries for TOTAL COLIFORM (TCR) - 3100 with 12 sampling requirements from 1/1/2018 to 12/31/2018.

Table with 3 columns: Chemicals, Monitoring Requirements, and Dates. Includes entries for TOTAL CHLORINE - 1000 with 12 sampling requirements from 1/1/2018 to 12/31/2018.

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: PLUMWOOD MOBILE HOME PK. DISTRIBUTIO
Location SMP ID: DS201 ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

Table with 3 columns: Chemicals, Monitoring Requirements, and Dates. Includes entry for DISINFECTION BYPRODUCTS with Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



Effective Date: 06/15/2018

2018 DISTRIBUTION SCHEDULE

OH4901212 PLUMWOOD MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: PLUMWOOD MOBILE HOME PK. DISTRIBUTIO
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022

Not Required



OH4901312 SOUTH SOLON VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955934 SMP ID: EP001	Facility Name: SOUTH SOLON WTP Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	6/1/2018 and 10/31/2018
RADIOLOGICALS	1 Sample(s) Required between	6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002 RADIUM-228 - 4030		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	6/1/2018 and 10/31/2018

OH4901312 SOUTH SOLON VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: SOUTH SOLON, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: SOUTH SOLON, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 9/8/2018 and 9/14/2018 at: DS201 Dual Sample Required between 12/8/2018 and 12/14/2018 at: DS201
-------------------------	--

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH4901412 SPRING VALLEY MHP

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955935	Facility Name: GARY STITES DBA SPRING VALLEY MHP
	SMP ID: EP001	Facility Source: Ground Water
		Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH4901412 SPRING VALLEY MHP

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: SPRING VALLEY MHP DISTRIBUTION
Location SMP ID: DS000

Chemicals

Monitoring Requirements

Table with 3 columns: Chemicals, Monitoring Requirements, and dates. Includes TOTAL COLIFORM (TCR) - 3100 with 12 sampling requirements from 1/1/2018 to 12/31/2018.

Table with 3 columns: Chemicals, Monitoring Requirements, and dates. Includes TOTAL CHLORINE - 1000 with 12 sampling requirements from 1/1/2018 to 12/31/2018.

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: SPRING VALLEY MHP DISTRIBUTION
Location SMP ID: DS201 ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

Table with 3 columns: Chemicals, Monitoring Requirements, and dates. Includes DISINFECTION BYPRODUCTS with Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



OH4901512 PICKET FENCES MOBILE HOME COMMUNITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955936	Facility Name: PICKETT FENCES MHP	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH4901512 PICKET FENCES MOBILE HOME COMMUNITY

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: PICKET FENCES MOBILE HOM DISTRIBUTION
Location SMP ID: DS000

Chemicals

Monitoring Requirements

Table with 3 columns: Chemicals, Monitoring Requirements, and dates. Includes TOTAL COLIFORM (TCR) - 3100 with 12 sampling requirements from 1/1/2018 to 12/31/2018.

Table with 3 columns: Chemicals, Monitoring Requirements, and dates. Includes TOTAL CHLORINE - 1000 with 12 sampling requirements from 1/1/2018 to 12/31/2018.

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: PICKET FENCES MOBILE HOM DISTRIBUTION
Location SMP ID: DS201 ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

Table with 3 columns: Chemicals, Monitoring Requirements, and dates. Includes DISINFECTION BYPRODUCTS with Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



Effective Date: 01/01/2018

2018 DISTRIBUTION SCHEDULE

OH4901512 PICKET FENCES MOBILE HOME COMMUNITY

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: PICKET FENCES MOBILE HOM DISTRIBUTION
Location	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH4901612 SUBURBANS COMMUNITY MHP

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955937 SMP ID: EP001	Facility Name: SUBURBANS COMMUNITY MHP Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS <i>Sample for all the analytes listed below:</i> ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	1 Sample(s) Required between 6/1/2018 and 10/31/2018
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS <i>Sample for all the analytes listed below:</i> GROSS ALPHA - 4002 RADIUM-228 - 4030	1 Sample(s) Required between 6/1/2018 and 10/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH4901612 SUBURBANS COMMUNITY MHP

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS1, SUBURBANS COMMUNITY MHP DISTRIBUTION, CLASS 1, DS000.

Chemicals Monitoring Requirements

Table for TOTAL COLIFORM (TCR) - 3100 with 12 rows of monitoring requirements from 1/1/2018 to 12/31/2018.

Table for TOTAL CHLORINE - 1000 with 12 rows of monitoring requirements from 1/1/2018 to 12/31/2018.

Samples should be collected at the same time and place as the Total Coliform samples.

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS201, ADDRESS NOT KNOWN, CLASS 1.

Chemicals Monitoring Requirements

Table for DISINFECTION BYPRODUCTS with 1 row: Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



OH4901612 SUBURBANS COMMUNITY MHP

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: SUBURBANS COMMUNITY MHP DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS202	ADDRESS NOT KNOWN	

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1	Facility Name: SUBURBANS COMMUNITY MHP DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs	

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH4901812 GREEN MEADOWS MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955939	Facility Name: GREEN MEADOWS MHP	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 7/1/2018 and 9/30/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH4901812 GREEN MEADOWS MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: GREEN MEDOWS MOBILE HOME DISTRIBUTIC	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: GREEN MEDOWS MOBILE HOME DISTRIBUTIC ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH4901812 GREEN MEADOWS MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: GREEN MEDOWS MOBILE HOME DISTRIBUTIC	Facility Class: CLASS 1
	SMP ID: DS202	ADDRESS NOT KNOWN	

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1	Facility Name: GREEN MEDOWS MOBILE HOME DISTRIBUTIC	Facility Class: CLASS 1
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs	

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH4902012 WEST JEFFERSON VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955940 SMP ID: EP001	Facility Name: WEST JEFFERSON PWS Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH4902012 WEST JEFFERSON VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: WEST JEFFERSON, VILLAGE DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	5 Sample(s) Required between	1/1/2018 and 1/31/2018
	5 Sample(s) Required between	2/1/2018 and 2/28/2018
	5 Sample(s) Required between	3/1/2018 and 3/31/2018
	5 Sample(s) Required between	4/1/2018 and 4/30/2018
	5 Sample(s) Required between	5/1/2018 and 5/31/2018
	5 Sample(s) Required between	6/1/2018 and 6/30/2018
	5 Sample(s) Required between	7/1/2018 and 7/31/2018
	5 Sample(s) Required between	8/1/2018 and 8/31/2018
	5 Sample(s) Required between	9/1/2018 and 9/30/2018
	5 Sample(s) Required between	10/1/2018 and 10/31/2018
	5 Sample(s) Required between	11/1/2018 and 11/30/2018
	5 Sample(s) Required between	12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	5 Sample(s) Required between	1/1/2018 and 1/31/2018
	5 Sample(s) Required between	2/1/2018 and 2/28/2018
	5 Sample(s) Required between	3/1/2018 and 3/31/2018
	5 Sample(s) Required between	4/1/2018 and 4/30/2018
	5 Sample(s) Required between	5/1/2018 and 5/31/2018
	5 Sample(s) Required between	6/1/2018 and 6/30/2018
	5 Sample(s) Required between	7/1/2018 and 7/31/2018
	5 Sample(s) Required between	8/1/2018 and 8/31/2018
	5 Sample(s) Required between	9/1/2018 and 9/30/2018
	5 Sample(s) Required between	10/1/2018 and 10/31/2018
	5 Sample(s) Required between	11/1/2018 and 11/30/2018
	5 Sample(s) Required between	12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: WEST JEFFERSON, VILLAGE DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH4902012 WEST JEFFERSON VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: WEST JEFFERSON, VILLAGE DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS202	ADDRESS NOT KNOWN	

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS202
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1	Facility Name: WEST JEFFERSON, VILLAGE DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs	

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH4902112 ROSEDALE BIBLE INSTITUTE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955941	Facility Name: ROSEDALE BIBLE COLLEGE	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH4902112 ROSEDALE BIBLE INSTITUTE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2018

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: DS1 Facility Name: ROSEDALE BIBLE INSTITUTE DISTRIBUTION SMP ID: DS000

Table with 2 columns: Chemicals and Monitoring Requirements. Lists monitoring schedules for TOTAL COLIFORM (TCR) - 3100 and TOTAL CHLORINE - 1000.

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: DS1 Facility Name: ROSEDALE BIBLE INSTITUTE DISTRIBUTION SMP ID: DS201 ADDRESS NOT KNOWN

Table with 2 columns: Chemicals and Monitoring Requirements. Lists monitoring schedule for DISINFECTION BYPRODUCTS.

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950

OH4930112 B AND B LODGE PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: B & B LODGE DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

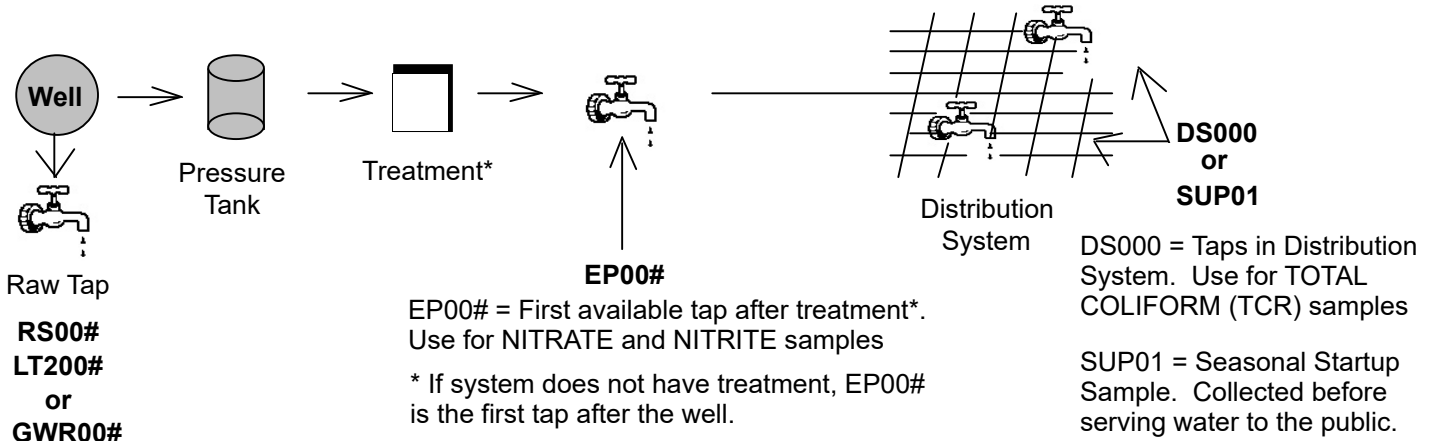

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4930112 B AND B LODGE PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4961059 Facility Name: B & B LODGE
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2018

2018 DISTRIBUTION SCHEDULE

OH4930212 BATTELLE-WEST JEFFERSON

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **BATTELLE-WEST JEFFERSON DISTRIBUTION**
Location SMP ID: **DS000**

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2018 and 3/31/2018
1 Sample(s) Required between 4/1/2018 and 6/30/2018
1 Sample(s) Required between 7/1/2018 and 9/30/2018
1 Sample(s) Required between 10/1/2018 and 12/31/2018

Sampling Facility ID: **DS1** Facility Name: **BATTELLE-WEST JEFFERSON DISTRIBUTION**
Location SMP ID: **LC###** Refer to your Lead and Copper plan for SMP IDs

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH4930912 CANAAN MIDDLE SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955943	Facility Name: CANAAN MIDDLE SCH	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2018 and 10/31/2018

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2018 and 10/31/2018

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH4930912 CANAAN MIDDLE SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: CANAAN MIDDLE SCHOOL DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: CANAAN MIDDLE SCHOOL DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: CANAAN MIDDLE SCHOOL DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH4931112 TOLLES TECHNICAL CENTER

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955944	Facility Name: CENTRAL OHIO JVS DIST TOLLES TECH WTP	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2018 and 10/31/2018

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2018 and 10/31/2018

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2018 and 10/31/2018

OH4931112 TOLLES TECHNICAL CENTER

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: TOLLES TECHNICAL DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: TOLLES TECHNICAL DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: TOLLES TECHNICAL DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS202
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: TOLLES TECHNICAL DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2018 and 9/30/2018
-------------------------------	--

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH4932812 JONATHAN ALDER JUNIOR HIGH SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955950	Facility Name: JONATHAN ALDER JUNIOR HIGH	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	
ARSENIC - 1005	1 Sample(s) Required between	1/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 12/31/2018
INORGANICS	1 Sample(s) Required between	6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024		
FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	6/1/2018 and 10/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	4/1/2018 and 6/30/2018



OH4932812 JONATHAN ALDER JUNIOR HIGH SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **JONATHAN ALDER JUNIOR HIGH SCL DISTRIE** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	12/31/2018

Sampling Location Facility ID: **DS1** Facility Name: **JONATHAN ALDER JUNIOR HIGH SCL DISTRIE** Facility Class: **CLASS 1**
SMP ID: **LC###** Refer to your Lead and Copper plan for SMP IDs

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between	6/1/2018	and	9/30/2018
-------------------------------	------------------------------	----------	-----	-----------

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH4933012 OLD 42 ANTIQUES AND VINTAGE MARKETPLACE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

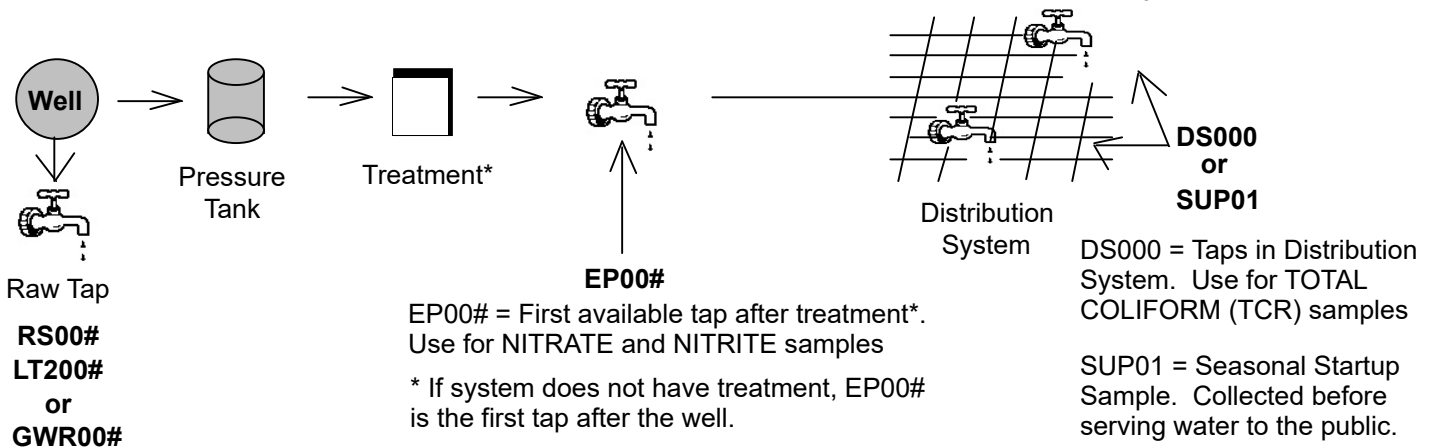

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4933012 OLD 42 ANTIQUES AND VINTAGE MARKETPLACE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955951 Facility Name: OLD 42 ANTIQUES AND VINTAGE MARKETPLACE
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4933412 LAFAYETTE UNITED METHODIST CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: LAFAYETTE UNITED METH CHURCH DISTRIBUTIO
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4933412 LAFAYETTE UNITED METHODIST CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4960716 Facility Name: LAFAYETTE UNITED METHODIST CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4933912 LONDON COUNTRY CLUB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **LONDON COUNTRY CLUB DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

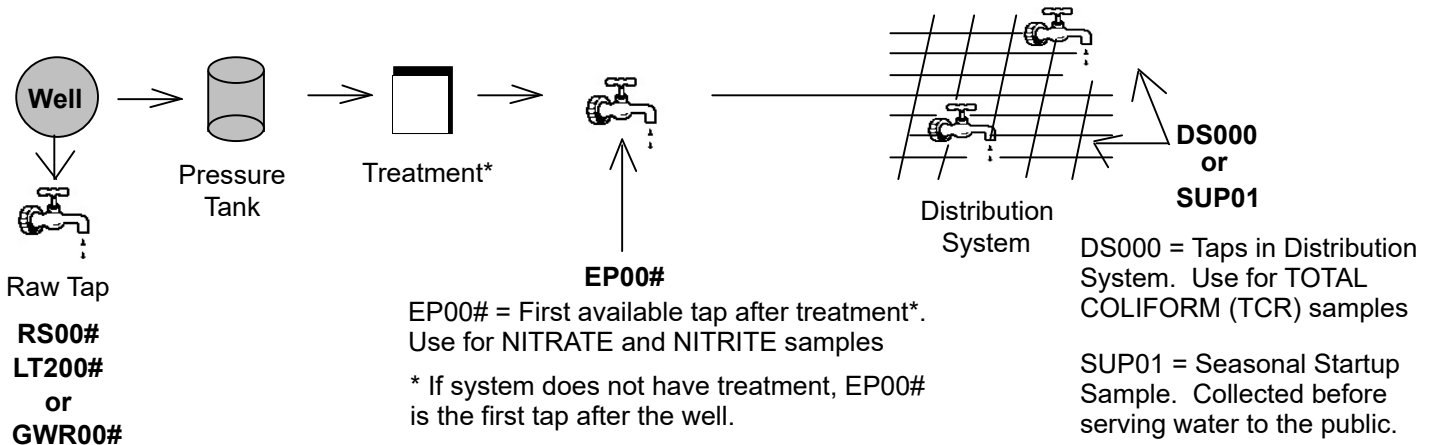

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4933912 LONDON COUNTRY CLUB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955954 Facility Name: LONDON COUNTRY CLUB
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH4934212 MADISON PLAINS HIGH SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955956	Facility Name: MADISON PLAINS HS	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2018 and 10/31/2018

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2018 and 10/31/2018

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH4934212 MADISON PLAINS HIGH SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **MADISON PLAINS HIGH SCH. DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Sampling Location Facility ID: **DS1** Facility Name: **MADISON PLAINS HIGH SCH. DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **LC###** Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH4934312 MADISON PLAINS ELEMENTARY SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955957	Facility Name: MADISON PLAINS MIDDLE SCHOOL	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2018 and 10/31/2018

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2018 and 10/31/2018

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH4934312 MADISON PLAINS ELEMENTARY SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **MADISON PLAINS MIDDLE SC DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	12/31/2018

Sampling Location Facility ID: **DS1** Facility Name: **MADISON PLAINS MIDDLE SC DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **LC###** Refer to your Lead and Copper plan for SMP IDs

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between	6/1/2018	and	9/30/2018
-------------------------------	-------------------------------	----------	-----	-----------

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH4934912 MARANATHA COMMUNITY FELLOWSHIP PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: MARANATHA COMMUNITY FELLOWSHIP DISTRIB.
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4934912 MARANATHA COMMUNITY FELLOWSHIP PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4962250 Facility Name: MARANATHA COMMUNITY FELLOWSHIP CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

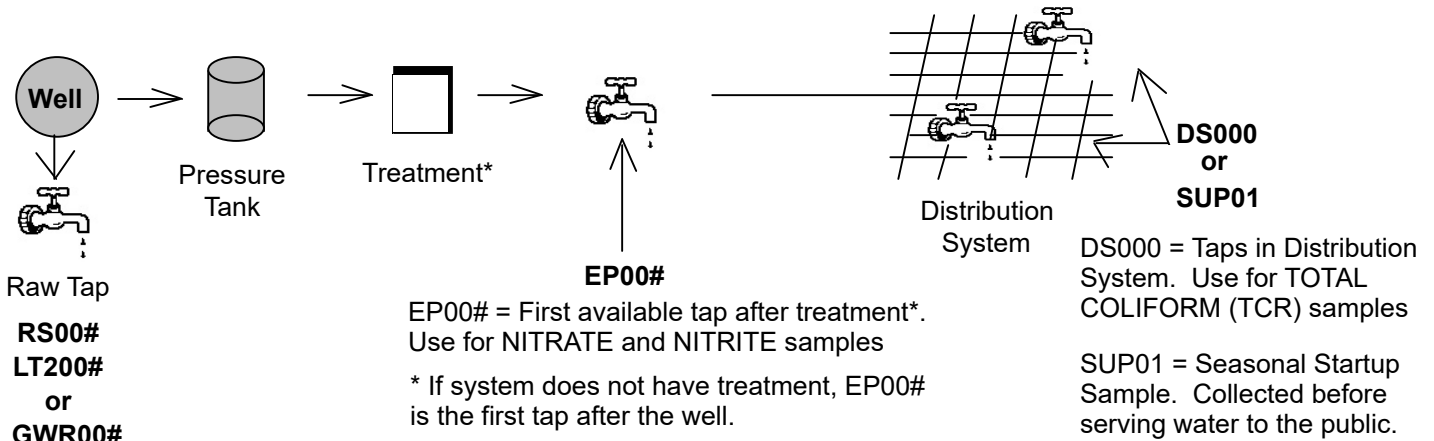

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4936112 RED BRICK TAVERN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: RED BRICK TAVERN DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4936112 RED BRICK TAVERN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955963 Facility Name: RED BRICK TAVERN
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

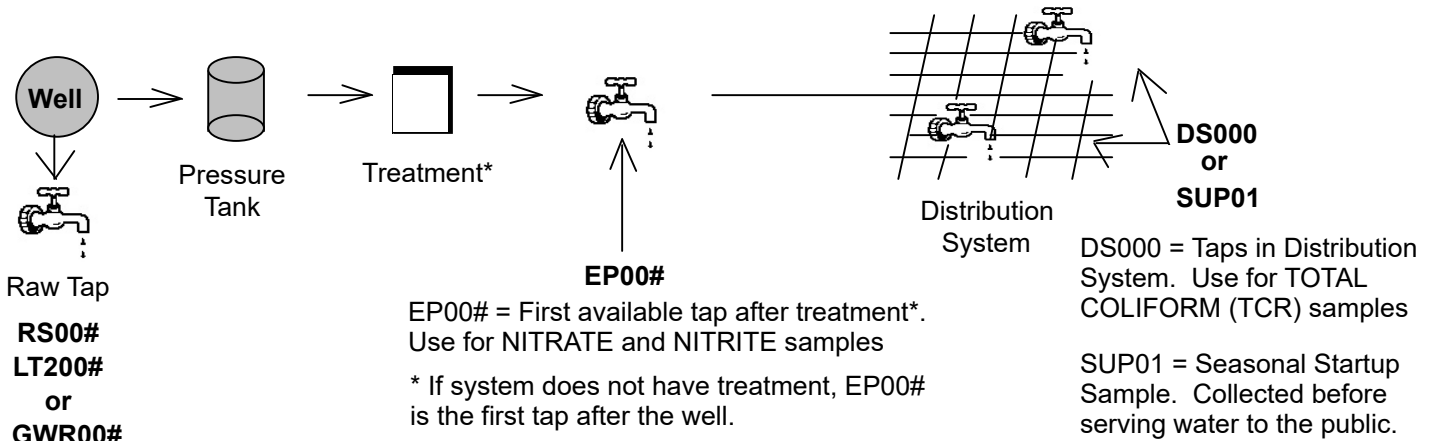

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4936212 PROCTER CONFERENCE CENTER

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: PROCTER CONFERENCE CENTER DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

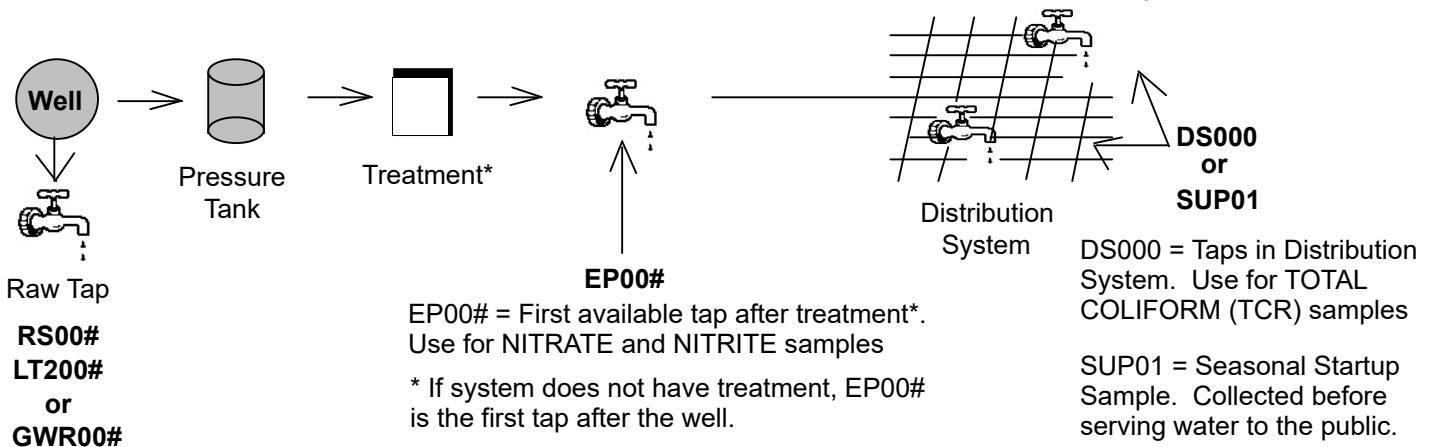

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4936212 PROCTER CONFERENCE CENTER

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955964	Facility Name: PROCTER CONFERENCE CENTER	
Location SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

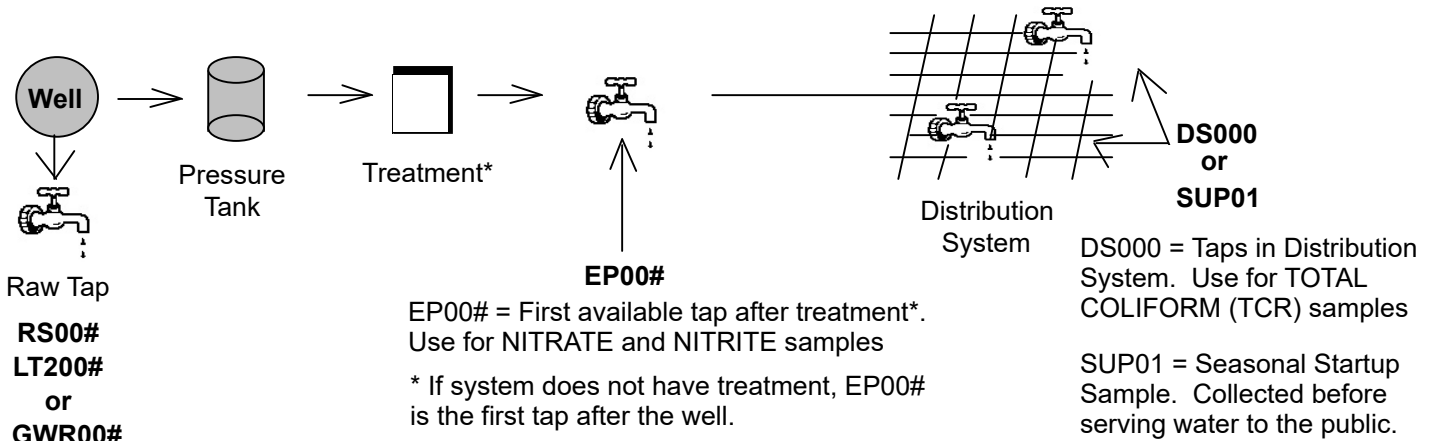

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4936812 HENRYS RESTAURANT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: HENRYS RESTAURANT DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

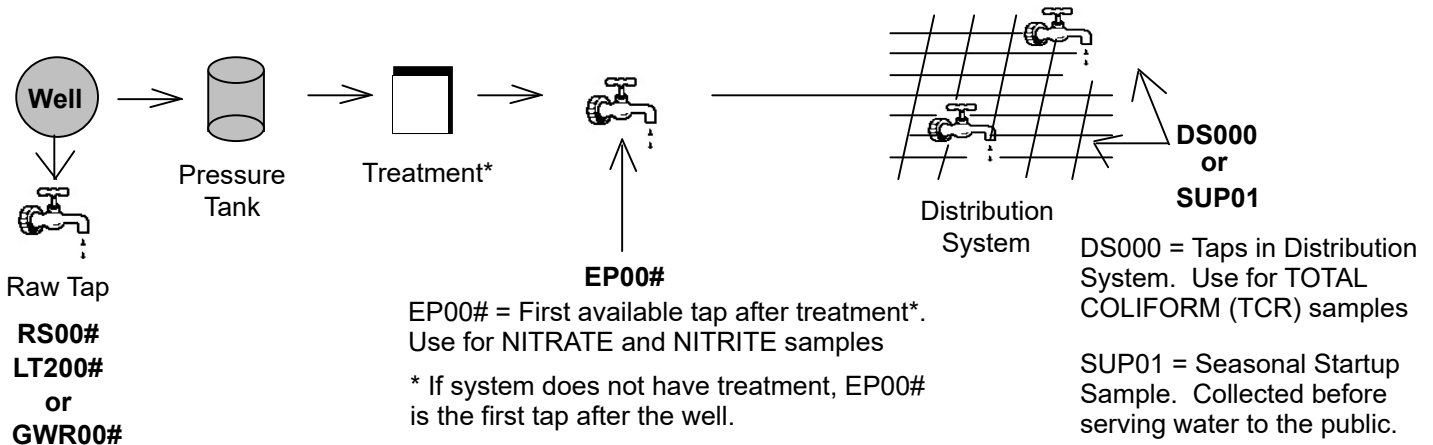

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4936812 HENRYS RESTAURANT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955967 Facility Name: HENRYS RESTAURANT
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4937012 BP OIL AT 56 AND 71

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BP OIL AT 56&71 DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

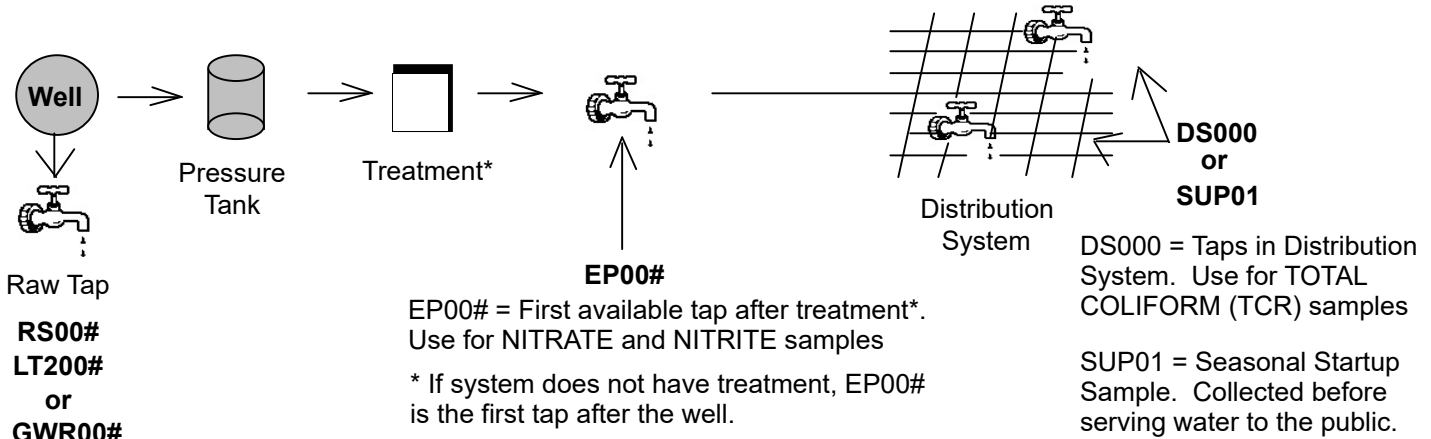

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4937012 BP OIL AT 56 AND 71

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955969 Facility Name: BP OIL AT 56 & 71
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH4937712 TRAVEL CENTERS OF AMERICA

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955971	Facility Name: TRAVEL CENTERS OF AMERICA LONDON	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	
ARSENIC - 1005	1 Sample(s) Required between	1/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 12/31/2018
INORGANICS	1 Sample(s) Required between	6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024		
FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	6/1/2018 and 10/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	6/1/2018 and 10/31/2018

OH4937712 TRAVEL CENTERS OF AMERICA

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: TRAVEL CENTERS OF AMERIC DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between	1/1/2018 and 1/31/2018
	2 Sample(s) Required between	2/1/2018 and 2/28/2018
	2 Sample(s) Required between	3/1/2018 and 3/31/2018
	2 Sample(s) Required between	4/1/2018 and 4/30/2018
	2 Sample(s) Required between	5/1/2018 and 5/31/2018
	2 Sample(s) Required between	6/1/2018 and 6/30/2018
	2 Sample(s) Required between	7/1/2018 and 7/31/2018
	2 Sample(s) Required between	8/1/2018 and 8/31/2018
	2 Sample(s) Required between	9/1/2018 and 9/30/2018
	2 Sample(s) Required between	10/1/2018 and 10/31/2018
	2 Sample(s) Required between	11/1/2018 and 11/30/2018
	2 Sample(s) Required between	12/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	2 Sample(s) Required between	1/1/2018 and 1/31/2018
	2 Sample(s) Required between	2/1/2018 and 2/28/2018
	2 Sample(s) Required between	3/1/2018 and 3/31/2018
	2 Sample(s) Required between	4/1/2018 and 4/30/2018
	2 Sample(s) Required between	5/1/2018 and 5/31/2018
	2 Sample(s) Required between	6/1/2018 and 6/30/2018
	2 Sample(s) Required between	7/1/2018 and 7/31/2018
	2 Sample(s) Required between	8/1/2018 and 8/31/2018
	2 Sample(s) Required between	9/1/2018 and 9/30/2018
	2 Sample(s) Required between	10/1/2018 and 10/31/2018
	2 Sample(s) Required between	11/1/2018 and 11/30/2018
	2 Sample(s) Required between	12/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: TRAVEL CENTERS OF AMERIC DISTRIBUTION MENS RR SINK 1	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2018 and 9/30/2018 at: DS201
-------------------------	------------------------------	----------------------------------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH4938212 COMMUNITY FREEWILL BAPTIST CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: COMMUNITY FREEWILL BAPTIST DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4938212 COMMUNITY FREEWILL BAPTIST CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955974 Facility Name: COMMUNITY FREEWILL BAPTIST CHURCH

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

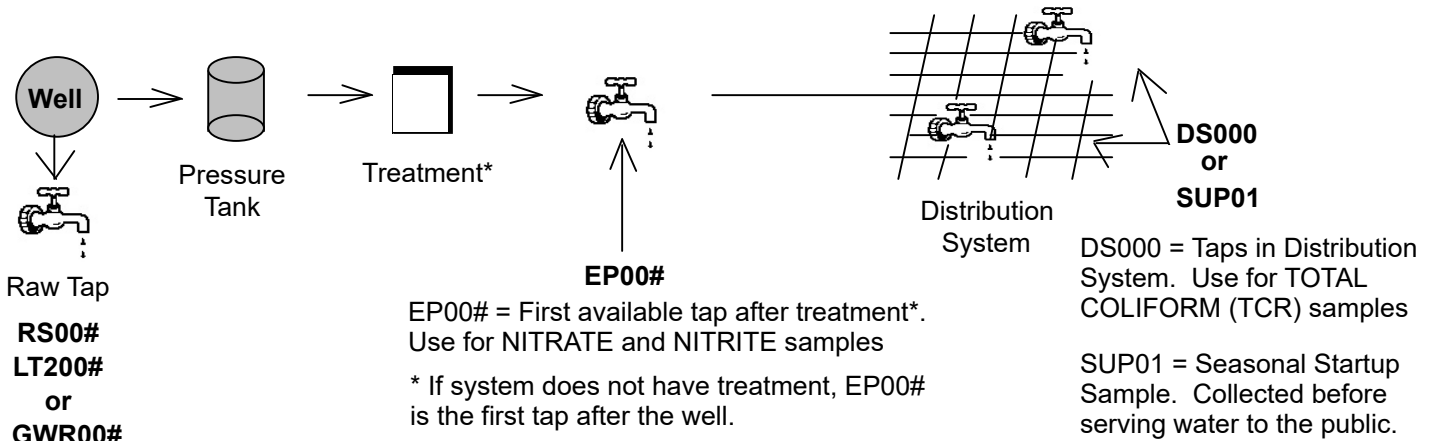

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4938412 FIRST CHURCH OF GOD

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: FIRST CHURCH OF GOD DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

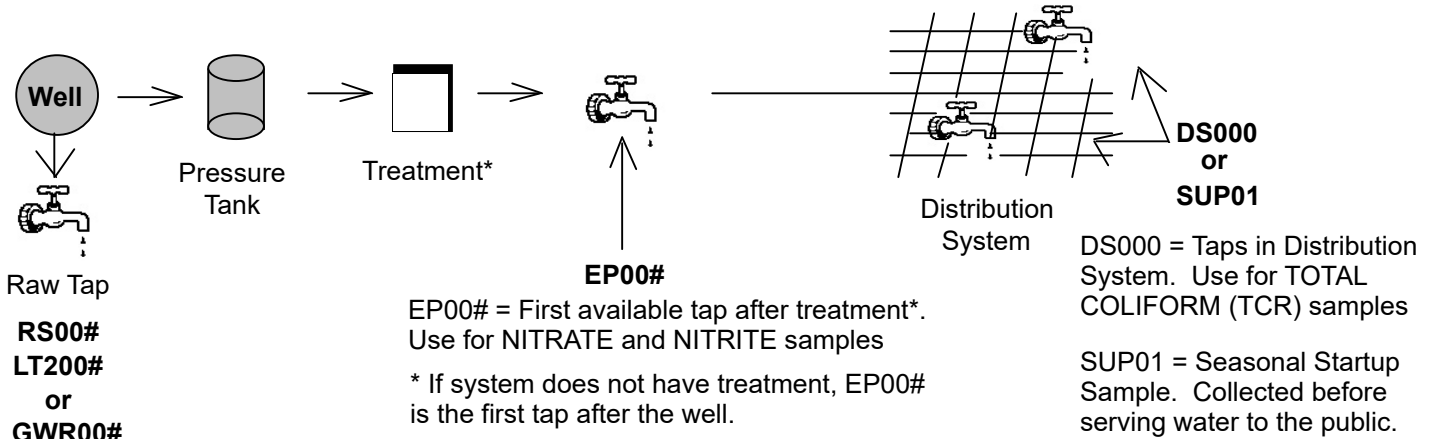

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4938412 FIRST CHURCH OF GOD

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955975 Facility Name: FIRST CHURCH OF GOD
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4938612 JEHOVAH WITNESS ASSEMBLY HALL

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: JEHOVAH WTNS ASSBLY HALL DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4938612 JEHOVAH WITNESS ASSEMBLY HALL

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955976	Facility Name: JEHOVAHS WITNESS ASSEMBLY HALL
Location SMP ID: EP001	Facility Source: Ground Water
	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4938712 LONDON BAPTIST CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LONDON BAPTIST CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

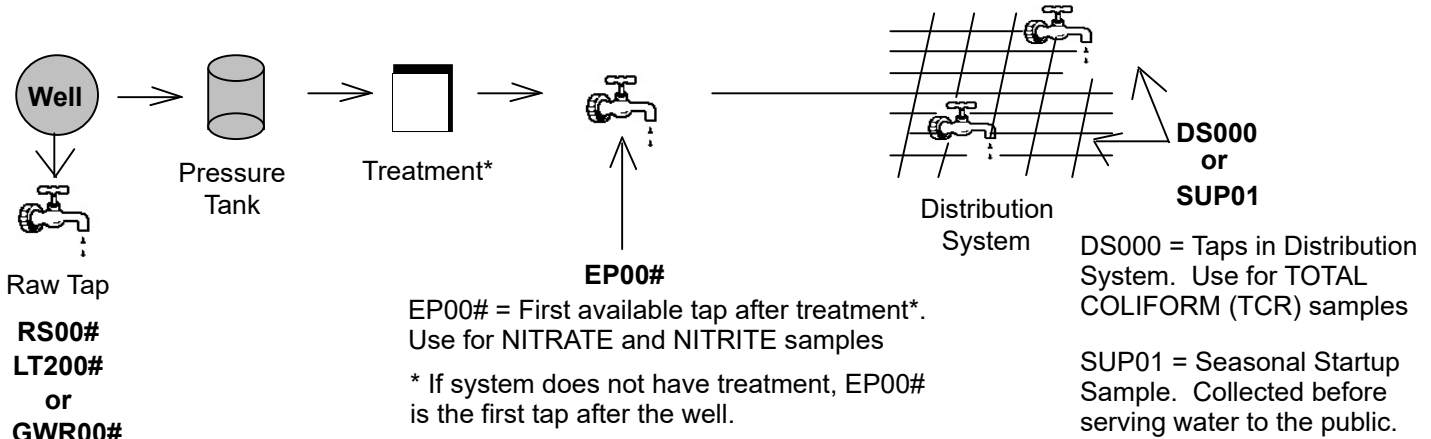

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4938712 LONDON BAPTIST CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955977 Facility Name: LONDON BAPTIST CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 08/20/2018

2018 ENTRY POINT SCHEDULE

OH4938912 MCDONALDS RESTAURANT

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955978	Facility Name: MCDONALDS RESTAURANT	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

ARSENIC - 1005	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
------------	--

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
----------------	--

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
---	--------------

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018
----------------------------------	--



OH4938912 MCDONALDS RESTAURANT

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MCDONALDS RESTAURANT DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2018 and 1/31/2018
	2 Sample(s) Required between 2/1/2018 and 2/28/2018
	2 Sample(s) Required between 3/1/2018 and 3/31/2018
	2 Sample(s) Required between 4/1/2018 and 4/30/2018
	2 Sample(s) Required between 5/1/2018 and 5/31/2018
	2 Sample(s) Required between 6/1/2018 and 6/30/2018
	2 Sample(s) Required between 7/1/2018 and 7/31/2018
	2 Sample(s) Required between 8/1/2018 and 8/31/2018
	2 Sample(s) Required between 9/1/2018 and 9/30/2018
	2 Sample(s) Required between 10/1/2018 and 10/31/2018
	2 Sample(s) Required between 11/1/2018 and 11/30/2018
	2 Sample(s) Required between 12/1/2018 and 12/31/2018

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MCDONALDS RESTAURANT DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: MCDONALDS RESTAURANT DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH4939412 PLAINVIEW CHRISTIAN SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955979	Facility Name: PLAINVIEW CHRISTIAN SCHOOL	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018



Effective Date: 01/01/2018

2018 DISTRIBUTION SCHEDULE

OH4939412 PLAINVIEW CHRISTIAN SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: PLAINVIEW CHRISTIAN SCH DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: PLAINVIEW CHRISTIAN SCH DISTRIBUTION	Facility Class: CLASS 1
Refer to your Lead and Copper plan for SMP IDs			

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH4939812 BUCKEYE FORD INC

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955980	Facility Name: BUCKEYE FORD	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH4939812 BUCKEYE FORD INC

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **BUCKEYE FORD INC DISTRIBUTION**
Location SMP ID: **DS000**

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	12/31/2018

Sampling Facility ID: **DS1** Facility Name: **BUCKEYE FORD INC DISTRIBUTION**
Location SMP ID: **LC###** **Refer to your Lead and Copper plan for SMP IDs**

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between	6/1/2018	and	9/30/2018
-------------------------------	------------------------------	----------	-----	-----------

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH4939912 UNITED BETHEL MENNONITE CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: UN BETHEL MENNONITE CH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4939912 UNITED BETHEL MENNONITE CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955981 Facility Name: UNITED BETHEL MENNONITE CHURCH

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH4940512 MONROE ELEMENTARY SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955982	Facility Name: MONROE ELEM SCH	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH4940512 MONROE ELEMENTARY SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: DS1 SMP ID: DS000 Facility Name: MONROE ELEMENTARY SCHOOL DISTRIBUTI Facility Class: CLASS 1

Table with 2 columns: Chemicals and Monitoring Requirements. Rows include TOTAL COLIFORM (TCR) - 3100 and TOTAL CHLORINE - 1000 with their respective sampling frequencies and dates.

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: DS1 SMP ID: DS201 Facility Name: MONROE ELEMENTARY SCHOOL DISTRIBUTI Facility Class: CLASS 1

Table with 2 columns: Chemicals and Monitoring Requirements. Row includes DISINFECTION BYPRODUCTS with a dual sample requirement between 7/1/2018 and 9/30/2018.

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950

Sampling Location Facility ID: DS1 SMP ID: LC### Facility Name: MONROE ELEMENTARY SCHOOL DISTRIBUTI Facility Class: CLASS 1

Table with 2 columns: Chemicals and Monitoring Requirements. Row includes LEAD - 1030 AND COPPER - 1022 with 5 sample(s) required between 6/1/2018 and 9/30/2018.

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results.

OH4940612 ODOT REST AREA 6-22 PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ODOT REST AREA 6-22 DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

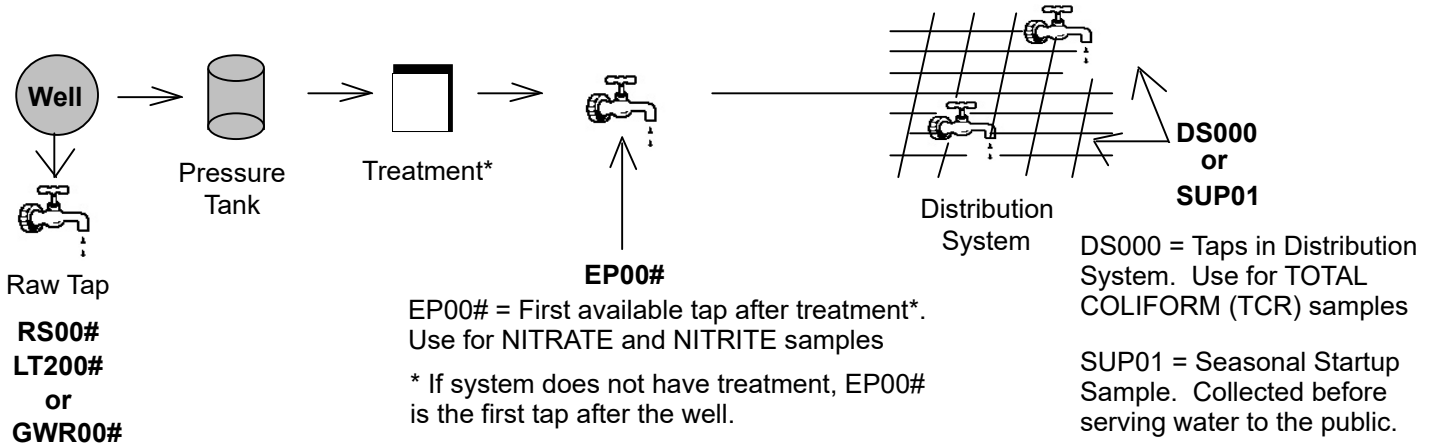

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4940612 ODOT REST AREA 6-22 PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955983	Facility Name: ODOT REST AREA 6-22	
Location SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4940712 ODOT REST AREA 6-21 PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ODOT REST AREA 6-21 DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

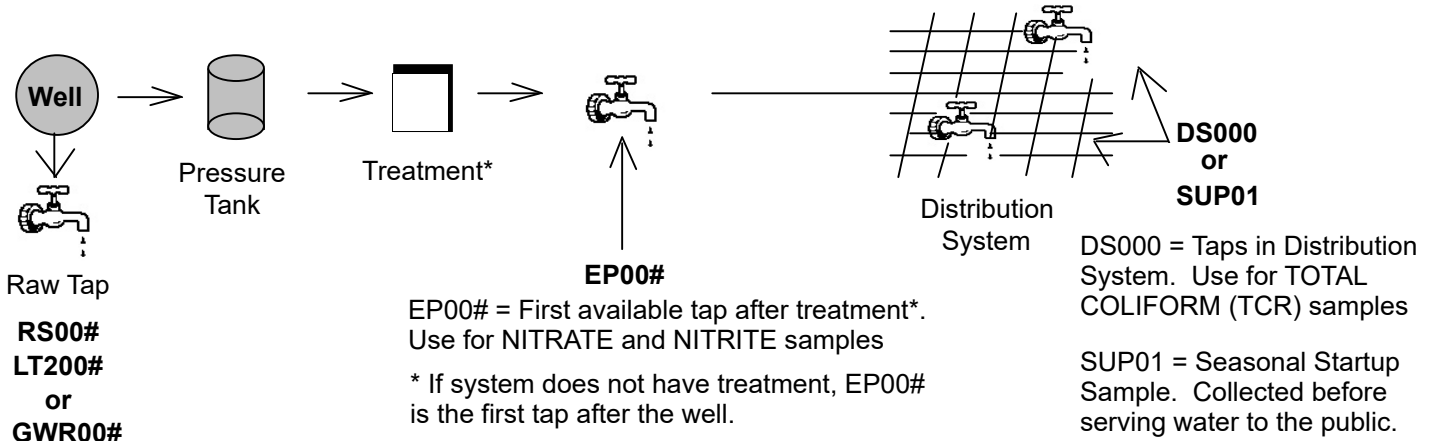

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4940712 ODOT REST AREA 6-21 PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955984	Facility Name: ODOT REST AREA 6-21	
Location SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

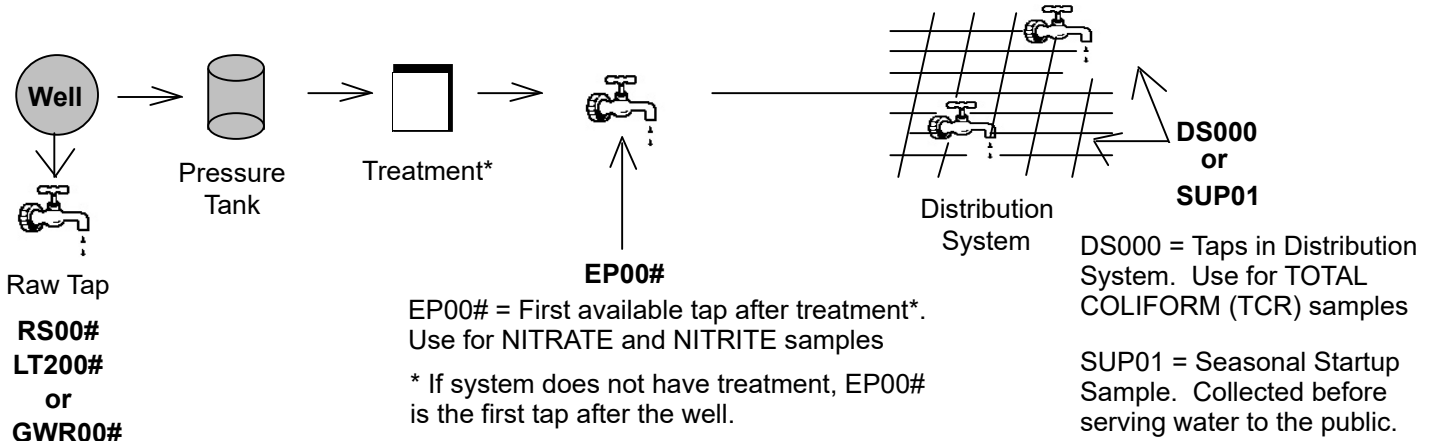

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4941012 TOTAL QUALITY INC WENDY PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: TOTAL QUALITY, INC WENDY DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

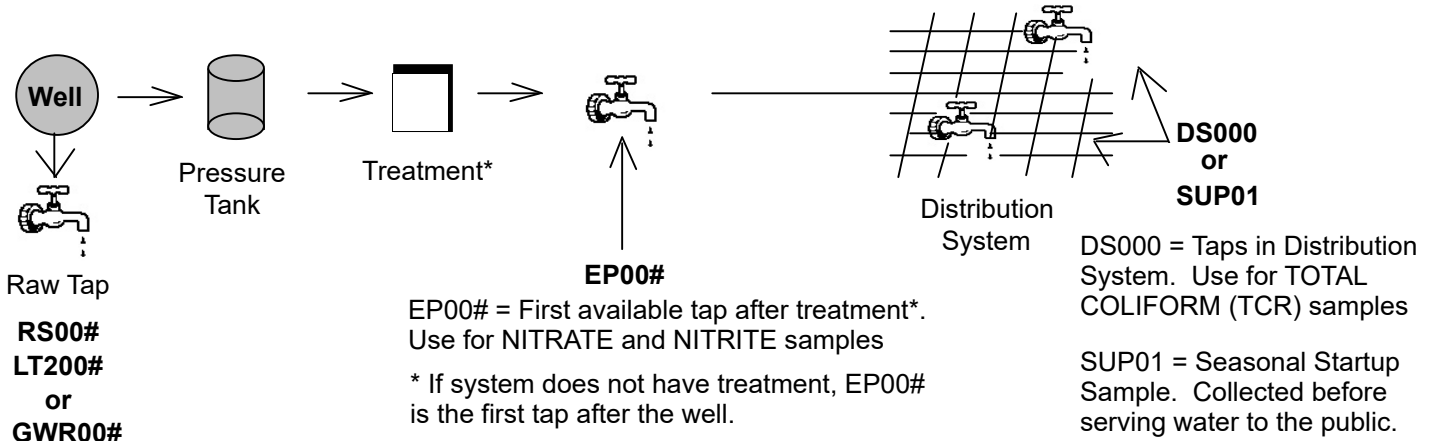

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4941012 TOTAL QUALITY INC WENDY PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955986	Facility Name: TOTAL QUALITY INC WENDYS
Location SMP ID: EP001	Facility Source: Ground Water
	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

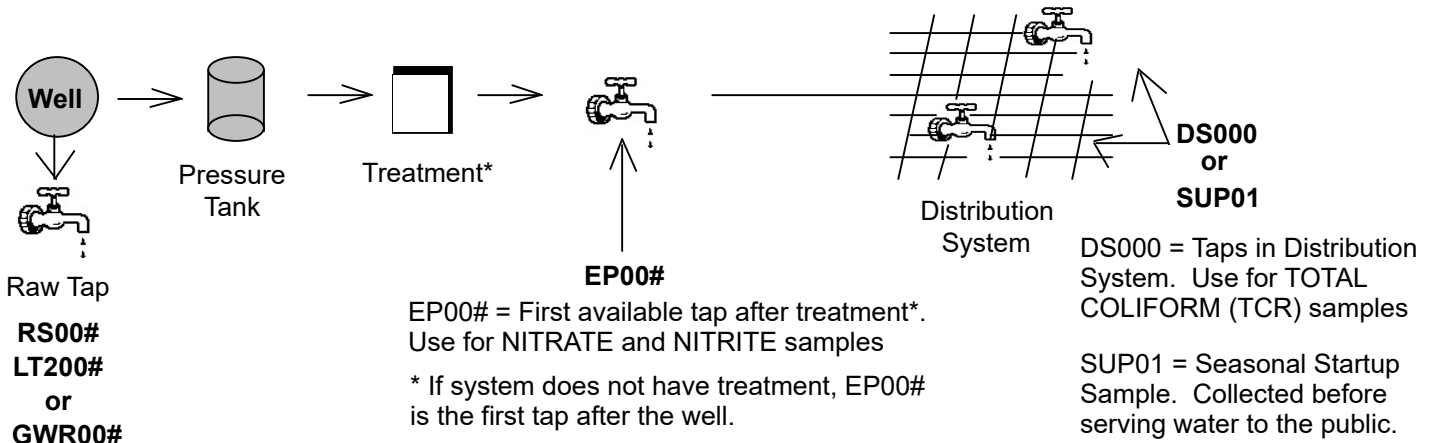

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4941112 MOTEL 6

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **MOTEL 6 DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4941112 MOTEL 6

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955987 Facility Name: MOTEL 6
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

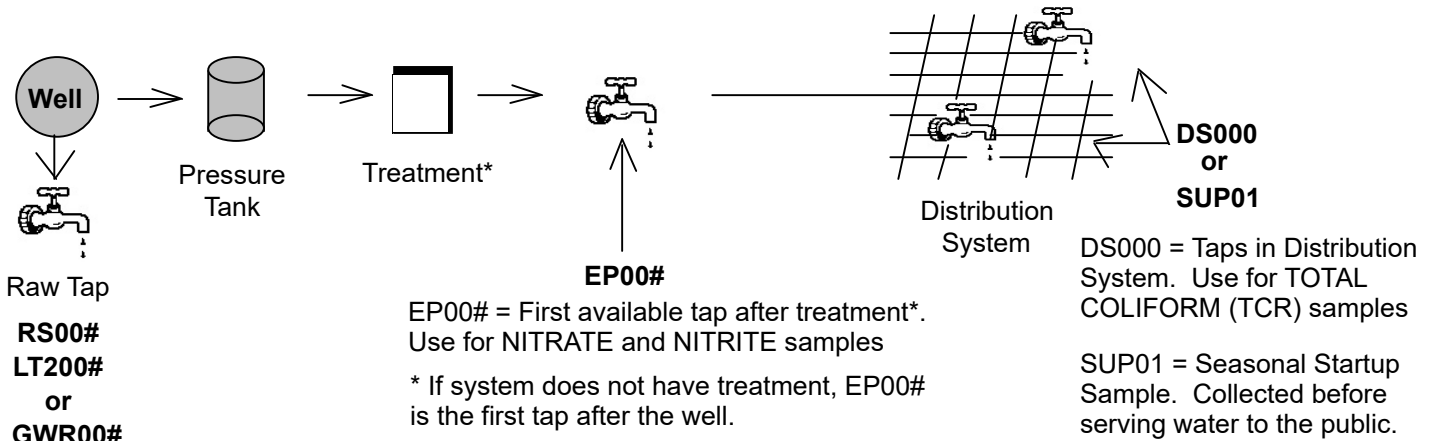

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4942012 WAFFLE HOUSE 716 PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **WAFFLE HOUSE 716 DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4942012 WAFFLE HOUSE 716 PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955989	Facility Name: WAFFLE HOUSE INC	
Location SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 7/1/2018 and 9/30/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4942212 SPEEDWAY 5360 PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: EMRO-SPEEDWAY 5360 DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2018 and 1/31/2018
	2 Sample(s) Required between 2/1/2018 and 2/28/2018
	2 Sample(s) Required between 3/1/2018 and 3/31/2018
	2 Sample(s) Required between 4/1/2018 and 4/30/2018
	2 Sample(s) Required between 5/1/2018 and 5/31/2018
	2 Sample(s) Required between 6/1/2018 and 6/30/2018
	2 Sample(s) Required between 7/1/2018 and 7/31/2018
	2 Sample(s) Required between 8/1/2018 and 8/31/2018
	2 Sample(s) Required between 9/1/2018 and 9/30/2018
	2 Sample(s) Required between 10/1/2018 and 10/31/2018
	2 Sample(s) Required between 11/1/2018 and 11/30/2018
	2 Sample(s) Required between 12/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

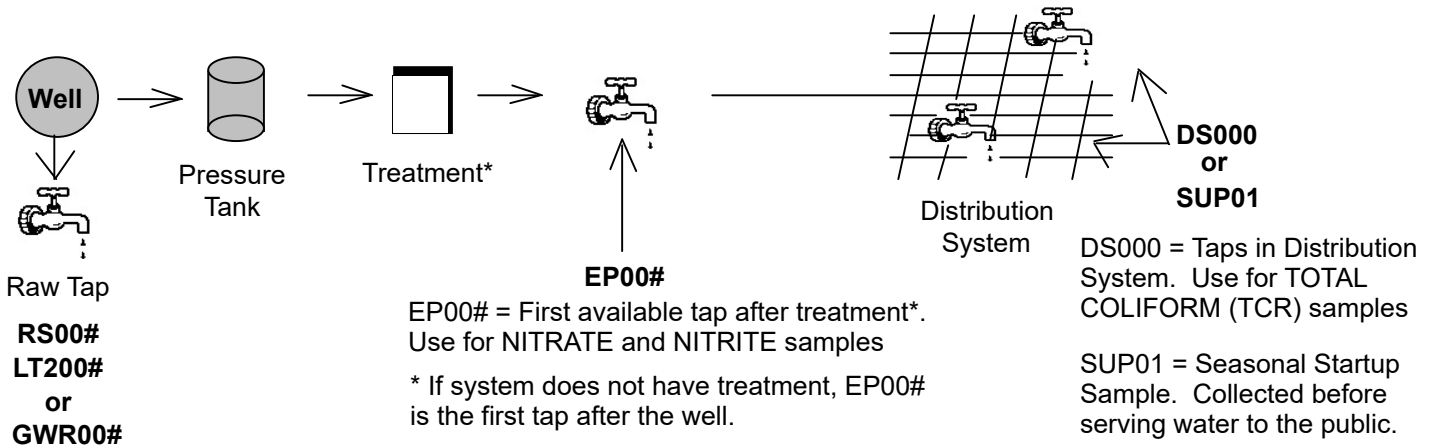

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4942212 SPEEDWAY 5360 PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955990	Facility Name: SPEEDWAY 5360	
Location SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4942312 TACO BELL STORE 16113

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: TACO BELL DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water
	Facility Class: CLASS 1

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4942312 TACO BELL STORE 16113

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955991	Facility Name: TACO BELL	
Location SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 1

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

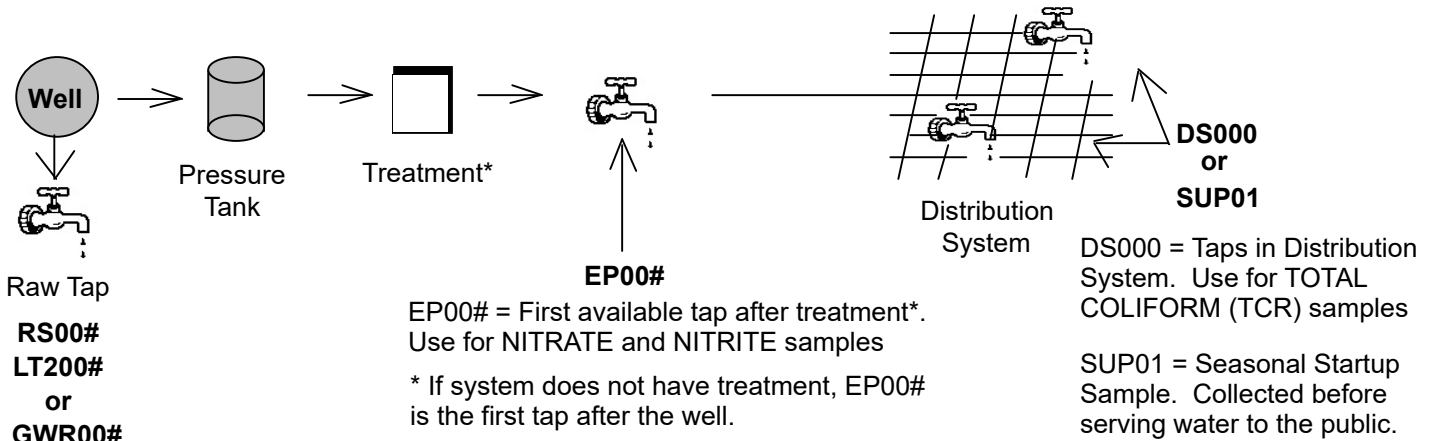

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4942412 JEHOVAH WITNESS KINGDOM

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **JEHOVAH WITNESS KINGDOM DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

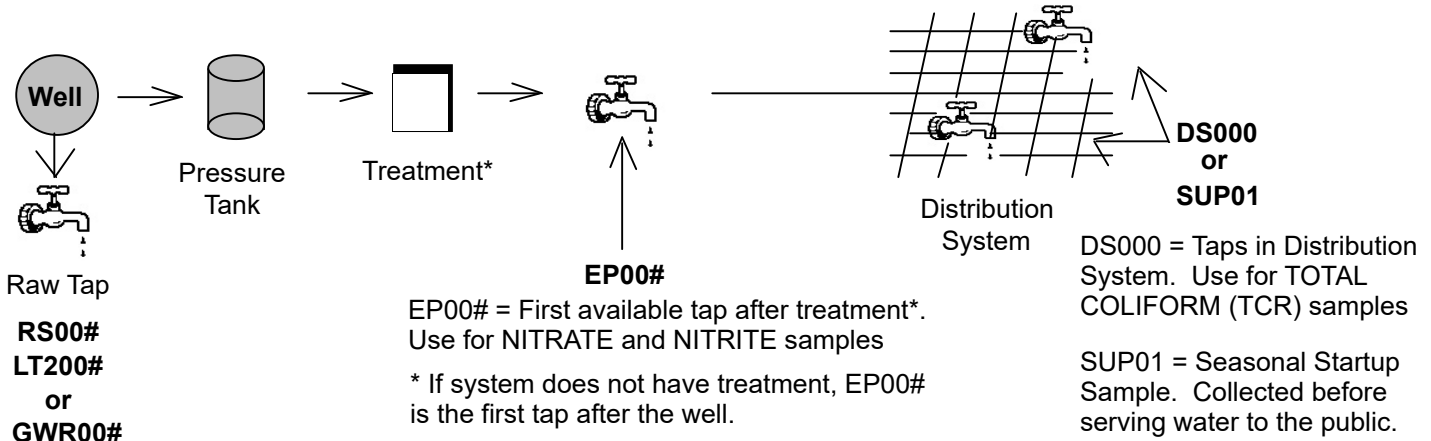

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4942412 JEHOVAH WITNESS KINGDOM

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955992 Facility Name: JEHOVAHS WITNESS KINGDOM HALL
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4942612 HOLIDAY INN EXPRESS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HOLIDAY INN EXPRESS DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

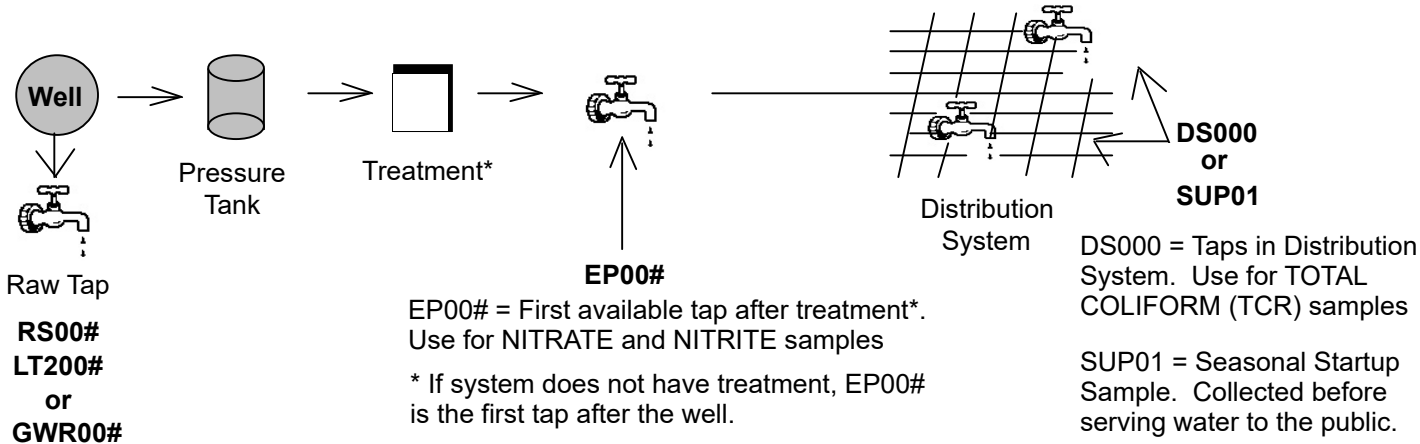

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4942612 HOLIDAY INN EXPRESS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955993 Facility Name: HOLIDAY INN EXPRESS
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4943312 PILOT TRAVEL CENTER 454

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: PILOT TRAVEL CENTER 454
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

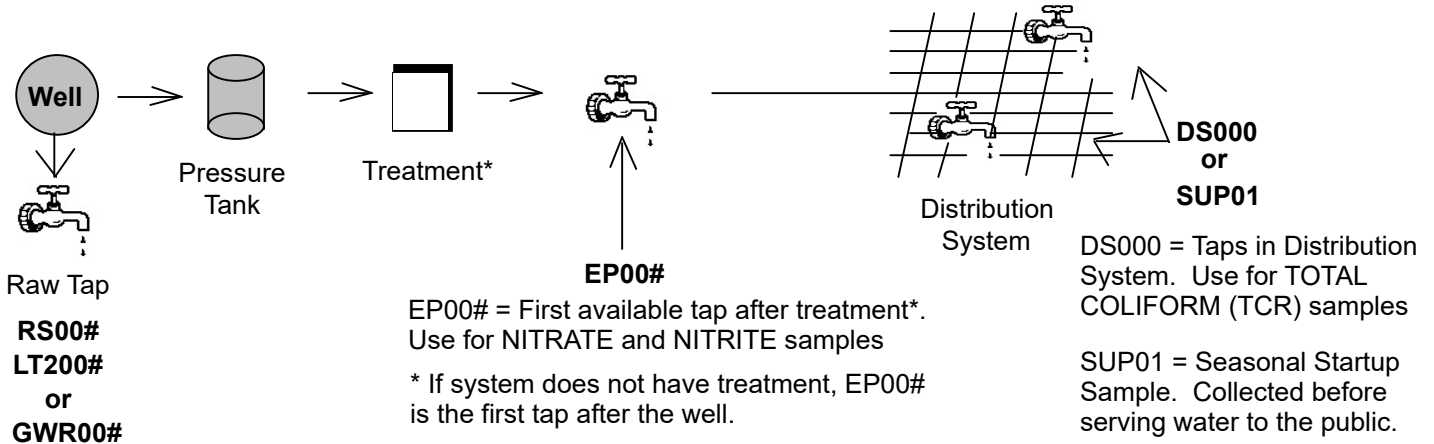

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4943312 PILOT TRAVEL CENTER 454

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4960653	Facility Name: PILOT TRAVEL CENTER 454
Location SMP ID: EP001	Facility Source: Ground Water
Facility Class: CLASS A	

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

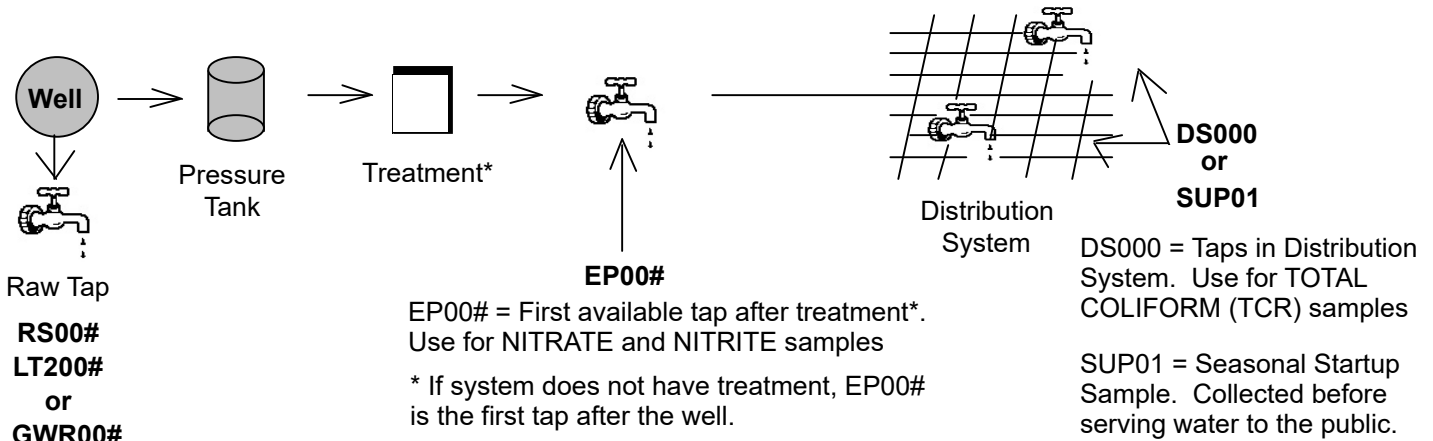

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH4943512 M.H. EBY, INC. PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4955997	Facility Name: MH EBY INC	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH4943512 M.H. EBY, INC. PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: M.H.EBY, INC DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: M.H.EBY, INC DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH4943612 NATIONAL ROAD GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: NATIONAL ROAD GOLF, INC. DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4943612 NATIONAL ROAD GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955998 Facility Name: NATIONAL ROAD GOLF COURSE
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4943712 VAUGHN C. DARDING, D.C.

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **DARDING CHIROPRACTIC DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4943712 VAUGHN C. DARDING, D.C.

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4955999 Facility Name: DARDING CHIROPRACTIC
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

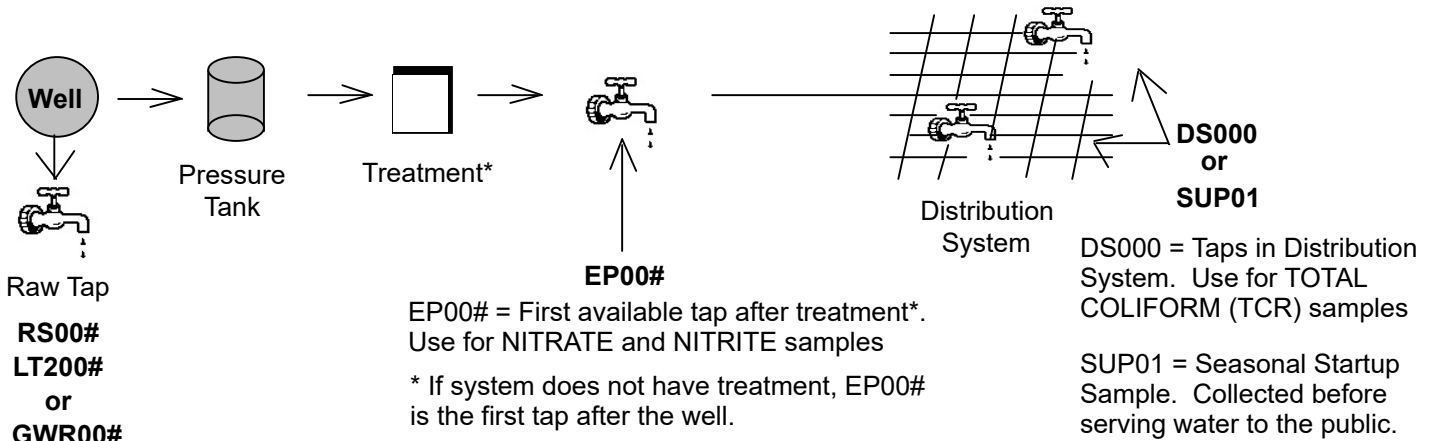

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH4943812 J.D. EQUIPMENT, INC.

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4956000	Facility Name: JD EQUIPMENT INC	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2018 and 3/31/2018 1 Sample(s) Required between 4/1/2018 and 6/30/2018 1 Sample(s) Required between 7/1/2018 and 9/30/2018 1 Sample(s) Required between 10/1/2018 and 12/31/2018
INORGANICS	1 Sample(s) Required between 6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2018 and 10/31/2018



Effective Date: 01/01/2018

2018 DISTRIBUTION SCHEDULE

OH4943812 J.D. EQUIPMENT, INC.

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: J.D. EQUIPMENT, INC. DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: J.D. EQUIPMENT, INC. DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH4943912 TRI-GREEN INTERSTATE EQ.

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **TRI-GREEN INTERSTATE EQ DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 1/31/2018
	1 Sample(s) Required between 2/1/2018 and 2/28/2018
	1 Sample(s) Required between 3/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 4/30/2018
	1 Sample(s) Required between 5/1/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018
	1 Sample(s) Required between 12/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

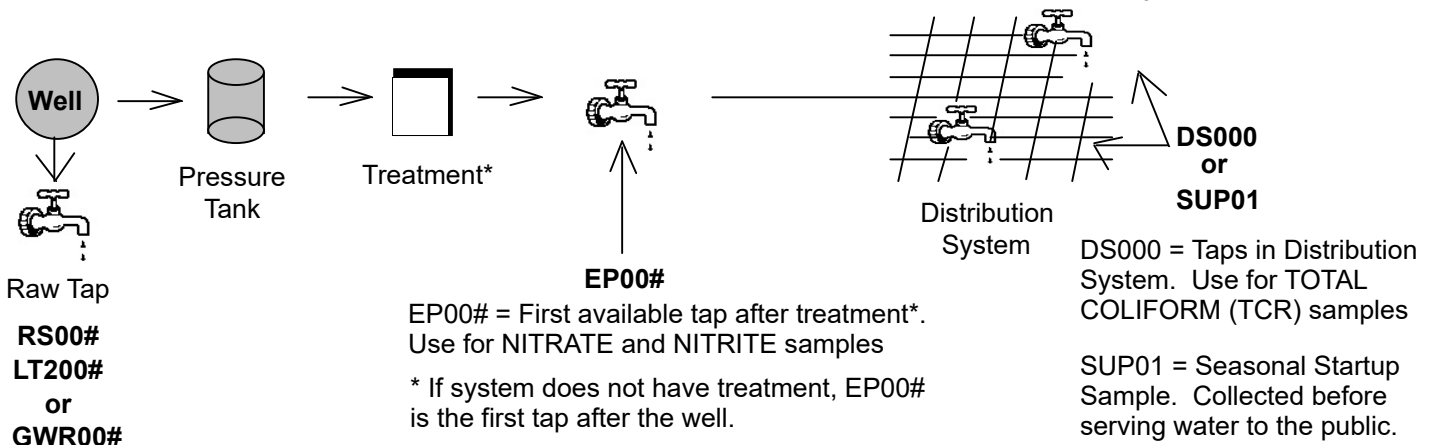

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4943912 TRI-GREEN INTERSTATE EQ.

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4956001 Facility Name: TRI-GREEN INTERSTATE EQ
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH4944112 SHEKINAH CHRISTIAN SCHOOL PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4956002	Facility Name: SHEKINAH CHRISTIAN SCHOOL	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2018 and 10/31/2018

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2018 and 10/31/2018

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2018 and 10/31/2018



OH4944112 SHEKINAH CHRISTIAN SCHOOL PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: SHEKINAH CHRISTIAN SCHOO DISTRIBUTION
	SMP ID: DS000	

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2018	and	3/31/2018
	1 Sample(s) Required between	4/1/2018	and	6/30/2018
	1 Sample(s) Required between	7/1/2018	and	9/30/2018
	1 Sample(s) Required between	10/1/2018	and	12/31/2018

Sampling Location	Facility ID: DS1	Facility Name: SHEKINAH CHRISTIAN SCHOO DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between	6/1/2018	and	9/30/2018
-------------------------------	------------------------------	----------	-----	-----------

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH4944312 FAITH ASSEMBLY OF GOD PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **FAITH ASSEMBLY OF GOD DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

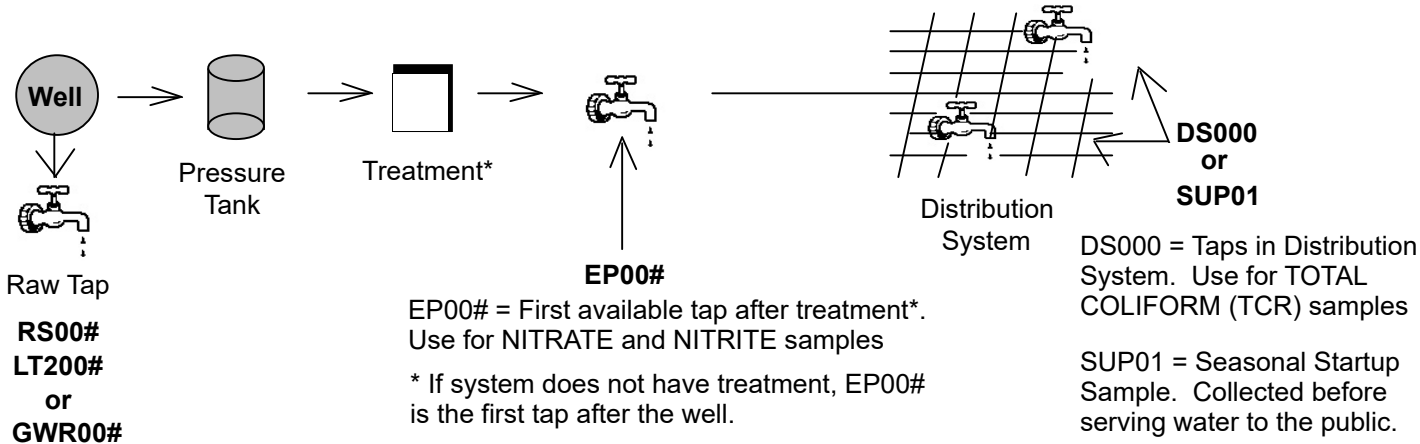

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4944312 FAITH ASSEMBLY OF GOD PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4960849 Facility Name: FAITH ASSEMBLY OF GOD
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2018

2018 ENTRY POINT SCHEDULE

OH4945212 JONATHAN ALDER PIONEER HIGH SCHOOL PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4961539	Facility Name: JONATHAN ALDER PIONEER HIGH SCHOOL
	SMP ID: EP001	Facility Source: Ground Water
		Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2018 and 10/31/2018

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2018 and 10/31/2018

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2018 and 10/31/2018

OH4945212 JONATHAN ALDER PIONEER HIGH SCHOOL PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: JONATHAN ALDER PIONEER HIGH DISTRIBUT	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: JONATHAN ALDER PIONEER HIGH DISTRIBUT	Facility Class: CLASS 1
2ND FLOOR RESTROOM NORTHEAST			

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: JONATHAN ALDER PIONEER HIGH DISTRIBUT	Facility Class: CLASS 1
ROOM 223 SINK			

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2018 and 9/30/2018 at: DS202
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: JONATHAN ALDER PIONEER HIGH DISTRIBUT	Facility Class: CLASS 1
Refer to your Lead and Copper plan for SMP IDs			

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2018 and 9/30/2018
-------------------------------	--

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH4945312 OHIO PEACE OFFICE TRAINING ACADEMY-TACTI

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: OHIO PEACE OFFICER TRAINING DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System

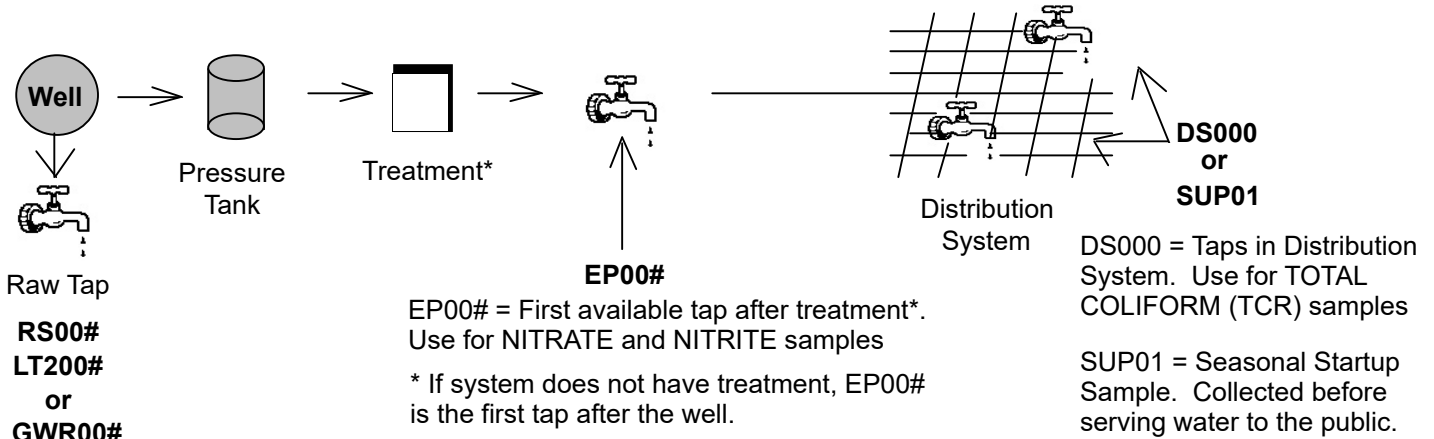

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4945312 OHIO PEACE OFFICE TRAINING ACADEMY-TACTI

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4961610 Facility Name: OHIO PEACE OFFICER TRAINING
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4945412 PRAIRIE OAKS VISITOR CENTER PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: PRAIRIE OAKS VISITOR CENTER DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4945412 PRAIRIE OAKS VISITOR CENTER PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4961624	Facility Name: PRAIRIE OAKS VISITOR CENTER	
Location SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

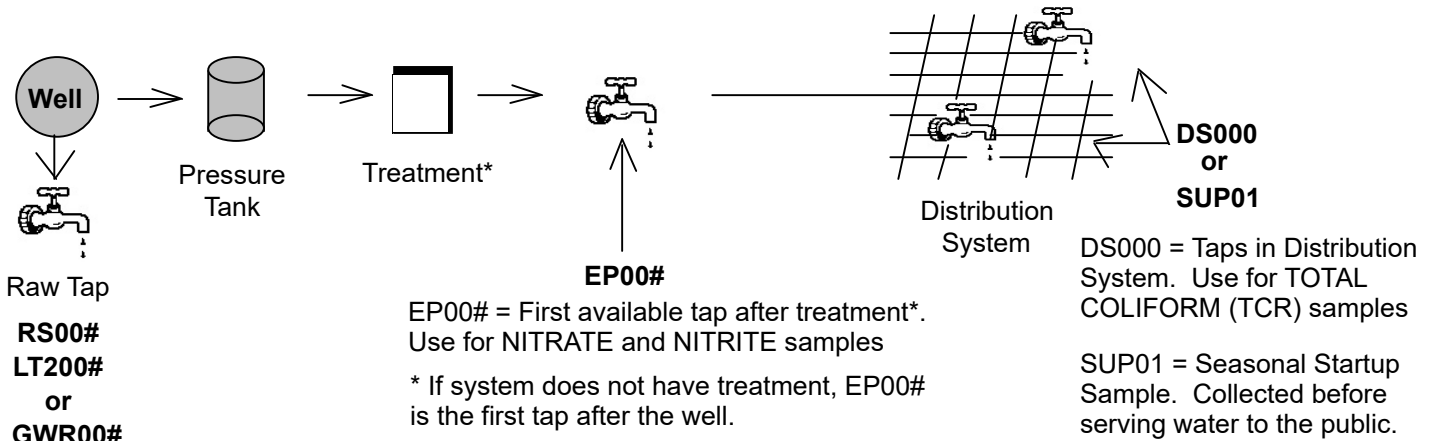

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4945512 BIG DARBY BAPTIST CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BIG DARBY BAPTIST CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4945512 BIG DARBY BAPTIST CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4961767 Facility Name: BIG DARBY BAPTIST CHURCH

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4945612 S S SIMON AND JUDE CATHOLIC CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: S.S.SIMON & JUDE CATHOLIC DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4945612 S S SIMON AND JUDE CATHOLIC CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4961834 Facility Name: S S SIMON & JUDE CATHOLIC CHURCH

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4945912 LIFE IN CHRIST FELLOWSHIP PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **LIFE IN CHRIST FELLOWSHIP DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4945912 LIFE IN CHRIST FELLOWSHIP PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4962369 Facility Name: LIFE IN CHRIST FELLOWSHIP
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH4946012 MADISON COUNTY ENGINEERS OFFICE PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 4961356	Facility Name: MADISON COUNTY ENGINEERS OFFICE	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements	
ARSENIC - 1005	1 Sample(s) Required between	1/1/2018 and 3/31/2018
	1 Sample(s) Required between	4/1/2018 and 6/30/2018
	1 Sample(s) Required between	7/1/2018 and 9/30/2018
	1 Sample(s) Required between	10/1/2018 and 12/31/2018
INORGANICS	1 Sample(s) Required between	6/1/2018 and 10/31/2018
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024		
FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	6/1/2018 and 10/31/2018
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	7/1/2018 and 9/30/2018



OH4946012 MADISON COUNTY ENGINEERS OFFICE PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MADISON COUNTY ENGINEERS DISTRIBUTIOI
--------------------------	---	---

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: MADISON COUNTY ENGINEERS DISTRIBUTIOI Refer to your Lead and Copper plan for SMP IDs
--------------------------	---	--

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2018 and 9/30/2018

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH4946112 NEWPORT CCCU PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: NEWPORT CCCU DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4946112 NEWPORT CCCU PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4962426 Facility Name: NEWPORT CCCU
Location SMP ID: EP001 Facility Source:

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4946212 WINNS ORCHARD PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **WINNS ORCHARD DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

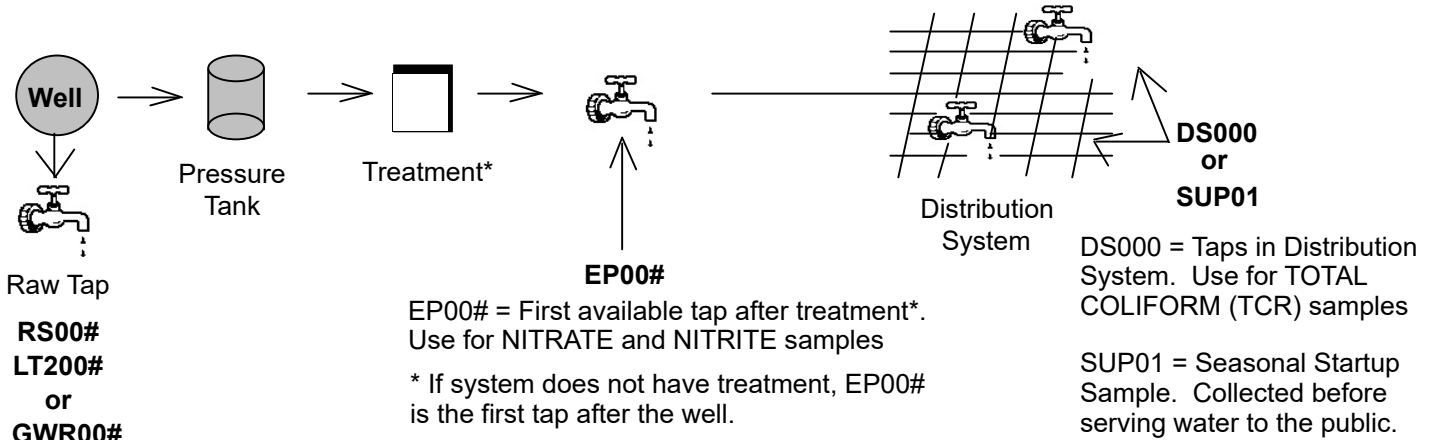

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4946212 WINNS ORCHARD PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: WINNS ORCHARD DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/9/2018 and 5/31/2018
	1 Sample(s) Required between 6/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 7/31/2018
	1 Sample(s) Required between 8/1/2018 and 8/31/2018
	1 Sample(s) Required between 9/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 10/31/2018
	1 Sample(s) Required between 11/1/2018 and 11/30/2018

Where to Collect Samples For a Small Public Water System

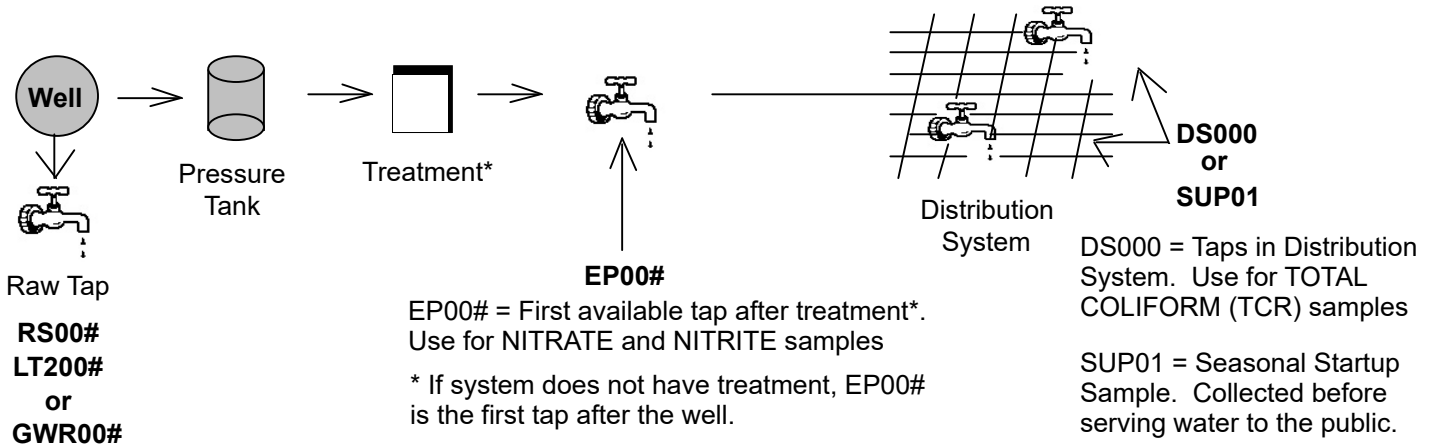

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4946212 WINNS ORCHARD PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4962427 Facility Name: WINNS ORCHARD
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System

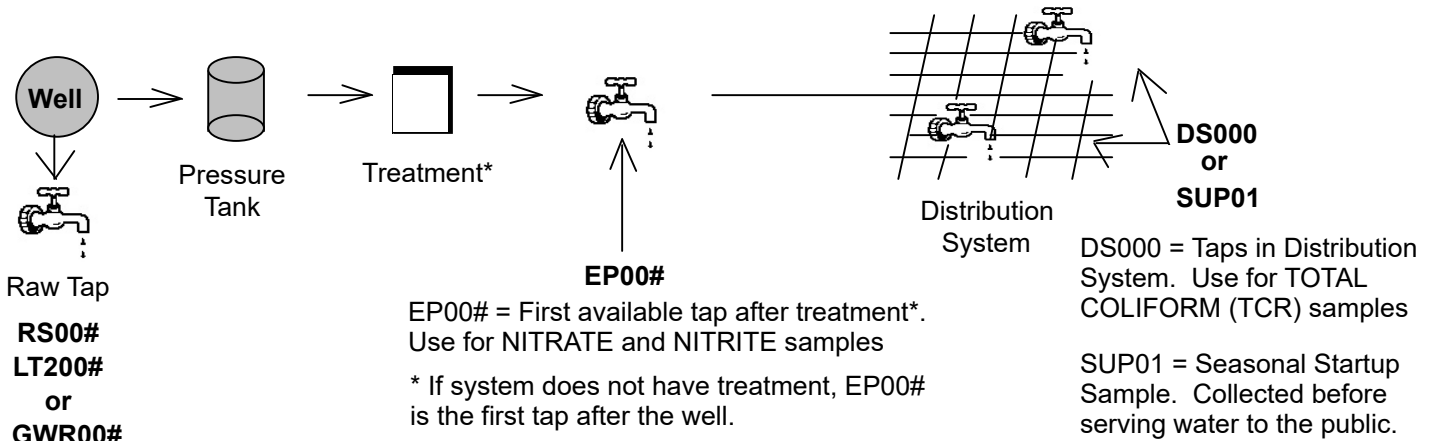

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4946312 LONDON CHRISTIAN FELLOWSHIP PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: LONDON CHRISTIAN FELLOWSHIP DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4946312 LONDON CHRISTIAN FELLOWSHIP PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4962428 Facility Name: LONDON CHRISTIAN FELLOWSHIP
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4946316 HOLMES LUMBER DUBLIN PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2018 and 3/31/2018
	1 Sample(s) Required between 4/1/2018 and 6/30/2018
	1 Sample(s) Required between 7/1/2018 and 9/30/2018
	1 Sample(s) Required between 10/1/2018 and 12/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH4946316 HOLMES LUMBER DUBLIN PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 4962433 Facility Name: HOLMES LUMBER DUBLIN
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2018 and 10/31/2018

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!