



Effective Date: 01/01/2019

2019 ENTRY POINT SCHEDULE

OH3200012 ARLINGTON VILLAGE WATER

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3254796	Facility Name: ARLINGTON WTP	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

OH3200012 ARLINGTON VILLAGE WATER

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** **REMINDER:** ** Consumer Confidence Report (CCR) is due July 1, 2019

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: ARLINGTON, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2019 and 1/31/2019
	2 Sample(s) Required between 2/1/2019 and 2/28/2019
	2 Sample(s) Required between 3/1/2019 and 3/31/2019
	2 Sample(s) Required between 4/1/2019 and 4/30/2019
	2 Sample(s) Required between 5/1/2019 and 5/31/2019
	2 Sample(s) Required between 6/1/2019 and 6/30/2019
	2 Sample(s) Required between 7/1/2019 and 7/31/2019
	2 Sample(s) Required between 8/1/2019 and 8/31/2019
	2 Sample(s) Required between 9/1/2019 and 9/30/2019
	2 Sample(s) Required between 10/1/2019 and 10/31/2019
	2 Sample(s) Required between 11/1/2019 and 11/30/2019
	2 Sample(s) Required between 12/1/2019 and 12/31/2019
TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2019 and 1/31/2019
	2 Sample(s) Required between 2/1/2019 and 2/28/2019
	2 Sample(s) Required between 3/1/2019 and 3/31/2019
	2 Sample(s) Required between 4/1/2019 and 4/30/2019
	2 Sample(s) Required between 5/1/2019 and 5/31/2019
	2 Sample(s) Required between 6/1/2019 and 6/30/2019
	2 Sample(s) Required between 7/1/2019 and 7/31/2019
	2 Sample(s) Required between 8/1/2019 and 8/31/2019
	2 Sample(s) Required between 9/1/2019 and 9/30/2019
	2 Sample(s) Required between 10/1/2019 and 10/31/2019
	2 Sample(s) Required between 11/1/2019 and 11/30/2019
	2 Sample(s) Required between 12/1/2019 and 12/31/2019

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: ARLINGTON, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2019 and 9/30/2019at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3200012 ARLINGTON VILLAGE WATER

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: ARLINGTON, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2019 and 9/30/2019 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: ARLINGTON, VILLAGE OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2019 and 9/30/2019

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH3200111 FINDLAY CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3254797	Facility Name: FINDLAY CITY	Facility Class: CLASS 4
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 1/1/2019 and 5/31/2019
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 1/31/2019 1 Sample(s) Required between 2/1/2019 and 2/28/2019 1 Sample(s) Required between 3/1/2019 and 3/31/2019 1 Sample(s) Required between 4/1/2019 and 4/30/2019 1 Sample(s) Required between 5/1/2019 and 5/31/2019 1 Sample(s) Required between 6/1/2019 and 6/30/2019 1 Sample(s) Required between 7/1/2019 and 7/31/2019 1 Sample(s) Required between 8/1/2019 and 8/31/2019 1 Sample(s) Required between 9/1/2019 and 9/30/2019 1 Sample(s) Required between 10/1/2019 and 10/31/2019 1 Sample(s) Required between 11/1/2019 and 11/30/2019 1 Sample(s) Required between 12/1/2019 and 12/31/2019
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2019 and 6/30/2019
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2019 and 5/31/2019
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2019 and 1/31/2019 1 Paired Sample Set Required between 2/1/2019 and 2/28/2019 1 Paired Sample Set Required between 3/1/2019 and 3/31/2019 1 Paired Sample Set Required between 4/1/2019 and 4/30/2019 1 Paired Sample Set Required between 5/1/2019 and 5/31/2019 1 Paired Sample Set Required between 6/1/2019 and 6/30/2019 1 Paired Sample Set Required between 7/1/2019 and 7/31/2019 1 Paired Sample Set Required between 8/1/2019 and 8/31/2019 1 Paired Sample Set Required between 9/1/2019 and 9/30/2019 1 Paired Sample Set Required between 10/1/2019 and 10/31/2019 1 Paired Sample Set Required between 11/1/2019 and 11/30/2019 1 Paired Sample Set Required between 12/1/2019 and 12/31/2019

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



OH3200111 FINDLAY CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3254797	Facility Name: FINDLAY CITY	
Location	SMP ID: EP001/LT2001	Facility Source: Surface Water	Facility Class: CLASS 4

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

Chemicals

Monitoring Requirements

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY*

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.

**Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH3200111 FINDLAY CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3254797	Facility Name: FINDLAY CITY	Facility Class: CLASS 4
	SMP ID: LT2001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/30/2018 and 1/5/2019
	1 Sample(s) Required between 1/13/2019 and 1/19/2019
	1 Sample(s) Required between 1/27/2019 and 2/2/2019
	1 Sample(s) Required between 2/10/2019 and 2/16/2019
	1 Sample(s) Required between 2/24/2019 and 3/2/2019
	1 Sample(s) Required between 3/10/2019 and 3/16/2019
	1 Sample(s) Required between 3/24/2019 and 3/30/2019
	1 Sample(s) Required between 4/7/2019 and 4/13/2019
	1 Sample(s) Required between 4/21/2019 and 4/27/2019
	1 Sample(s) Required between 5/5/2019 and 5/11/2019
	1 Sample(s) Required between 5/19/2019 and 5/25/2019
	1 Sample(s) Required between 6/2/2019 and 6/8/2019
	1 Sample(s) Required between 6/16/2019 and 6/22/2019
	1 Sample(s) Required between 6/30/2019 and 7/6/2019
	1 Sample(s) Required between 7/14/2019 and 7/20/2019
	1 Sample(s) Required between 7/28/2019 and 8/3/2019
	1 Sample(s) Required between 8/11/2019 and 8/17/2019
	1 Sample(s) Required between 8/25/2019 and 8/31/2019
	1 Sample(s) Required between 9/8/2019 and 9/14/2019
	1 Sample(s) Required between 9/22/2019 and 9/28/2019
1 Sample(s) Required between 10/6/2019 and 10/12/2019	
1 Sample(s) Required between 10/20/2019 and 10/26/2019	
1 Sample(s) Required between 11/3/2019 and 11/9/2019	
1 Sample(s) Required between 11/17/2019 and 11/23/2019	
1 Sample(s) Required between 12/1/2019 and 12/7/2019	
1 Sample(s) Required between 12/15/2019 and 12/21/2019	

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.



OH3200111 FINDLAY CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: FINDLAY CITY DISTRIBUTION SYSTEM	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100	60 Sample(s) Required between	1/1/2019	and	1/31/2019
	60 Sample(s) Required between	2/1/2019	and	2/28/2019
	60 Sample(s) Required between	3/1/2019	and	3/31/2019
	60 Sample(s) Required between	4/1/2019	and	4/30/2019
	60 Sample(s) Required between	5/1/2019	and	5/31/2019
	60 Sample(s) Required between	6/1/2019	and	6/30/2019
	60 Sample(s) Required between	7/1/2019	and	7/31/2019
	60 Sample(s) Required between	8/1/2019	and	8/31/2019
	60 Sample(s) Required between	9/1/2019	and	9/30/2019
	60 Sample(s) Required between	10/1/2019	and	10/31/2019
	60 Sample(s) Required between	11/1/2019	and	11/30/2019
	60 Sample(s) Required between	12/1/2019	and	12/31/2019

TOTAL CHLORINE - 1000	60 Sample(s) Required between	1/1/2019	and	1/31/2019
	60 Sample(s) Required between	2/1/2019	and	2/28/2019
	60 Sample(s) Required between	3/1/2019	and	3/31/2019
	60 Sample(s) Required between	4/1/2019	and	4/30/2019
	60 Sample(s) Required between	5/1/2019	and	5/31/2019
	60 Sample(s) Required between	6/1/2019	and	6/30/2019
	60 Sample(s) Required between	7/1/2019	and	7/31/2019
	60 Sample(s) Required between	8/1/2019	and	8/31/2019
	60 Sample(s) Required between	9/1/2019	and	9/30/2019
	60 Sample(s) Required between	10/1/2019	and	10/31/2019
	60 Sample(s) Required between	11/1/2019	and	11/30/2019
	60 Sample(s) Required between	12/1/2019	and	12/31/2019

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: FINDLAY CITY DISTRIBUTION SYSTEM 301 E. MARKET ST. VAN BUREN	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	3/8/2019	and	3/14/2019	at: DS201
	Dual Sample Required between	6/8/2019	and	6/14/2019	at: DS201
	Dual Sample Required between	9/8/2019	and	9/14/2019	at: DS201
	Dual Sample Required between	12/8/2019	and	12/14/2019	at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3200111 FINDLAY CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: **** Consumer Confidence Report (CCR) is due July 1, 2019

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: FINDLAY CITY DISTRIBUTION SYSTEM 9500 ST. RT. 12 W.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements		
DISINFECTION BYPRODUCTS	Dual Sample Required between	3/8/2019 and 3/14/2019	at: DS202
	Dual Sample Required between	6/8/2019 and 6/14/2019	at: DS202
	Dual Sample Required between	9/8/2019 and 9/14/2019	at: DS202
	Dual Sample Required between	12/8/2019 and 12/14/2019	at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS203	Facility Name: FINDLAY CITY DISTRIBUTION SYSTEM 401 OLIVE ST.	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements		
DISINFECTION BYPRODUCTS	Dual Sample Required between	3/8/2019 and 3/14/2019	at: DS203
	Dual Sample Required between	6/8/2019 and 6/14/2019	at: DS203
	Dual Sample Required between	9/8/2019 and 9/14/2019	at: DS203
	Dual Sample Required between	12/8/2019 and 12/14/2019	at: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: FINDLAY CITY DISTRIBUTION SYSTEM TWP. RD. 201 AT DEER TRAIL CT.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements		
DISINFECTION BYPRODUCTS	Dual Sample Required between	3/8/2019 and 3/14/2019	at: DS204
	Dual Sample Required between	6/8/2019 and 6/14/2019	at: DS204
	Dual Sample Required between	9/8/2019 and 9/14/2019	at: DS204
	Dual Sample Required between	12/8/2019 and 12/14/2019	at: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

OH3200111 FINDLAY CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: **** Consumer Confidence Report (CCR) is due July 1, 2019

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: FINDLAY CITY DISTRIBUTION SYSTEM Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 30 Sample(s) Required between 6/1/2019 and 9/30/2019

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH3200411 MCCOMB VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3254799	Facility Name: MCCOMB VILLAGE	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

Chemicals	Monitoring Requirements
------------------	--------------------------------

INORGANICS	1 Sample(s) Required between 1/1/2019 and 5/31/2019
------------	---

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 1/31/2019
	1 Sample(s) Required between 2/1/2019 and 2/28/2019
	1 Sample(s) Required between 3/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 4/30/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019
	1 Sample(s) Required between 11/1/2019 and 11/30/2019
	1 Sample(s) Required between 12/1/2019 and 12/31/2019

RADIOLOGICALS	Not Required
---------------	--------------

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2019 and 6/30/2019
---	---

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2019 and 5/31/2019
----------------------------------	---



OH3200411 MCCOMB VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3254799	Facility Name: MCCOMB VILLAGE	
Location	SMP ID: EP001/LT2001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

Chemicals

Monitoring Requirements

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY*

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.

**Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH3200411 MCCOMB VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3254799 SMP ID: LT2001	Facility Name: MCCOMB VILLAGE Facility Source: Surface Water	Facility Class: CLASS 3
--------------------------	--	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/30/2018 and 1/5/2019
	1 Sample(s) Required between 1/13/2019 and 1/19/2019
	1 Sample(s) Required between 1/27/2019 and 2/2/2019
	1 Sample(s) Required between 2/10/2019 and 2/16/2019
	1 Sample(s) Required between 2/24/2019 and 3/2/2019
	1 Sample(s) Required between 3/10/2019 and 3/16/2019
	1 Sample(s) Required between 3/24/2019 and 3/30/2019
	1 Sample(s) Required between 4/7/2019 and 4/13/2019
	1 Sample(s) Required between 4/21/2019 and 4/27/2019
	1 Sample(s) Required between 5/5/2019 and 5/11/2019
	1 Sample(s) Required between 5/19/2019 and 5/25/2019
	1 Sample(s) Required between 6/2/2019 and 6/8/2019
	1 Sample(s) Required between 6/16/2019 and 6/22/2019
	1 Sample(s) Required between 6/30/2019 and 7/6/2019
	1 Sample(s) Required between 7/14/2019 and 7/20/2019
	1 Sample(s) Required between 7/28/2019 and 8/3/2019
	1 Sample(s) Required between 8/11/2019 and 8/17/2019
	1 Sample(s) Required between 8/25/2019 and 8/31/2019
	1 Sample(s) Required between 9/8/2019 and 9/14/2019
	1 Sample(s) Required between 9/22/2019 and 9/28/2019
1 Sample(s) Required between 10/6/2019 and 10/12/2019	
1 Sample(s) Required between 10/20/2019 and 10/26/2019	
1 Sample(s) Required between 11/3/2019 and 11/9/2019	
1 Sample(s) Required between 11/17/2019 and 11/23/2019	
1 Sample(s) Required between 12/1/2019 and 12/7/2019	
1 Sample(s) Required between 12/15/2019 and 12/21/2019	

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.



OH3200411 MCCOMB VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MCCOMB VILLAGE DISTRIBUTION SYSTEM	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2019 and 1/31/2019
	2 Sample(s) Required between 2/1/2019 and 2/28/2019
	2 Sample(s) Required between 3/1/2019 and 3/31/2019
	2 Sample(s) Required between 4/1/2019 and 4/30/2019
	2 Sample(s) Required between 5/1/2019 and 5/31/2019
	2 Sample(s) Required between 6/1/2019 and 6/30/2019
	2 Sample(s) Required between 7/1/2019 and 7/31/2019
	2 Sample(s) Required between 8/1/2019 and 8/31/2019
	2 Sample(s) Required between 9/1/2019 and 9/30/2019
	2 Sample(s) Required between 10/1/2019 and 10/31/2019
	2 Sample(s) Required between 11/1/2019 and 11/30/2019
	2 Sample(s) Required between 12/1/2019 and 12/31/2019
TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2019 and 1/31/2019
	2 Sample(s) Required between 2/1/2019 and 2/28/2019
	2 Sample(s) Required between 3/1/2019 and 3/31/2019
	2 Sample(s) Required between 4/1/2019 and 4/30/2019
	2 Sample(s) Required between 5/1/2019 and 5/31/2019
	2 Sample(s) Required between 6/1/2019 and 6/30/2019
	2 Sample(s) Required between 7/1/2019 and 7/31/2019
	2 Sample(s) Required between 8/1/2019 and 8/31/2019
	2 Sample(s) Required between 9/1/2019 and 9/30/2019
	2 Sample(s) Required between 10/1/2019 and 10/31/2019
	2 Sample(s) Required between 11/1/2019 and 11/30/2019
	2 Sample(s) Required between 12/1/2019 and 12/31/2019

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MCCOMB VILLAGE DISTRIBUTION SYSTEM 444 MAPLE ST	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2019 and 2/14/2019at: DS201
	Dual Sample Required between 5/8/2019 and 5/14/2019at: DS201
	Dual Sample Required between 8/8/2019 and 8/14/2019at: DS201
	Dual Sample Required between 11/8/2019 and 11/14/2019at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH3200411 MCCOMB VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: MCCOMB VILLAGE DISTRIBUTION SYSTEM 328 SOUTH TODD ST	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2019 and 2/14/2019 at: DS202
	Dual Sample Required between 5/8/2019 and 5/14/2019 at: DS202
	Dual Sample Required between 8/8/2019 and 8/14/2019 at: DS202
	Dual Sample Required between 11/8/2019 and 11/14/2019 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: MCCOMB VILLAGE DISTRIBUTION SYSTEM Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required



Effective Date: 01/01/2019

2019 ENTRY POINT SCHEDULE

OH3200512 MT BLANCHARD VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3254800	Facility Name: MT BLANCHARD STU 1	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH3200512 MT BLANCHARD VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3260378 SMP ID: EP002	Facility Name: MT BLANCHARD STU 2 Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

OH3200512 MT BLANCHARD VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MT BLANCHARD DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 1/31/2019
	1 Sample(s) Required between 2/1/2019 and 2/28/2019
	1 Sample(s) Required between 3/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 4/30/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019
	1 Sample(s) Required between 11/1/2019 and 11/30/2019
	1 Sample(s) Required between 12/1/2019 and 12/31/2019

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2019 and 1/31/2019
	1 Sample(s) Required between 2/1/2019 and 2/28/2019
	1 Sample(s) Required between 3/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 4/30/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019
	1 Sample(s) Required between 11/1/2019 and 11/30/2019
	1 Sample(s) Required between 12/1/2019 and 12/31/2019

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MT BLANCHARD DISTRIBUTION 16988 ST RT 103	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2019 and 9/30/2019at: DS201
-------------------------	--

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

OH3200512 MT BLANCHARD VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: MT BLANCHARD DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2019 and 9/30/2019

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2019

2019 ENTRY POINT SCHEDULE

OH3200612 RAWSON VILLAGE WATER

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3254801	Facility Name: RAWSON VILLAGE	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH3200612 RAWSON VILLAGE WATER

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: RAWSON, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 1/31/2019
	1 Sample(s) Required between 2/1/2019 and 2/28/2019
	1 Sample(s) Required between 3/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 4/30/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019
	1 Sample(s) Required between 11/1/2019 and 11/30/2019
	1 Sample(s) Required between 12/1/2019 and 12/31/2019

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2019 and 1/31/2019
	1 Sample(s) Required between 2/1/2019 and 2/28/2019
	1 Sample(s) Required between 3/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 4/30/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019
	1 Sample(s) Required between 11/1/2019 and 11/30/2019
	1 Sample(s) Required between 12/1/2019 and 12/31/2019

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: RAWSON, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2019 and 9/30/2019at: DS201
-------------------------	--

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

OH3200612 RAWSON VILLAGE WATER

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: RAWSON, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2019 and 9/30/2019 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: RAWSON, VILLAGE OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required



Effective Date: 01/01/2019

2019 ENTRY POINT SCHEDULE

OH3200812 GREEN MEADOW MHP-HANCOCK CO

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3254803	Facility Name: GREEN MEADOW MHP	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH3200812 GREEN MEADOW MHP-HANCOCK CO

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: GREEN MEADOW MOBILE HOME DISTRIBUTI
	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 1/31/2019
	1 Sample(s) Required between 2/1/2019 and 2/28/2019
	1 Sample(s) Required between 3/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 4/30/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019
	1 Sample(s) Required between 11/1/2019 and 11/30/2019
	1 Sample(s) Required between 12/1/2019 and 12/31/2019
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2019 and 1/31/2019
	1 Sample(s) Required between 2/1/2019 and 2/28/2019
	1 Sample(s) Required between 3/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 4/30/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019
	1 Sample(s) Required between 11/1/2019 and 11/30/2019
	1 Sample(s) Required between 12/1/2019 and 12/31/2019

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: GREEN MEADOW MOBILE HOME DISTRIBUTI
	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2019 and 9/30/2019at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

OH3200812 GREEN MEADOW MHP-HANCOCK CO

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: GREEN MEADOW MOBILE HOME DISTRIBUTI
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2019 and 9/30/2019

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH3200903 ARCADIA VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: ARCADIA VILLAGE DISTRIBUTION SYSTEM	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 1/31/2019 1 Sample(s) Required between 2/1/2019 and 2/28/2019 1 Sample(s) Required between 3/1/2019 and 3/31/2019 1 Sample(s) Required between 4/1/2019 and 4/30/2019 1 Sample(s) Required between 5/1/2019 and 5/31/2019 1 Sample(s) Required between 6/1/2019 and 6/30/2019 1 Sample(s) Required between 7/1/2019 and 7/31/2019 1 Sample(s) Required between 8/1/2019 and 8/31/2019 1 Sample(s) Required between 9/1/2019 and 9/30/2019 1 Sample(s) Required between 10/1/2019 and 10/31/2019 1 Sample(s) Required between 11/1/2019 and 11/30/2019 1 Sample(s) Required between 12/1/2019 and 12/31/2019
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2019 and 1/31/2019 1 Sample(s) Required between 2/1/2019 and 2/28/2019 1 Sample(s) Required between 3/1/2019 and 3/31/2019 1 Sample(s) Required between 4/1/2019 and 4/30/2019 1 Sample(s) Required between 5/1/2019 and 5/31/2019 1 Sample(s) Required between 6/1/2019 and 6/30/2019 1 Sample(s) Required between 7/1/2019 and 7/31/2019 1 Sample(s) Required between 8/1/2019 and 8/31/2019 1 Sample(s) Required between 9/1/2019 and 9/30/2019 1 Sample(s) Required between 10/1/2019 and 10/31/2019 1 Sample(s) Required between 11/1/2019 and 11/30/2019 1 Sample(s) Required between 12/1/2019 and 12/31/2019

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: ARCADIA VILLAGE DISTRIBUTION SYSTEM NOBLE HAWK CT AND RIDGE RUN DR.	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 3/1/2019 and 3/7/2019 at: DS201 Dual Sample Required between 6/1/2019 and 6/7/2019 at: DS201 Dual Sample Required between 9/1/2019 and 9/7/2019 at: DS201 Dual Sample Required between 12/1/2019 and 12/7/2019 at: DS201

- Sample for all the analytes listed below:
- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
 - 2) TTHM - 2950



OH3200903 ARCADIA VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: ARCADIA VILLAGE DISTRIBUTION SYSTEM TEST TAP @ OLYMPIC DR	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 3/1/2019 and 3/7/2019 at: DS202 Dual Sample Required between 6/1/2019 and 6/7/2019 at: DS202 Dual Sample Required between 9/1/2019 and 9/7/2019 at: DS202 Dual Sample Required between 12/1/2019 and 12/7/2019 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: ARCADIA VILLAGE DISTRIBUTION SYSTEM Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required

OH3230412 BETHEL CHURCH OF CHRIST

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BETHEL CHURCH OF CHRIST DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

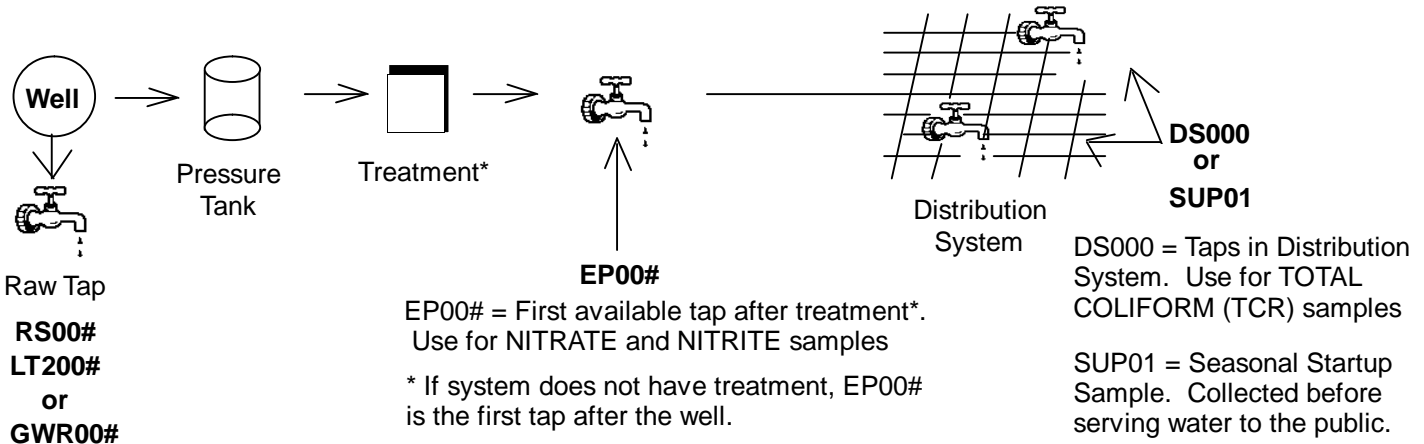

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3230412 BETHEL CHURCH OF CHRIST

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254807 Facility Name: **BETHEL CHURCH OF CHRIST**

Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

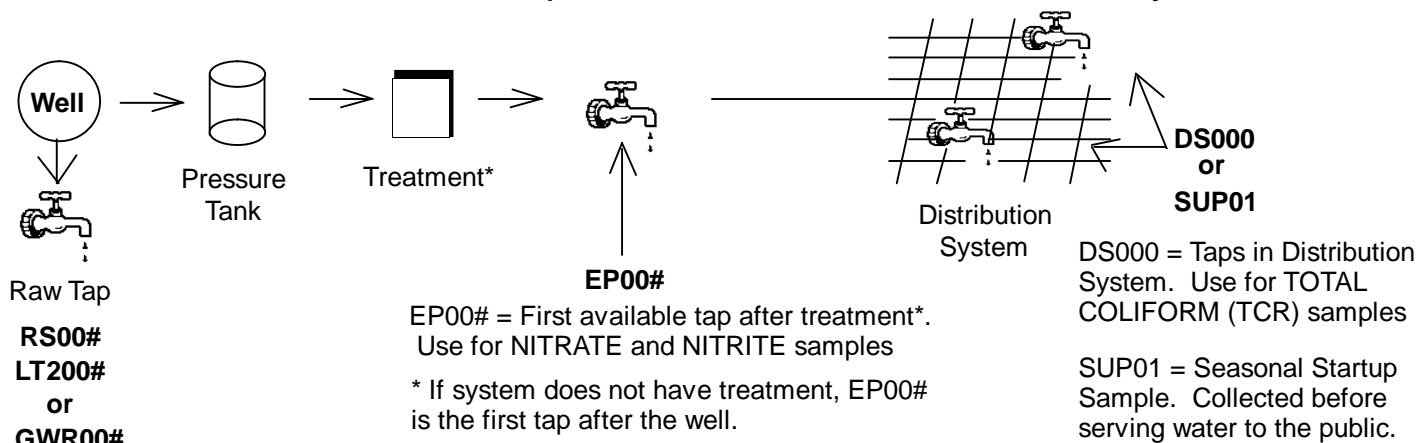

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3231212 CAMP BERRY [BSA]-WEST CAMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CAMP BERRY-WEST CAMP DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

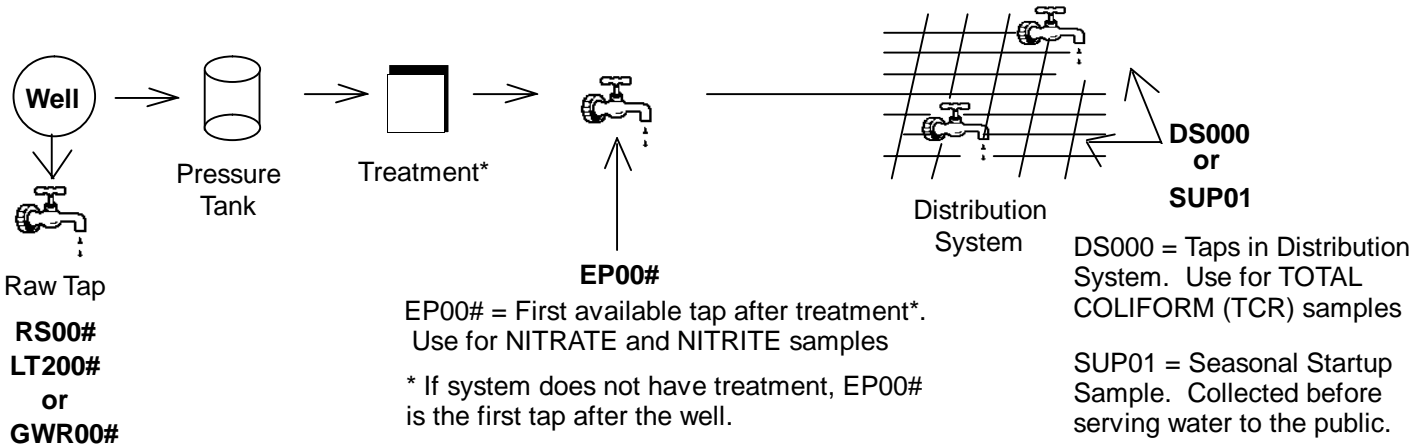

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3231212 CAMP BERRY [BSA]-WEST CAMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3254810** Facility Name: **CAMP BERRY WEST CAMP**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

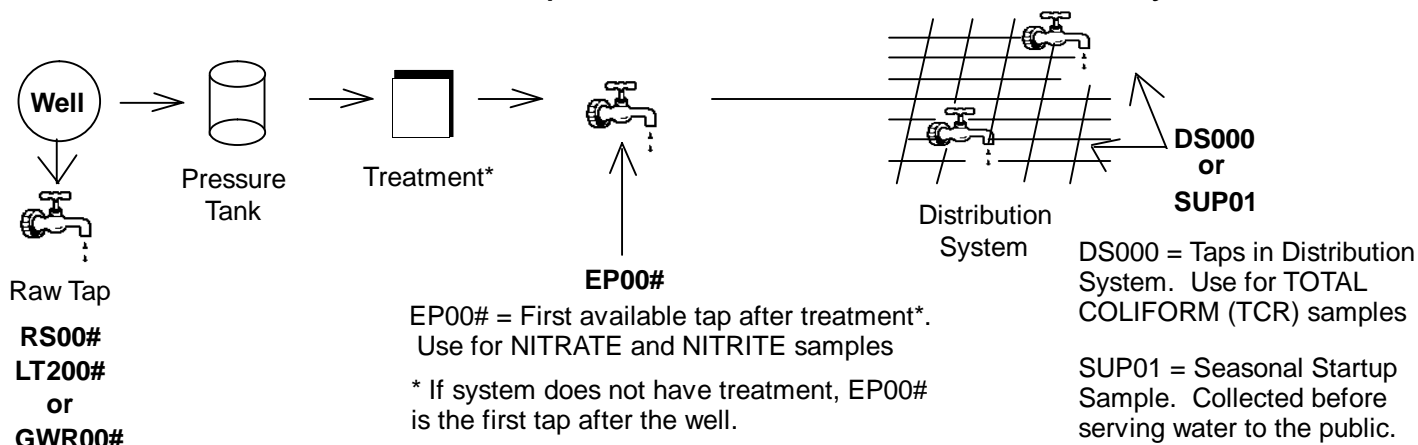

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3231312 CAMP BERRY [BSA]-EAST CAMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CAMP BERRY-EAST CAMP DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

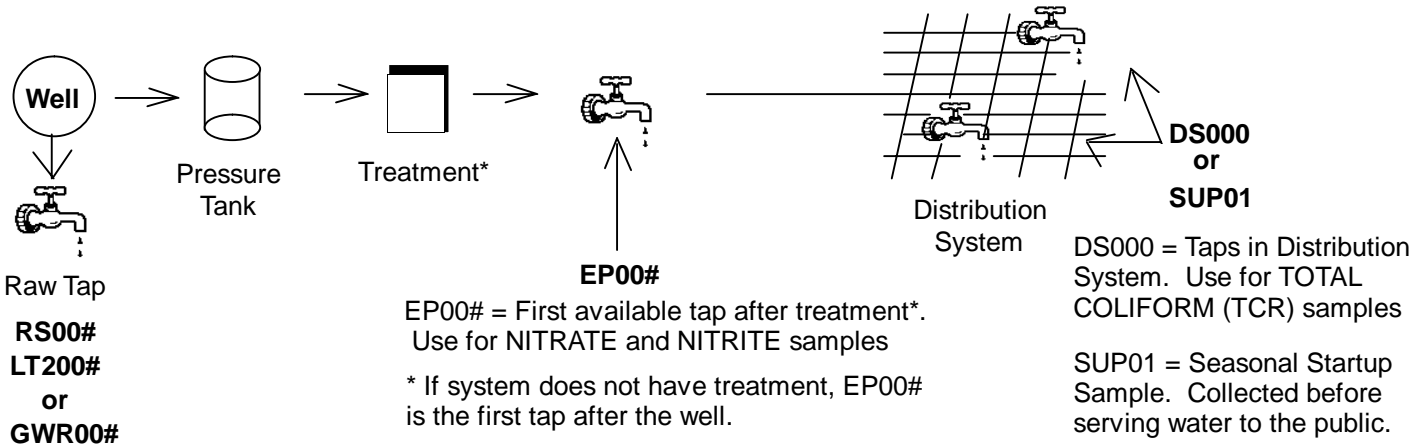

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3231312 CAMP BERRY [BSA]-EAST CAMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3254811** Facility Name: **CAMP BERRY EAST CAMP**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

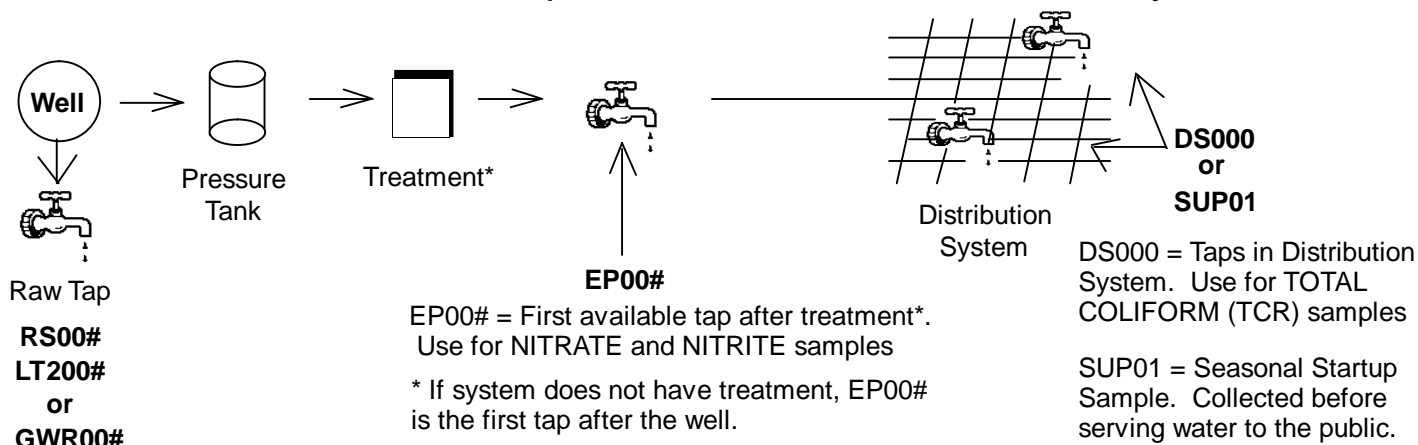

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3231412 CAMP BERRY [BSA]-CENTRAL AREA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CAMP BERRY-CENTRAL AREA DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

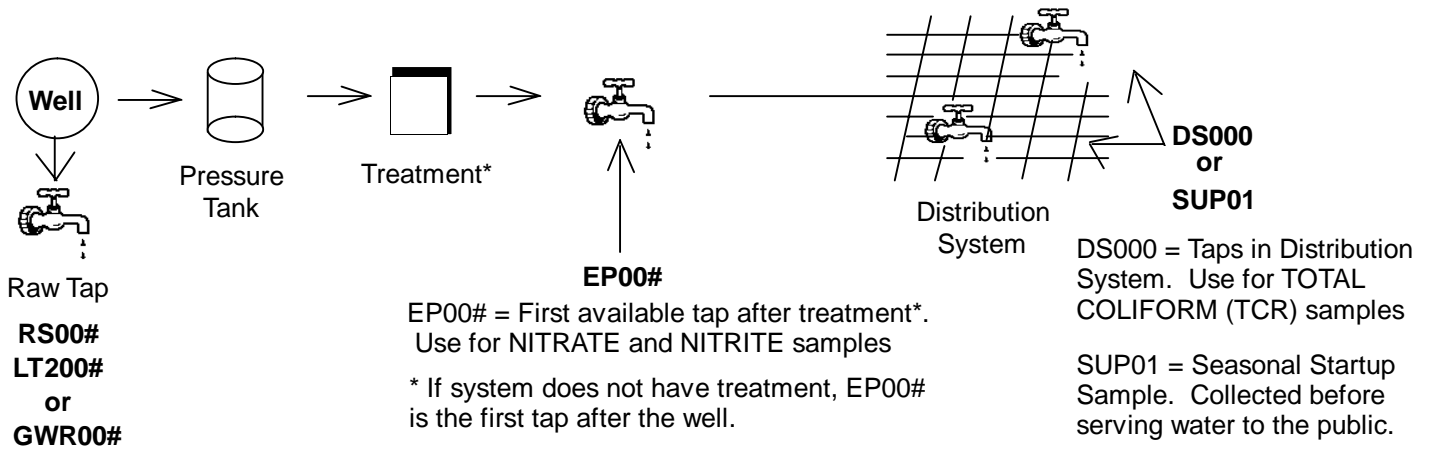

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3231412 CAMP BERRY [BSA]-CENTRAL AREA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254812 Facility Name: **CAMP BERRY CENTRAL AREA**

Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

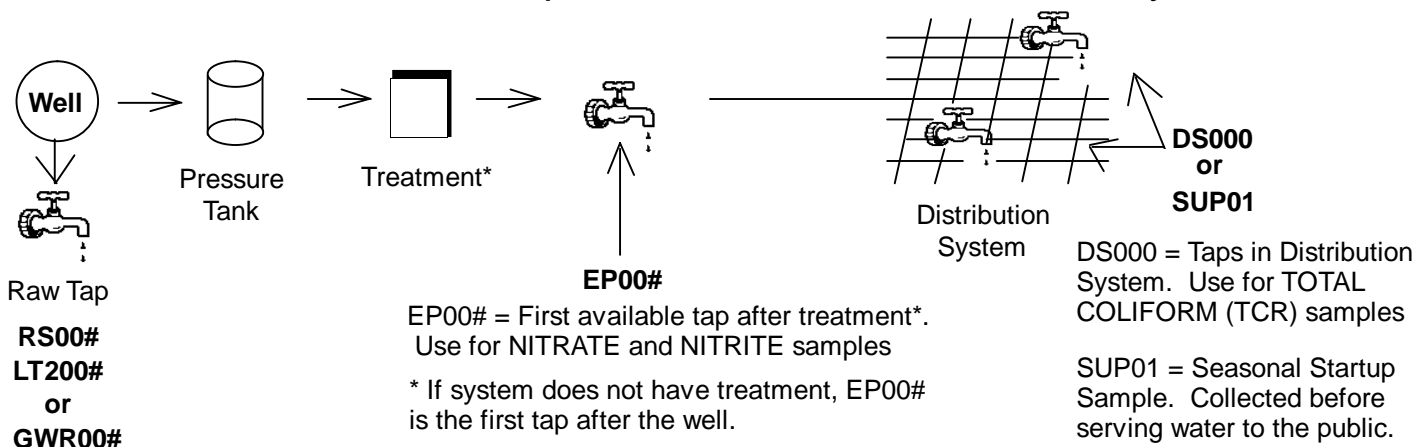

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2019

2019 ENTRY POINT SCHEDULE

OH3232112 CORY RAWSON SCHOOLS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3254815	Facility Name: CORY RAWSON SCHOOL	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH3232112 CORY RAWSON SCHOOLS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: CORY RAWSON SCHOOL DISTRIBUTION SYS1	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019 1 Sample(s) Required between 4/1/2019 and 6/30/2019 1 Sample(s) Required between 7/1/2019 and 9/30/2019 1 Sample(s) Required between 10/1/2019 and 12/31/2019
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2019 and 3/31/2019 1 Sample(s) Required between 4/1/2019 and 6/30/2019 1 Sample(s) Required between 7/1/2019 and 9/30/2019 1 Sample(s) Required between 10/1/2019 and 12/31/2019

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: CORY RAWSON SCHOOL DISTRIBUTION SYS1 ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2019 and 9/30/2019 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: CORY RAWSON SCHOOL DISTRIBUTION SYS1 ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2019 and 9/30/2019 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: CORY RAWSON SCHOOL DISTRIBUTION SYS1 Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2019 and 9/30/2019

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH3233412 GOOD SHEPHERD U M CH -BENTON RIDGE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: GOOD SHEPHERD U M CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

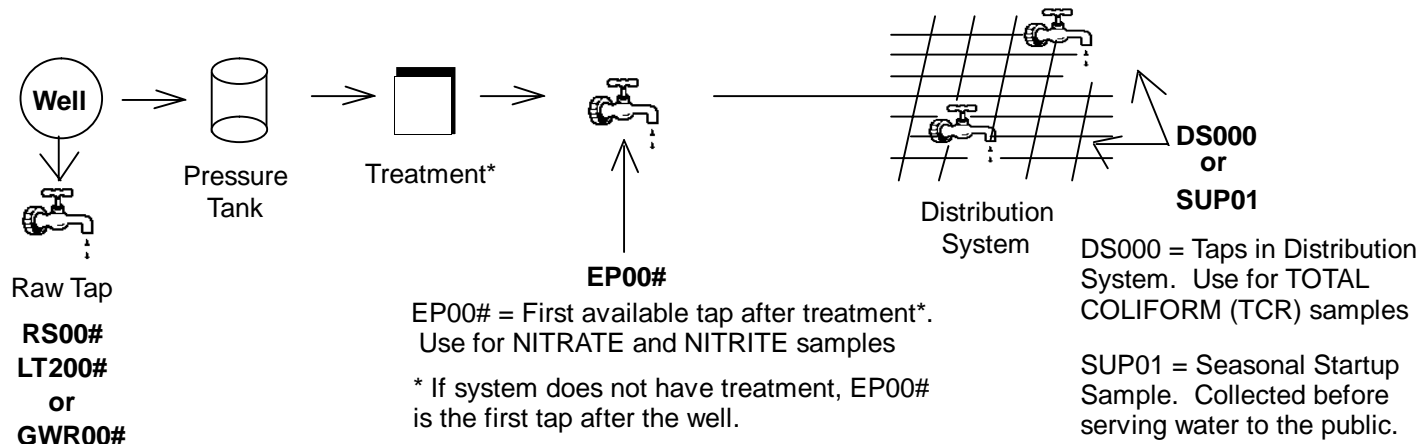

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3233412 GOOD SHEPHERD U M CH -BENTON RIDGE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254820 Facility Name: **GOOD SHEPHERD U M CHURCH**

Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

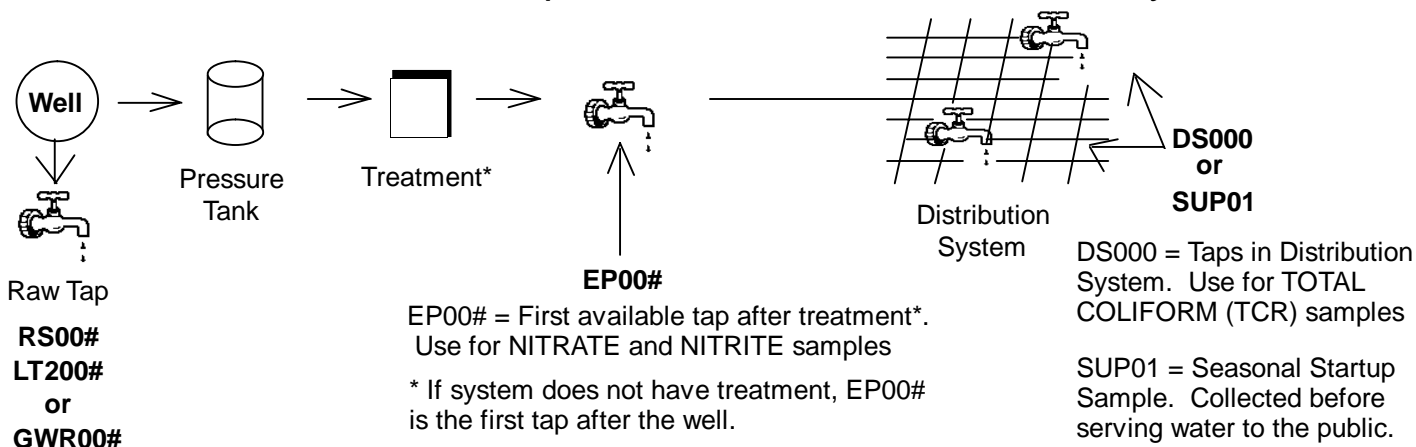

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3236212 HERITAGE SPRINGS CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HERITAGE SPRINGS CMPGRD DISTRIBUTION
Location SMP ID: SUP01	Facility Source: Ground Water

Chemicals


Monitoring Requirements

TOTAL COLIFORM - SEASONAL STARTUP

At least 1 negative Total Coliform
Bacteria sample prior to serving
water to the public

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

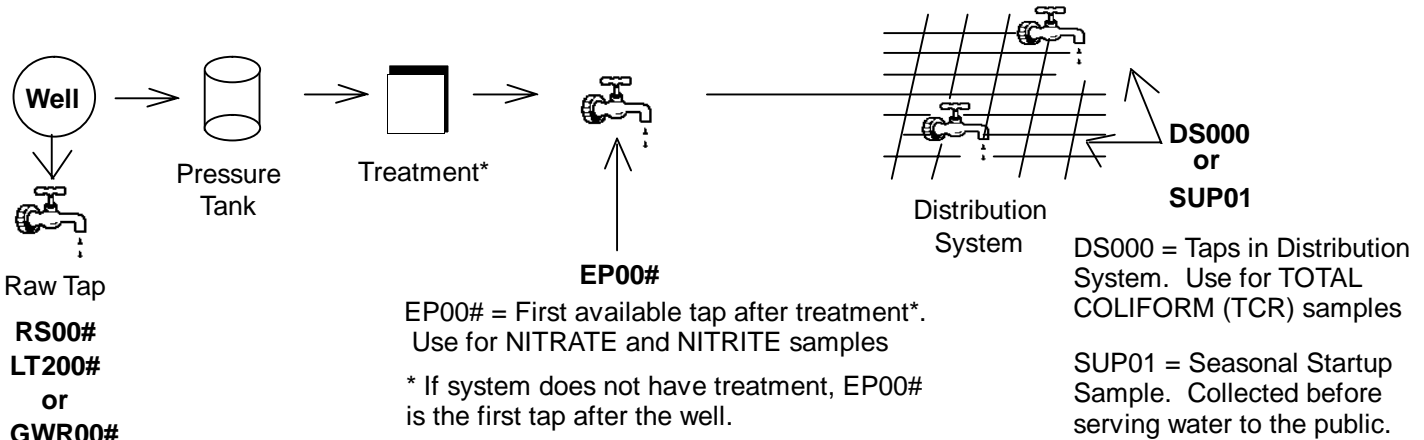

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3236212 HERITAGE SPRINGS CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HERITAGE SPRINGS CMPGRD DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

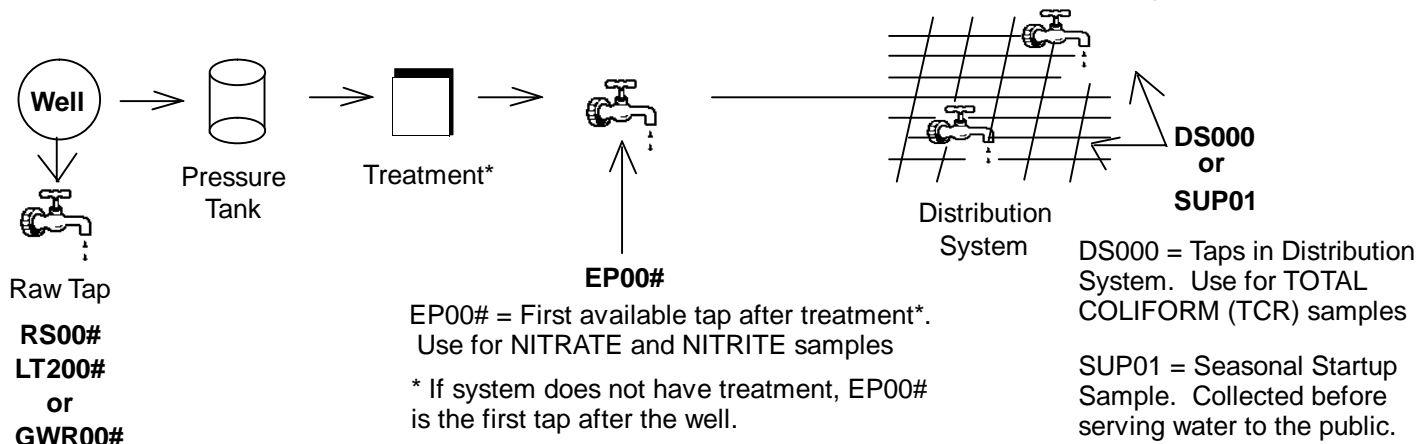

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3236212 HERITAGE SPRINGS CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254826 Facility Name: HERITAGE SPRINGS CAMPGROUD

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

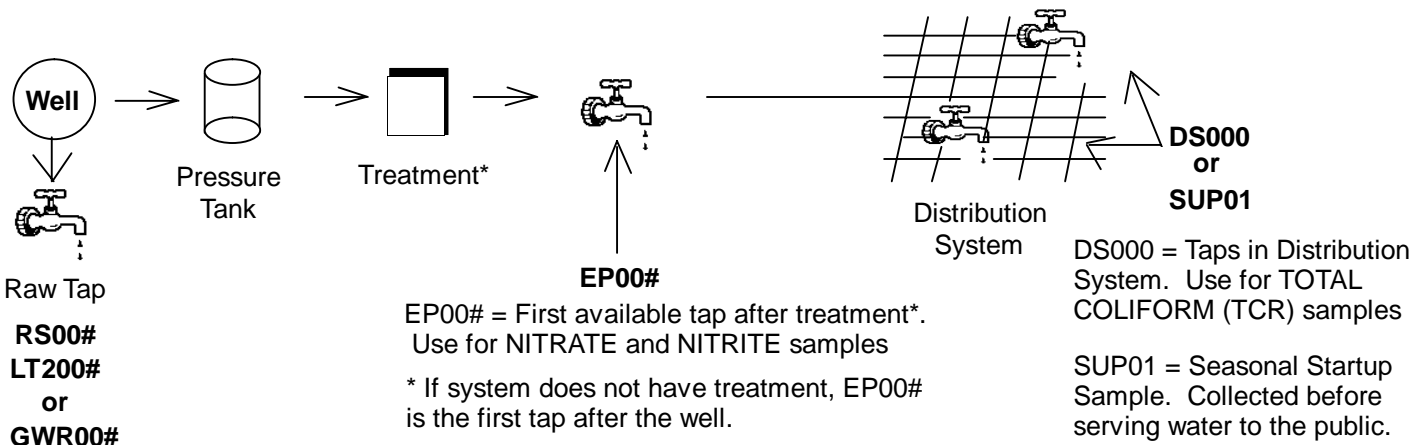

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3236412 LAKELAND GOLF COURSE FOSTORIA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling Facility ID: DS1	Facility Name: LAKELAND GOLF COURSE DISTRIBUTION
Location SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	--

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

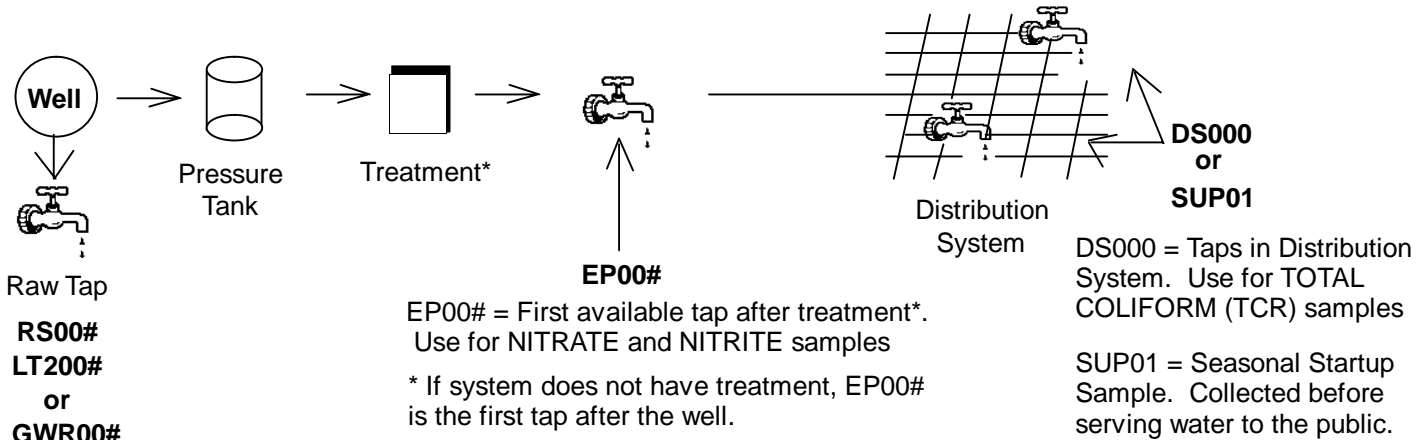

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3236412 LAKELAND GOLF COURSE FOSTORIA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LAKELAND GOLF COURSE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/2/2019 and 4/30/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/29/2019

Where to Collect Samples For a Small Public Water System

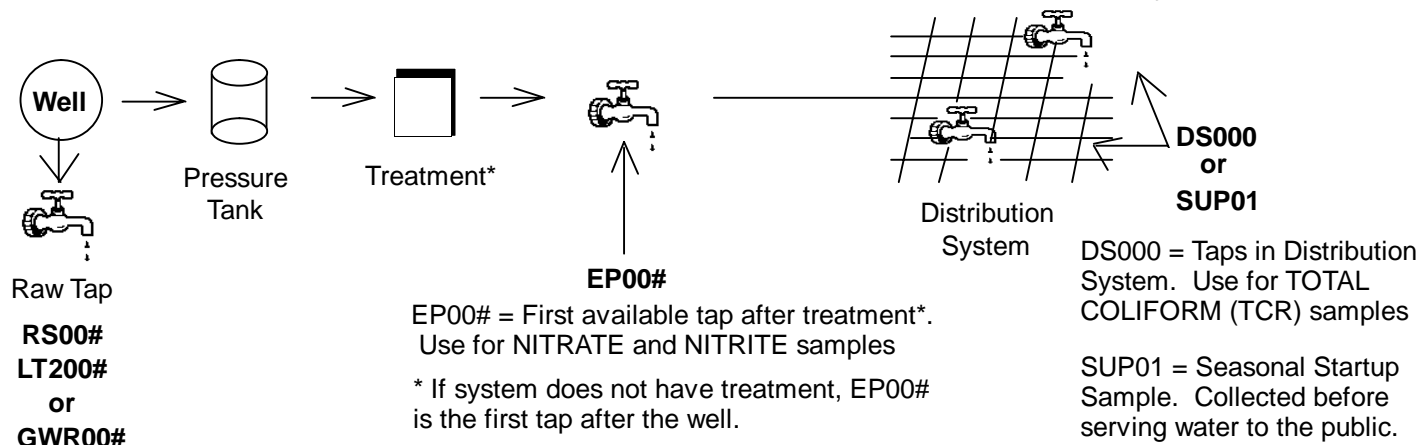

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3236412 LAKELAND GOLF COURSE FOSTORIA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254828 Facility Name: LAKELAND GOLF COURSE FOSTORIA

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

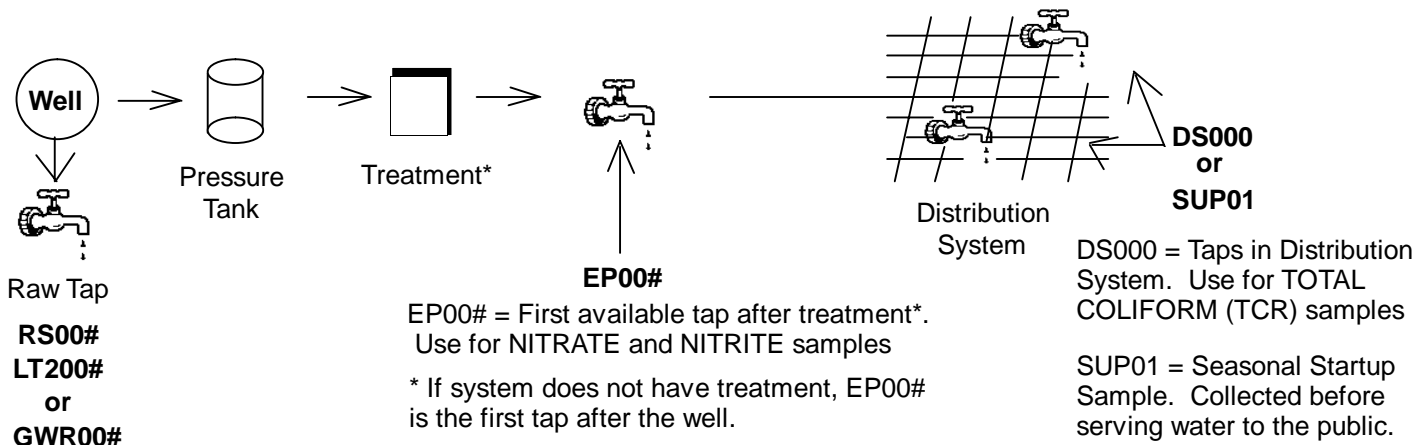

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3238812 PLEASANT VIEW METHODIST CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: PLEASANT VIEW METH CH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

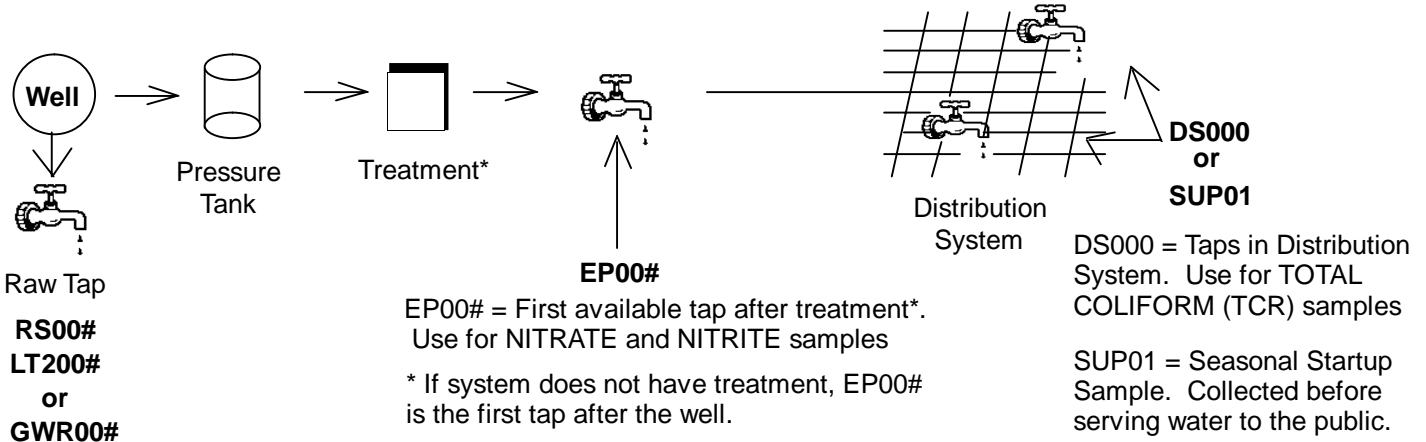

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3238812 PLEASANT VIEW METHODIST CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254832 Facility Name: PLEASANT VIEW METH CHURCH

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

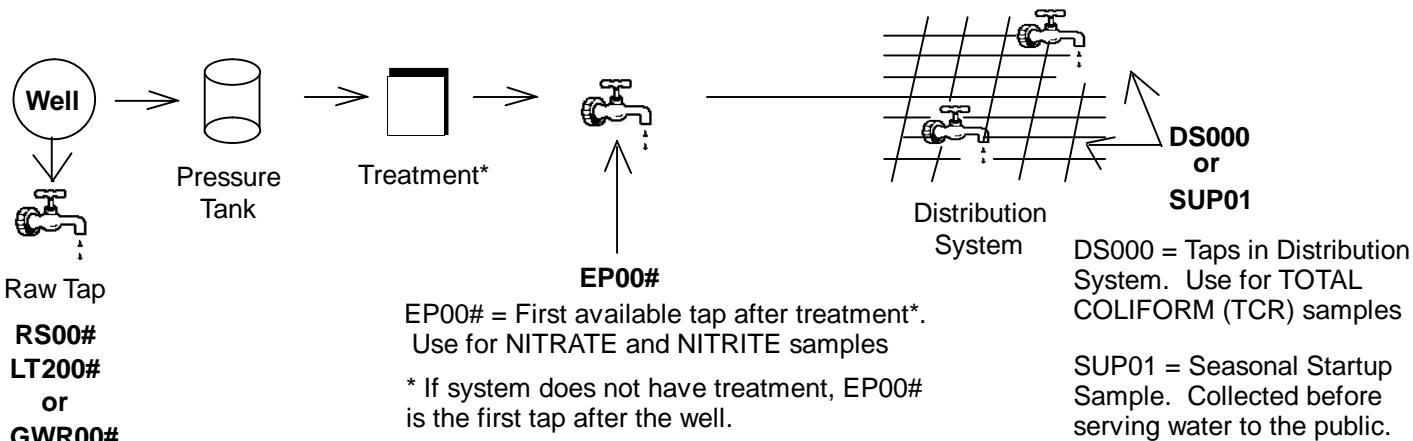

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3238912 ADVENTURE BOUND RESORT-PLEASANT VIEW E

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ADVENTURE B PLEASANTVIEW EAST DISTRIBUTI
Location SMP ID: SUP01	Facility Source: Ground Water

Chemicals


Monitoring Requirements

TOTAL COLIFORM - SEASONAL STARTUP

At least 1 negative Total Coliform
Bacteria sample prior to serving
water to the public

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

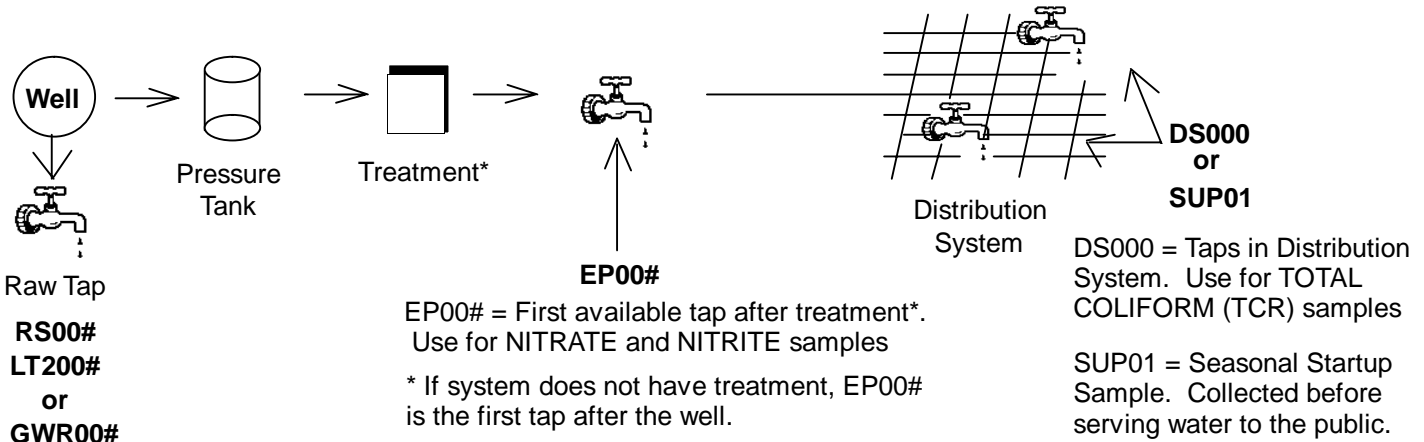

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3238912 ADVENTURE BOUND RESORT-PLEASANT VIEW E

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ADVENTURE B PLEASANTVIEW EAST DISTRIBUTI
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/15/2019

Where to Collect Samples For a Small Public Water System

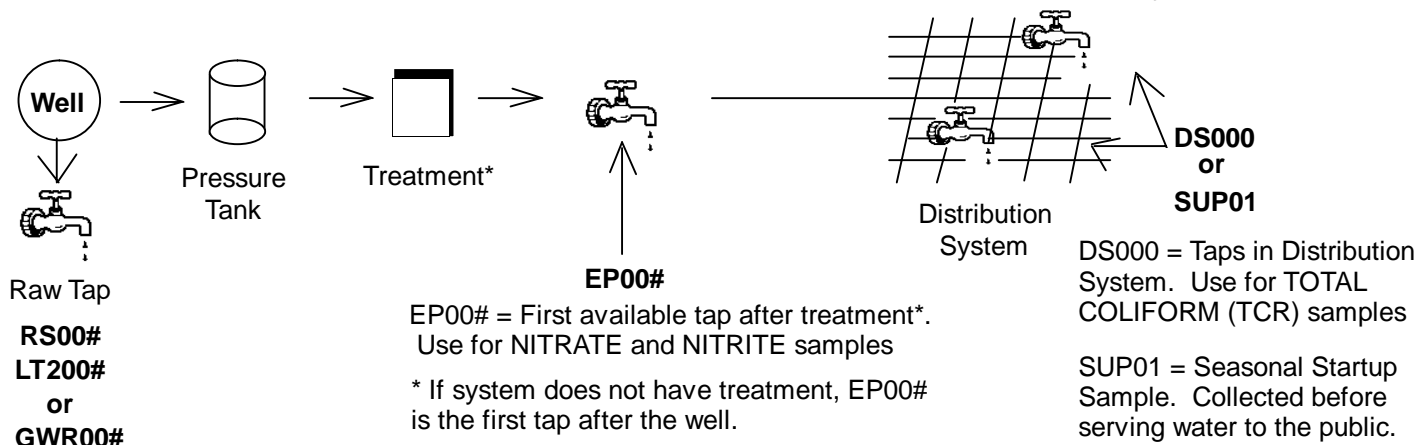

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3238912 ADVENTURE BOUND RESORT-PLEASANT VIEW E

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254833	Facility Name: ADVENTURE BOUND RESORT PLEASANTVIEW EAST
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

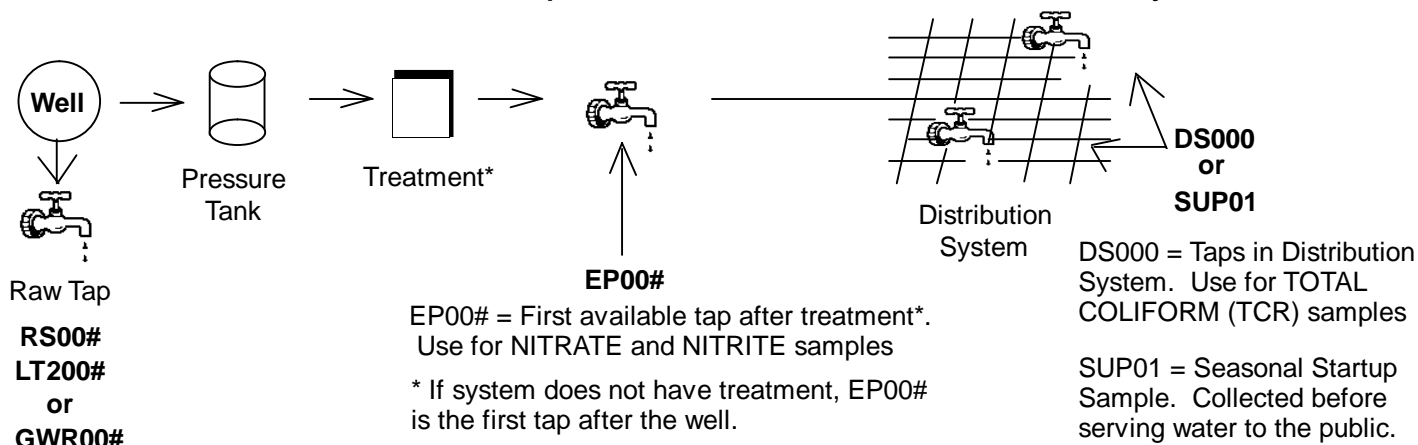

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2019

2019 ENTRY POINT SCHEDULE

OH3239812 RIVERDALE LOCAL SCHOOLS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 3261718	Facility Name: RIVERDALE LOCAL SCHOOLS TP
Location	SMP ID: EP002	Facility Source: Ground Water Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH3239812 RIVERDALE LOCAL SCHOOLS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: RIVERDALE LOCAL SCHOOLS DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2019 and 1/31/2019
	2 Sample(s) Required between 2/1/2019 and 2/28/2019
	2 Sample(s) Required between 3/1/2019 and 3/31/2019
	2 Sample(s) Required between 4/1/2019 and 4/30/2019
	2 Sample(s) Required between 5/1/2019 and 5/31/2019
	2 Sample(s) Required between 6/1/2019 and 6/30/2019
	2 Sample(s) Required between 7/1/2019 and 7/31/2019
	2 Sample(s) Required between 8/1/2019 and 8/31/2019
	2 Sample(s) Required between 9/1/2019 and 9/30/2019
	2 Sample(s) Required between 10/1/2019 and 10/31/2019
	2 Sample(s) Required between 11/1/2019 and 11/30/2019
	2 Sample(s) Required between 12/1/2019 and 12/31/2019
TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2019 and 1/31/2019
	2 Sample(s) Required between 2/1/2019 and 2/28/2019
	2 Sample(s) Required between 3/1/2019 and 3/31/2019
	2 Sample(s) Required between 4/1/2019 and 4/30/2019
	2 Sample(s) Required between 5/1/2019 and 5/31/2019
	2 Sample(s) Required between 6/1/2019 and 6/30/2019
	2 Sample(s) Required between 7/1/2019 and 7/31/2019
	2 Sample(s) Required between 8/1/2019 and 8/31/2019
	2 Sample(s) Required between 9/1/2019 and 9/30/2019
	2 Sample(s) Required between 10/1/2019 and 10/31/2019
	2 Sample(s) Required between 11/1/2019 and 11/30/2019
	2 Sample(s) Required between 12/1/2019 and 12/31/2019

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: RIVERDALE LOCAL SCHOOLS DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2019 and 9/30/2019 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

OH3239812 RIVERDALE LOCAL SCHOOLS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: RIVERDALE LOCAL SCHOOLS DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2019 and 9/30/2019 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: RIVERDALE LOCAL SCHOOLS DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022

10 Sample(s) Required between 6/1/2019 and 9/30/2019

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH3240112 SHADYLAKE CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: SHADYLAKE CAMPGROUND DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 1/31/2019
	1 Sample(s) Required between 2/1/2019 and 2/28/2019
	1 Sample(s) Required between 3/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 4/30/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019
	1 Sample(s) Required between 11/1/2019 and 11/30/2019
	1 Sample(s) Required between 12/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

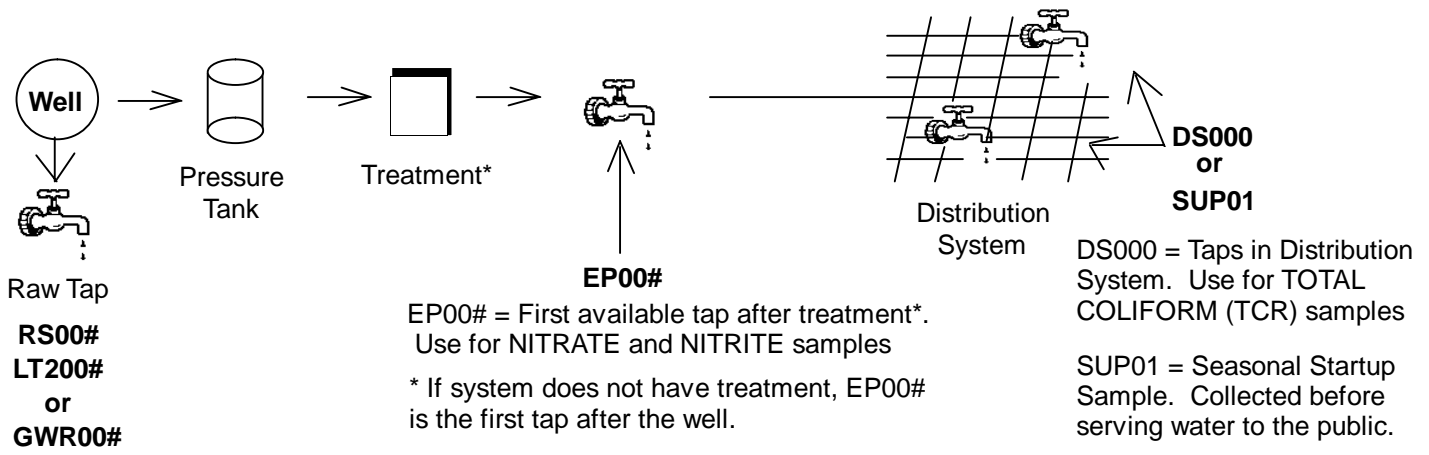

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3240112 SHADYLAKE CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254838 Facility Name: SHADYLAKE CAMPGROUND

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

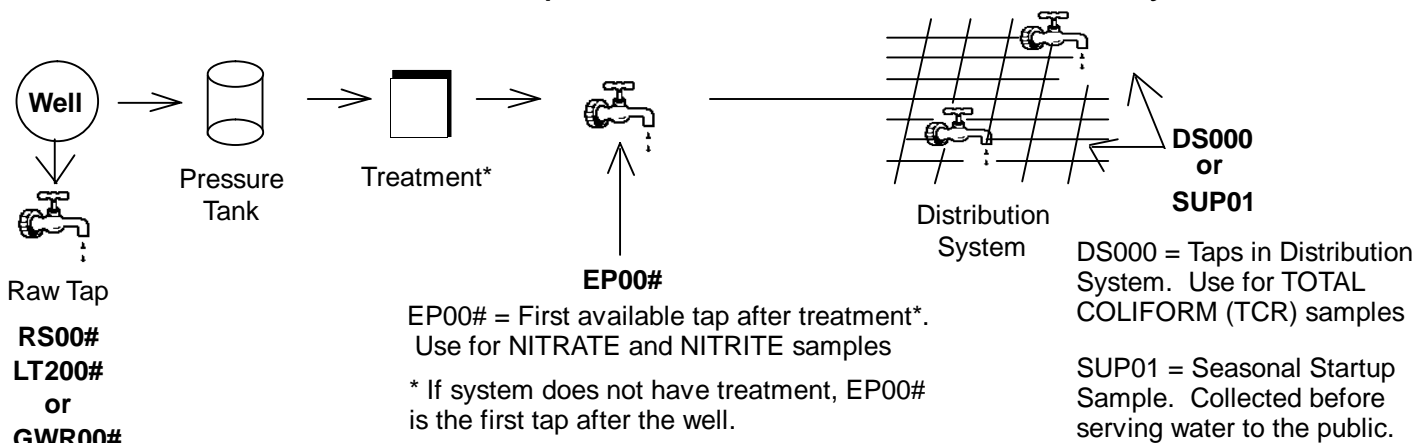

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3240912 ST PAUL EVANGELICAL LUTHERAN CH-JENERA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ST PAUL EV LUTHERAN CH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

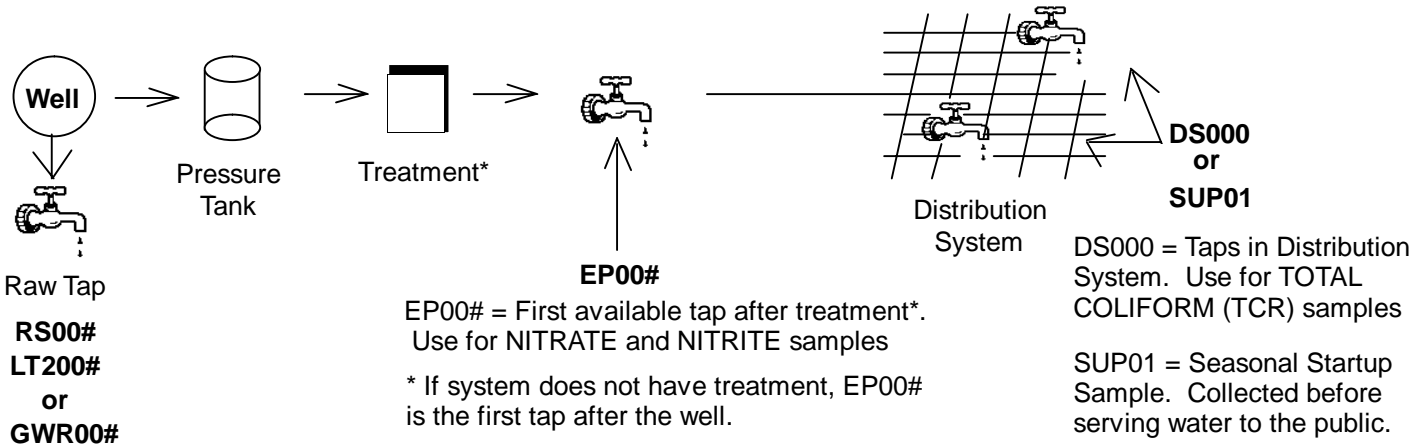

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3240912 ST PAUL EVANGELICAL LUTHERAN CH-JENERA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254839 Facility Name: ST PAUL EV LUTHERAN CHURCH

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

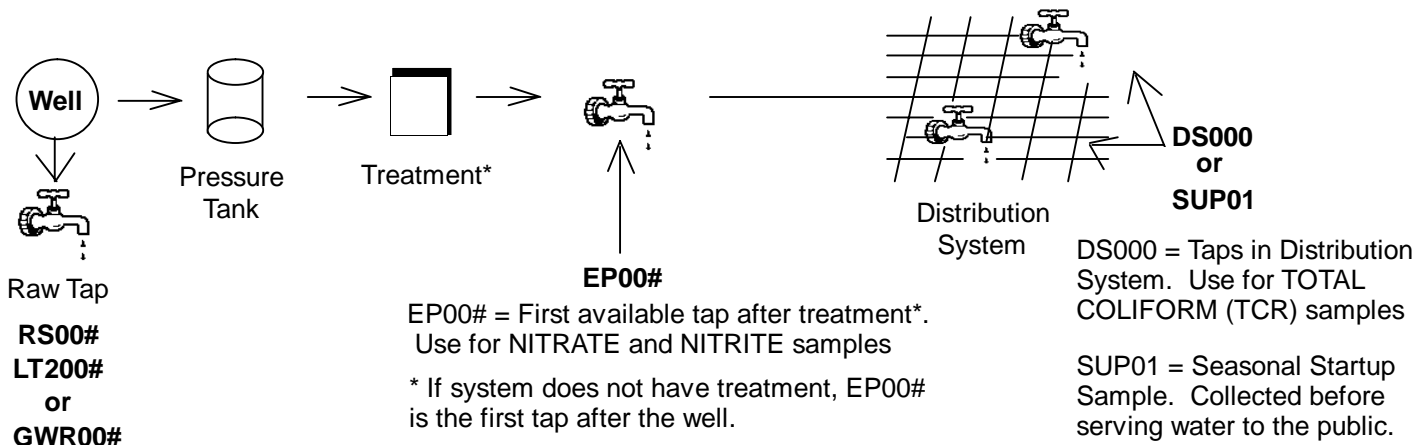

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3241312 SYCAMORE SPRINGS GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: SYCAMORE SPR GOLF COURSE DISTRIBUTION
Location SMP ID: SUP01	Facility Source: Ground Water

Chemicals


Monitoring Requirements

TOTAL COLIFORM - SEASONAL STARTUP

At least 1 negative Total Coliform
Bacteria sample prior to serving
water to the public

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

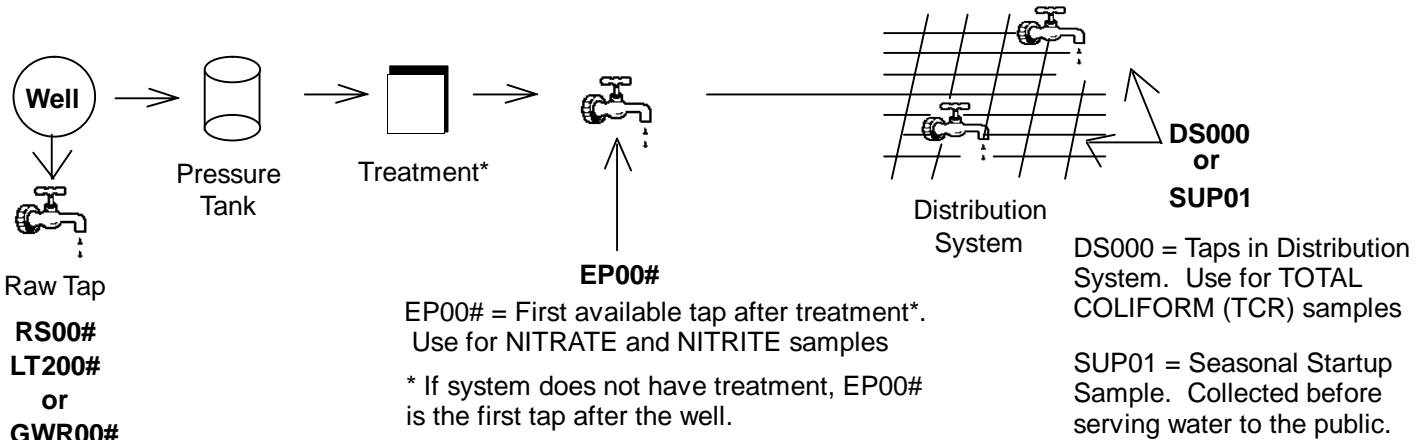

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3241312 SYCAMORE SPRINGS GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: SYCAMORE SPR GOLF COURSE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/2/2019 and 4/30/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/29/2019

Where to Collect Samples For a Small Public Water System

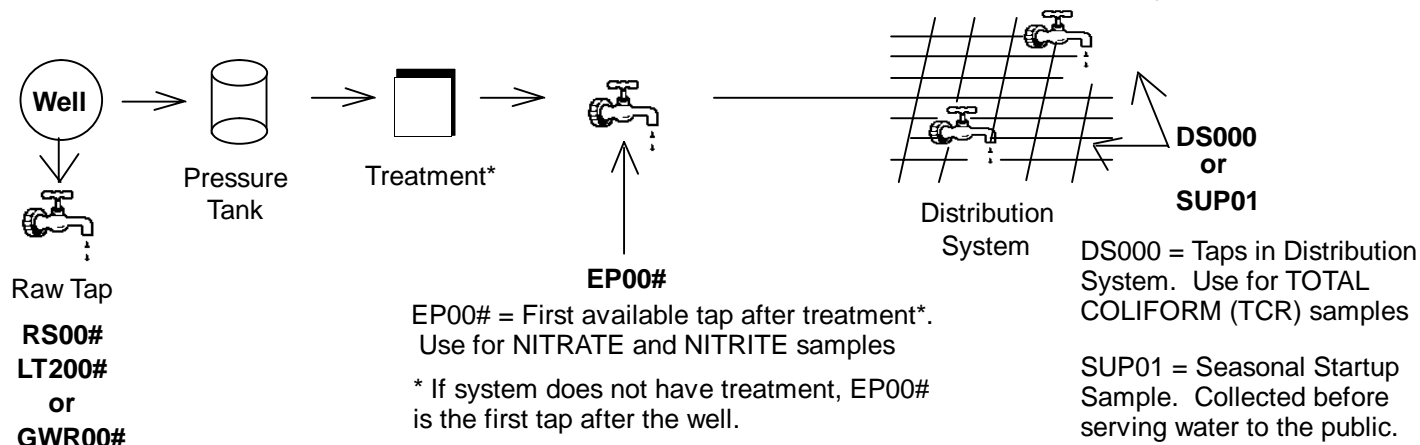

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3241312 SYCAMORE SPRINGS GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254841	Facility Name: SYCAMORE SPRINGS GOLF COURSE STU 1
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

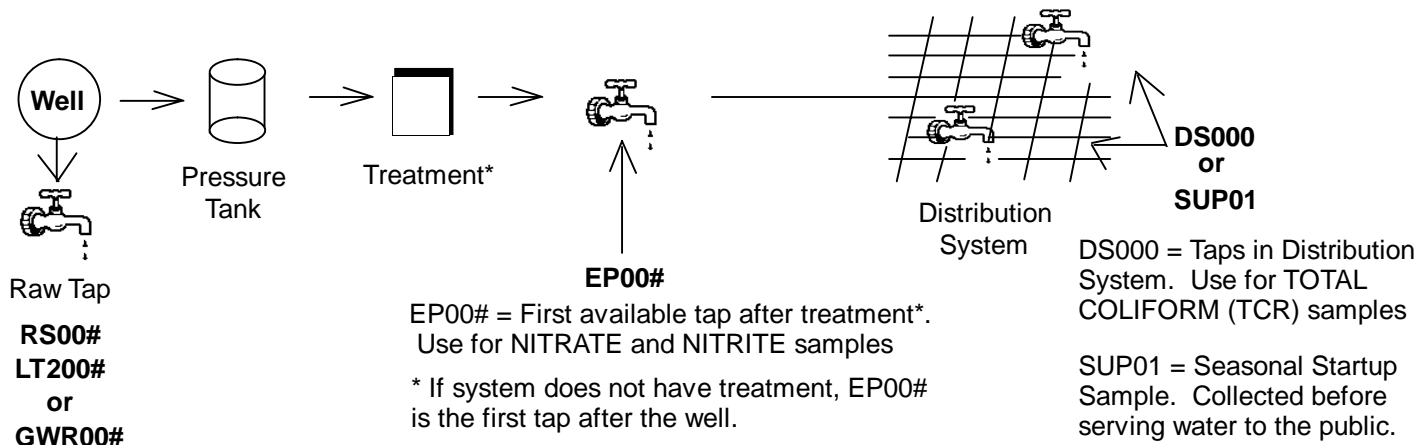

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3241812 TWIN LAKES PARK

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: TWIN LAKES PARK DISTRIBUTION
Location SMP ID: SUP01	Facility Source: Ground Water

Chemicals


Monitoring Requirements

TOTAL COLIFORM - SEASONAL STARTUP

At least 1 negative Total Coliform
Bacteria sample prior to serving
water to the public

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

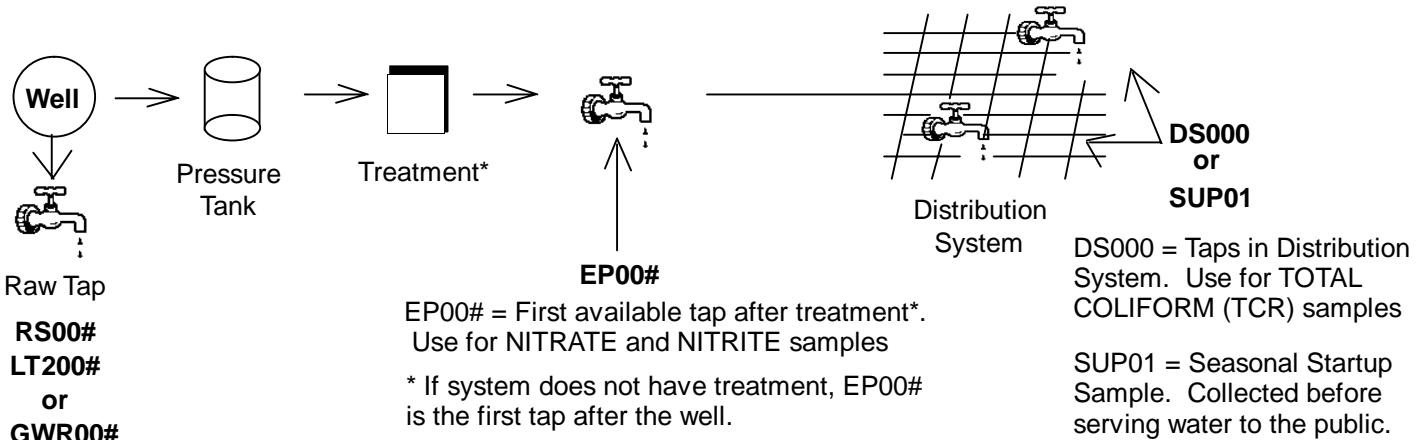

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3241812 TWIN LAKES PARK

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: TWIN LAKES PARK DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

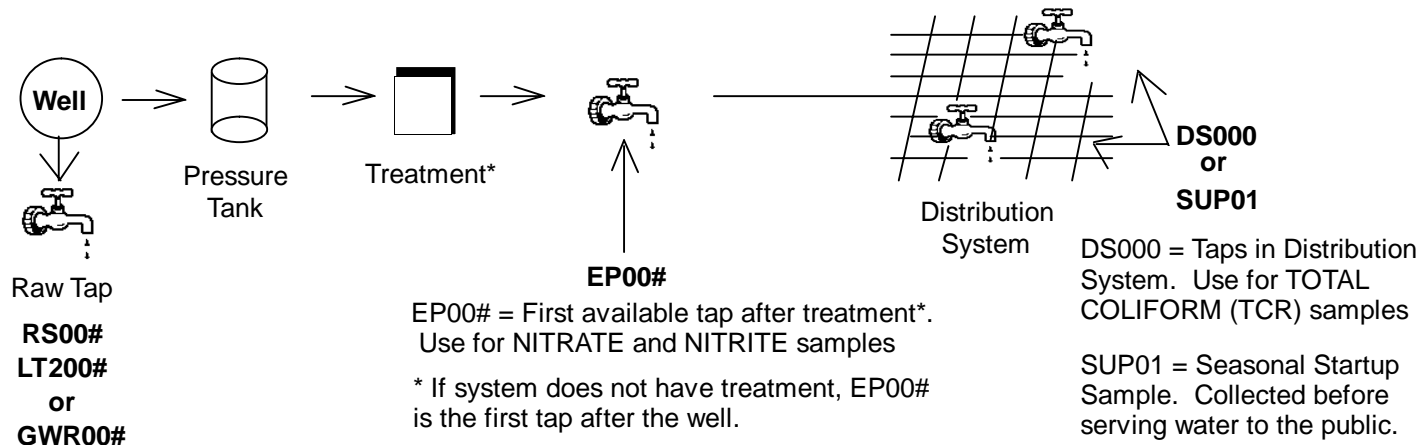

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3241812 TWIN LAKES PARK

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3260521 Facility Name: TWIN LAKES PARK-STORE

Location SMP ID: EP002 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

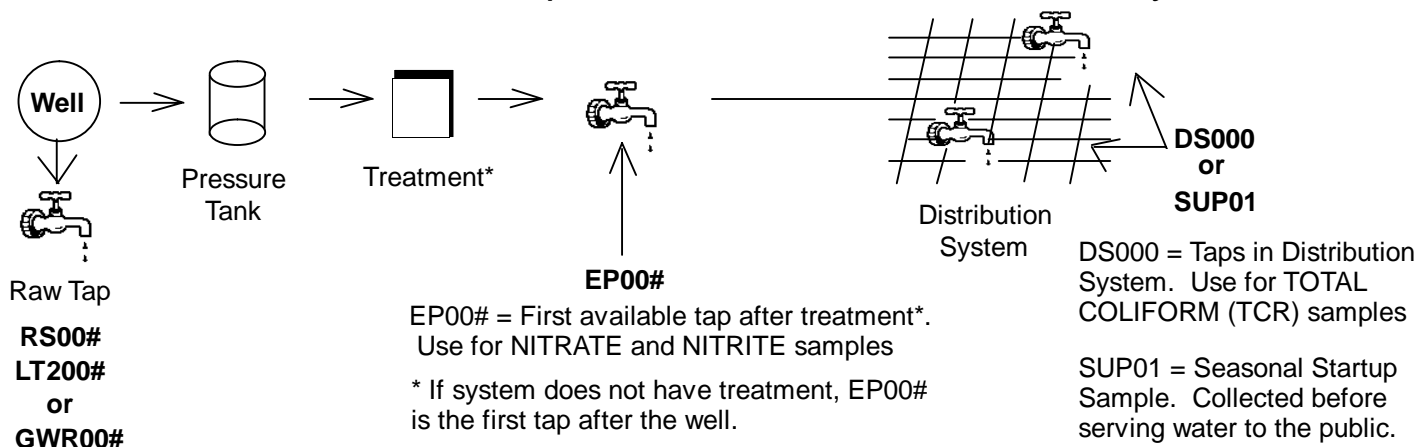

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3241812 TWIN LAKES PARK

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3254846** Facility Name: **TWIN LAKES PARK-BATHHOUSE**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

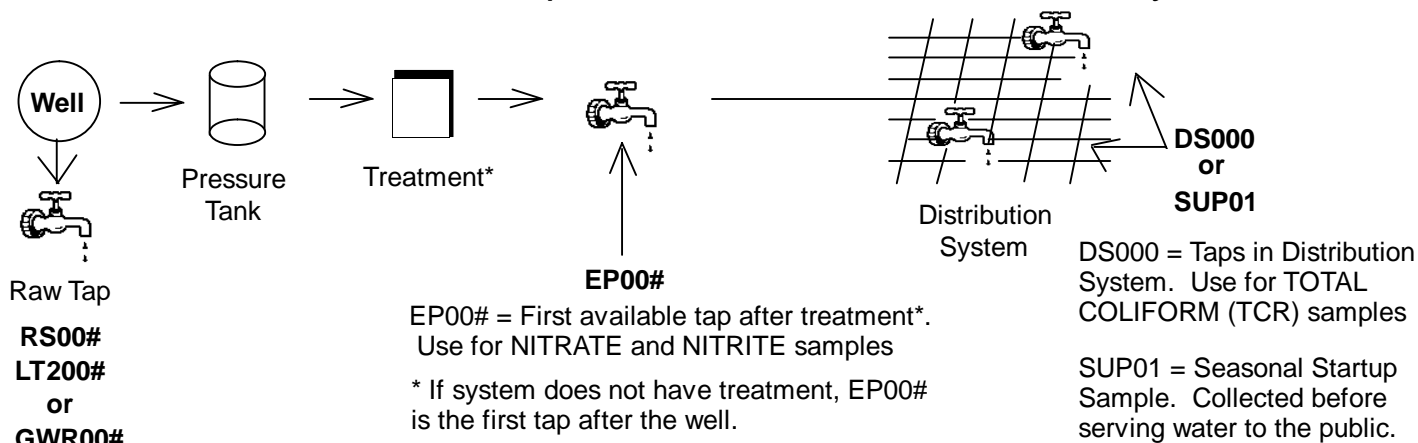

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3242012 UNITED CONSERVATION AND OUTDOOR ASSN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: UN CONSV & OUTDOOR ASSN DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

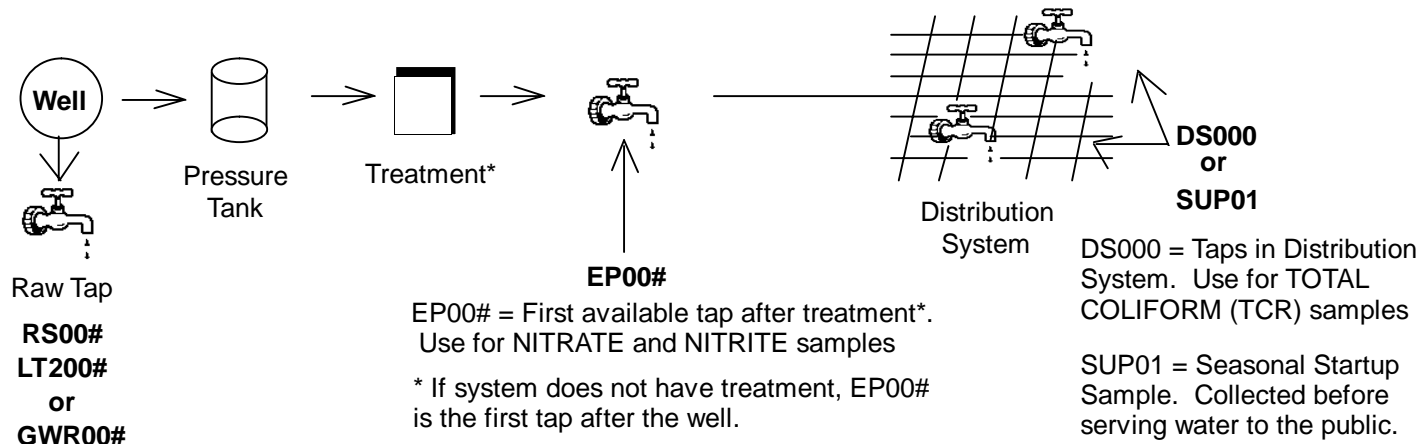

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3242012 UNITED CONSERVATION AND OUTDOOR ASSN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254847 Facility Name: UN CONSV & OUTDOOR ASSN

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

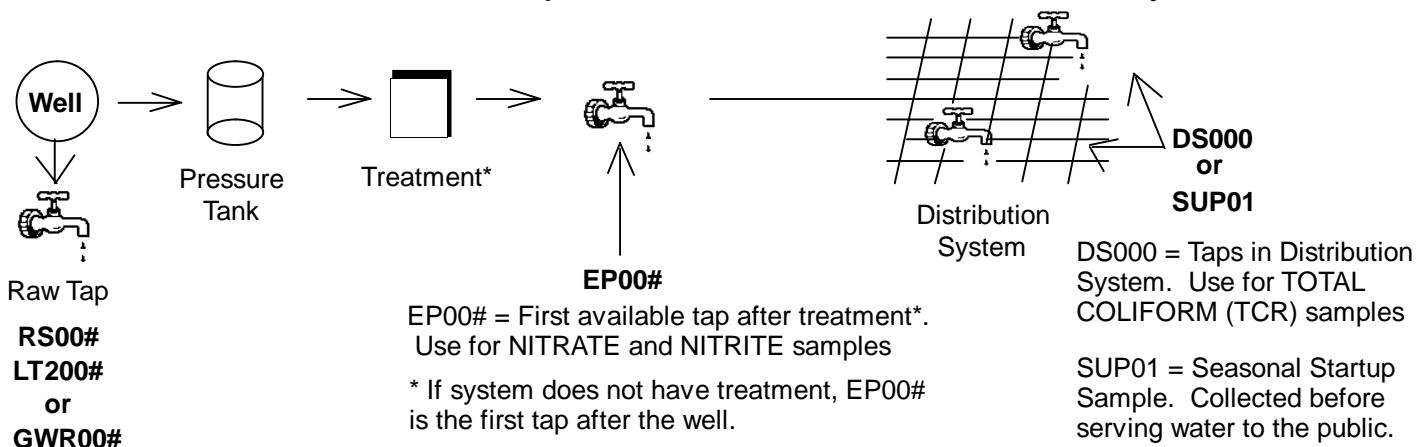

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3243112 WEST INDEPENDENCE UM CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

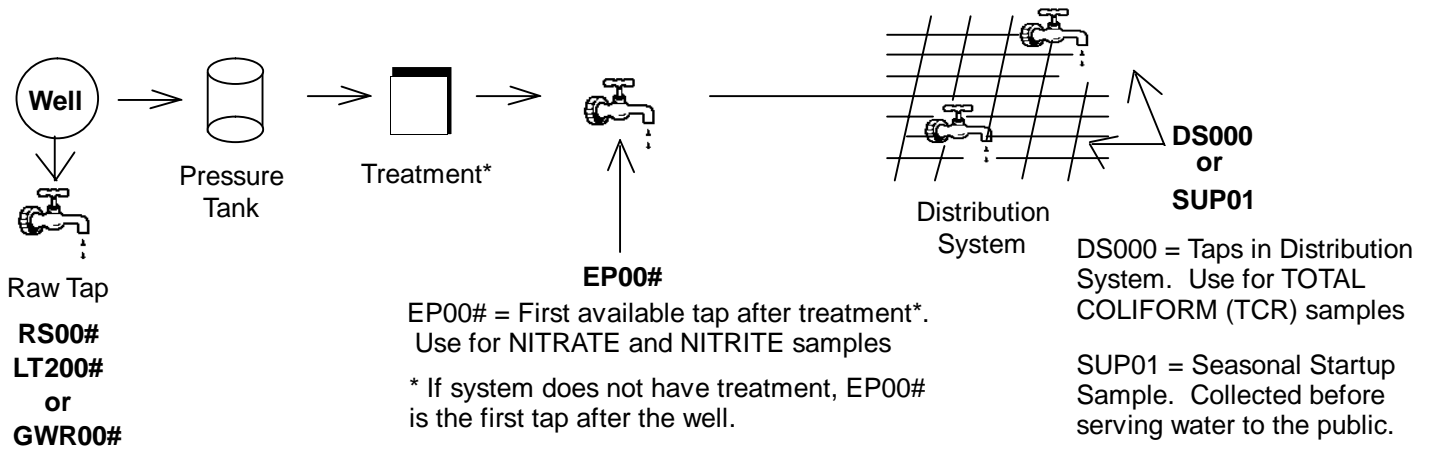

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3243112 WEST INDEPENDENCE UM CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254852 Facility Name: WEST INDEPENDENCE UM CHURCH

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

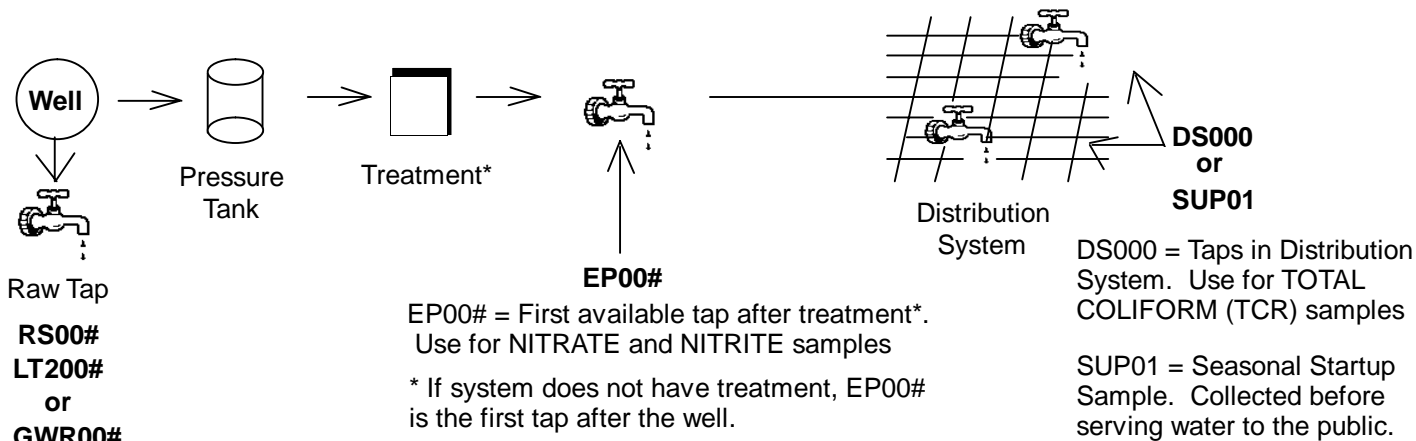

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3243812 ODOT REST AREA 1-25 NB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ODOT RA 1-25 NB DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2019 and 1/31/2019
	2 Sample(s) Required between 2/1/2019 and 2/28/2019
	2 Sample(s) Required between 3/1/2019 and 3/31/2019
	2 Sample(s) Required between 4/1/2019 and 4/30/2019
	2 Sample(s) Required between 5/1/2019 and 5/31/2019
	2 Sample(s) Required between 6/1/2019 and 6/30/2019
	2 Sample(s) Required between 7/1/2019 and 7/31/2019
	2 Sample(s) Required between 8/1/2019 and 8/31/2019
	2 Sample(s) Required between 9/1/2019 and 9/30/2019
	2 Sample(s) Required between 10/1/2019 and 10/31/2019
	2 Sample(s) Required between 11/1/2019 and 11/30/2019
	2 Sample(s) Required between 12/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

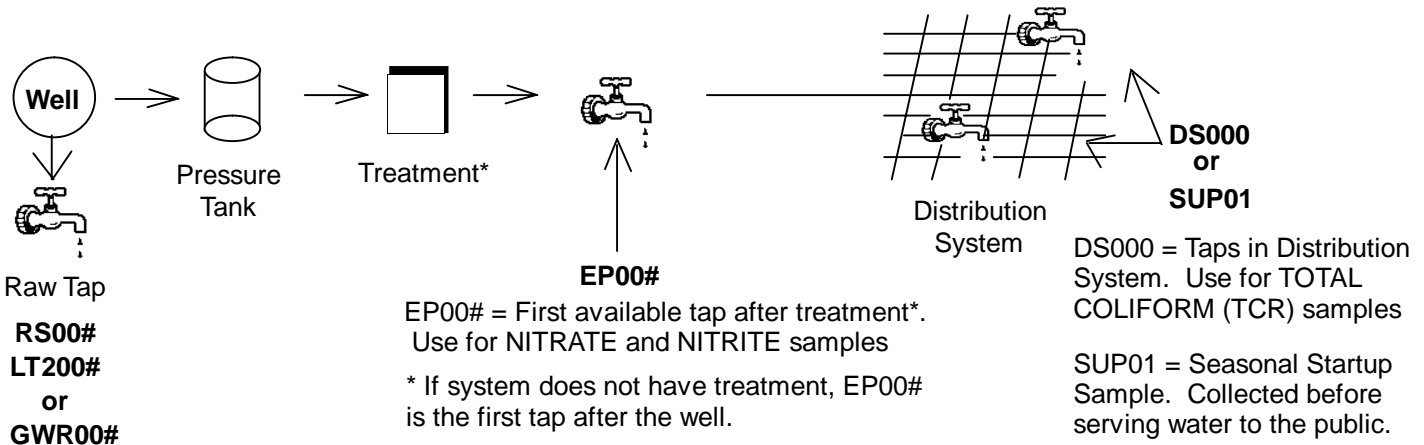

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3243812 ODOT REST AREA 1-25 NB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254855	Facility Name: ODOT RA 1-25 NB
Location SMP ID: EP001	Facility Source: Ground Water
Facility Class: CLASS A	

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

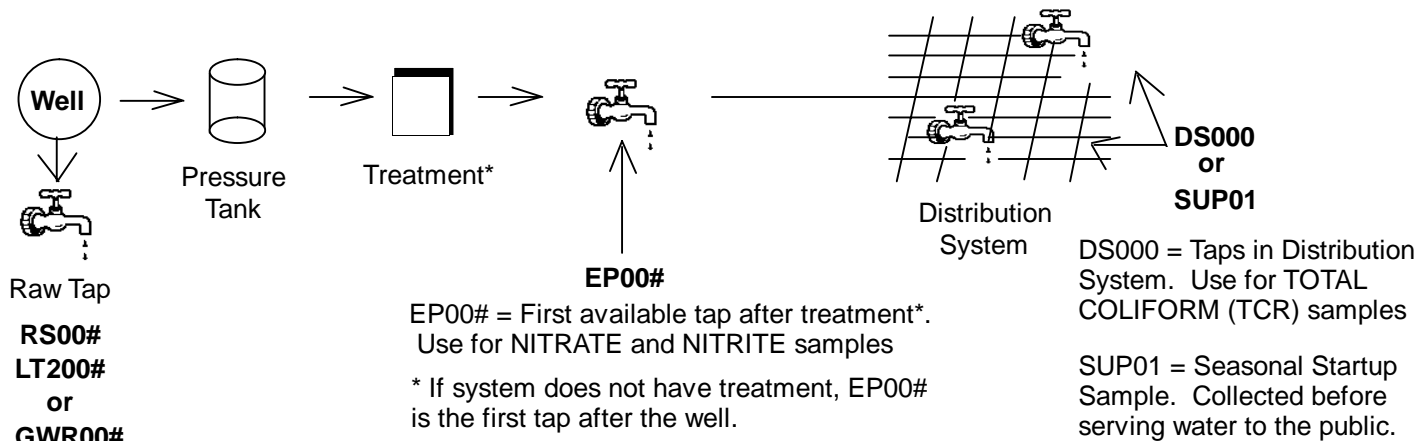

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3244012 ODOT REST AREA 1-26 SB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: ODOT RA 1-26 SB DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2019 and 1/31/2019
	2 Sample(s) Required between 2/1/2019 and 2/28/2019
	2 Sample(s) Required between 3/1/2019 and 3/31/2019
	2 Sample(s) Required between 4/1/2019 and 4/30/2019
	2 Sample(s) Required between 5/1/2019 and 5/31/2019
	2 Sample(s) Required between 6/1/2019 and 6/30/2019
	2 Sample(s) Required between 7/1/2019 and 7/31/2019
	2 Sample(s) Required between 8/1/2019 and 8/31/2019
	2 Sample(s) Required between 9/1/2019 and 9/30/2019
	2 Sample(s) Required between 10/1/2019 and 10/31/2019
	2 Sample(s) Required between 11/1/2019 and 11/30/2019
	2 Sample(s) Required between 12/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

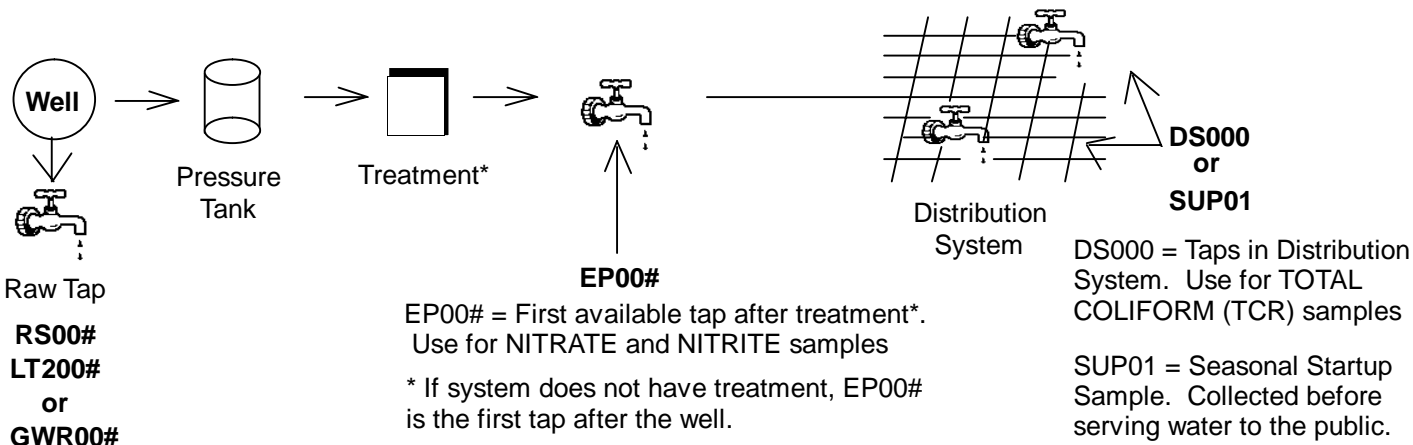

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3244012 ODOT REST AREA 1-26 SB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254856	Facility Name: ODOT RA 1-26 SB TP
Location SMP ID: EP001	Facility Source: Ground Water
Facility Class: CLASS A	

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

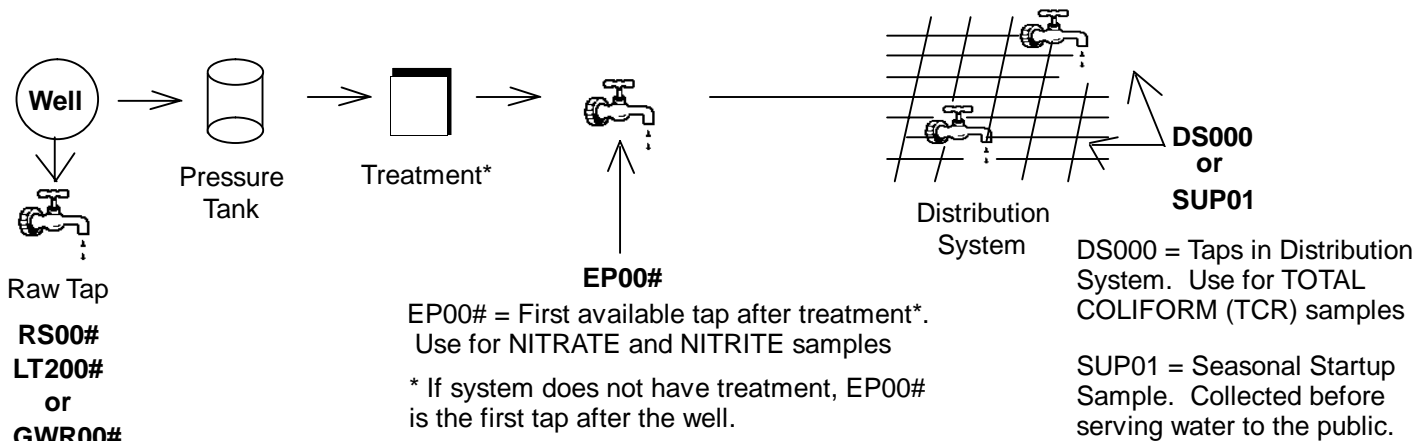

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2019

2019 ENTRY POINT SCHEDULE

OH3244912 UNIVERSITY OF FINDLAY-SOUTH CAMPUS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3254863	Facility Name: UNIVERSITY OF FINDLAY-S	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH3244912 UNIVERSITY OF FINDLAY-SOUTH CAMPUS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: UNIV OF FINDLAY-S DIST
	SMP ID: DS000	

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2019	and	3/31/2019
	1 Sample(s) Required between	4/1/2019	and	6/30/2019
	1 Sample(s) Required between	7/1/2019	and	9/30/2019
	1 Sample(s) Required between	10/1/2019	and	12/31/2019

Sampling Location	Facility ID: DS1	Facility Name: UNIV OF FINDLAY-S DIST
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between	6/1/2019	and	9/30/2019
-------------------------------	------------------------------	----------	-----	-----------

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH3245512 RILEY CREEK BAPTIST CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: RILEY CREEK BAPTIST CHUR DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

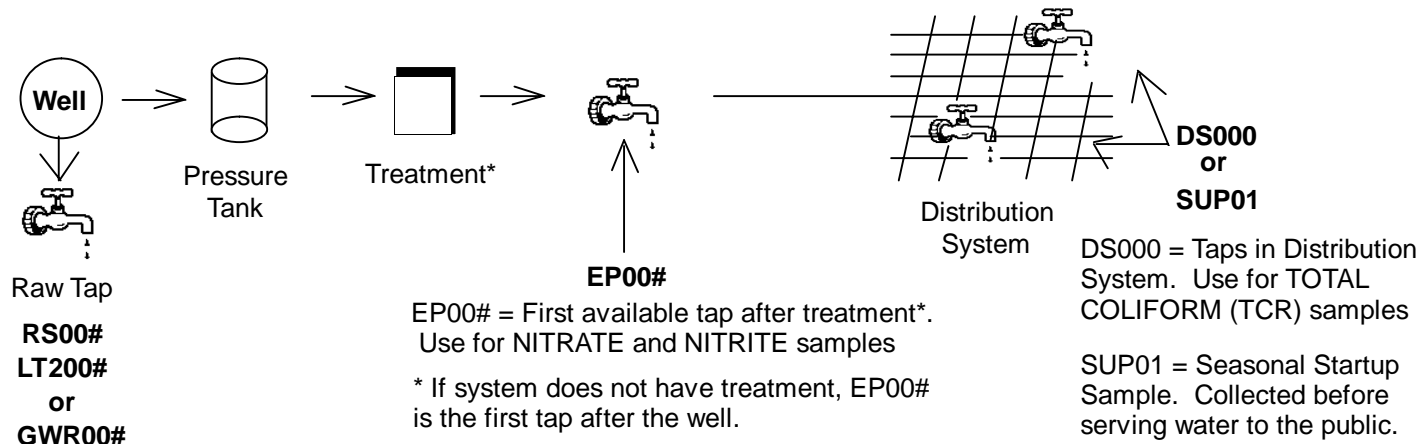

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3245512 RILEY CREEK BAPTIST CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3254869** Facility Name: **RILEY CREEK BAPTIST CHURCH**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

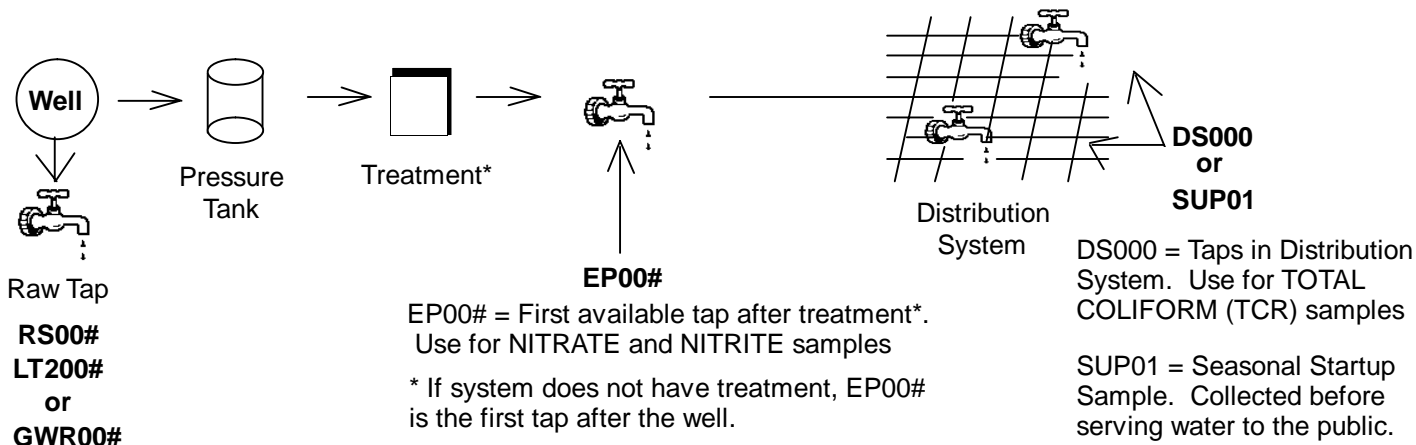

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3245612 GARNER TRANSPORTATION GROUP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: GARNER TRANSPORTATION GROUP DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

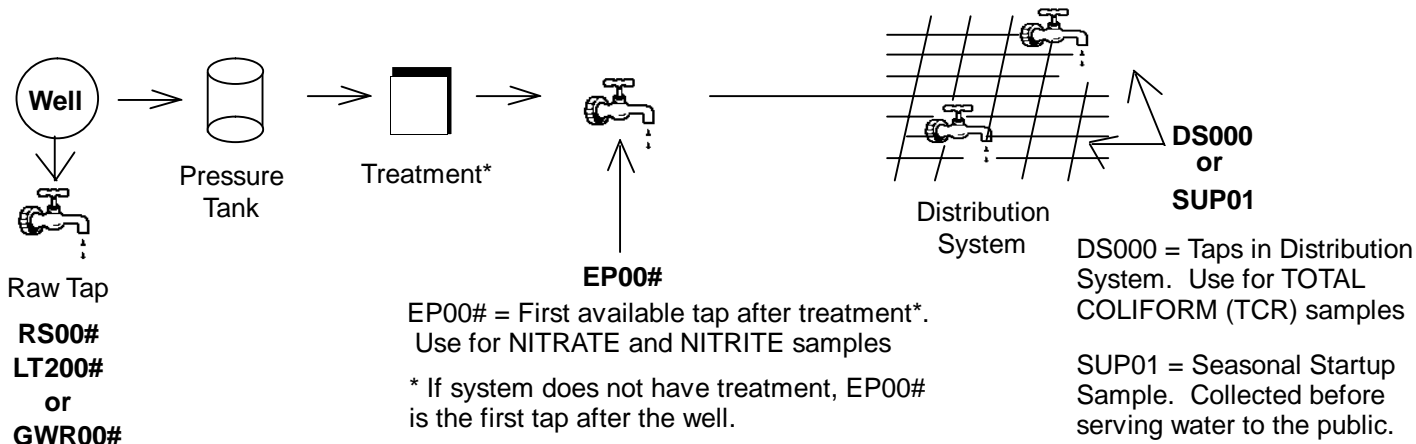

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3245612 GARNER TRANSPORTATION GROUP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254870 Facility Name: GARNER TRANSPORTATION GROUP

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019
SYNTHETIC ORGANIC CHEMICALS (SOC) GROU	Not Required

Where to Collect Samples For a Small Public Water System

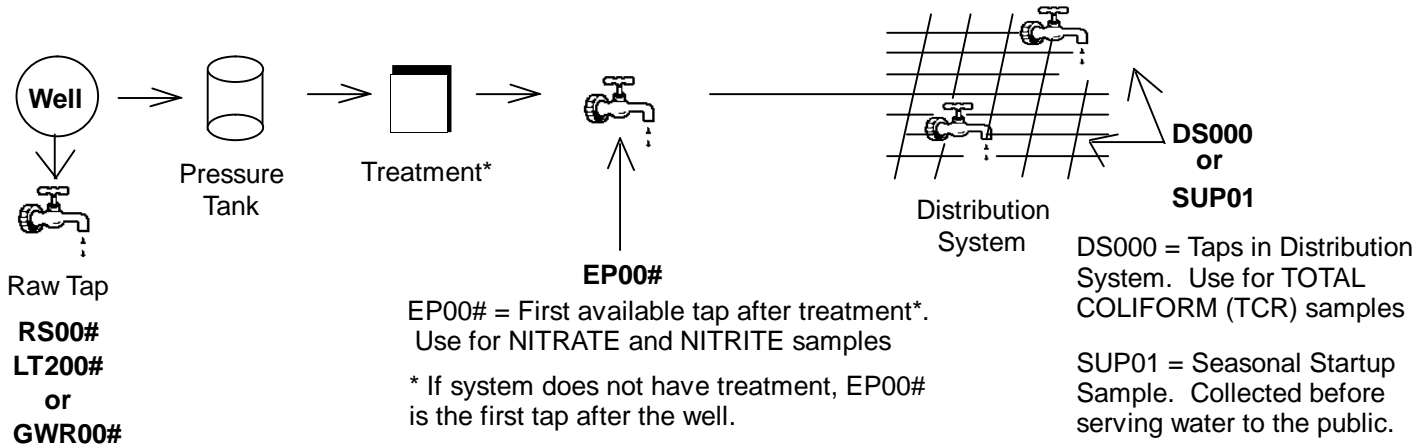

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3245812 HANCOCK PRK DIS-RIVERBEND MEADOWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: RIVERBEND PK MEADOWS PAV DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

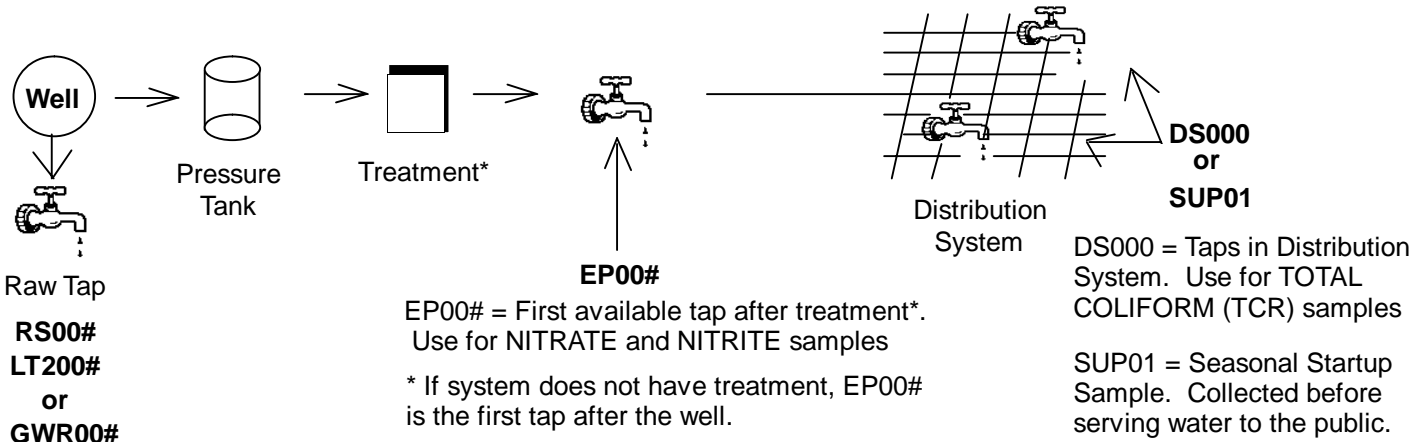

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3245812 HANCOCK PRK DIS-RIVERBEND MEADOWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254872 Facility Name: RIVERBEND MEADOWS

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

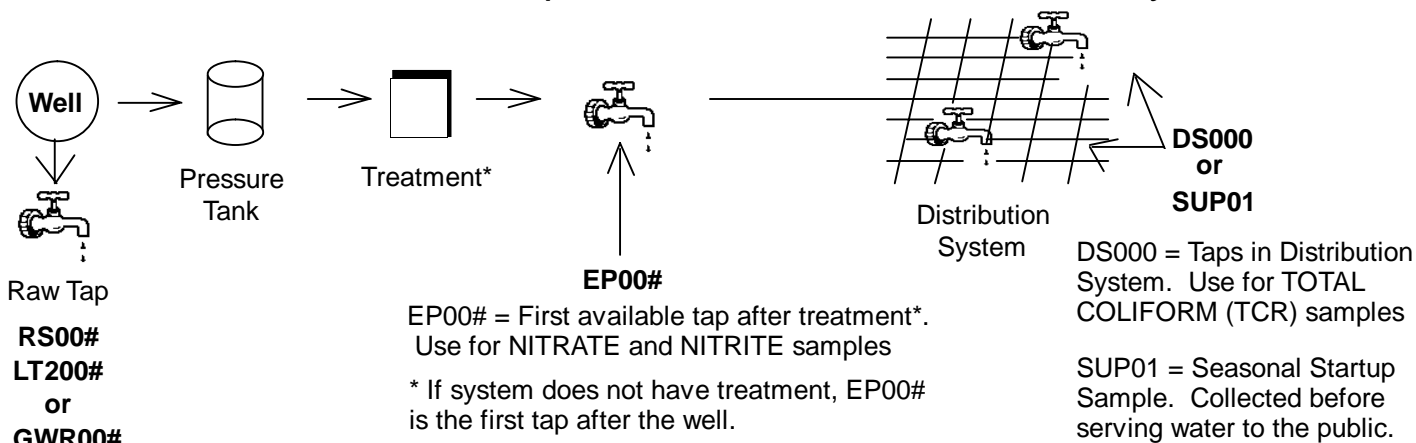

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2019

2019 ENTRY POINT SCHEDULE

OH3245912 TRINITY LUTHERAN SCHOOL-JENERA

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3254873	Facility Name: TRINITY EVANGELICAL LUTHERAN SCHOOL	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2019 and 3/31/2019 1 Sample(s) Required between 4/1/2019 and 6/30/2019 1 Sample(s) Required between 7/1/2019 and 9/30/2019 1 Sample(s) Required between 10/1/2019 and 12/31/2019
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH3245912 TRINITY LUTHERAN SCHOOL-JENERA

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: DISTRIBUTION SYSTEM
	SMP ID: DS000	

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2019	and	3/31/2019
	1 Sample(s) Required between	4/1/2019	and	6/30/2019
	1 Sample(s) Required between	7/1/2019	and	9/30/2019
	1 Sample(s) Required between	10/1/2019	and	12/31/2019

Sampling Location	Facility ID: DS1	Facility Name: DISTRIBUTION SYSTEM
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between	6/1/2019	and	9/30/2019
-------------------------------	------------------------------	----------	-----	-----------

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH3246112 JEFFREYS ANTIQUE GALLERY

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: JEFFREYS ANTIQUE GALLERY DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

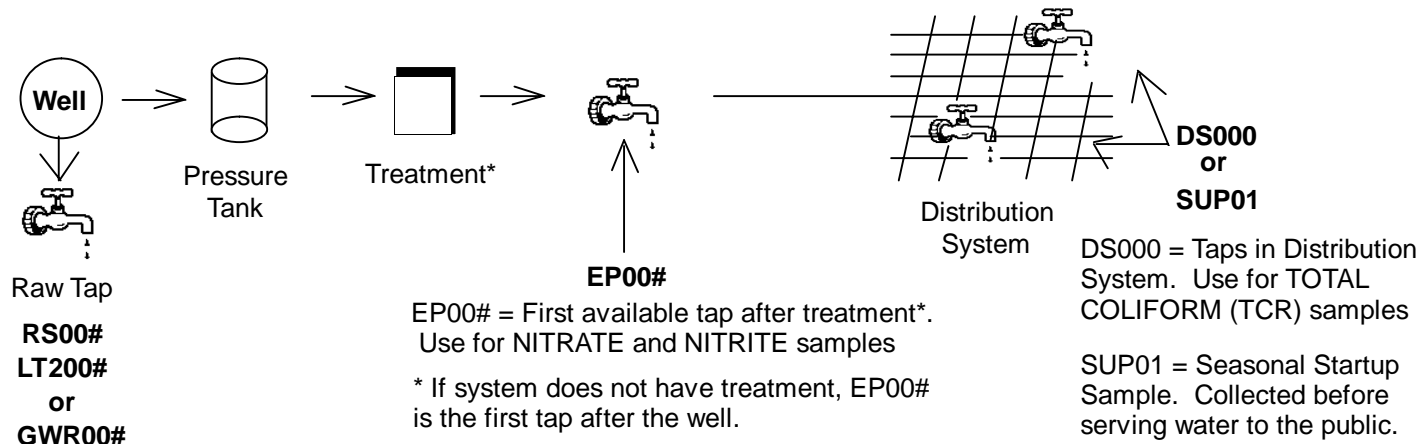

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3246112 JEFFREYS ANTIQUE GALLERY

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254875 Facility Name: JEFFERYS ANTIQUE GALLERY

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

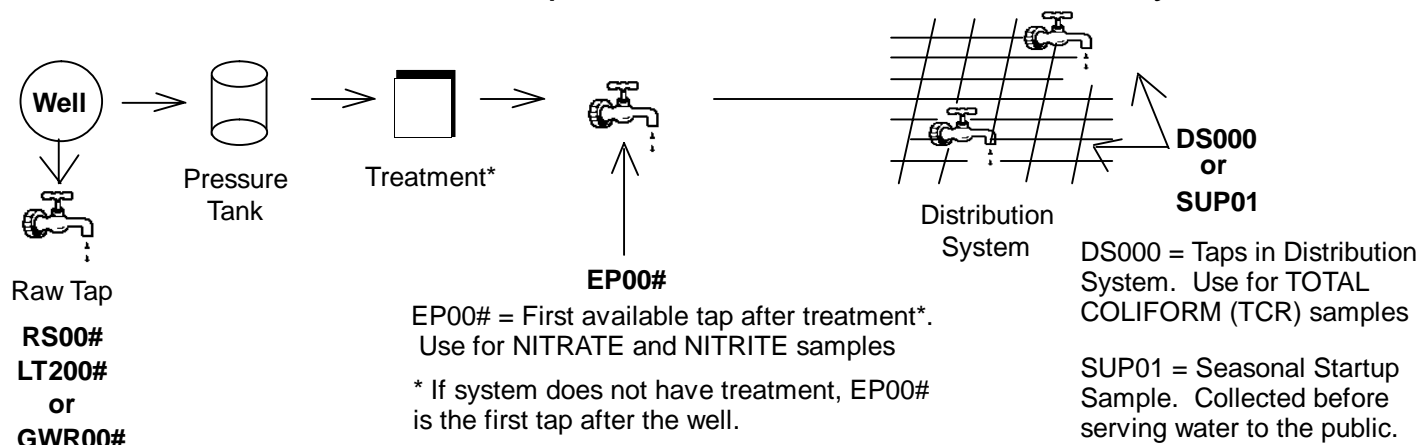

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3246512 PLEASANT VIEW RESORT- WEST

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ADVENTURE B PLEASANTVIEW WEST DISTRIBUTI
Location SMP ID: SUP01	Facility Source: Ground Water

Chemicals


Monitoring Requirements

TOTAL COLIFORM - SEASONAL STARTUP

At least 1 negative Total Coliform
Bacteria sample prior to serving
water to the public

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

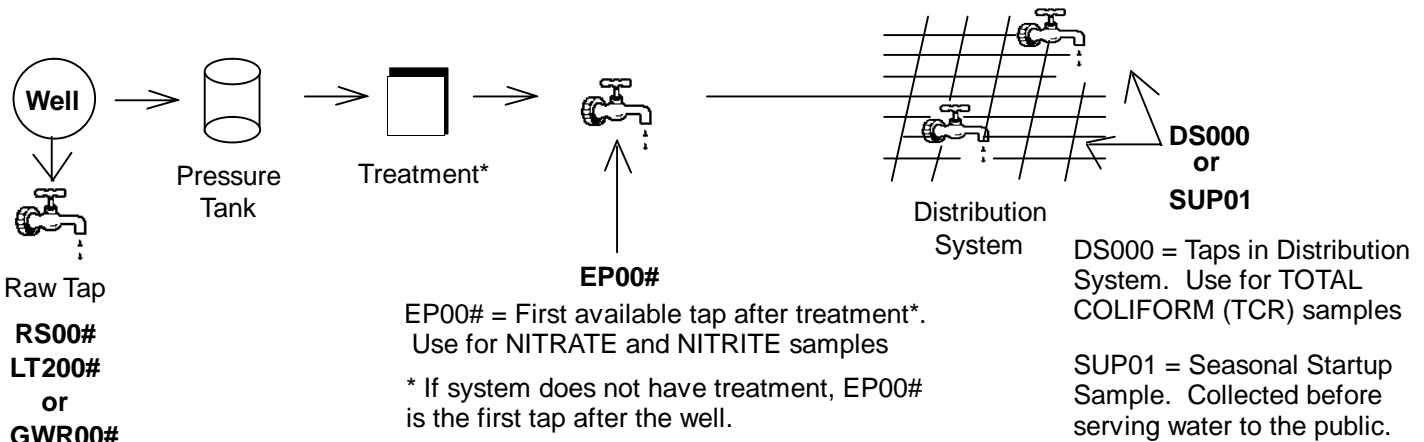

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3246512 PLEASANT VIEW RESORT- WEST

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ADVENTURE B PLEASANTVIEW WEST DISTRIBUTI
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2019 and 3/31/2019

Where to Collect Samples For a Small Public Water System

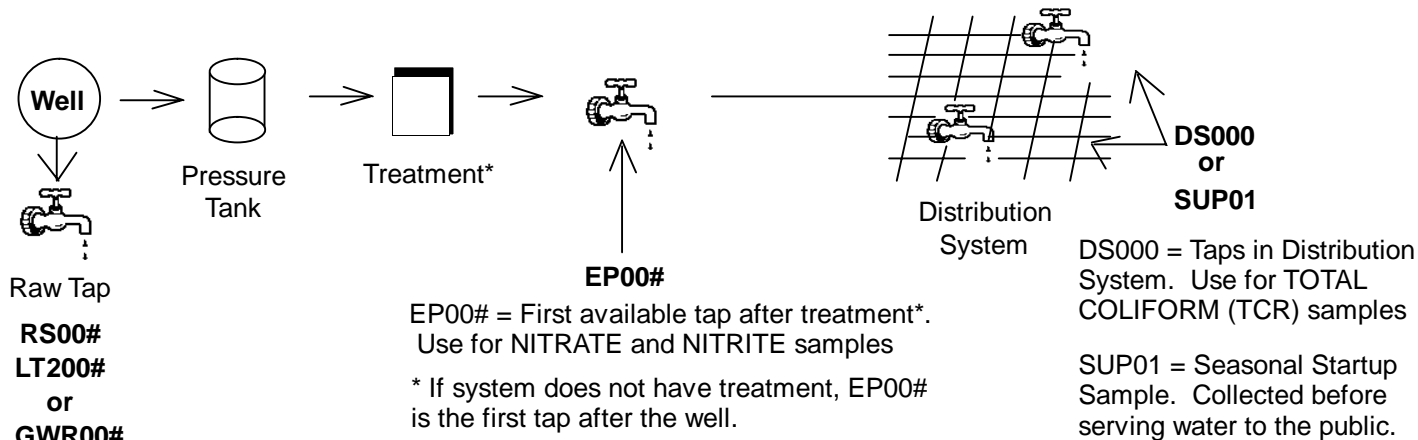

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3246512 PLEASANT VIEW RESORT- WEST

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254879	Facility Name: ADVENTURE BOUND RESORT PLEASANTVIEW WEST
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

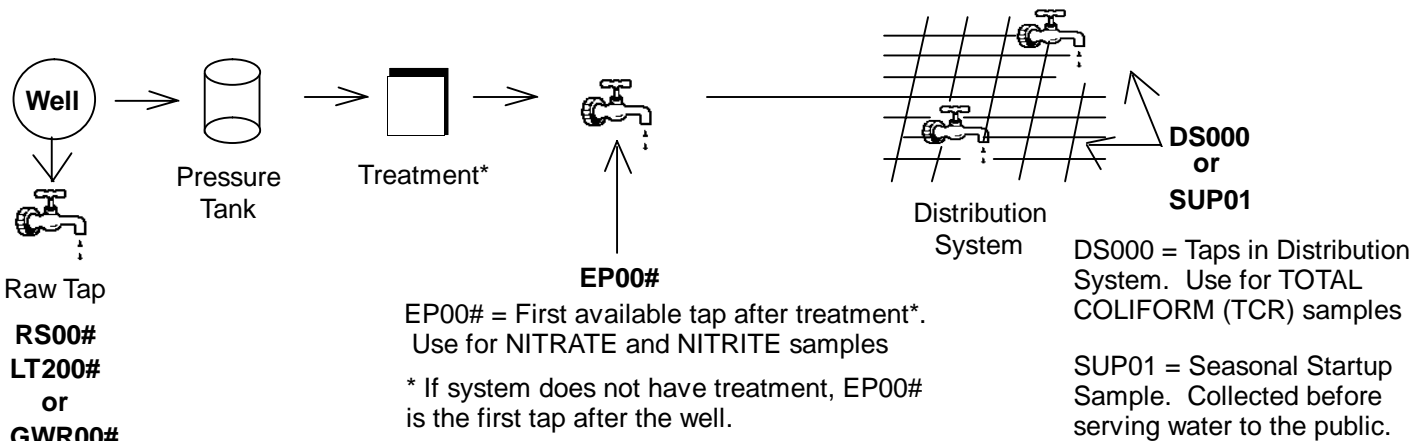

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3247112 HANCOCK PRK DIS-LITZENBERG MEMORIAL PARK

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LITZENBERG MEMORIAL WOOD DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

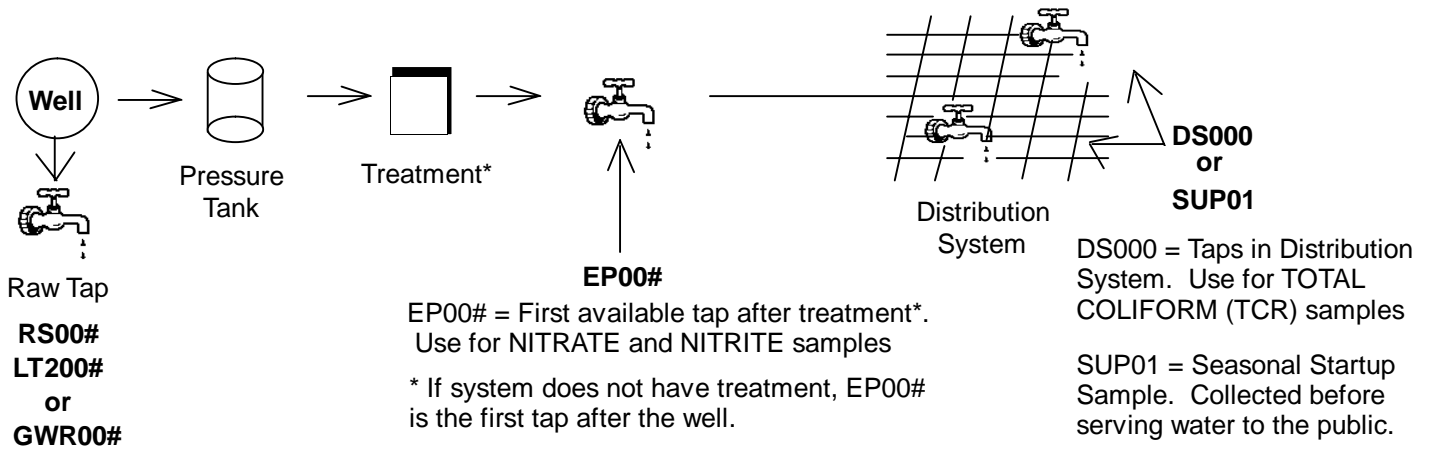

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3247112 HANCOCK PRK DIS-LITZENBERG MEMORIAL PARK

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3254882 Facility Name: LITZENBERG MEMORIAL WOODS

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

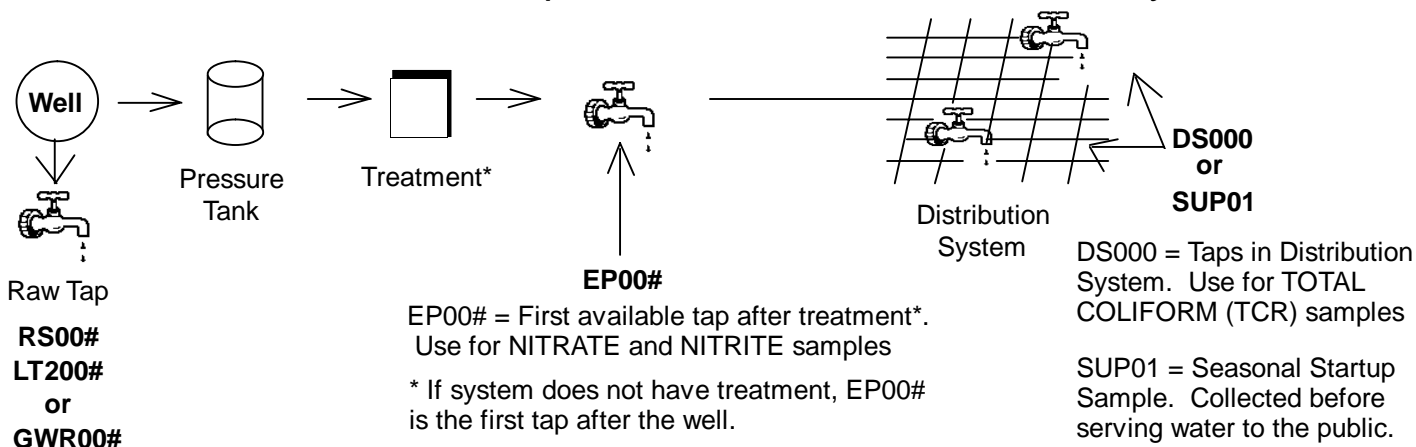

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3247412 SULPHUR LAKE CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE


Sampling Facility ID: DS1	Facility Name: DISTRIBUTION
Location SMP ID: SUP01	Facility Source: Ground Water

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	--

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

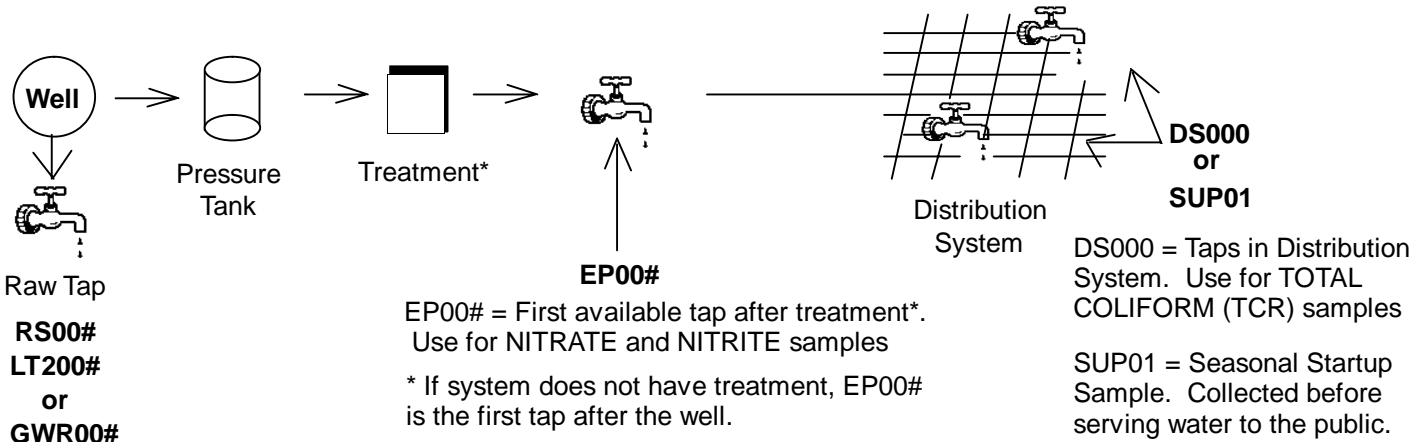

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3247412 SULPHUR LAKE CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

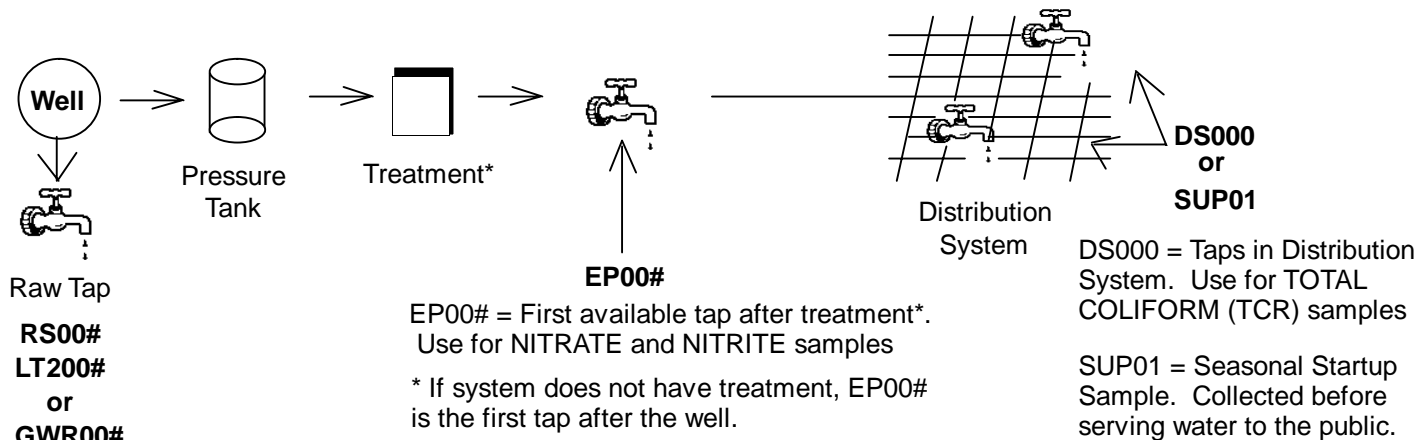

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3247412 SULPHUR LAKE CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3260783** Facility Name: **TREATMENT PLANT**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

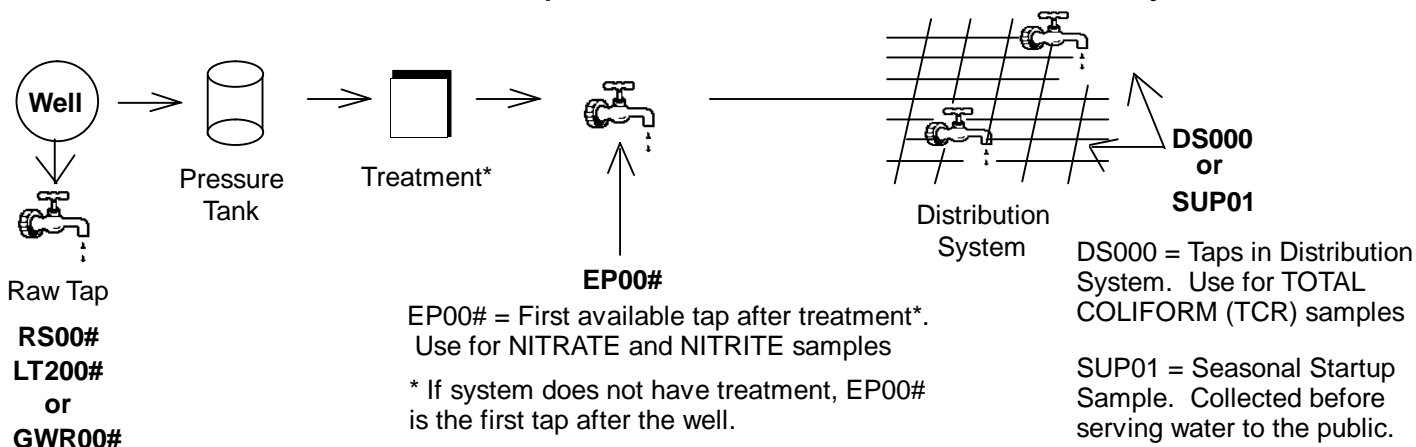

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3248212 SPARKS COMMERCIAL TIRE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: SPARKS COMMERCIAL TIRE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

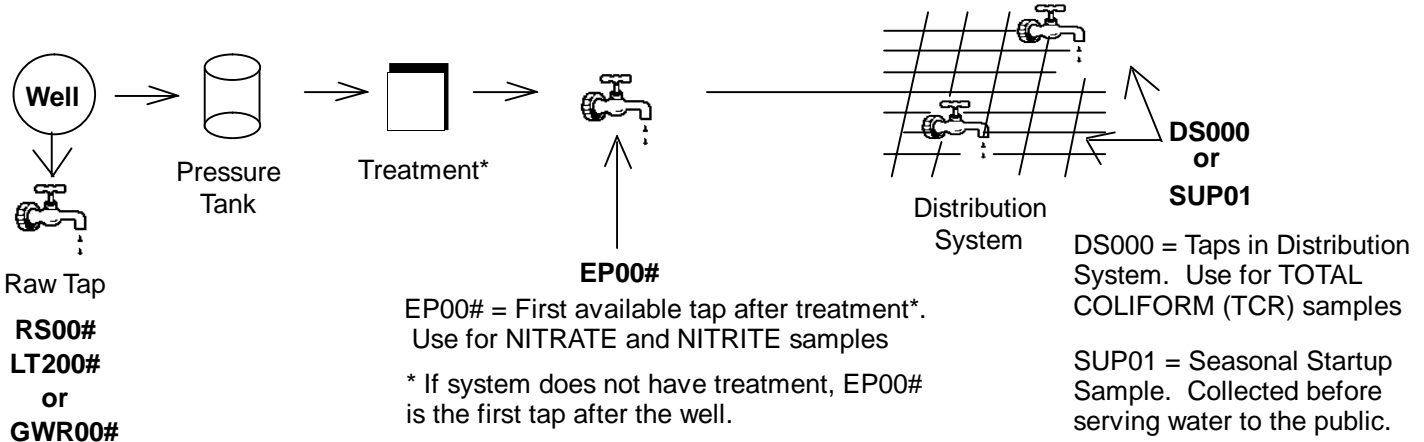

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3248212 SPARKS COMMERCIAL TIRE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **3261908** Facility Name: **SPARKS COMMERCIAL TIRE INC**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

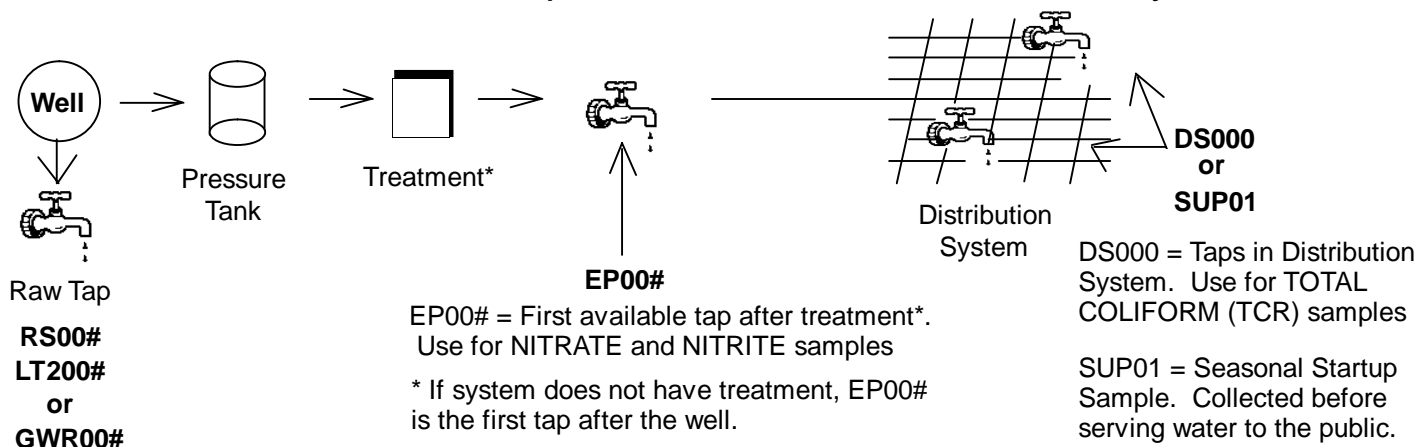

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2019

2019 ENTRY POINT SCHEDULE

OH3248312 VANLUE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 3261964	Facility Name: VANLUE VILLAGE	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2019 and 5/31/2019



OH3248312 VANLUE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: VANLUE VILLAGE DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2019	and	1/31/2019
	1 Sample(s) Required between	2/1/2019	and	2/28/2019
	1 Sample(s) Required between	3/1/2019	and	3/31/2019
	1 Sample(s) Required between	4/1/2019	and	4/30/2019
	1 Sample(s) Required between	5/1/2019	and	5/31/2019
	1 Sample(s) Required between	6/1/2019	and	6/30/2019
	1 Sample(s) Required between	7/1/2019	and	7/31/2019
	1 Sample(s) Required between	8/1/2019	and	8/31/2019
	1 Sample(s) Required between	9/1/2019	and	9/30/2019
	1 Sample(s) Required between	10/1/2019	and	10/31/2019
	1 Sample(s) Required between	11/1/2019	and	11/30/2019
	1 Sample(s) Required between	12/1/2019	and	12/31/2019

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2019	and	1/31/2019
	1 Sample(s) Required between	2/1/2019	and	2/28/2019
	1 Sample(s) Required between	3/1/2019	and	3/31/2019
	1 Sample(s) Required between	4/1/2019	and	4/30/2019
	1 Sample(s) Required between	5/1/2019	and	5/31/2019
	1 Sample(s) Required between	6/1/2019	and	6/30/2019
	1 Sample(s) Required between	7/1/2019	and	7/31/2019
	1 Sample(s) Required between	8/1/2019	and	8/31/2019
	1 Sample(s) Required between	9/1/2019	and	9/30/2019
	1 Sample(s) Required between	10/1/2019	and	10/31/2019
	1 Sample(s) Required between	11/1/2019	and	11/30/2019
	1 Sample(s) Required between	12/1/2019	and	12/31/2019

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: VANLUE VILLAGE DISTRIBUTION 401 EAST ST	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2019	and	9/30/2019	at: DS201
-------------------------	------------------------------	----------	-----	-----------	-----------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

OH3248312 VANLUE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: VANLUE VILLAGE DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required

OH3248512 MARANATHA BIBLE CHURCH-VAN BUREN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: MARANATHA BIBLE CHURCH-VAN BUREN DISTRIB
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

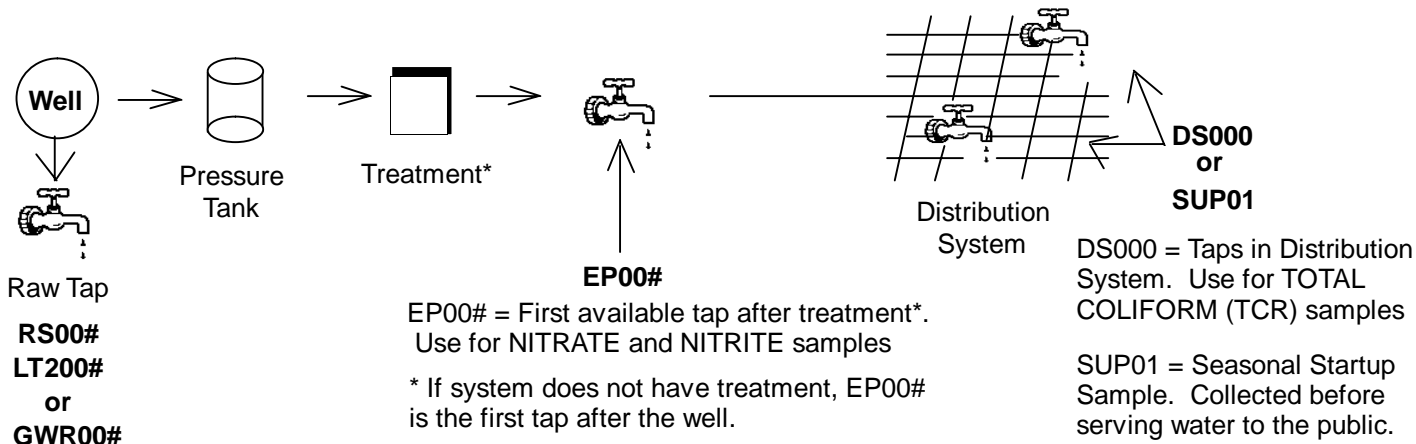

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3248512 MARANATHA BIBLE CHURCH-VAN BUREN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3262234	Facility Name: MARANATHA BIBLE CHURCH-VAN BUREN
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2019 and 5/31/2019
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

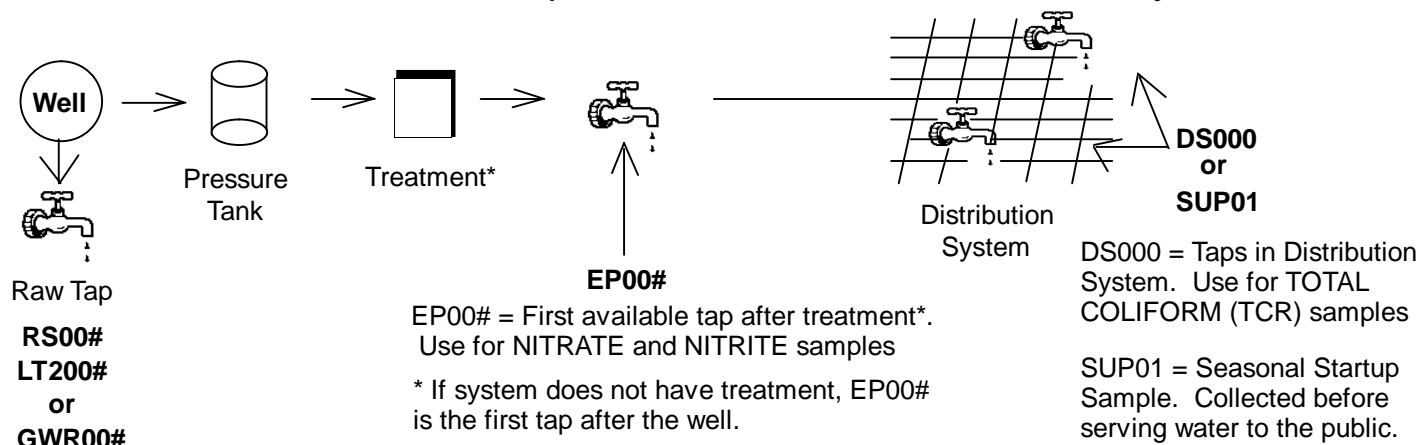

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3248613 THE BARN AT WALNUT CREEK

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BARN DISTRIBUTION SYSTEM
Location SMP ID: DS000	Facility Source:

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

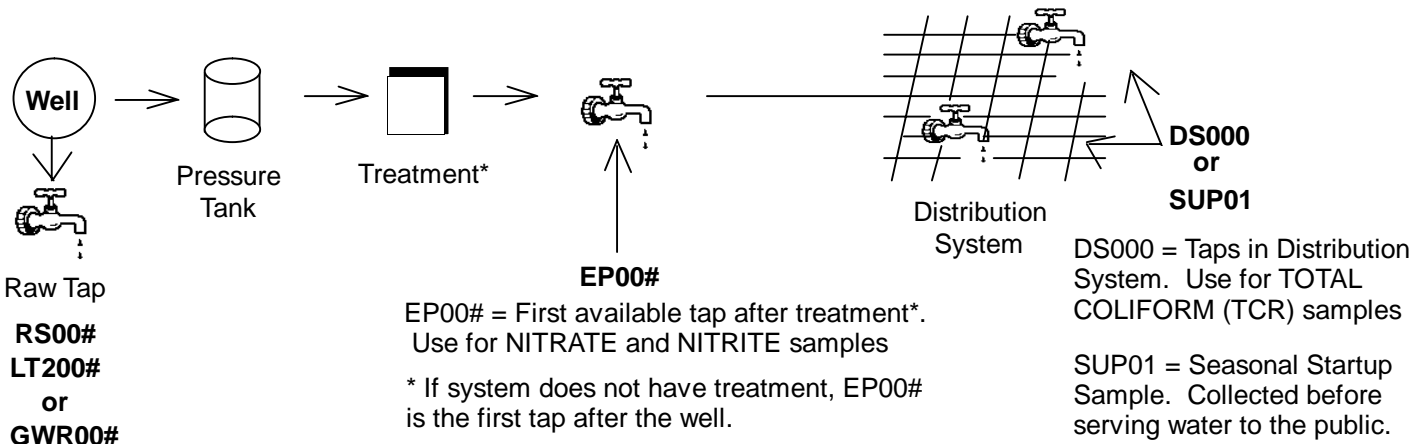

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3248613 THE BARN AT WALNUT CREEK

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3262331 Facility Name: THE BARN AT WALNUT CREEK

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

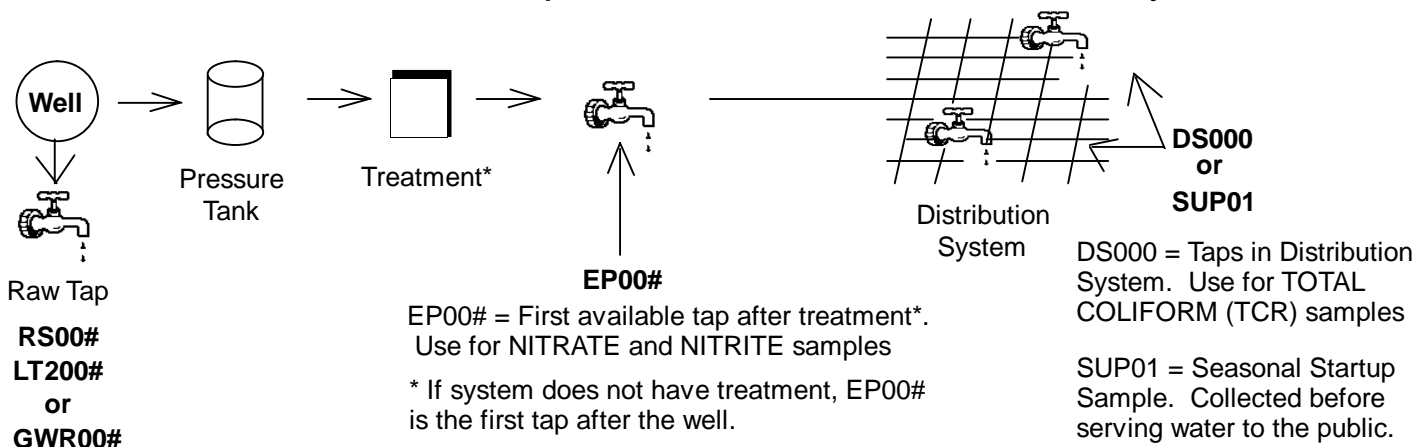

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3248614 ARLINGTON VETERINARY CLINIC

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ARLINGTON VETERINARY CLINIC DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

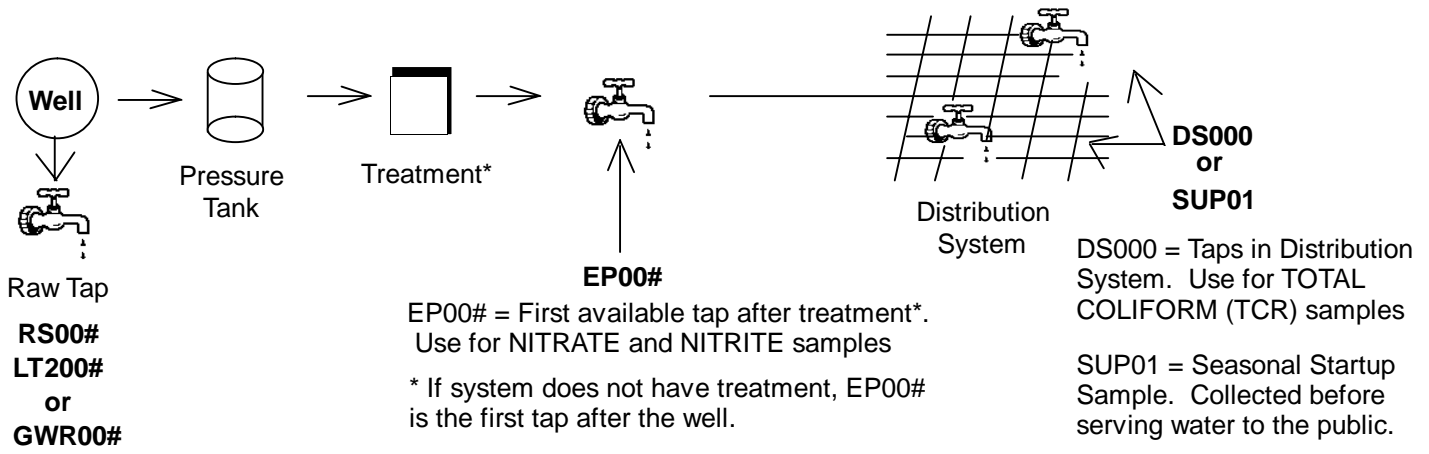

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3248614 ARLINGTON VETERINARY CLINIC

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3262332 Facility Name: ARLINGTON VETERINARY CLINIC

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2019 and 5/31/2019
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

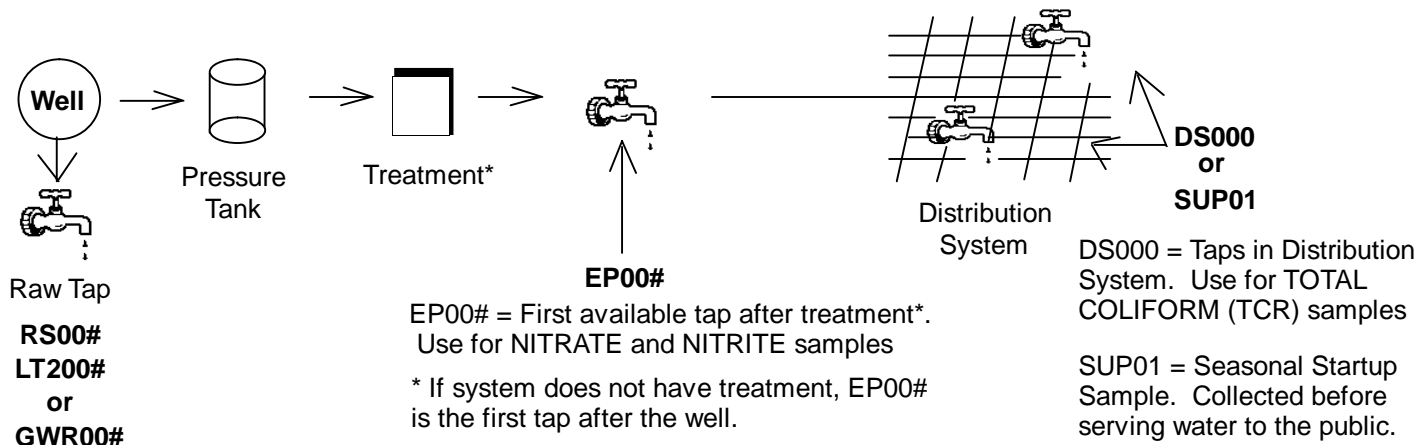

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3248615 CRIMSON LANE WEDDING & EVENT VENUE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CRIMSON LANE DISTRIBUTION SYSTEM
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

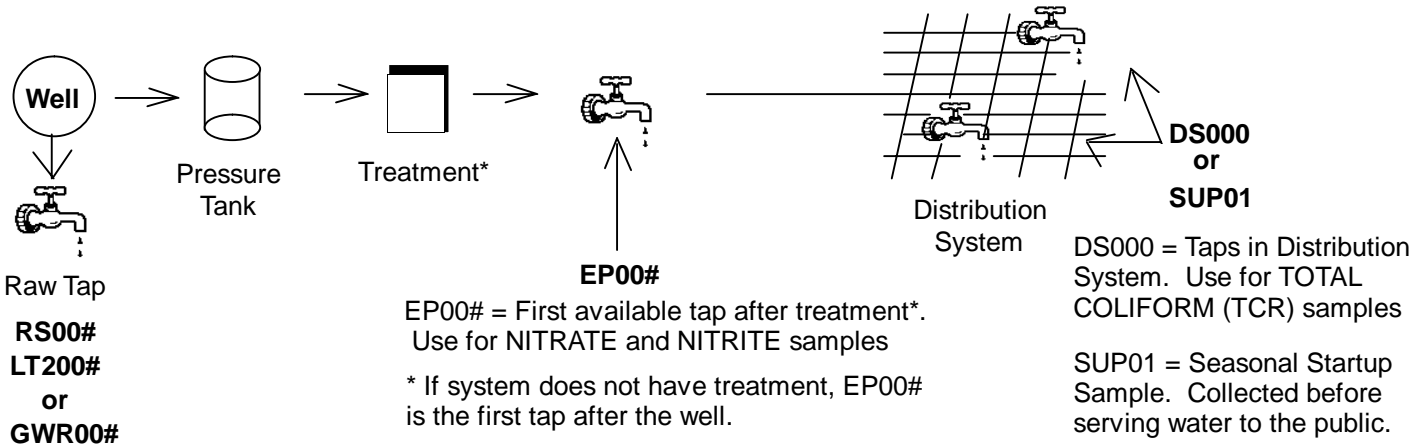

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH3248615 CRIMSON LANE WEDDING & EVENT VENUE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 3262333 Facility Name: CRIMSON LANE

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2019 and 5/31/2019
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019

Where to Collect Samples For a Small Public Water System

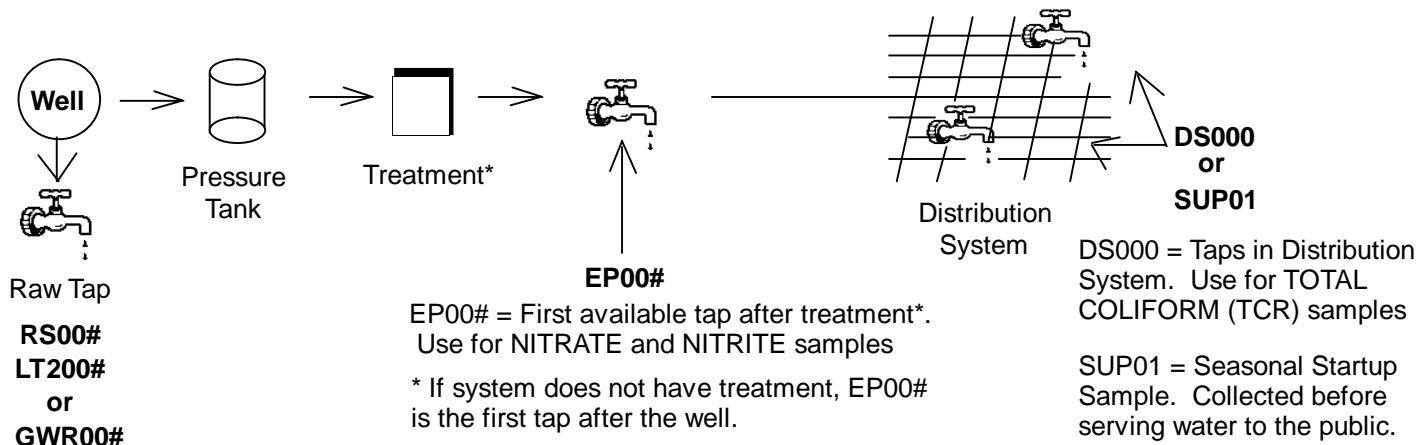

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!