



**OH3900011 BELLEVUE CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>3955235</b>	Facility Name: <b>BELLEVUE CITY</b>	Facility Class: <b>CLASS 3</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

<b>Chemicals</b>	<b>Monitoring Requirements</b>		
<b>INORGANICS</b>	1 Sample(s) Required between	1/1/2019 and	5/31/2019
<i>Sample for all the analytes listed below:</i>			
<b>ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020</b>			
<b>CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085</b>			
<b>NITRITE - 1041</b>	Not Required		
<b>NITRATE - 1040</b>	1 Sample(s) Required between	1/1/2019 and	1/31/2019
	1 Sample(s) Required between	2/1/2019 and	2/28/2019
	1 Sample(s) Required between	3/1/2019 and	3/31/2019
	1 Sample(s) Required between	4/1/2019 and	4/30/2019
	1 Sample(s) Required between	5/1/2019 and	5/31/2019
	1 Sample(s) Required between	6/1/2019 and	6/30/2019
	1 Sample(s) Required between	7/1/2019 and	7/31/2019
	1 Sample(s) Required between	8/1/2019 and	8/31/2019
	1 Sample(s) Required between	9/1/2019 and	9/30/2019
	1 Sample(s) Required between	10/1/2019 and	10/31/2019
	1 Sample(s) Required between	11/1/2019 and	11/30/2019
	1 Sample(s) Required between	12/1/2019 and	12/31/2019
<b>RADIOLOGICALS</b>	Not Required		
<b>SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1</b>	1 Sample(s) Required between	4/1/2019 and	6/30/2019
<i>Sample for all the analytes listed below:</i>			
<b>ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037</b>			
<b>VOLATILE ORGANIC CHEMICALS (VOC)</b>	1 Sample(s) Required between	1/1/2019 and	5/31/2019
<b>TOTAL ORGANIC CARBON (TOC)</b>	1 Paired Sample Set Required between	1/1/2019 and	1/31/2019
	1 Paired Sample Set Required between	2/1/2019 and	2/28/2019
	1 Paired Sample Set Required between	3/1/2019 and	3/31/2019
	1 Paired Sample Set Required between	4/1/2019 and	4/30/2019
	1 Paired Sample Set Required between	5/1/2019 and	5/31/2019
	1 Paired Sample Set Required between	6/1/2019 and	6/30/2019
	1 Paired Sample Set Required between	7/1/2019 and	7/31/2019
	1 Paired Sample Set Required between	8/1/2019 and	8/31/2019
	1 Paired Sample Set Required between	9/1/2019 and	9/30/2019
	1 Paired Sample Set Required between	10/1/2019 and	10/31/2019
	1 Paired Sample Set Required between	11/1/2019 and	11/30/2019
	1 Paired Sample Set Required between	12/1/2019 and	12/31/2019

**A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.**



**OH3900011 BELLEVUE CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>3955235</b>	Facility Name: <b>BELLEVUE CITY</b>	
<b>Location</b>	SMP ID: <b>EP001/LT2001</b>	Facility Source: <b>Surface Water</b>	Facility Class: <b>CLASS 3</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**Chemicals**

**Monitoring Requirements**

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY\*

*Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.*

*\*Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH3900011 BELLEVUE CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>3955235</b> SMP ID: <b>LT2001</b>	Facility Name: <b>BELLEVUE CITY</b> Facility Source: <b>Surface Water</b>	Facility Class: <b>CLASS 3</b>
--------------------------	--	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019

Chemicals	Monitoring Requirements
-----------	-------------------------

CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/30/2018 and 1/5/2019
	1 Sample(s) Required between 1/13/2019 and 1/19/2019
	1 Sample(s) Required between 1/27/2019 and 2/2/2019
	1 Sample(s) Required between 2/10/2019 and 2/16/2019
	1 Sample(s) Required between 2/24/2019 and 3/2/2019
	1 Sample(s) Required between 3/10/2019 and 3/16/2019
	1 Sample(s) Required between 3/24/2019 and 3/30/2019
	1 Sample(s) Required between 4/7/2019 and 4/13/2019
	1 Sample(s) Required between 4/21/2019 and 4/27/2019
	1 Sample(s) Required between 5/5/2019 and 5/11/2019
	1 Sample(s) Required between 5/19/2019 and 5/25/2019
	1 Sample(s) Required between 6/2/2019 and 6/8/2019
	1 Sample(s) Required between 6/16/2019 and 6/22/2019
	1 Sample(s) Required between 6/30/2019 and 7/6/2019
	1 Sample(s) Required between 7/14/2019 and 7/20/2019
	1 Sample(s) Required between 7/28/2019 and 8/3/2019
	1 Sample(s) Required between 8/11/2019 and 8/17/2019
	1 Sample(s) Required between 8/25/2019 and 8/31/2019
	1 Sample(s) Required between 9/8/2019 and 9/14/2019
	1 Sample(s) Required between 9/22/2019 and 9/28/2019
1 Sample(s) Required between 10/6/2019 and 10/12/2019	
1 Sample(s) Required between 10/20/2019 and 10/26/2019	
1 Sample(s) Required between 11/3/2019 and 11/9/2019	
1 Sample(s) Required between 11/17/2019 and 11/23/2019	
1 Sample(s) Required between 12/1/2019 and 12/7/2019	
1 Sample(s) Required between 12/15/2019 and 12/21/2019	

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.



**OH3900011 BELLEVUE CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>BELLEVUE, CITY OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM (TCR) - 3100	9 Sample(s) Required between	1/1/2019 and 1/31/2019
	9 Sample(s) Required between	2/1/2019 and 2/28/2019
	9 Sample(s) Required between	3/1/2019 and 3/31/2019
	9 Sample(s) Required between	4/1/2019 and 4/30/2019
	9 Sample(s) Required between	5/1/2019 and 5/31/2019
	9 Sample(s) Required between	6/1/2019 and 6/30/2019
	9 Sample(s) Required between	7/1/2019 and 7/31/2019
	9 Sample(s) Required between	8/1/2019 and 8/31/2019
	9 Sample(s) Required between	9/1/2019 and 9/30/2019
	9 Sample(s) Required between	10/1/2019 and 10/31/2019
	9 Sample(s) Required between	11/1/2019 and 11/30/2019
	9 Sample(s) Required between	12/1/2019 and 12/31/2019

TOTAL CHLORINE - 1000	9 Sample(s) Required between	1/1/2019 and 1/31/2019
	9 Sample(s) Required between	2/1/2019 and 2/28/2019
	9 Sample(s) Required between	3/1/2019 and 3/31/2019
	9 Sample(s) Required between	4/1/2019 and 4/30/2019
	9 Sample(s) Required between	5/1/2019 and 5/31/2019
	9 Sample(s) Required between	6/1/2019 and 6/30/2019
	9 Sample(s) Required between	7/1/2019 and 7/31/2019
	9 Sample(s) Required between	8/1/2019 and 8/31/2019
	9 Sample(s) Required between	9/1/2019 and 9/30/2019
	9 Sample(s) Required between	10/1/2019 and 10/31/2019
	9 Sample(s) Required between	11/1/2019 and 11/30/2019
	9 Sample(s) Required between	12/1/2019 and 12/31/2019

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>BELLEVUE, CITY OF DISTRIBUTION</b> <b>110 CHERRY BLVD</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between	1/8/2019 and 1/14/2019at: DS201
	Dual Sample Required between	4/8/2019 and 4/14/2019at: DS201
	Dual Sample Required between	7/8/2019 and 7/14/2019at: DS201
	Dual Sample Required between	10/8/2019 and 10/14/2019at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

**OH3900011 BELLEVUE CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>BELLEVUE, CITY OF DISTRIBUTION</b> <b>1265 W. MAIN ST.</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between 1/8/2019 and 1/14/2019 at: DS202
	Dual Sample Required between 4/8/2019 and 4/14/2019 at: DS202
	Dual Sample Required between 7/8/2019 and 7/14/2019 at: DS202
	Dual Sample Required between 10/8/2019 and 10/14/2019 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>BELLEVUE, CITY OF DISTRIBUTION</b> <b>Refer to your Lead and Copper plan for SMP IDs</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------



Effective Date: 01/01/2019

2019 ENTRY POINT SCHEDULE

**OH3900112 COBLE VILLAGE MHP**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>3955236</b>	Facility Name: <b>COBLE VILLAGE MHP</b>	Facility Class: <b>CLASS A</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



**OH3900112 COBLE VILLAGE MHP**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>COBLE VILLAGE MHP DISTRIBUTION</b>
	SMP ID: <b>DS000</b>	

**Chemicals**

**Monitoring Requirements**

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2019	and	1/31/2019
	1 Sample(s) Required between	2/1/2019	and	2/28/2019
	1 Sample(s) Required between	3/1/2019	and	3/31/2019
	1 Sample(s) Required between	4/1/2019	and	4/30/2019
	1 Sample(s) Required between	5/1/2019	and	5/31/2019
	1 Sample(s) Required between	6/1/2019	and	6/30/2019
	1 Sample(s) Required between	7/1/2019	and	7/31/2019
	1 Sample(s) Required between	8/1/2019	and	8/31/2019
	1 Sample(s) Required between	9/1/2019	and	9/30/2019
	1 Sample(s) Required between	10/1/2019	and	10/31/2019
	1 Sample(s) Required between	11/1/2019	and	11/30/2019
	1 Sample(s) Required between	12/1/2019	and	12/31/2019

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2019	and	1/31/2019
	1 Sample(s) Required between	2/1/2019	and	2/28/2019
	1 Sample(s) Required between	3/1/2019	and	3/31/2019
	1 Sample(s) Required between	4/1/2019	and	4/30/2019
	1 Sample(s) Required between	5/1/2019	and	5/31/2019
	1 Sample(s) Required between	6/1/2019	and	6/30/2019
	1 Sample(s) Required between	7/1/2019	and	7/31/2019
	1 Sample(s) Required between	8/1/2019	and	8/31/2019
	1 Sample(s) Required between	9/1/2019	and	9/30/2019
	1 Sample(s) Required between	10/1/2019	and	10/31/2019
	1 Sample(s) Required between	11/1/2019	and	11/30/2019
	1 Sample(s) Required between	12/1/2019	and	12/31/2019

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>COBLE VILLAGE MHP DISTRIBUTION</b>
	SMP ID: <b>DS201</b>	<b>ADDRESS NOT KNOWN</b>

**Chemicals**

**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2019	and	9/30/2019	at: DS201
-------------------------	------------------------------	----------	-----	-----------	-----------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950







Effective Date: 01/01/2019

2019 ENTRY POINT SCHEDULE

**OH3900312 GREENWICH VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>3955237</b>	Facility Name: <b>GREENWICH VILLAGE</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

**OH3900312 GREENWICH VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>GREENWICH, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2019 and 1/31/2019 2 Sample(s) Required between 2/1/2019 and 2/28/2019 2 Sample(s) Required between 3/1/2019 and 3/31/2019 2 Sample(s) Required between 4/1/2019 and 4/30/2019 2 Sample(s) Required between 5/1/2019 and 5/31/2019 2 Sample(s) Required between 6/1/2019 and 6/30/2019 2 Sample(s) Required between 7/1/2019 and 7/31/2019 2 Sample(s) Required between 8/1/2019 and 8/31/2019 2 Sample(s) Required between 9/1/2019 and 9/30/2019 2 Sample(s) Required between 10/1/2019 and 10/31/2019 2 Sample(s) Required between 11/1/2019 and 11/30/2019 2 Sample(s) Required between 12/1/2019 and 12/31/2019
TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2019 and 1/31/2019 2 Sample(s) Required between 2/1/2019 and 2/28/2019 2 Sample(s) Required between 3/1/2019 and 3/31/2019 2 Sample(s) Required between 4/1/2019 and 4/30/2019 2 Sample(s) Required between 5/1/2019 and 5/31/2019 2 Sample(s) Required between 6/1/2019 and 6/30/2019 2 Sample(s) Required between 7/1/2019 and 7/31/2019 2 Sample(s) Required between 8/1/2019 and 8/31/2019 2 Sample(s) Required between 9/1/2019 and 9/30/2019 2 Sample(s) Required between 10/1/2019 and 10/31/2019 2 Sample(s) Required between 11/1/2019 and 11/30/2019 2 Sample(s) Required between 12/1/2019 and 12/31/2019

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>GREENWICH, VILLAGE OF DISTRIBUTION</b> <b>19 CENTER ST</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2019 and 9/30/2019at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

**OH3900312 GREENWICH VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>GREENWICH, VILLAGE OF DISTRIBUTION</b> <b>92 TOWNSEND ST</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2019 and 9/30/2019 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>GREENWICH, VILLAGE OF DISTRIBUTION</b> <b>Refer to your Lead and Copper plan for SMP IDs</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2019 and 9/30/2019

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH3900811 MONROEVILLE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>3955241</b>	Facility Name: <b>MONROEVILLE VILLAGE</b>	Facility Class: <b>CLASS 3</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019

Chemicals	Monitoring Requirements
-----------	-------------------------

INORGANICS	1 Sample(s) Required between 1/1/2019 and 5/31/2019
------------	---

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020  
 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 1/31/2019
	1 Sample(s) Required between 2/1/2019 and 2/28/2019
	1 Sample(s) Required between 3/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 4/30/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019
	1 Sample(s) Required between 11/1/2019 and 11/30/2019
	1 Sample(s) Required between 12/1/2019 and 12/31/2019

RADIOLOGICALS	Not Required
---------------	--------------

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2019 and 6/30/2019
---	---

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2019 and 5/31/2019
----------------------------------	---

TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2019 and 1/31/2019
	1 Paired Sample Set Required between 2/1/2019 and 2/28/2019
	1 Paired Sample Set Required between 3/1/2019 and 3/31/2019
	1 Paired Sample Set Required between 4/1/2019 and 4/30/2019
	1 Paired Sample Set Required between 5/1/2019 and 5/31/2019
	1 Paired Sample Set Required between 6/1/2019 and 6/30/2019
	1 Paired Sample Set Required between 7/1/2019 and 7/31/2019
	1 Paired Sample Set Required between 8/1/2019 and 8/31/2019
	1 Paired Sample Set Required between 9/1/2019 and 9/30/2019
	1 Paired Sample Set Required between 10/1/2019 and 10/31/2019
	1 Paired Sample Set Required between 11/1/2019 and 11/30/2019
	1 Paired Sample Set Required between 12/1/2019 and 12/31/2019

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



**OH3900811 MONROEVILLE VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>3955241</b>	Facility Name: <b>MONROEVILLE VILLAGE</b>	
<b>Location</b>	SMP ID: <b>EP001/LT2001</b>	Facility Source: <b>Surface Water</b>	Facility Class: <b>CLASS 3</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**Chemicals**

**Monitoring Requirements**

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY\*

*Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.*

*\*Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH3900811 MONROEVILLE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>3955241</b> SMP ID: <b>LT2001</b>	Facility Name: <b>MONROEVILLE VILLAGE</b> Facility Source: <b>Surface Water</b>	Facility Class: <b>CLASS 3</b>
--------------------------	--	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/30/2018 and 1/5/2019
	1 Sample(s) Required between 1/13/2019 and 1/19/2019
	1 Sample(s) Required between 1/27/2019 and 2/2/2019
	1 Sample(s) Required between 2/10/2019 and 2/16/2019
	1 Sample(s) Required between 2/24/2019 and 3/2/2019
	1 Sample(s) Required between 3/10/2019 and 3/16/2019
	1 Sample(s) Required between 3/24/2019 and 3/30/2019
	1 Sample(s) Required between 4/7/2019 and 4/13/2019
	1 Sample(s) Required between 4/21/2019 and 4/27/2019
	1 Sample(s) Required between 5/5/2019 and 5/11/2019
	1 Sample(s) Required between 5/19/2019 and 5/25/2019
	1 Sample(s) Required between 6/2/2019 and 6/8/2019
	1 Sample(s) Required between 6/16/2019 and 6/22/2019
	1 Sample(s) Required between 6/30/2019 and 7/6/2019
	1 Sample(s) Required between 7/14/2019 and 7/20/2019
	1 Sample(s) Required between 7/28/2019 and 8/3/2019
	1 Sample(s) Required between 8/11/2019 and 8/17/2019
	1 Sample(s) Required between 8/25/2019 and 8/31/2019
	1 Sample(s) Required between 9/8/2019 and 9/14/2019
	1 Sample(s) Required between 9/22/2019 and 9/28/2019
1 Sample(s) Required between 10/6/2019 and 10/12/2019	
1 Sample(s) Required between 10/20/2019 and 10/26/2019	
1 Sample(s) Required between 11/3/2019 and 11/9/2019	
1 Sample(s) Required between 11/17/2019 and 11/23/2019	
1 Sample(s) Required between 12/1/2019 and 12/7/2019	
1 Sample(s) Required between 12/15/2019 and 12/21/2019	

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.



**OH3900811 MONROEVILLE VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>MONROEVILLE VILLAGE DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Required between	1/1/2019	and	1/31/2019
	4 Sample(s) Required between	2/1/2019	and	2/28/2019
	4 Sample(s) Required between	3/1/2019	and	3/31/2019
	4 Sample(s) Required between	4/1/2019	and	4/30/2019
	4 Sample(s) Required between	5/1/2019	and	5/31/2019
	4 Sample(s) Required between	6/1/2019	and	6/30/2019
	4 Sample(s) Required between	7/1/2019	and	7/31/2019
	4 Sample(s) Required between	8/1/2019	and	8/31/2019
	4 Sample(s) Required between	9/1/2019	and	9/30/2019
	4 Sample(s) Required between	10/1/2019	and	10/31/2019
	4 Sample(s) Required between	11/1/2019	and	11/30/2019
	4 Sample(s) Required between	12/1/2019	and	12/31/2019

TOTAL CHLORINE - 1000	4 Sample(s) Required between	1/1/2019	and	1/31/2019
	4 Sample(s) Required between	2/1/2019	and	2/28/2019
	4 Sample(s) Required between	3/1/2019	and	3/31/2019
	4 Sample(s) Required between	4/1/2019	and	4/30/2019
	4 Sample(s) Required between	5/1/2019	and	5/31/2019
	4 Sample(s) Required between	6/1/2019	and	6/30/2019
	4 Sample(s) Required between	7/1/2019	and	7/31/2019
	4 Sample(s) Required between	8/1/2019	and	8/31/2019
	4 Sample(s) Required between	9/1/2019	and	9/30/2019
	4 Sample(s) Required between	10/1/2019	and	10/31/2019
	4 Sample(s) Required between	11/1/2019	and	11/30/2019
	4 Sample(s) Required between	12/1/2019	and	12/31/2019

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>MONROEVILLE VILLAGE DISTRIBUTION</b> <b>2706 US RT 20</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between	1/1/2019	and	1/7/2019	at: DS201
	Dual Sample Required between	4/1/2019	and	4/7/2019	at: DS201
	Dual Sample Required between	7/1/2019	and	7/7/2019	at: DS201
	Dual Sample Required between	10/1/2019	and	10/7/2019	at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

**OH3900811 MONROEVILLE VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>MONROEVILLE VILLAGE DISTRIBUTION</b> <b>95 NORTH ST</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between 1/1/2019 and 1/7/2019 at: DS202
	Dual Sample Required between 4/1/2019 and 4/7/2019 at: DS202
	Dual Sample Required between 7/1/2019 and 7/7/2019 at: DS202
	Dual Sample Required between 10/1/2019 and 10/7/2019 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>MONROEVILLE VILLAGE DISTRIBUTION</b> <b>Refer to your Lead and Copper plan for SMP IDs</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------





**OH3900911 NEW LONDON VILLAGE-PLANT 1**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>3955242</b>	Facility Name: <b>NEW LONDON VILLAGE</b>	Facility Class: <b>CLASS 3</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

<b>Chemicals</b>	<b>Monitoring Requirements</b>		
<b>INORGANICS</b>	1 Sample(s) Required between	1/1/2019 and	5/31/2019
<i>Sample for all the analytes listed below:</i>			
<b>ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020</b>			
<b>CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085</b>			
<b>NITRITE - 1041</b>	Not Required		
<b>NITRATE - 1040</b>	1 Sample(s) Required between	1/1/2019 and	1/31/2019
	1 Sample(s) Required between	2/1/2019 and	2/28/2019
	1 Sample(s) Required between	3/1/2019 and	3/31/2019
	1 Sample(s) Required between	4/1/2019 and	4/30/2019
	1 Sample(s) Required between	5/1/2019 and	5/31/2019
	1 Sample(s) Required between	6/1/2019 and	6/30/2019
	1 Sample(s) Required between	7/1/2019 and	7/31/2019
	1 Sample(s) Required between	8/1/2019 and	8/31/2019
	1 Sample(s) Required between	9/1/2019 and	9/30/2019
	1 Sample(s) Required between	10/1/2019 and	10/31/2019
	1 Sample(s) Required between	11/1/2019 and	11/30/2019
	1 Sample(s) Required between	12/1/2019 and	12/31/2019
<b>RADIOLOGICALS</b>	Not Required		
<b>SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1</b>	1 Sample(s) Required between	4/1/2019 and	6/30/2019
<i>Sample for all the analytes listed below:</i>			
<b>ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037</b>			
<b>VOLATILE ORGANIC CHEMICALS (VOC)</b>	1 Sample(s) Required between	1/1/2019 and	5/31/2019
<b>TOTAL ORGANIC CARBON (TOC)</b>	1 Paired Sample Set Required between	1/1/2019 and	1/31/2019
	1 Paired Sample Set Required between	2/1/2019 and	2/28/2019
	1 Paired Sample Set Required between	3/1/2019 and	3/31/2019
	1 Paired Sample Set Required between	4/1/2019 and	4/30/2019
	1 Paired Sample Set Required between	5/1/2019 and	5/31/2019
	1 Paired Sample Set Required between	6/1/2019 and	6/30/2019
	1 Paired Sample Set Required between	7/1/2019 and	7/31/2019
	1 Paired Sample Set Required between	8/1/2019 and	8/31/2019
	1 Paired Sample Set Required between	9/1/2019 and	9/30/2019
	1 Paired Sample Set Required between	10/1/2019 and	10/31/2019
	1 Paired Sample Set Required between	11/1/2019 and	11/30/2019
	1 Paired Sample Set Required between	12/1/2019 and	12/31/2019

**A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.**



**OH3900911 NEW LONDON VILLAGE-PLANT 1**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>3955242</b>	Facility Name: <b>NEW LONDON VILLAGE</b>	
<b>Location</b>	SMP ID: <b>EP001/LT2001</b>	Facility Source: <b>Surface Water</b>	Facility Class: <b>CLASS 3</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**  
Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
TOTAL MICROCYSTINS	1 Sample Set Required WEEKLY*

*Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.*

*\*Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH3900911 NEW LONDON VILLAGE-PLANT 1

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>3955242</b> SMP ID: <b>LT2001</b>	Facility Name: <b>NEW LONDON VILLAGE</b> Facility Source: <b>Surface Water</b>	Facility Class: <b>CLASS 3</b>
--------------------------	--	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/30/2018 and 1/5/2019
	1 Sample(s) Required between 1/13/2019 and 1/19/2019
	1 Sample(s) Required between 1/27/2019 and 2/2/2019
	1 Sample(s) Required between 2/10/2019 and 2/16/2019
	1 Sample(s) Required between 2/24/2019 and 3/2/2019
	1 Sample(s) Required between 3/10/2019 and 3/16/2019
	1 Sample(s) Required between 3/24/2019 and 3/30/2019
	1 Sample(s) Required between 4/7/2019 and 4/13/2019
	1 Sample(s) Required between 4/21/2019 and 4/27/2019
	1 Sample(s) Required between 5/5/2019 and 5/11/2019
	1 Sample(s) Required between 5/19/2019 and 5/25/2019
	1 Sample(s) Required between 6/2/2019 and 6/8/2019
	1 Sample(s) Required between 6/16/2019 and 6/22/2019
	1 Sample(s) Required between 6/30/2019 and 7/6/2019
	1 Sample(s) Required between 7/14/2019 and 7/20/2019
	1 Sample(s) Required between 7/28/2019 and 8/3/2019
	1 Sample(s) Required between 8/11/2019 and 8/17/2019
	1 Sample(s) Required between 8/25/2019 and 8/31/2019
	1 Sample(s) Required between 9/8/2019 and 9/14/2019
	1 Sample(s) Required between 9/22/2019 and 9/28/2019
1 Sample(s) Required between 10/6/2019 and 10/12/2019	
1 Sample(s) Required between 10/20/2019 and 10/26/2019	
1 Sample(s) Required between 11/3/2019 and 11/9/2019	
1 Sample(s) Required between 11/17/2019 and 11/23/2019	
1 Sample(s) Required between 12/1/2019 and 12/7/2019	
1 Sample(s) Required between 12/15/2019 and 12/21/2019	

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.



**OH3900911 NEW LONDON VILLAGE-PLANT 1**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>NEW LONDON, VLG OF-PLT 1 DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
ASBESTOS - 1094	Not Required
TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Required between 1/1/2019 and 1/31/2019 3 Sample(s) Required between 2/1/2019 and 2/28/2019 3 Sample(s) Required between 3/1/2019 and 3/31/2019 3 Sample(s) Required between 4/1/2019 and 4/30/2019 3 Sample(s) Required between 5/1/2019 and 5/31/2019 3 Sample(s) Required between 6/1/2019 and 6/30/2019 3 Sample(s) Required between 7/1/2019 and 7/31/2019 3 Sample(s) Required between 8/1/2019 and 8/31/2019 3 Sample(s) Required between 9/1/2019 and 9/30/2019 3 Sample(s) Required between 10/1/2019 and 10/31/2019 3 Sample(s) Required between 11/1/2019 and 11/30/2019 3 Sample(s) Required between 12/1/2019 and 12/31/2019
TOTAL CHLORINE - 1000	3 Sample(s) Required between 1/1/2019 and 1/31/2019 3 Sample(s) Required between 2/1/2019 and 2/28/2019 3 Sample(s) Required between 3/1/2019 and 3/31/2019 3 Sample(s) Required between 4/1/2019 and 4/30/2019 3 Sample(s) Required between 5/1/2019 and 5/31/2019 3 Sample(s) Required between 6/1/2019 and 6/30/2019 3 Sample(s) Required between 7/1/2019 and 7/31/2019 3 Sample(s) Required between 8/1/2019 and 8/31/2019 3 Sample(s) Required between 9/1/2019 and 9/30/2019 3 Sample(s) Required between 10/1/2019 and 10/31/2019 3 Sample(s) Required between 11/1/2019 and 11/30/2019 3 Sample(s) Required between 12/1/2019 and 12/31/2019

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>NEW LONDON, VLG OF-PLT 1 DISTRIBUTION</b> <b>6503 SECTIONLINE RD. 21</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2019 and 2/14/2019at: DS201 Dual Sample Required between 5/8/2019 and 5/14/2019at: DS201 Dual Sample Required between 8/8/2019 and 8/14/2019at: DS201 Dual Sample Required between 11/8/2019 and 11/14/2019at: DS201

Sample for all the analytes listed below:  
 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456  
 2) TTHM - 2950



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

**OH3900911 NEW LONDON VILLAGE-PLANT 1**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>NEW LONDON, VLG OF-PLT 1 DISTRIBUTION</b> <b>2546 SR 60 S</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2019 and 2/14/2019 at: DS202
	Dual Sample Required between 5/8/2019 and 5/14/2019 at: DS202
	Dual Sample Required between 8/8/2019 and 8/14/2019 at: DS202
	Dual Sample Required between 11/8/2019 and 11/14/2019 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>NEW LONDON, VLG OF-PLT 1 DISTRIBUTION</b> <b>Refer to your Lead and Copper plan for SMP IDs</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
LEAD - 1030 AND COPPER - 1022	Not Required



**OH3901012 NORTH FAIRFIELD VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>3955243</b>	Facility Name: <b>NORTH FAIRFIELD VLG</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Ground Water</b>	

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 10/1/2019 and 12/31/2019
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 2	1 Sample(s) Required between 4/1/2019 and 6/30/2019
<i>Sample for all the analytes listed below:</i>	
<i>2,4-D - 2105 CARBOFURAN - 2046 OXAMYL (VYDATE) - 2036</i>	
<i>PENTACHLOROPHENOL - 2326 PICLORAM - 2040</i>	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 3	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 4	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



**OH3901012 NORTH FAIRFIELD VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>NORTH FAIRFIELD, VLG. OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 1/31/2019
	1 Sample(s) Required between 2/1/2019 and 2/28/2019
	1 Sample(s) Required between 3/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 4/30/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019
	1 Sample(s) Required between 11/1/2019 and 11/30/2019
	1 Sample(s) Required between 12/1/2019 and 12/31/2019
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2019 and 1/31/2019
	1 Sample(s) Required between 2/1/2019 and 2/28/2019
	1 Sample(s) Required between 3/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 4/30/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019
	1 Sample(s) Required between 11/1/2019 and 11/30/2019
	1 Sample(s) Required between 12/1/2019 and 12/31/2019

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>NORTH FAIRFIELD, VLG. OF DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2019 and 9/30/2019at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH3901012 NORTH FAIRFIELD VILLAGE**

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>NORTH FAIRFIELD, VLG. OF DISTRIBUTION</b> <b>ADDRESS NOT KNOWN</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2019 and 9/30/2019 at: DS202
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>NORTH FAIRFIELD, VLG. OF DISTRIBUTION</b> <b>Refer to your Lead and Copper plan for SMP IDs</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2019 and 9/30/2019
-------------------------------	--

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.*





OH3901111 NORWALK CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>3955244</b>	Facility Name: <b>NORWALK CITY</b>	Facility Class: <b>CLASS 3</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019

Chemicals	Monitoring Requirements
-----------	-------------------------

INORGANICS	1 Sample(s) Required between 1/1/2019 and 5/31/2019
------------	---

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020  
 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 1/31/2019
	1 Sample(s) Required between 2/1/2019 and 2/28/2019
	1 Sample(s) Required between 3/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 4/30/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019
	1 Sample(s) Required between 11/1/2019 and 11/30/2019
	1 Sample(s) Required between 12/1/2019 and 12/31/2019

RADIOLOGICALS	Not Required
---------------	--------------

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2019 and 4/30/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2019 and 3/31/2019
----------------------------------	---

TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2019 and 1/31/2019
	1 Paired Sample Set Required between 2/1/2019 and 2/28/2019
	1 Paired Sample Set Required between 3/1/2019 and 3/31/2019
	1 Paired Sample Set Required between 4/1/2019 and 4/30/2019
	1 Paired Sample Set Required between 5/1/2019 and 5/31/2019
	1 Paired Sample Set Required between 6/1/2019 and 6/30/2019
	1 Paired Sample Set Required between 7/1/2019 and 7/31/2019
	1 Paired Sample Set Required between 8/1/2019 and 8/31/2019
	1 Paired Sample Set Required between 9/1/2019 and 9/30/2019
	1 Paired Sample Set Required between 10/1/2019 and 10/31/2019
	1 Paired Sample Set Required between 11/1/2019 and 11/30/2019
	1 Paired Sample Set Required between 12/1/2019 and 12/31/2019

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



**OH3901111 NORWALK CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>3955244</b>	Facility Name: <b>NORWALK CITY</b>	
<b>Location</b>	SMP ID: <b>EP001/LT2001</b>	Facility Source: <b>Surface Water</b>	Facility Class: <b>CLASS 3</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
TOTAL MICROCYSTINS	1 Sample Set Required WEEKLY*

*Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.*

*\*Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH3901111 NORWALK CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>3955244</b> SMP ID: <b>LT2001</b>	Facility Name: <b>NORWALK CITY</b> Facility Source: <b>Surface Water</b>	Facility Class: <b>CLASS 3</b>
--------------------------	--	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/30/2018 and 1/5/2019
	1 Sample(s) Required between 1/13/2019 and 1/19/2019
	1 Sample(s) Required between 1/27/2019 and 2/2/2019
	1 Sample(s) Required between 2/10/2019 and 2/16/2019
	1 Sample(s) Required between 2/24/2019 and 3/2/2019
	1 Sample(s) Required between 3/10/2019 and 3/16/2019
	1 Sample(s) Required between 3/24/2019 and 3/30/2019
	1 Sample(s) Required between 4/7/2019 and 4/13/2019
	1 Sample(s) Required between 4/21/2019 and 4/27/2019
	1 Sample(s) Required between 5/5/2019 and 5/11/2019
	1 Sample(s) Required between 5/19/2019 and 5/25/2019
	1 Sample(s) Required between 6/2/2019 and 6/8/2019
	1 Sample(s) Required between 6/16/2019 and 6/22/2019
	1 Sample(s) Required between 6/30/2019 and 7/6/2019
	1 Sample(s) Required between 7/14/2019 and 7/20/2019
	1 Sample(s) Required between 7/28/2019 and 8/3/2019
	1 Sample(s) Required between 8/11/2019 and 8/17/2019
	1 Sample(s) Required between 8/25/2019 and 8/31/2019
	1 Sample(s) Required between 9/8/2019 and 9/14/2019
	1 Sample(s) Required between 9/22/2019 and 9/28/2019
1 Sample(s) Required between 10/6/2019 and 10/12/2019	
1 Sample(s) Required between 10/20/2019 and 10/26/2019	
1 Sample(s) Required between 11/3/2019 and 11/9/2019	
1 Sample(s) Required between 11/17/2019 and 11/23/2019	
1 Sample(s) Required between 12/1/2019 and 12/7/2019	
1 Sample(s) Required between 12/15/2019 and 12/21/2019	

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.



**OH3901111 NORWALK CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>NORWALK CITY DISTRIBUTION SYSTEM</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	15 Sample(s) Required between 1/1/2019 and 1/31/2019
	15 Sample(s) Required between 2/1/2019 and 2/28/2019
	15 Sample(s) Required between 3/1/2019 and 3/31/2019
	15 Sample(s) Required between 4/1/2019 and 4/30/2019
	15 Sample(s) Required between 5/1/2019 and 5/31/2019
	15 Sample(s) Required between 6/1/2019 and 6/30/2019
	15 Sample(s) Required between 7/1/2019 and 7/31/2019
	15 Sample(s) Required between 8/1/2019 and 8/31/2019
	15 Sample(s) Required between 9/1/2019 and 9/30/2019
	15 Sample(s) Required between 10/1/2019 and 10/31/2019
	15 Sample(s) Required between 11/1/2019 and 11/30/2019
	15 Sample(s) Required between 12/1/2019 and 12/31/2019
	TOTAL CHLORINE - 1000
15 Sample(s) Required between 2/1/2019 and 2/28/2019	
15 Sample(s) Required between 3/1/2019 and 3/31/2019	
15 Sample(s) Required between 4/1/2019 and 4/30/2019	
15 Sample(s) Required between 5/1/2019 and 5/31/2019	
15 Sample(s) Required between 6/1/2019 and 6/30/2019	
15 Sample(s) Required between 7/1/2019 and 7/31/2019	
15 Sample(s) Required between 8/1/2019 and 8/31/2019	
15 Sample(s) Required between 9/1/2019 and 9/30/2019	
15 Sample(s) Required between 10/1/2019 and 10/31/2019	
15 Sample(s) Required between 11/1/2019 and 11/30/2019	
15 Sample(s) Required between 12/1/2019 and 12/31/2019	

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>NORWALK CITY DISTRIBUTION SYSTEM</b> <b>394 CLEVELAND RD.</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2019 and 2/7/2019 at: DS201
	Dual Sample Required between 5/1/2019 and 5/7/2019 at: DS201
	Dual Sample Required between 8/1/2019 and 8/7/2019 at: DS201
	Dual Sample Required between 11/1/2019 and 11/7/2019 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH3901111 NORWALK CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\*** Consumer Confidence Report (CCR) is due July 1, 2019

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>NORWALK CITY DISTRIBUTION SYSTEM</b> <b>77 CHRISTIE AVE.</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2019 and 2/7/2019 at: DS202
	Dual Sample Required between 5/1/2019 and 5/7/2019 at: DS202
	Dual Sample Required between 8/1/2019 and 8/7/2019 at: DS202
	Dual Sample Required between 11/1/2019 and 11/7/2019 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS203</b>	Facility Name: <b>NORWALK CITY DISTRIBUTION SYSTEM</b> <b>9 SYCAMORE DR HYDRANT #330</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2019 and 2/7/2019 at: DS203
	Dual Sample Required between 5/1/2019 and 5/7/2019 at: DS203
	Dual Sample Required between 8/1/2019 and 8/7/2019 at: DS203
	Dual Sample Required between 11/1/2019 and 11/7/2019 at: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS204</b>	Facility Name: <b>NORWALK CITY DISTRIBUTION SYSTEM</b> <b>340 WESTWIND DR.</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2019 and 2/7/2019 at: DS204
	Dual Sample Required between 5/1/2019 and 5/7/2019 at: DS204
	Dual Sample Required between 8/1/2019 and 8/7/2019 at: DS204
	Dual Sample Required between 11/1/2019 and 11/7/2019 at: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950





**OH3901411 WAKEMAN VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>WAKEMAN, VILLAGE OF DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2019 and 1/31/2019 2 Sample(s) Required between 2/1/2019 and 2/28/2019 2 Sample(s) Required between 3/1/2019 and 3/31/2019 2 Sample(s) Required between 4/1/2019 and 4/30/2019 2 Sample(s) Required between 5/1/2019 and 5/31/2019 2 Sample(s) Required between 6/1/2019 and 6/30/2019 2 Sample(s) Required between 7/1/2019 and 7/31/2019 2 Sample(s) Required between 8/1/2019 and 8/31/2019 2 Sample(s) Required between 9/1/2019 and 9/30/2019 2 Sample(s) Required between 10/1/2019 and 10/31/2019 2 Sample(s) Required between 11/1/2019 and 11/30/2019 2 Sample(s) Required between 12/1/2019 and 12/31/2019
TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2019 and 1/31/2019 2 Sample(s) Required between 2/1/2019 and 2/28/2019 2 Sample(s) Required between 3/1/2019 and 3/31/2019 2 Sample(s) Required between 4/1/2019 and 4/30/2019 2 Sample(s) Required between 5/1/2019 and 5/31/2019 2 Sample(s) Required between 6/1/2019 and 6/30/2019 2 Sample(s) Required between 7/1/2019 and 7/31/2019 2 Sample(s) Required between 8/1/2019 and 8/31/2019 2 Sample(s) Required between 9/1/2019 and 9/30/2019 2 Sample(s) Required between 10/1/2019 and 10/31/2019 2 Sample(s) Required between 11/1/2019 and 11/30/2019 2 Sample(s) Required between 12/1/2019 and 12/31/2019

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>WAKEMAN, VILLAGE OF DISTRIBUTION</b> <b>60 MECHANIC ST.</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2019 and 2/14/2019 at: DS201 Dual Sample Required between 5/8/2019 and 5/14/2019 at: DS201 Dual Sample Required between 8/8/2019 and 8/14/2019 at: DS201 Dual Sample Required between 11/8/2019 and 11/14/2019 at: DS201

- Sample for all the analytes listed below:
- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
  - 2) TTHM - 2950



**OH3901411 WAKEMAN VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\*** Consumer Confidence Report (CCR) is due July 1, 2019

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>WAKEMAN, VILLAGE OF DISTRIBUTION</b> <b>64 E. MAIN ST.</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2019 and 2/14/2019 at: DS202
	Dual Sample Required between 5/8/2019 and 5/14/2019 at: DS202
	Dual Sample Required between 8/8/2019 and 8/14/2019 at: DS202
	Dual Sample Required between 11/8/2019 and 11/14/2019 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>WAKEMAN, VILLAGE OF DISTRIBUTION</b> <b>Refer to your Lead and Copper plan for SMP IDs</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2019 and 9/30/2019
-------------------------------	--

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.





OH3901511 WILLARD CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>3955247</b>	Facility Name: <b>WILLARD CITY</b>	Facility Class: <b>CLASS 3</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019

Chemicals	Monitoring Requirements
-----------	-------------------------

INORGANICS	1 Sample(s) Required between 1/1/2019 and 5/31/2019
------------	---

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020  
 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 1/31/2019
	1 Sample(s) Required between 2/1/2019 and 2/28/2019
	1 Sample(s) Required between 3/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 4/30/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019
	1 Sample(s) Required between 11/1/2019 and 11/30/2019
	1 Sample(s) Required between 12/1/2019 and 12/31/2019

RADIOLOGICALS	Not Required
---------------	--------------

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2019 and 6/30/2019
---	---

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2019 and 5/31/2019
----------------------------------	---

TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2019 and 1/31/2019
	1 Paired Sample Set Required between 2/1/2019 and 2/28/2019
	1 Paired Sample Set Required between 3/1/2019 and 3/31/2019
	1 Paired Sample Set Required between 4/1/2019 and 4/30/2019
	1 Paired Sample Set Required between 5/1/2019 and 5/31/2019
	1 Paired Sample Set Required between 6/1/2019 and 6/30/2019
	1 Paired Sample Set Required between 7/1/2019 and 7/31/2019
	1 Paired Sample Set Required between 8/1/2019 and 8/31/2019
	1 Paired Sample Set Required between 9/1/2019 and 9/30/2019
	1 Paired Sample Set Required between 10/1/2019 and 10/31/2019
	1 Paired Sample Set Required between 11/1/2019 and 11/30/2019
	1 Paired Sample Set Required between 12/1/2019 and 12/31/2019

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



**OH3901511 WILLARD CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling</b>	Facility ID: <b>3955247</b>	Facility Name: <b>WILLARD CITY</b>	
<b>Location</b>	SMP ID: <b>EP001/LT2001</b>	Facility Source: <b>Surface Water</b>	Facility Class: <b>CLASS 3</b>

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**Chemicals**

**Monitoring Requirements**

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY\*

*Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.*

*\*Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



**OH3901511 WILLARD CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>3955247</b> SMP ID: <b>LT2001</b>	Facility Name: <b>WILLARD CITY</b> Facility Source: <b>Surface Water</b>	Facility Class: <b>CLASS 3</b>
--------------------------	--	---	--------------------------------

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

**For water emergencies that occur after hours, please call 800-282-9378**

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

<b>Chemicals</b>	<b>Monitoring Requirements</b>
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/30/2018 and 1/5/2019
	1 Sample(s) Required between 1/13/2019 and 1/19/2019
	1 Sample(s) Required between 1/27/2019 and 2/2/2019
	1 Sample(s) Required between 2/10/2019 and 2/16/2019
	1 Sample(s) Required between 2/24/2019 and 3/2/2019
	1 Sample(s) Required between 3/10/2019 and 3/16/2019
	1 Sample(s) Required between 3/24/2019 and 3/30/2019
	1 Sample(s) Required between 4/7/2019 and 4/13/2019
	1 Sample(s) Required between 4/21/2019 and 4/27/2019
	1 Sample(s) Required between 5/5/2019 and 5/11/2019
	1 Sample(s) Required between 5/19/2019 and 5/25/2019
	1 Sample(s) Required between 6/2/2019 and 6/8/2019
	1 Sample(s) Required between 6/16/2019 and 6/22/2019
	1 Sample(s) Required between 6/30/2019 and 7/6/2019
	1 Sample(s) Required between 7/14/2019 and 7/20/2019
	1 Sample(s) Required between 7/28/2019 and 8/3/2019
	1 Sample(s) Required between 8/11/2019 and 8/17/2019
	1 Sample(s) Required between 8/25/2019 and 8/31/2019
	1 Sample(s) Required between 9/8/2019 and 9/14/2019
	1 Sample(s) Required between 9/22/2019 and 9/28/2019
1 Sample(s) Required between 10/6/2019 and 10/12/2019	
1 Sample(s) Required between 10/20/2019 and 10/26/2019	
1 Sample(s) Required between 11/3/2019 and 11/9/2019	
1 Sample(s) Required between 11/17/2019 and 11/23/2019	
1 Sample(s) Required between 12/1/2019 and 12/7/2019	
1 Sample(s) Required between 12/15/2019 and 12/21/2019	

*Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.*



**OH3901511 WILLARD CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>WILLARD CITY DISTRIBUTION SYSTEM</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	8 Sample(s) Required between 1/1/2019 and 1/31/2019
	8 Sample(s) Required between 2/1/2019 and 2/28/2019
	8 Sample(s) Required between 3/1/2019 and 3/31/2019
	8 Sample(s) Required between 4/1/2019 and 4/30/2019
	8 Sample(s) Required between 5/1/2019 and 5/31/2019
	8 Sample(s) Required between 6/1/2019 and 6/30/2019
	8 Sample(s) Required between 7/1/2019 and 7/31/2019
	8 Sample(s) Required between 8/1/2019 and 8/31/2019
	8 Sample(s) Required between 9/1/2019 and 9/30/2019
	8 Sample(s) Required between 10/1/2019 and 10/31/2019
	8 Sample(s) Required between 11/1/2019 and 11/30/2019
	8 Sample(s) Required between 12/1/2019 and 12/31/2019

TOTAL CHLORINE - 1000	8 Sample(s) Required between 1/1/2019 and 1/31/2019
	8 Sample(s) Required between 2/1/2019 and 2/28/2019
	8 Sample(s) Required between 3/1/2019 and 3/31/2019
	8 Sample(s) Required between 4/1/2019 and 4/30/2019
	8 Sample(s) Required between 5/1/2019 and 5/31/2019
	8 Sample(s) Required between 6/1/2019 and 6/30/2019
	8 Sample(s) Required between 7/1/2019 and 7/31/2019
	8 Sample(s) Required between 8/1/2019 and 8/31/2019
	8 Sample(s) Required between 9/1/2019 and 9/30/2019
	8 Sample(s) Required between 10/1/2019 and 10/31/2019
	8 Sample(s) Required between 11/1/2019 and 11/30/2019
	8 Sample(s) Required between 12/1/2019 and 12/31/2019

*Samples should be collected at the same time and place as the Total Coliform samples.*

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>WILLARD CITY DISTRIBUTION SYSTEM</b> <b>4676 WILLARD WEST ROAD</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
------------------	--------------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 1/1/2019 and 1/7/2019 at: DS201
	Dual Sample Required between 4/1/2019 and 4/7/2019 at: DS201
	Dual Sample Required between 7/1/2019 and 7/7/2019 at: DS201
	Dual Sample Required between 10/1/2019 and 10/7/2019 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



**OH3901511 WILLARD CITY**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>WILLARD CITY DISTRIBUTION SYSTEM</b> <b>8 EAST TIFFIN STREET</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
DISINFECTION BYPRODUCTS	Dual Sample Required between 1/1/2019 and 1/7/2019 at: DS202
	Dual Sample Required between 4/1/2019 and 4/7/2019 at: DS202
	Dual Sample Required between 7/1/2019 and 7/7/2019 at: DS202
	Dual Sample Required between 10/1/2019 and 10/7/2019 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>WILLARD CITY DISTRIBUTION SYSTEM</b> <b>Refer to your Lead and Copper plan for SMP IDs</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
LEAD - 1030 AND COPPER - 1022	Not Required



**OH3902403 NORTHERN OHIO RURAL WATER**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>NORTHERN OHIO RURAL WATER DISTRIBUTI</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements		
TOTAL COLIFORM (TCR) - 3100	20 Sample(s) Required between	1/1/2019	and 1/31/2019
	20 Sample(s) Required between	2/1/2019	and 2/28/2019
	20 Sample(s) Required between	3/1/2019	and 3/31/2019
	20 Sample(s) Required between	4/1/2019	and 4/30/2019
	20 Sample(s) Required between	5/1/2019	and 5/31/2019
	20 Sample(s) Required between	6/1/2019	and 6/30/2019
	20 Sample(s) Required between	7/1/2019	and 7/31/2019
	20 Sample(s) Required between	8/1/2019	and 8/31/2019
	20 Sample(s) Required between	9/1/2019	and 9/30/2019
	20 Sample(s) Required between	10/1/2019	and 10/31/2019
	20 Sample(s) Required between	11/1/2019	and 11/30/2019
	20 Sample(s) Required between	12/1/2019	and 12/31/2019
TOTAL CHLORINE - 1000	20 Sample(s) Required between	1/1/2019	and 1/31/2019
	20 Sample(s) Required between	2/1/2019	and 2/28/2019
	20 Sample(s) Required between	3/1/2019	and 3/31/2019
	20 Sample(s) Required between	4/1/2019	and 4/30/2019
	20 Sample(s) Required between	5/1/2019	and 5/31/2019
	20 Sample(s) Required between	6/1/2019	and 6/30/2019
	20 Sample(s) Required between	7/1/2019	and 7/31/2019
	20 Sample(s) Required between	8/1/2019	and 8/31/2019
	20 Sample(s) Required between	9/1/2019	and 9/30/2019
	20 Sample(s) Required between	10/1/2019	and 10/31/2019
	20 Sample(s) Required between	11/1/2019	and 11/30/2019
	20 Sample(s) Required between	12/1/2019	and 12/31/2019

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>NORTHERN OHIO RURAL WATER DISTRIBUTI</b> <b>FITCHVILLE TANK</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements		
DISINFECTION BYPRODUCTS	Dual Sample Required between	1/1/2019	and 1/7/2019at: DS201
	Dual Sample Required between	4/1/2019	and 4/7/2019at: DS201
	Dual Sample Required between	7/1/2019	and 7/7/2019at: DS201
	Dual Sample Required between	10/1/2019	and 10/7/2019at: DS201

- Sample for all the analytes listed below:
- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
  - 2) TTHM - 2950



**OH3902403 NORTHERN OHIO RURAL WATER**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>NORTHERN OHIO RURAL WATER DISTRIBUTION</b> <b>3333 SR 60</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 1/1/2019 and 1/7/2019 at: DS202
	Dual Sample Required between 4/1/2019 and 4/7/2019 at: DS202
	Dual Sample Required between 7/1/2019 and 7/7/2019 at: DS202
	Dual Sample Required between 10/1/2019 and 10/7/2019 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS203</b>	Facility Name: <b>NORTHERN OHIO RURAL WATER DISTRIBUTION</b> <b>2205 US HWY 20</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 1/1/2019 and 1/7/2019 at: DS203
	Dual Sample Required between 4/1/2019 and 4/7/2019 at: DS203
	Dual Sample Required between 7/1/2019 and 7/7/2019 at: DS203
	Dual Sample Required between 10/1/2019 and 10/7/2019 at: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS204</b>	Facility Name: <b>NORTHERN OHIO RURAL WATER DISTRIBUTION</b> <b>SETTLEMENT RD</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 1/1/2019 and 1/7/2019 at: DS204
	Dual Sample Required between 4/1/2019 and 4/7/2019 at: DS204
	Dual Sample Required between 7/1/2019 and 7/7/2019 at: DS204
	Dual Sample Required between 10/1/2019 and 10/7/2019 at: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

**OH3902403 NORTHERN OHIO RURAL WATER**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>NORTHERN OHIO RURAL WATER DISTRIBUTION</b> Refer to your Lead and Copper plan for SMP IDs	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 30 Sample(s) Required between 6/1/2019 and 9/30/2019

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.*





OH3902611 NEW LONDON VILLAGE -PLANT 2

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>3955252</b>	Facility Name: <b>NEW LONDON PLANT NO 2</b>	Facility Class: <b>CLASS 3</b>
	SMP ID: <b>EP001</b>	Facility Source: <b>Surface Water</b>	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019

Chemicals	Monitoring Requirements
-----------	-------------------------

INORGANICS	1 Sample(s) Required between 1/1/2019 and 5/31/2019
------------	---

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020  
 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 1/31/2019
	1 Sample(s) Required between 2/1/2019 and 2/28/2019
	1 Sample(s) Required between 3/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 4/30/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019
	1 Sample(s) Required between 11/1/2019 and 11/30/2019
	1 Sample(s) Required between 12/1/2019 and 12/31/2019

RADIOLOGICALS	Not Required
---------------	--------------

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2019 and 6/30/2019
---	---

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2019 and 5/31/2019
----------------------------------	---

**OH3934612 JOHN F STAMBAUGH AND COMPANY AMLC**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> STAMBAUGH, JOHN F. & COM DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

**Where to Collect Samples For a Small Public Water System**

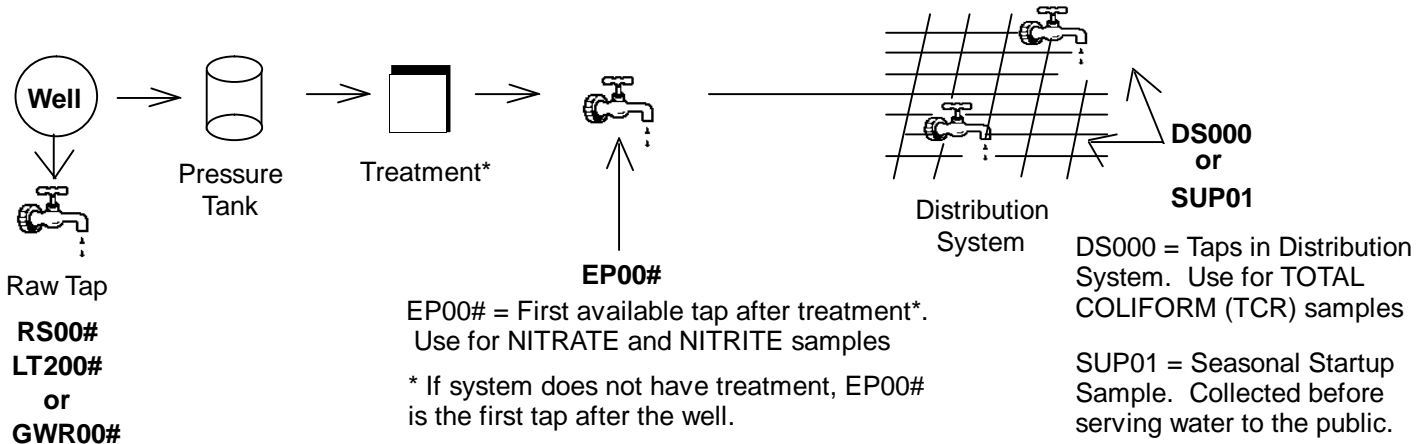

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3934612 JOHN F STAMBAUGH AND COMPANY AMLC**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: 3960532 Facility Name: JOHN F. STAMBAUGH & CO STU 3

**Location** SMP ID: EP003 Facility Source: Ground Water

**Chemicals**

**Monitoring Requirements**


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2019 and 5/31/2019

**Where to Collect Samples For a Small Public Water System**

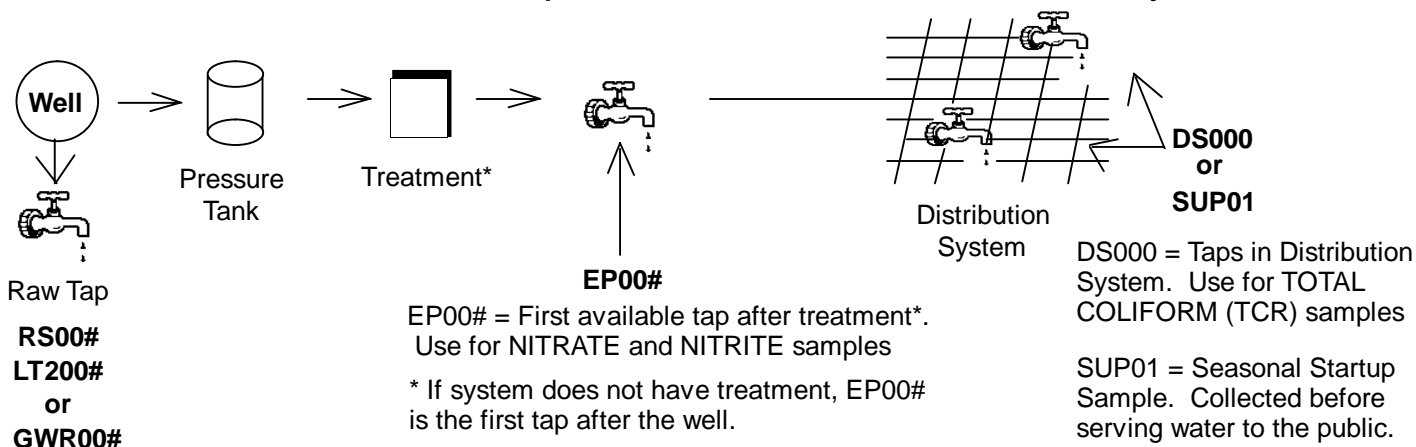

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3934612 JOHN F STAMBAUGH AND COMPANY AMLC**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **3960531** Facility Name: **JOHN F. STAMBAUGH & CO STU 2**

**Location** SMP ID: **EP002** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019

**Where to Collect Samples For a Small Public Water System**

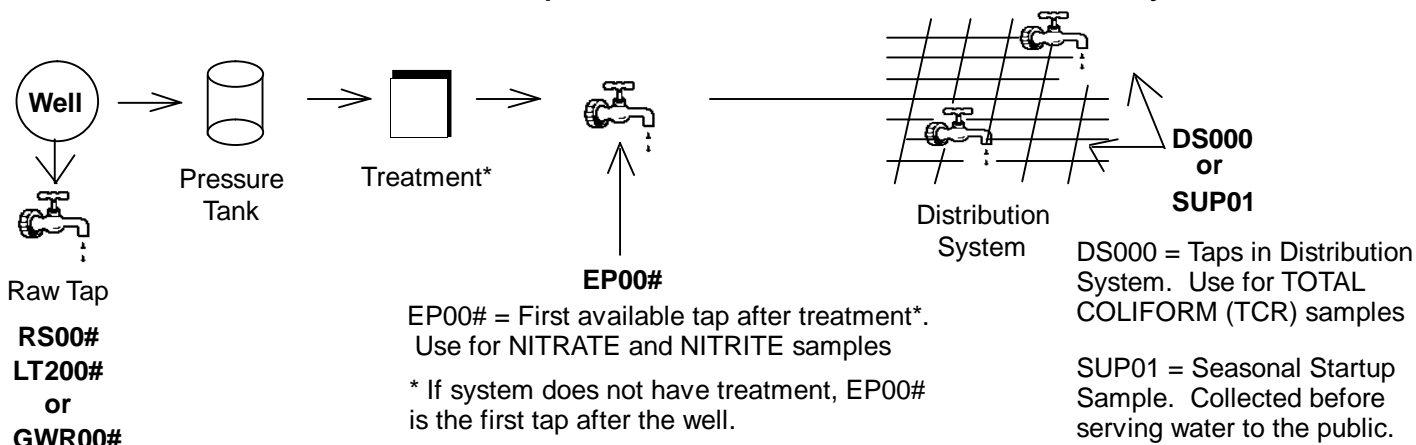

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3934612 JOHN F STAMBAUGH AND COMPANY AMLC**

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **3955256** Facility Name: **JOHN F. STAMBAUGH & CO STU 1**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

**Chemicals**

**Monitoring Requirements**


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2019 and 5/31/2019

**Where to Collect Samples For a Small Public Water System**

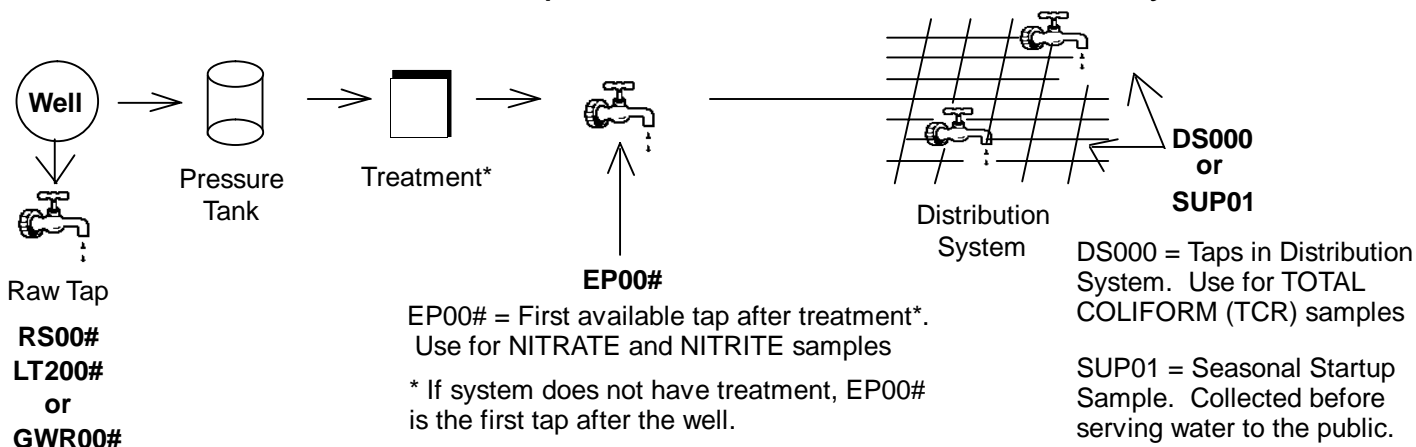

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3940212 BUURMA FARMS AMLC 1 PWS**

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**


<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> BUURMA FARMS AMLC 1 DISTRIBUTION
<b>Location SMP ID:</b> SUP01	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	--

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

## Where to Collect Samples For a Small Public Water System

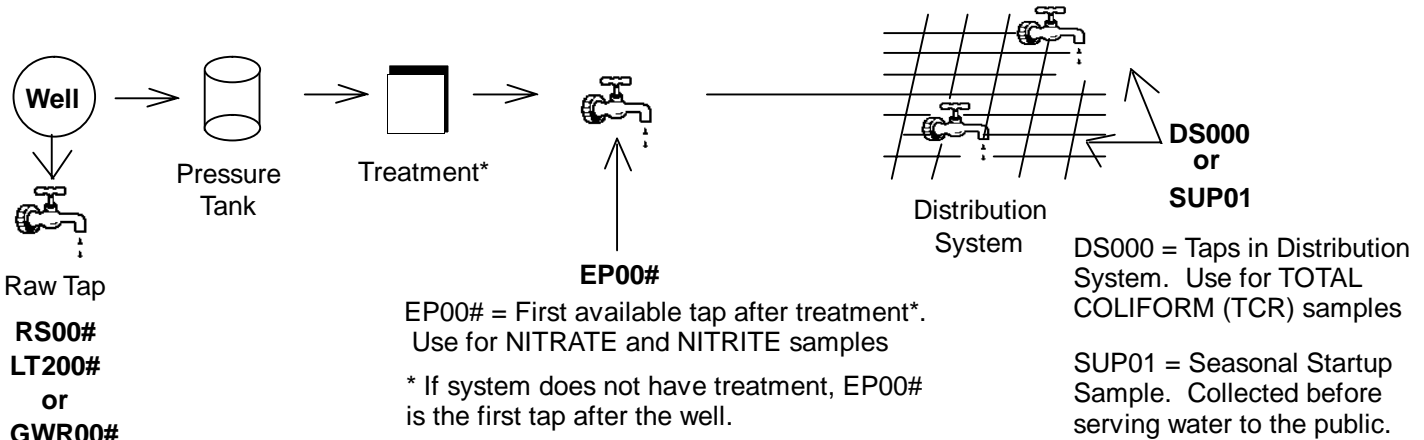

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

**Save a dime. Sample on time!**

**OH3940212 BUURMA FARMS AMLC 1 PWS**

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> BUURMA FARMS AMLC 1 DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/7/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019

**Where to Collect Samples For a Small Public Water System**

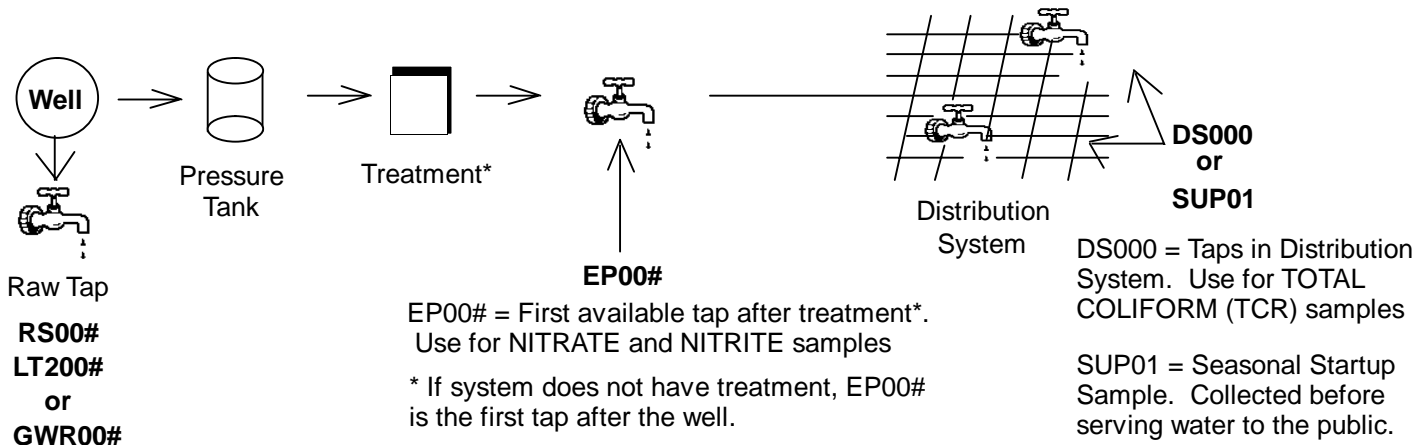

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3940212 BUURMA FARMS AMLC 1 PWS**

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **3955263** Facility Name: **BUURMA FARMS AMLC NO 1**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

**Chemicals**

**Monitoring Requirements**


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2019 and 10/31/2019

**Where to Collect Samples For a Small Public Water System**

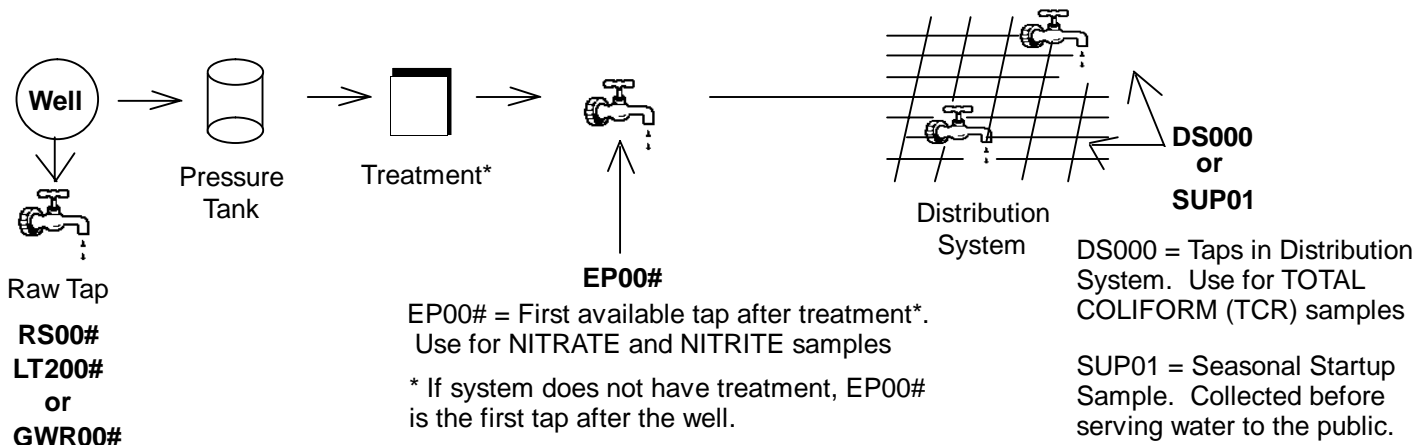

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH3943112 STARVIEW DRIVE IN 1**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> STARVIEW DRIVE IN 1 DISTRIBUTION
<b>Location SMP ID:</b> SUP01	<b>Facility Source:</b> Ground Water

**Chemicals**


**Monitoring Requirements**

TOTAL COLIFORM - SEASONAL STARTUP

At least 1 negative Total Coliform  
Bacteria sample prior to serving  
water to the public

**\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\***

**Where to Collect Samples For a Small Public Water System**

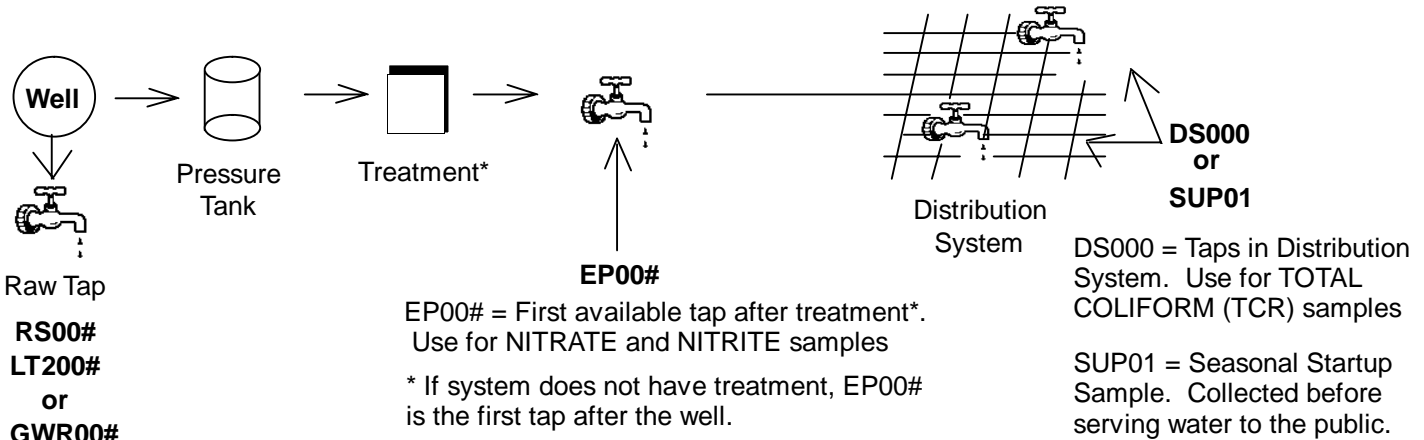

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3943112 STARVIEW DRIVE IN 1**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> STARVIEW DRIVE IN 1 DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/18/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019

**Where to Collect Samples For a Small Public Water System**

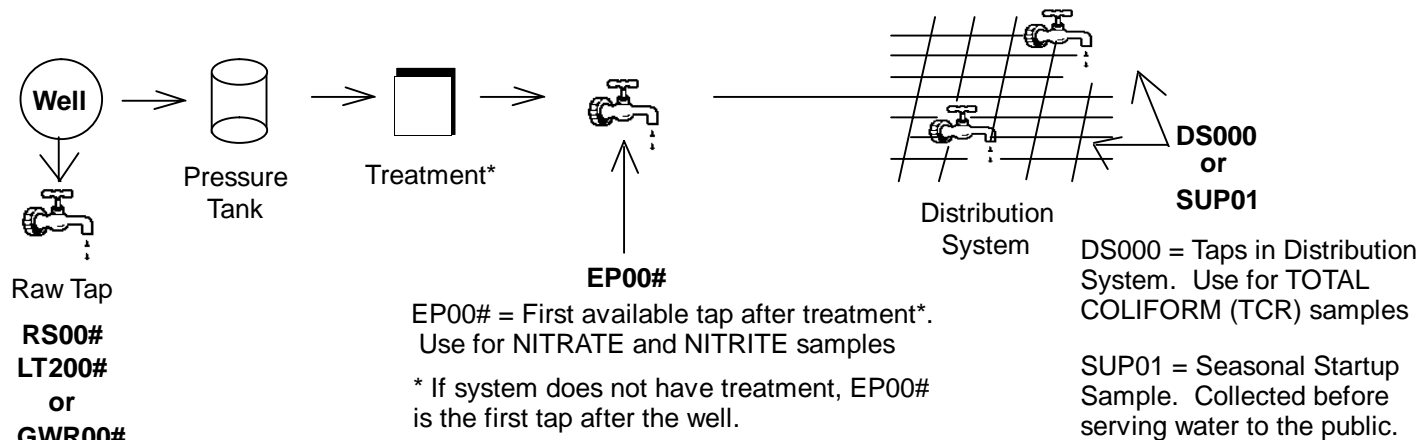

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3943112 STARVIEW DRIVE IN 1**

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 3955269	<b>Facility Name:</b> STARVIEW DRIVE IN NO 1
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019

**Where to Collect Samples For a Small Public Water System**

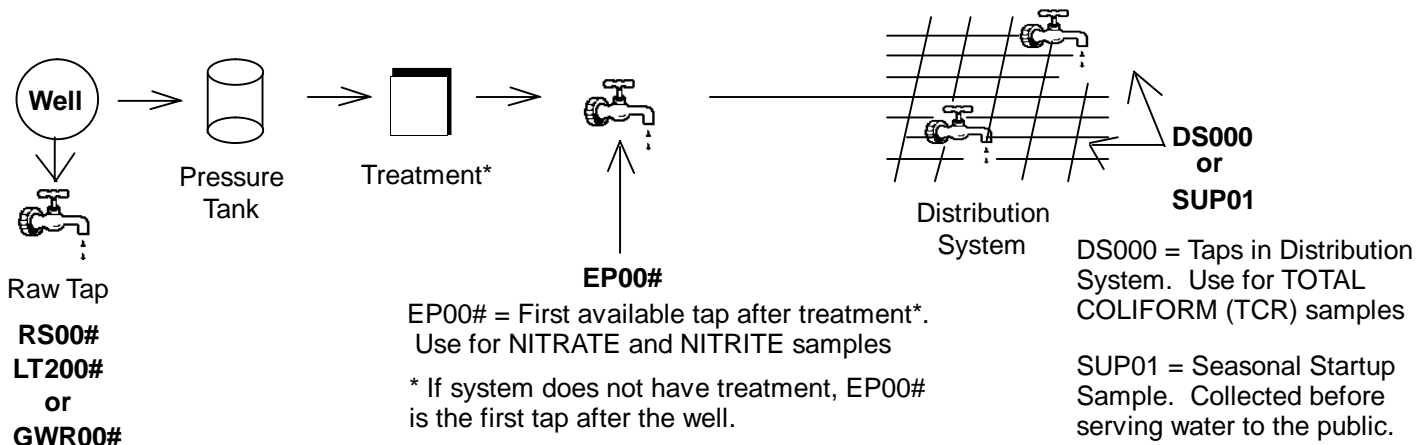

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

**Save a dime. Sample on time!**

**OH3943612 WIERS FARM AMLC #01**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**


<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> WIERS FARM AMLC 1 DISTRIBUTION
<b>Location SMP ID:</b> SUP01	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	--

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

## Where to Collect Samples For a Small Public Water System

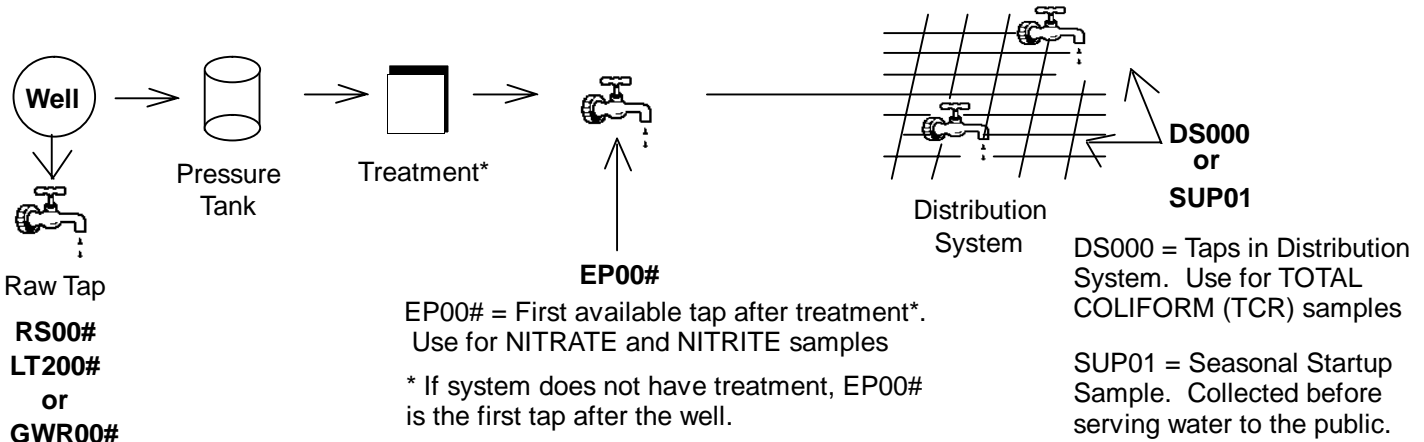

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

**Save a dime. Sample on time!**

**OH3943612 WIERS FARM AMLC #01**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> WIERS FARM AMLC 1 DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/16/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019

**Where to Collect Samples For a Small Public Water System**

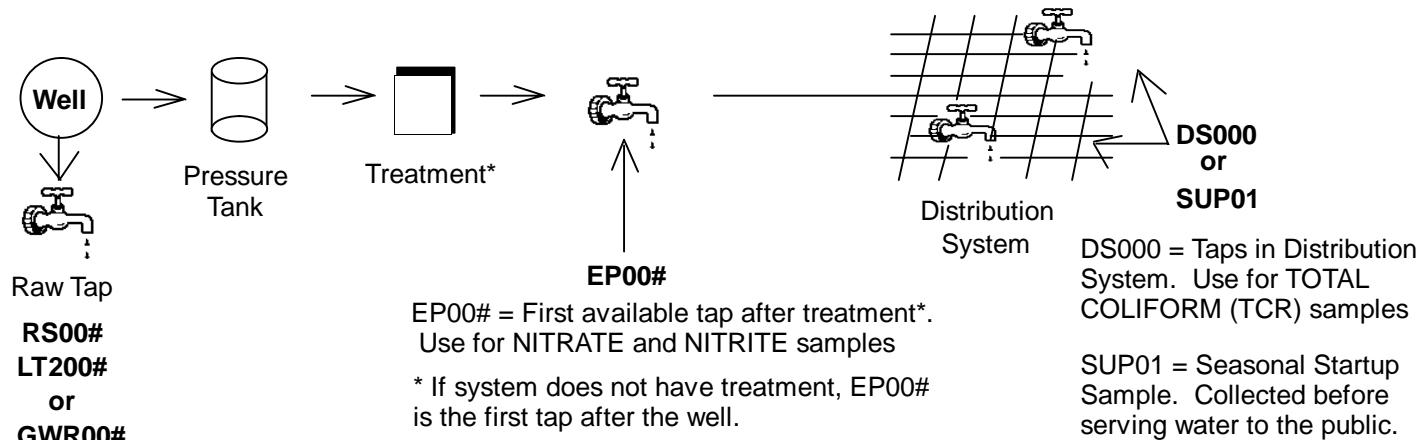

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3943612 WIERS FARM AMLC #01**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **3955271** Facility Name: **WIERS FARM AMLC 1**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

**Chemicals**

**Monitoring Requirements**


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2019 and 5/31/2019

**Where to Collect Samples For a Small Public Water System**

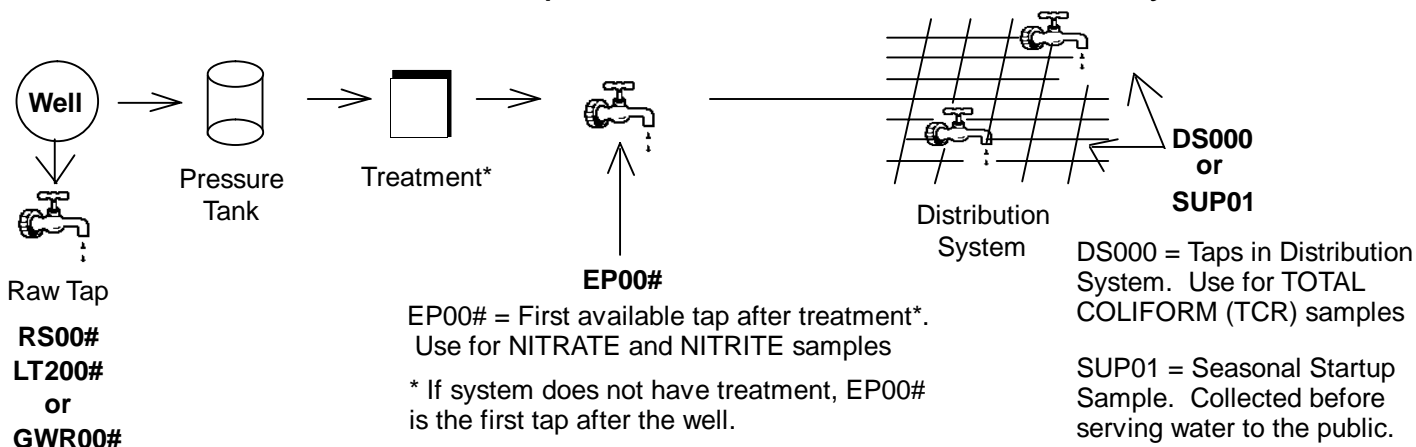

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3943712 WIERS FARM AMLC #02**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**


<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> WIERS FARM AMLC 2 DISTRIBUTION
<b>Location SMP ID:</b> SUP01	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	--

**\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\***

## Where to Collect Samples For a Small Public Water System

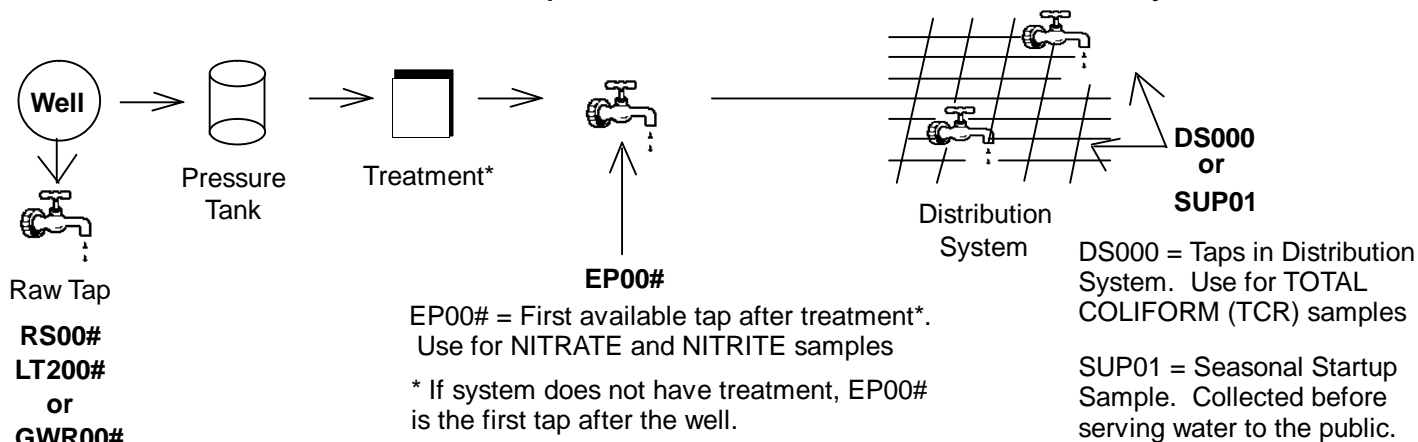

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3943712 WIERS FARM AMLC #02**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> WIERS FARM AMLC 2 DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/16/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019

**Where to Collect Samples For a Small Public Water System**

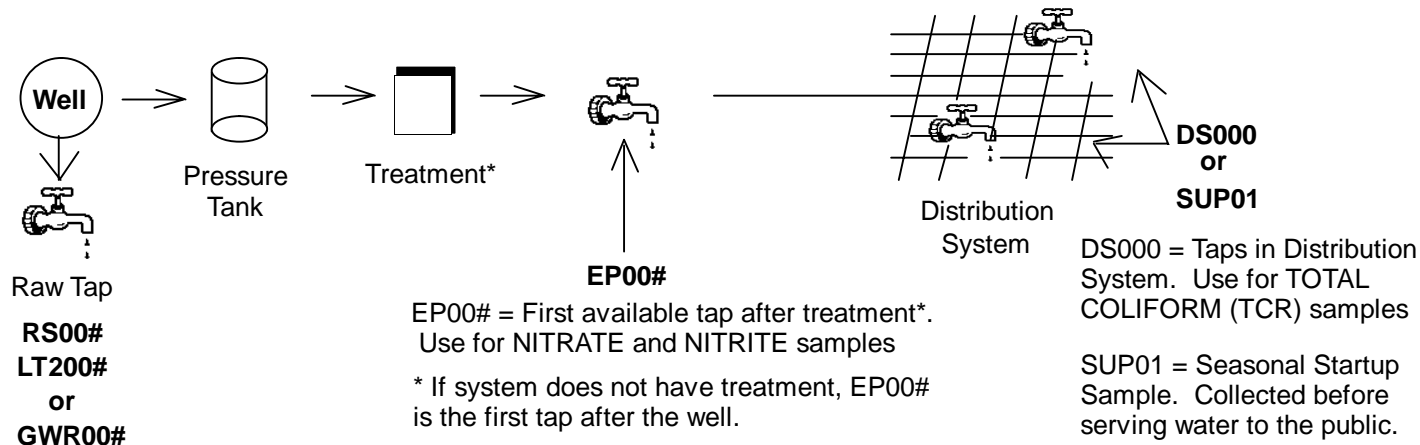

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH3943712 WIERS FARM AMLC #02**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: 3955272 Facility Name: **WIERS FARM AMLC 2**

**Location** SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019

**Where to Collect Samples For a Small Public Water System**

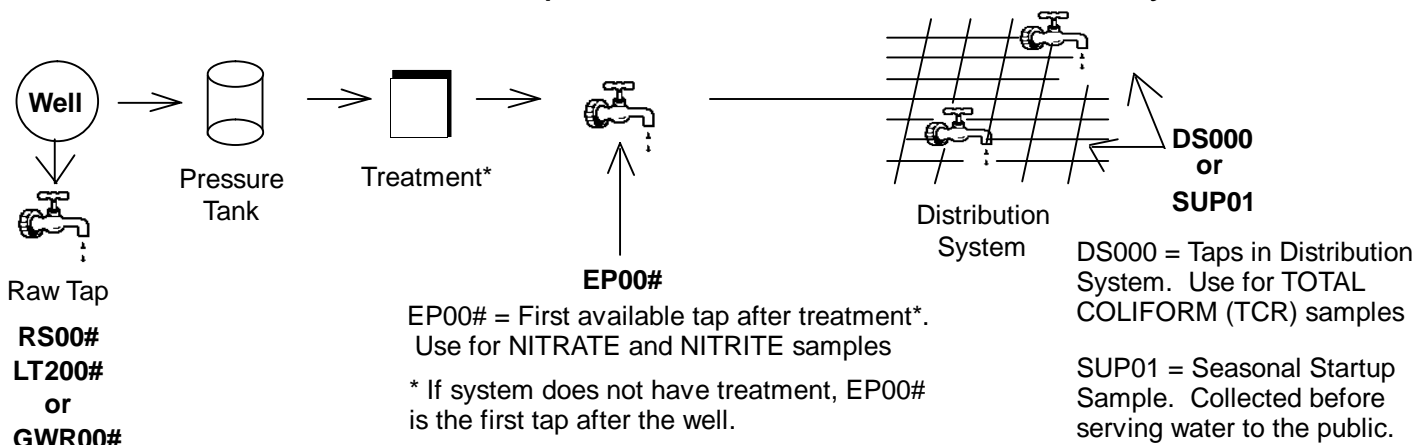

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3945612 WIERS FARM AMLC #04A-BLDG #01 & #02**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> WIERS FARM AMLC 4A-BLDG 1&2 DISTRIBUTION
<b>Location SMP ID:</b> SUP01	<b>Facility Source:</b> Ground Water

**Chemicals**


**Monitoring Requirements**

TOTAL COLIFORM - SEASONAL STARTUP

At least 1 negative Total Coliform  
Bacteria sample prior to serving  
water to the public

**\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\***

**Where to Collect Samples For a Small Public Water System**

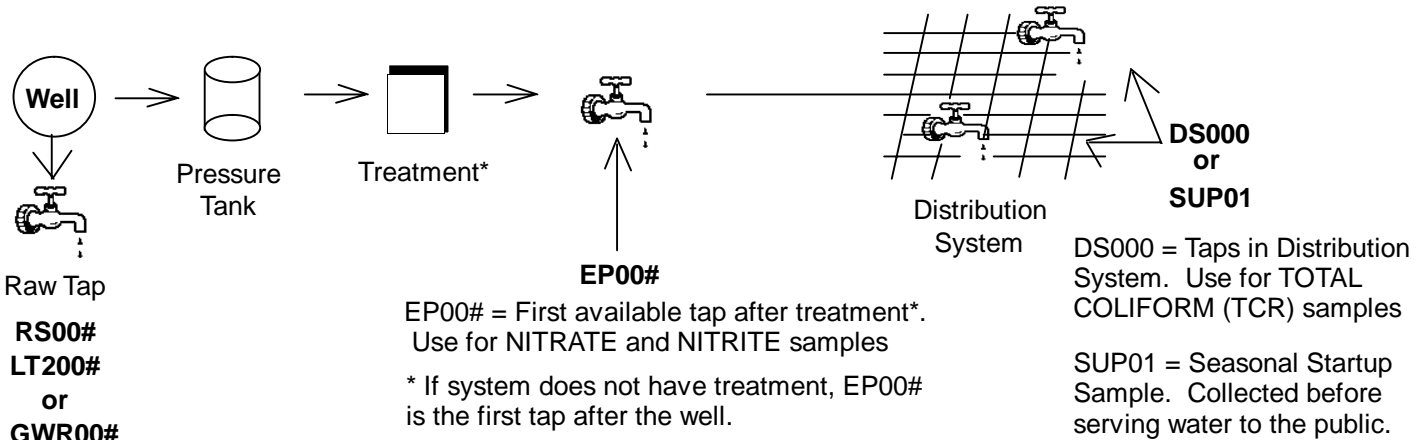

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3945612 WIERS FARM AMLC #04A-BLDG #01 & #02**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> WIERS FARM AMLC 4A-BLDG 1&2 DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/16/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019

**Where to Collect Samples For a Small Public Water System**

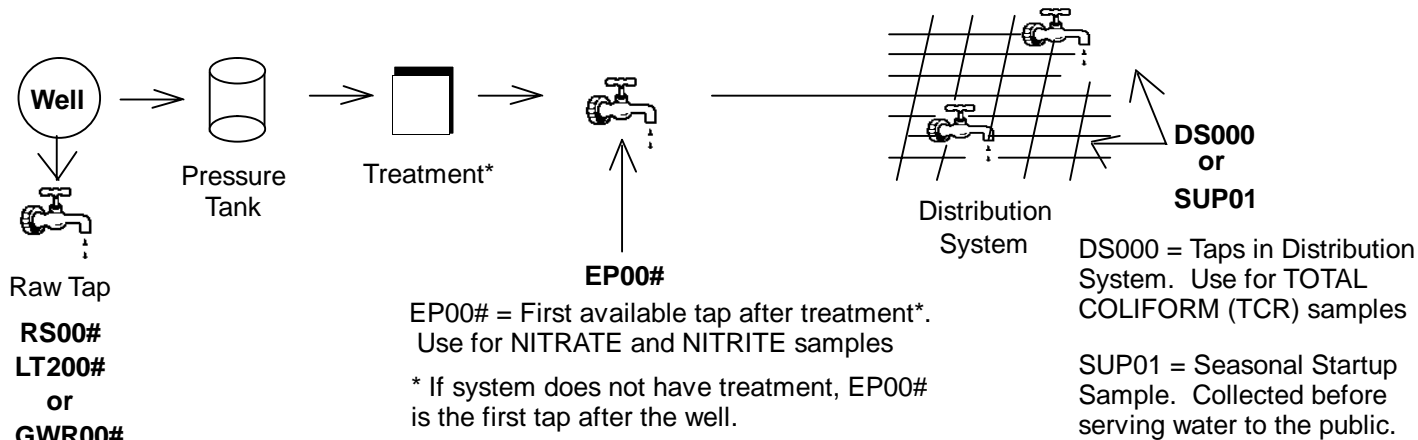

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3945612 WIERS FARM AMLC #04A-BLDG #01 & #02**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: 3955276 Facility Name: WIERS FARM AMLC 4A-BLDG 1 & 2

**Location** SMP ID: EP001 Facility Source: Ground Water

**Chemicals**

**Monitoring Requirements**


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2019 and 5/31/2019

**Where to Collect Samples For a Small Public Water System**

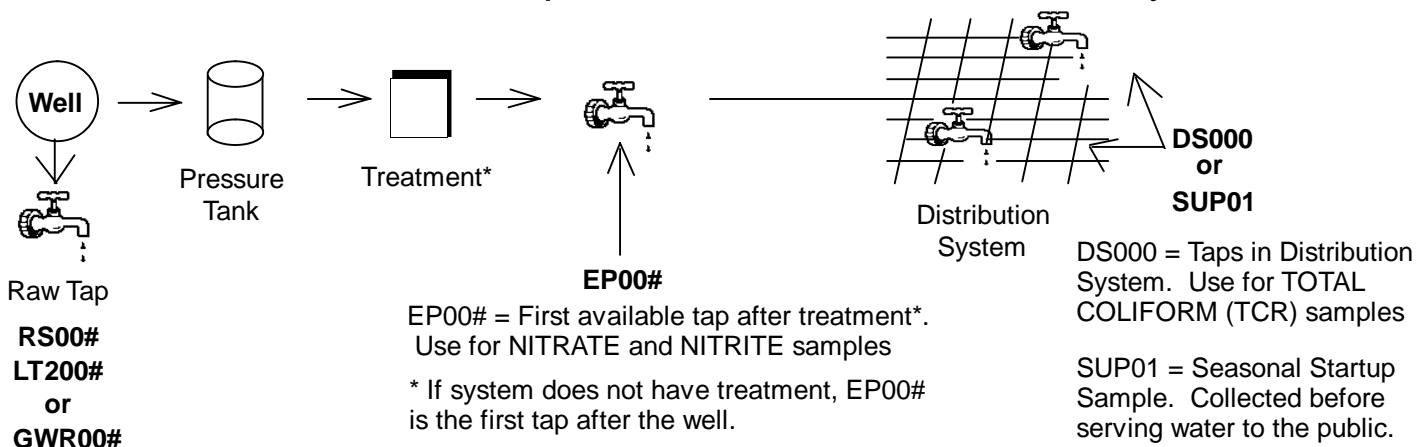

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3946012 BUURMA FARMS AMLC 2 PWS**

System Type: Transient Noncommunity

Operating Period: 5/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**


<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> BUURMA FARMS AMLC 2 DISTRIBUTION
<b>Location SMP ID:</b> SUP01	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	--

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

## Where to Collect Samples For a Small Public Water System

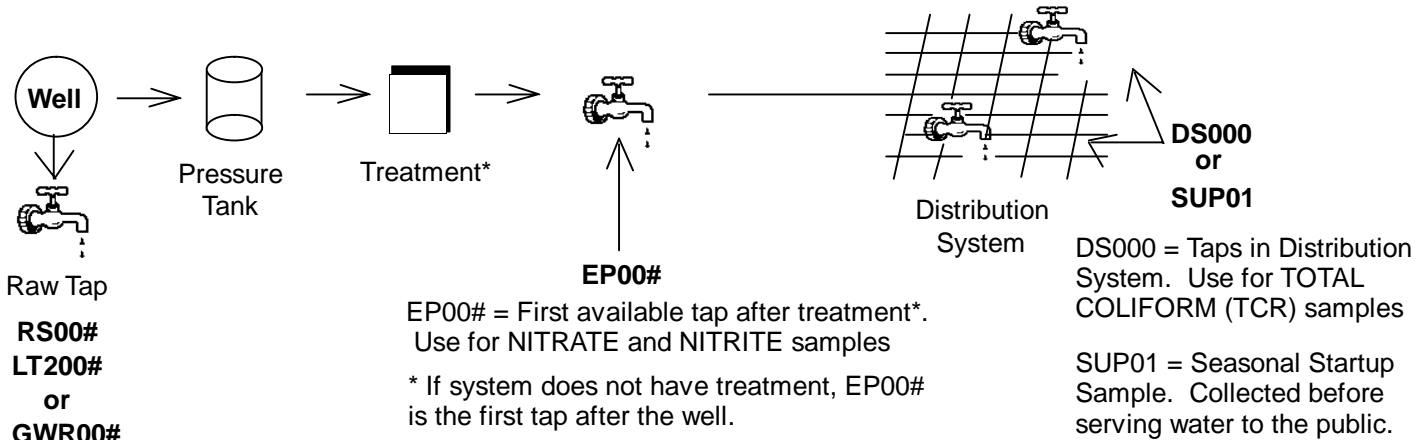

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

**Save a dime. Sample on time!**

**OH3946012 BUURMA FARMS AMLC 2 PWS**

System Type: Transient Noncommunity

Operating Period: 5/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> BUURMA FARMS AMLC 2 DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/7/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 11/30/2019

**Where to Collect Samples For a Small Public Water System**

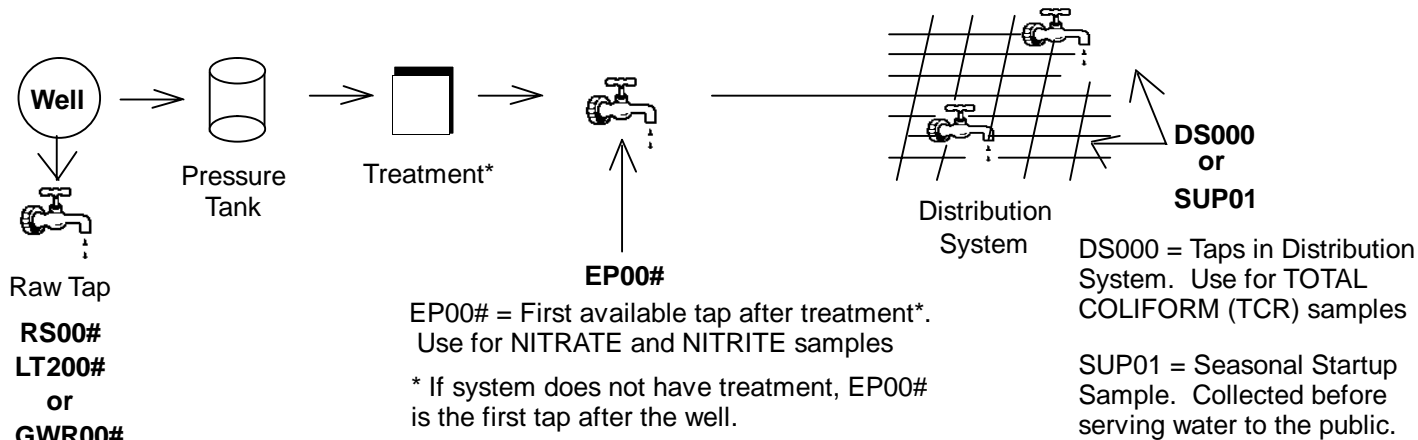

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

**Save a dime. Sample on time!**

**OH3946012 BUURMA FARMS AMLC 2 PWS**

System Type: Transient Noncommunity

Operating Period: 5/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **3955278** Facility Name: **BUURMA FARMS AMLC 2**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

**Chemicals**

**Monitoring Requirements**


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2019 and 10/31/2019

**Where to Collect Samples For a Small Public Water System**

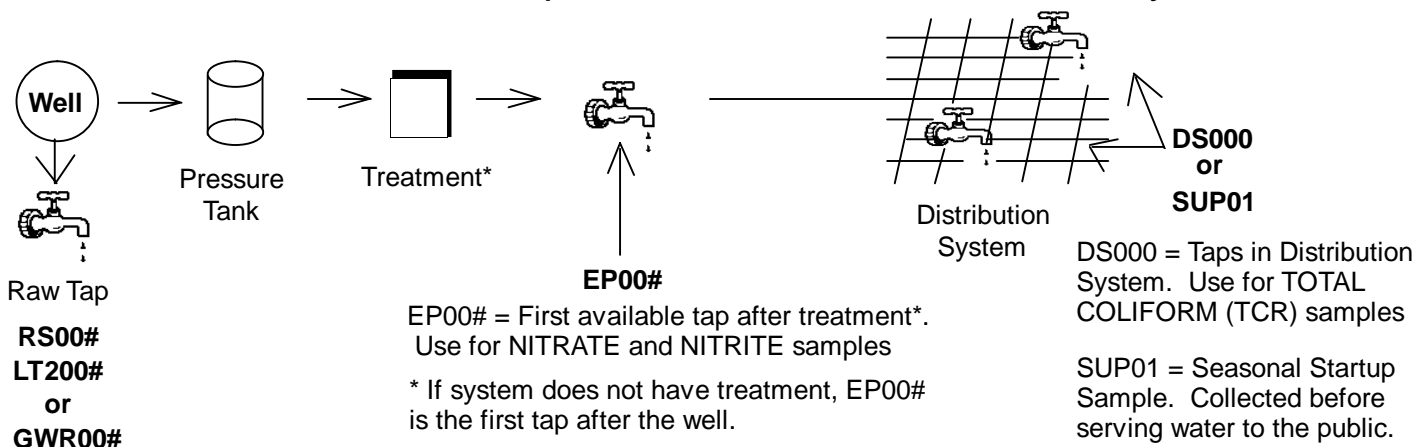

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3946312 KEKEKIST LTD AMLC**

System Type: Transient Noncommunity

Operating Period: 5/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> KEKEKIST LTD DISTRIBUTION
<b>Location SMP ID:</b> SUP01	<b>Facility Source:</b> Ground Water

**Chemicals**


**Monitoring Requirements**

TOTAL COLIFORM - SEASONAL STARTUP

At least 1 negative Total Coliform  
Bacteria sample prior to serving water to the public

**\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\***

**Where to Collect Samples For a Small Public Water System**

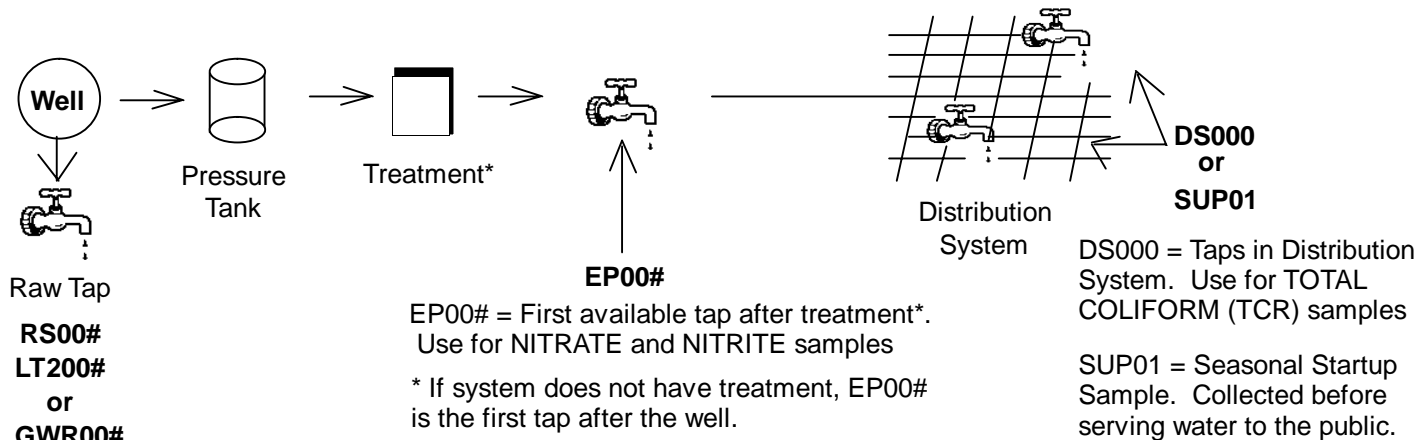

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**



**OH3946312 KEKEKIST LTD AMLC**

System Type: Transient Noncommunity

Operating Period: 5/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> KEKEKIST LTD DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019
	1 Sample(s) Required between 11/1/2019 and 11/30/2019

**Where to Collect Samples For a Small Public Water System**

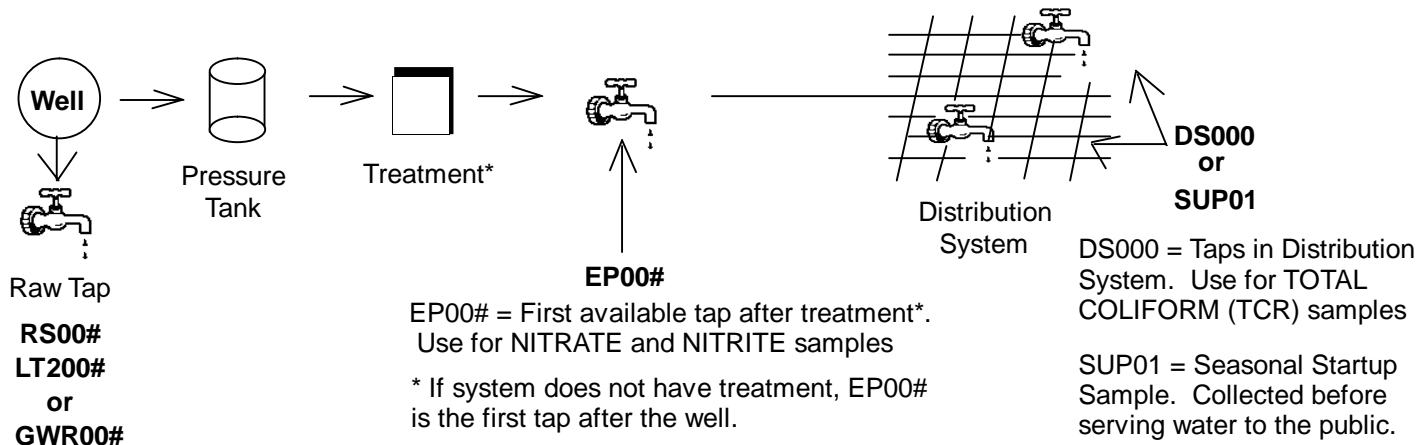

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3946312 KEKEKIST LTD AMLC**

System Type: Transient Noncommunity

Operating Period: 5/1 to 11/30

Ground Water Rule Minimal Treatment System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **3961015** Facility Name: **KEKEKIST LTD**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

**Chemicals**

**Monitoring Requirements**


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2019 and 10/31/2019

**Where to Collect Samples For a Small Public Water System**

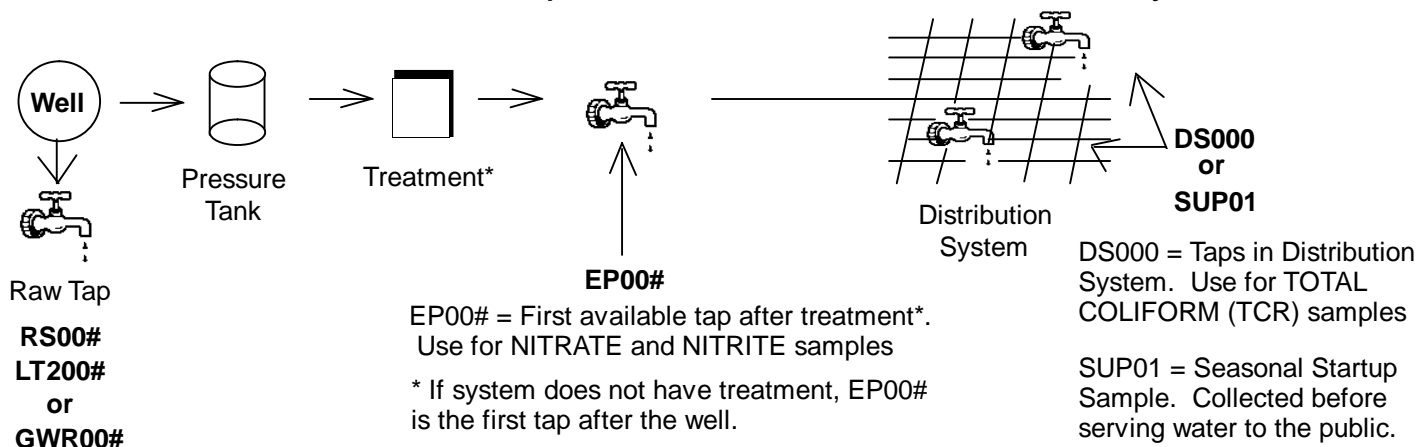

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3946412 FREEDOM VALLEY OF HURON COUNTY LLC**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> FREEDOM VALLEY OF HURON CO DISTRIBUTION
<b>Location SMP ID:</b> SUP01	<b>Facility Source:</b> Ground Water

**Chemicals**


**Monitoring Requirements**

TOTAL COLIFORM - SEASONAL STARTUP

At least 1 negative Total Coliform  
Bacteria sample prior to serving water to the public

\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\*

**Where to Collect Samples For a Small Public Water System**

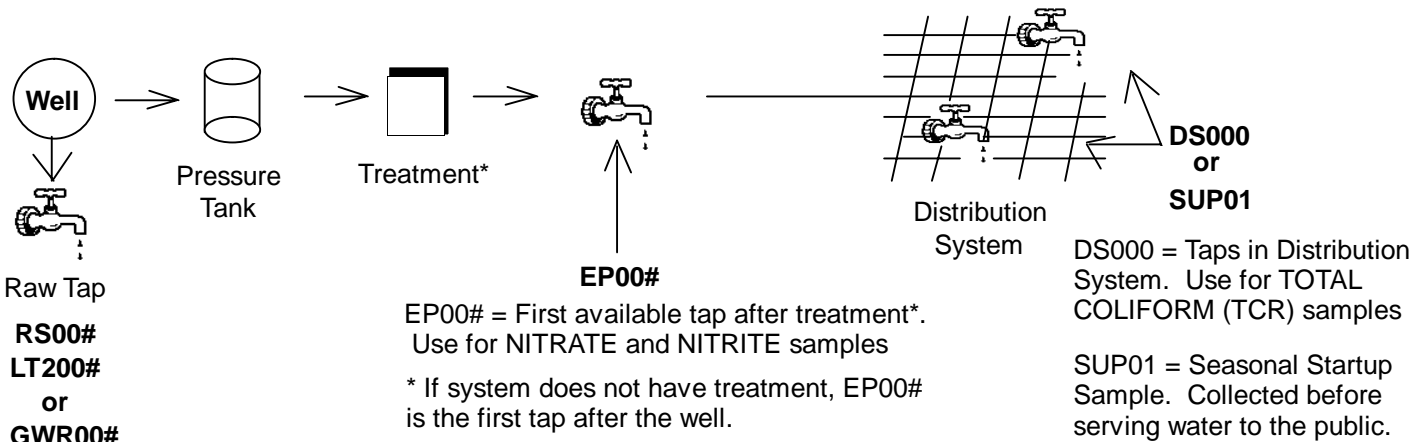

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

**Save a dime. Sample on time!**

**OH3946412 FREEDOM VALLEY OF HURON COUNTY LLC**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> FREEDOM VALLEY OF HURON CO DISTRIBUTION
<b>Location SMP ID:</b> DS000	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019

**Where to Collect Samples For a Small Public Water System**

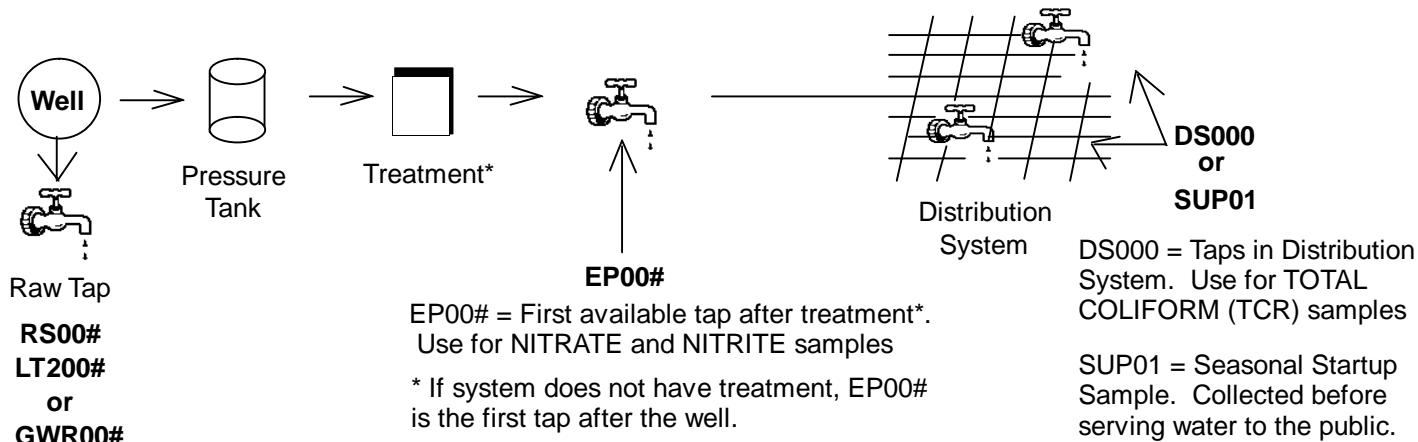

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3946412 FREEDOM VALLEY OF HURON COUNTY LLC**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

<b>Sampling Facility ID:</b> 3960838	<b>Facility Name:</b> FREEDOM VALLEY OF HURON COUNTY
<b>Location SMP ID:</b> EP001	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2019 and 5/31/2019

**Where to Collect Samples For a Small Public Water System**

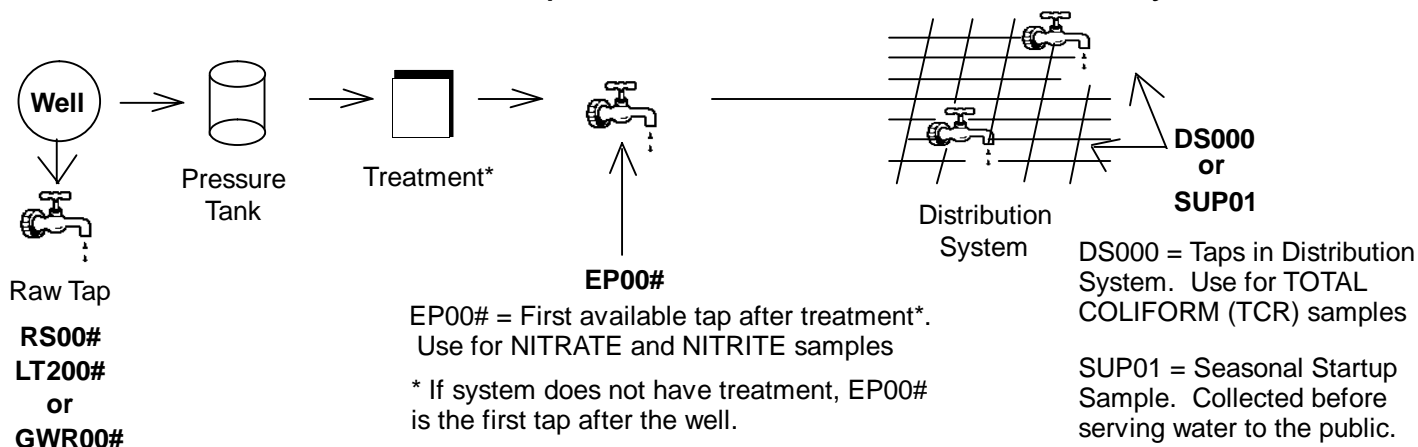

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

**Save a dime. Sample on time!**

**OH3946512 WIERS FARM AMLC #03/04 B**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**


<b>Sampling Facility ID:</b> DS1	<b>Facility Name:</b> WIERS FARM AMLC 3/4B DISTRIBUTION
<b>Location SMP ID:</b> SUP01	<b>Facility Source:</b> Ground Water

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public
-----------------------------------	--

**\*\*\* Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.\*\*\***

## Where to Collect Samples For a Small Public Water System

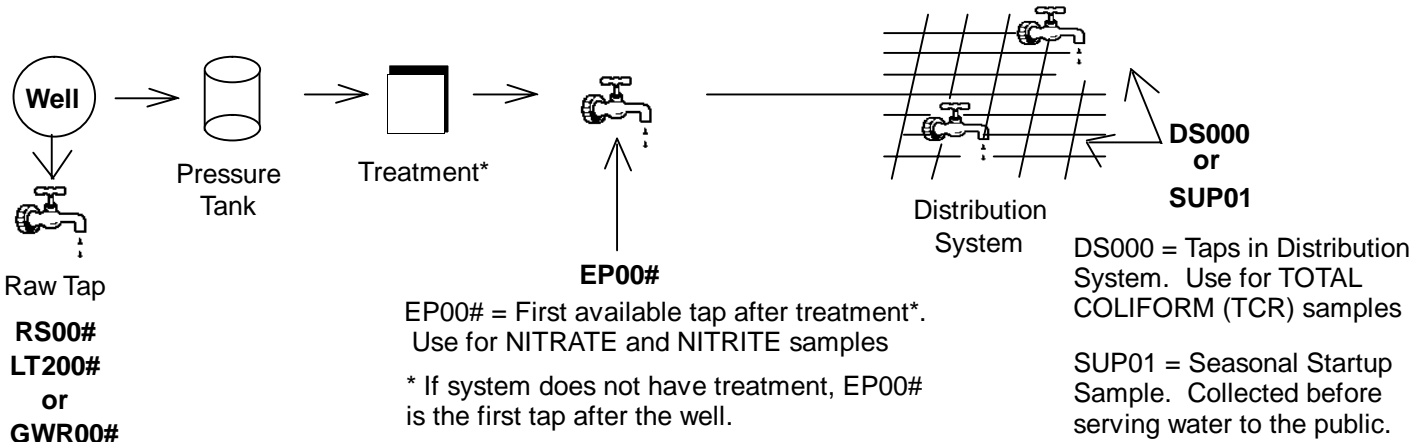

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3946512 WIERS FARM AMLC #03/04 B**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Facility ID: DS1</b>	<b>Facility Name: WIERS FARM AMLC 3/4B DISTRIBUTION</b>
<b>Location SMP ID: DS000</b>	<b>Facility Source: Ground Water</b>

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/16/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019

**Where to Collect Samples For a Small Public Water System**

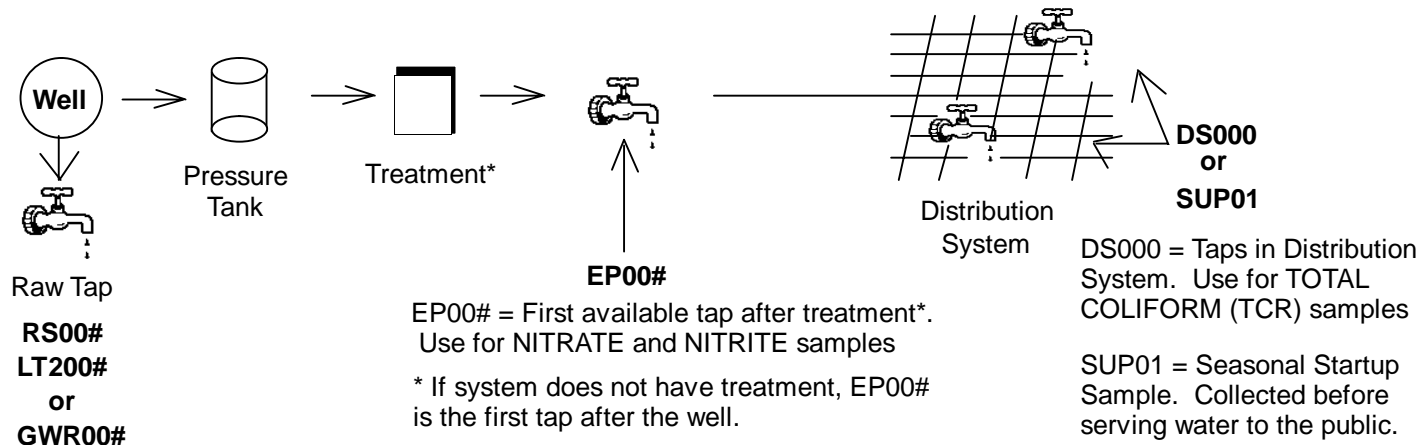

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**

**OH3946512 WIERS FARM AMLC #03/04 B**

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**ENTRY POINT MONITORING SCHEDULE**

**Sampling** Facility ID: **7061017** Facility Name: **WIERS FARM AMLC 3/4B**

**Location** SMP ID: **EP001** Facility Source: **Ground Water**

**Chemicals**

**Monitoring Requirements**


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2019 and 5/31/2019

**Where to Collect Samples For a Small Public Water System**

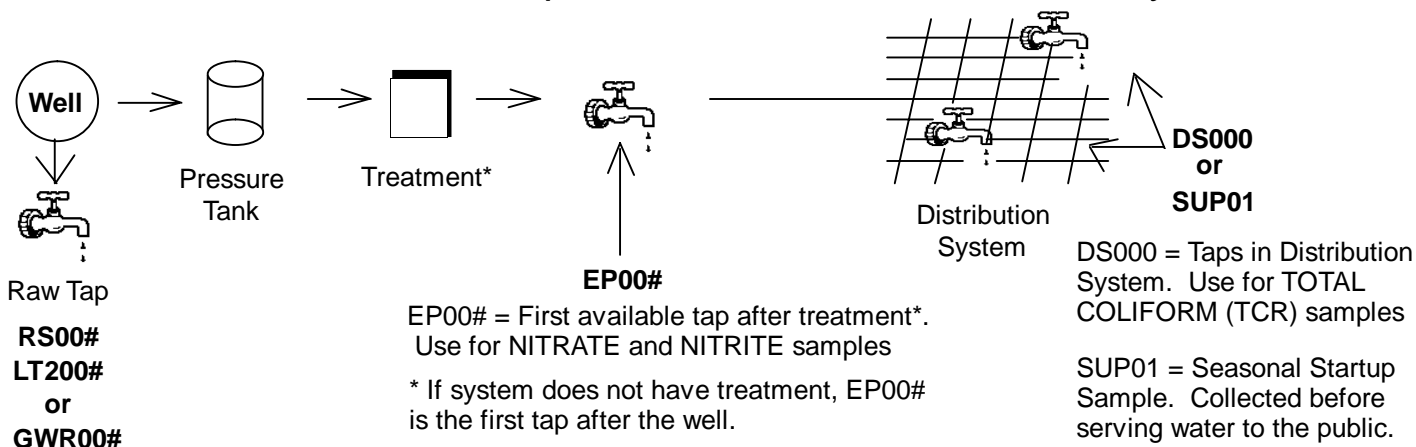

**Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.**

**Save a dime. Sample on time!**





**OH3946612 NORTHERN OHIO RURAL WATER - SE DISTRICT**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>NORTHERN OHIO RURAL WATER- SE DISTRICT</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>DS000</b>		

Chemicals	Monitoring Requirements		
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2019	and 1/31/2019
	1 Sample(s) Required between	2/1/2019	and 2/28/2019
	1 Sample(s) Required between	3/1/2019	and 3/31/2019
	1 Sample(s) Required between	4/1/2019	and 4/30/2019
	1 Sample(s) Required between	5/1/2019	and 5/31/2019
	1 Sample(s) Required between	6/1/2019	and 6/30/2019
	1 Sample(s) Required between	7/1/2019	and 7/31/2019
	1 Sample(s) Required between	8/1/2019	and 8/31/2019
	1 Sample(s) Required between	9/1/2019	and 9/30/2019
	1 Sample(s) Required between	10/1/2019	and 10/31/2019
	1 Sample(s) Required between	11/1/2019	and 11/30/2019
	1 Sample(s) Required between	12/1/2019	and 12/31/2019
TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2019	and 1/31/2019
	1 Sample(s) Required between	2/1/2019	and 2/28/2019
	1 Sample(s) Required between	3/1/2019	and 3/31/2019
	1 Sample(s) Required between	4/1/2019	and 4/30/2019
	1 Sample(s) Required between	5/1/2019	and 5/31/2019
	1 Sample(s) Required between	6/1/2019	and 6/30/2019
	1 Sample(s) Required between	7/1/2019	and 7/31/2019
	1 Sample(s) Required between	8/1/2019	and 8/31/2019
	1 Sample(s) Required between	9/1/2019	and 9/30/2019
	1 Sample(s) Required between	10/1/2019	and 10/31/2019
	1 Sample(s) Required between	11/1/2019	and 11/30/2019
	1 Sample(s) Required between	12/1/2019	and 12/31/2019

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>NORTHERN OHIO RURAL WATER- SE DISTRICT</b>	Facility Class: <b>CLASS 1</b>
	SMP ID: <b>DS201</b>	<b>257 TWP RD 1601</b>	

Chemicals	Monitoring Requirements		
DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2019	and 9/30/2019 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

**OH3946612 NORTHERN OHIO RURAL WATER - SE DISTRICT**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\*** Consumer Confidence Report (CCR) is due July 1, 2019

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>NORTHERN OHIO RURAL WATER- SE DISTRICT</b> Refer to your Lead and Copper plan for SMP IDs	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

**Chemicals Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2019 and 9/30/2019

*Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.*



OH3946712 NORW - SOUTH DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019

DISTRIBUTION MONITORING SCHEDULE

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS000</b>	Facility Name: <b>NORW - SOUTH DISTRICT DISTRIBUTION</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
ASBESTOS - 1094	Not Required
TOTAL COLIFORM (TCR) - 3100	6 Sample(s) Required between 1/1/2019 and 1/31/2019 6 Sample(s) Required between 2/1/2019 and 2/28/2019 6 Sample(s) Required between 3/1/2019 and 3/31/2019 6 Sample(s) Required between 4/1/2019 and 4/30/2019 6 Sample(s) Required between 5/1/2019 and 5/31/2019 6 Sample(s) Required between 6/1/2019 and 6/30/2019 6 Sample(s) Required between 7/1/2019 and 7/31/2019 6 Sample(s) Required between 8/1/2019 and 8/31/2019 6 Sample(s) Required between 9/1/2019 and 9/30/2019 6 Sample(s) Required between 10/1/2019 and 10/31/2019 6 Sample(s) Required between 11/1/2019 and 11/30/2019 6 Sample(s) Required between 12/1/2019 and 12/31/2019
TOTAL CHLORINE - 1000	6 Sample(s) Required between 1/1/2019 and 1/31/2019 6 Sample(s) Required between 2/1/2019 and 2/28/2019 6 Sample(s) Required between 3/1/2019 and 3/31/2019 6 Sample(s) Required between 4/1/2019 and 4/30/2019 6 Sample(s) Required between 5/1/2019 and 5/31/2019 6 Sample(s) Required between 6/1/2019 and 6/30/2019 6 Sample(s) Required between 7/1/2019 and 7/31/2019 6 Sample(s) Required between 8/1/2019 and 8/31/2019 6 Sample(s) Required between 9/1/2019 and 9/30/2019 6 Sample(s) Required between 10/1/2019 and 10/31/2019 6 Sample(s) Required between 11/1/2019 and 11/30/2019 6 Sample(s) Required between 12/1/2019 and 12/31/2019

Samples should be collected at the same time and place as the Total Coliform samples.

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS201</b>	Facility Name: <b>NORW - SOUTH DISTRICT DISTRIBUTION</b> <b>5403 GUISS ROAD</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2019 and 2/7/2019 at: DS201 Dual Sample Required between 5/1/2019 and 5/7/2019 at: DS201 Dual Sample Required between 8/1/2019 and 8/7/2019 at: DS201 Dual Sample Required between 11/1/2019 and 11/7/2019 at: DS201

Sample for all the analytes listed below:  
1) TOTAL HALOACETIC ACIDS (HAA5) – 2456  
2) TTHM - 2950



**OH3946712 NORW - SOUTH DISTRICT**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\*** Consumer Confidence Report (CCR) is due July 1, 2019

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>DS202</b>	Facility Name: <b>NORW - SOUTH DISTRICT DISTRIBUTION</b> <b>1750 NIVER ROAD</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	--	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2019 and 2/7/2019 at: DS202 Dual Sample Required between 5/1/2019 and 5/7/2019 at: DS202 Dual Sample Required between 8/1/2019 and 8/7/2019 at: DS202 Dual Sample Required between 11/1/2019 and 11/7/2019 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b> SMP ID: <b>LC###</b>	Facility Name: <b>NORW - SOUTH DISTRICT DISTRIBUTION</b> <b>Refer to your Lead and Copper plan for SMP IDs</b>	Facility Class: <b>CLASS 1</b>
--------------------------	---	---	--------------------------------

<b>Chemicals</b>	<b>Monitoring Requirements</b>
LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between 6/1/2019 and 9/30/2019

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



**OH3946912 FIRELANDS MANOR MHP PWS**

System Type: Community

Operating Period: 1/1 to 12/31

**THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**\*\* REMINDER: \*\* Consumer Confidence Report (CCR) is due July 1, 2019**

**DISTRIBUTION MONITORING SCHEDULE**

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>FIRELANDS MANOR MOBILE HOME PARK DIS</b>
	SMP ID: <b>DS000</b>	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 1/31/2019
	1 Sample(s) Required between 2/1/2019 and 2/28/2019
	1 Sample(s) Required between 3/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 4/30/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019
	1 Sample(s) Required between 11/1/2019 and 11/30/2019
	1 Sample(s) Required between 12/1/2019 and 12/31/2019

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>FIRELANDS MANOR MOBILE HOME PARK DIS</b>
	SMP ID: <b>DS201</b>	<b>ADDRESS NOT KNOWN</b>

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2019 and 9/30/2019 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

<b>Sampling Location</b>	Facility ID: <b>DS1</b>	Facility Name: <b>FIRELANDS MANOR MOBILE HOME PARK DIS</b>
	SMP ID: <b>LC###</b>	<b>Refer to your Lead and Copper plan for SMP IDs</b>

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2019 and 9/30/2019

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.