



OH8100112 CONVOY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 8159421	Facility Name: CONVOY VILLAGE STU 1	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.
 Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.
 Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

Chemicals	Monitoring Requirements
INORGANICS <i>Sample for all the analytes listed below:</i> ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	1 Sample(s) Required between 6/1/2019 and 10/31/2019
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2019 and 10/31/2019
RADIOLOGICALS <i>Sample for all the analytes listed below:</i> GROSS ALPHA - 4002 RADIUM-228 - 4030	1 Sample(s) Required between 6/1/2019 and 10/31/2019
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2019 and 10/31/2019



OH8100112 CONVOY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 8160620	Facility Name: CONVOY VILLAGE STU 2	Facility Class: CLASS 1
	SMP ID: EP002	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	6/1/2019 and 10/31/2019
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020		
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	6/1/2019 and 10/31/2019
RADIOLOGICALS	1 Sample(s) Required between	6/1/2019 and 10/31/2019
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002 RADIUM-228 - 4030		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	6/1/2019 and 10/31/2019



OH8100112 CONVOY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 8162394	Facility Name: CONVOY VILLAGE STU 3	Facility Class: CLASS 1
	SMP ID: EP003	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	6/1/2019 and 10/31/2019
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020		
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	6/1/2019 and 10/31/2019
RADIOLOGICALS	1 Sample(s) Required between	6/1/2019 and 10/31/2019
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002 RADIUM-228 - 4030		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	6/1/2019 and 10/31/2019



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

OH8100112 CONVOY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: CONVOY, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	-------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2019 and 1/31/2019
	2 Sample(s) Required between 2/1/2019 and 2/28/2019
	2 Sample(s) Required between 3/1/2019 and 3/31/2019
	2 Sample(s) Required between 4/1/2019 and 4/30/2019
	2 Sample(s) Required between 5/1/2019 and 5/31/2019
	2 Sample(s) Required between 6/1/2019 and 6/30/2019
	2 Sample(s) Required between 7/1/2019 and 7/31/2019
	2 Sample(s) Required between 8/1/2019 and 8/31/2019
	2 Sample(s) Required between 9/1/2019 and 9/30/2019
	2 Sample(s) Required between 10/1/2019 and 10/31/2019
	2 Sample(s) Required between 11/1/2019 and 11/30/2019
	2 Sample(s) Required between 12/1/2019 and 12/31/2019

TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2019 and 1/31/2019
	2 Sample(s) Required between 2/1/2019 and 2/28/2019
	2 Sample(s) Required between 3/1/2019 and 3/31/2019
	2 Sample(s) Required between 4/1/2019 and 4/30/2019
	2 Sample(s) Required between 5/1/2019 and 5/31/2019
	2 Sample(s) Required between 6/1/2019 and 6/30/2019
	2 Sample(s) Required between 7/1/2019 and 7/31/2019
	2 Sample(s) Required between 8/1/2019 and 8/31/2019
	2 Sample(s) Required between 9/1/2019 and 9/30/2019
	2 Sample(s) Required between 10/1/2019 and 10/31/2019
	2 Sample(s) Required between 11/1/2019 and 11/30/2019
	2 Sample(s) Required between 12/1/2019 and 12/31/2019

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: CONVOY, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	-----------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 3/1/2019 and 3/7/2019at: DS201
	Dual Sample Required between 6/1/2019 and 6/7/2019at: DS201
	Dual Sample Required between 9/1/2019 and 9/7/2019at: DS201
	Dual Sample Required between 12/1/2019 and 12/7/2019at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH8100112 CONVOY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: **** Consumer Confidence Report (CCR) is due July 1, 2019

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: CONVOY, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	-----------------------------------------------------------------------------------	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between 3/1/2019 and 3/7/2019at: DS202
	Dual Sample Required between 6/1/2019 and 6/7/2019at: DS202
	Dual Sample Required between 9/1/2019 and 9/7/2019at: DS202
	Dual Sample Required between 12/1/2019 and 12/7/2019at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: CONVOY, VILLAGE OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	----------------------------------------------------------------------------------------------------------------	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2019 and 9/30/2019
-------------------------------	------------------------------------------------------

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH8100312 MIDDLE POINT VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 8162463	Facility Name: MIDDLE POINT NEW WTP 2	Facility Class: CLASS 1
	SMP ID: EP002	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	6/1/2019 and 10/31/2019
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	6/1/2019 and 10/31/2019
RADIOLOGICALS	1 Sample(s) Required between	6/1/2019 and 10/31/2019
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002 RADIUM-228 - 4030		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	7/1/2019 and 9/30/2019



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

OH8100312 MIDDLE POINT VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MIDDLE POINT, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	-------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 1/31/2019 1 Sample(s) Required between 2/1/2019 and 2/28/2019 1 Sample(s) Required between 3/1/2019 and 3/31/2019 1 Sample(s) Required between 4/1/2019 and 4/30/2019 1 Sample(s) Required between 5/1/2019 and 5/31/2019 1 Sample(s) Required between 6/1/2019 and 6/30/2019 1 Sample(s) Required between 7/1/2019 and 7/31/2019 1 Sample(s) Required between 8/1/2019 and 8/31/2019 1 Sample(s) Required between 9/1/2019 and 9/30/2019 1 Sample(s) Required between 10/1/2019 and 10/31/2019 1 Sample(s) Required between 11/1/2019 and 11/30/2019 1 Sample(s) Required between 12/1/2019 and 12/31/2019
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2019 and 1/31/2019 1 Sample(s) Required between 2/1/2019 and 2/28/2019 1 Sample(s) Required between 3/1/2019 and 3/31/2019 1 Sample(s) Required between 4/1/2019 and 4/30/2019 1 Sample(s) Required between 5/1/2019 and 5/31/2019 1 Sample(s) Required between 6/1/2019 and 6/30/2019 1 Sample(s) Required between 7/1/2019 and 7/31/2019 1 Sample(s) Required between 8/1/2019 and 8/31/2019 1 Sample(s) Required between 9/1/2019 and 9/30/2019 1 Sample(s) Required between 10/1/2019 and 10/31/2019 1 Sample(s) Required between 11/1/2019 and 11/30/2019 1 Sample(s) Required between 12/1/2019 and 12/31/2019

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MIDDLE POINT, VILLAGE OF DISTRIBUTION 507 EASTVIEW ST	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	---------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 3/1/2019 and 3/7/2019at: DS201 Dual Sample Required between 6/1/2019 and 6/7/2019at: DS201 Dual Sample Required between 9/1/2019 and 9/7/2019at: DS201 Dual Sample Required between 12/1/2019 and 12/7/2019at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

OH8100312 MIDDLE POINT VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: MIDDLE POINT, VILLAGE OF DISTRIBUTION 103 N ADAMS ST	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	--------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 3/1/2019 and 3/7/2019at: DS202
	Dual Sample Required between 6/1/2019 and 6/7/2019at: DS202
	Dual Sample Required between 9/1/2019 and 9/7/2019at: DS202
	Dual Sample Required between 12/1/2019 and 12/7/2019at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: MIDDLE POINT, VILLAGE OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	----------------------------------------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required



OH8100412 OHIO CITY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 8161766	Facility Name: OHIO CITY WTP -WATER PLANT 2	Facility Class: CLASS 1
	SMP ID: EP003	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	6/1/2019 and 10/31/2019
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	6/1/2019 and 10/31/2019
RADIOLOGICALS	1 Sample(s) Required between	6/1/2019 and 10/31/2019
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002 RADIUM-228 - 4030		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	6/1/2019 and 10/31/2019



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

OH8100412 OHIO CITY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: OHIO CITY, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	----------------------------------------------------------	--------------------------------

Chemicals Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2019	and	1/31/2019
	1 Sample(s) Required between	2/1/2019	and	2/28/2019
	1 Sample(s) Required between	3/1/2019	and	3/31/2019
	1 Sample(s) Required between	4/1/2019	and	4/30/2019
	1 Sample(s) Required between	5/1/2019	and	5/31/2019
	1 Sample(s) Required between	6/1/2019	and	6/30/2019
	1 Sample(s) Required between	7/1/2019	and	7/31/2019
	1 Sample(s) Required between	8/1/2019	and	8/31/2019
	1 Sample(s) Required between	9/1/2019	and	9/30/2019
	1 Sample(s) Required between	10/1/2019	and	10/31/2019
	1 Sample(s) Required between	11/1/2019	and	11/30/2019
	1 Sample(s) Required between	12/1/2019	and	12/31/2019

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2019	and	1/31/2019
	1 Sample(s) Required between	2/1/2019	and	2/28/2019
	1 Sample(s) Required between	3/1/2019	and	3/31/2019
	1 Sample(s) Required between	4/1/2019	and	4/30/2019
	1 Sample(s) Required between	5/1/2019	and	5/31/2019
	1 Sample(s) Required between	6/1/2019	and	6/30/2019
	1 Sample(s) Required between	7/1/2019	and	7/31/2019
	1 Sample(s) Required between	8/1/2019	and	8/31/2019
	1 Sample(s) Required between	9/1/2019	and	9/30/2019
	1 Sample(s) Required between	10/1/2019	and	10/31/2019
	1 Sample(s) Required between	11/1/2019	and	11/30/2019
	1 Sample(s) Required between	12/1/2019	and	12/31/2019

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: OHIO CITY, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	--------------------------------------------------------------------------------------	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2019	and	9/30/2019	at: DS201
-------------------------	------------------------------	----------	-----	-----------	-----------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

OH8100412 OHIO CITY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: OHIO CITY, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	--------------------------------------------------------------------------------------	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2019 and 9/30/2019at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: OHIO CITY, VILLAGE OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	-------------------------------------------------------------------------------------------------------------------	--------------------------------

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022

10 Sample(s) Required between 6/1/2019 and 9/30/2019

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH8100611 VAN WERT CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 8159424	Facility Name: VAN WERT CITY	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

Chemicals	Monitoring Requirements		
INORGANICS	1 Sample(s) Required between	6/1/2019 and	10/31/2019
<i>Sample for all the analytes listed below:</i>			
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020			
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085			
NITRITE - 1041	Not Required		
NITRATE - 1040	1 Sample(s) Required between	1/1/2019 and	1/31/2019
	1 Sample(s) Required between	2/1/2019 and	2/28/2019
	1 Sample(s) Required between	3/1/2019 and	3/31/2019
	1 Sample(s) Required between	4/1/2019 and	4/30/2019
	1 Sample(s) Required between	5/1/2019 and	5/31/2019
	1 Sample(s) Required between	6/1/2019 and	6/30/2019
	1 Sample(s) Required between	7/1/2019 and	7/31/2019
	1 Sample(s) Required between	8/1/2019 and	8/31/2019
	1 Sample(s) Required between	9/1/2019 and	9/30/2019
	1 Sample(s) Required between	10/1/2019 and	10/31/2019
	1 Sample(s) Required between	11/1/2019 and	11/30/2019
	1 Sample(s) Required between	12/1/2019 and	12/31/2019
RADIOLOGICALS	1 Sample(s) Required between	6/1/2019 and	10/31/2019
<i>Sample for all the analytes listed below:</i>			
GROSS ALPHA - 4002 RADIUM-228 - 4030			
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	4/1/2019 and	4/30/2019
	1 Sample(s) Required between	5/1/2019 and	5/31/2019
	1 Sample(s) Required between	6/1/2019 and	6/30/2019
<i>Sample for all the analytes listed below:</i>			
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037			
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	6/1/2019 and	10/31/2019
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between	1/1/2019 and	1/31/2019
	1 Paired Sample Set Required between	2/1/2019 and	2/28/2019
	1 Paired Sample Set Required between	3/1/2019 and	3/31/2019
	1 Paired Sample Set Required between	4/1/2019 and	4/30/2019
	1 Paired Sample Set Required between	5/1/2019 and	5/31/2019
	1 Paired Sample Set Required between	6/1/2019 and	6/30/2019
	1 Paired Sample Set Required between	7/1/2019 and	7/31/2019
	1 Paired Sample Set Required between	8/1/2019 and	8/31/2019
	1 Paired Sample Set Required between	9/1/2019 and	9/30/2019
	1 Paired Sample Set Required between	10/1/2019 and	10/31/2019
	1 Paired Sample Set Required between	11/1/2019 and	11/30/2019
	1 Paired Sample Set Required between	12/1/2019 and	12/31/2019

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



OH8100611 VAN WERT CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 8159424	Facility Name: VAN WERT CITY	
Location	SMP ID: EP001/LT2001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

Chemicals

Monitoring Requirements

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY*

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.

**Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH8100611 VAN WERT CITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 8159424	Facility Name: VAN WERT CITY	Facility Class: CLASS 3
	SMP ID: LT2001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/30/2018 and 1/5/2019
	1 Sample(s) Required between 1/13/2019 and 1/19/2019
	1 Sample(s) Required between 1/27/2019 and 2/2/2019
	1 Sample(s) Required between 2/10/2019 and 2/16/2019
	1 Sample(s) Required between 2/24/2019 and 3/2/2019
	1 Sample(s) Required between 3/10/2019 and 3/16/2019
	1 Sample(s) Required between 3/24/2019 and 3/30/2019
	1 Sample(s) Required between 4/7/2019 and 4/13/2019
	1 Sample(s) Required between 4/21/2019 and 4/27/2019
	1 Sample(s) Required between 5/5/2019 and 5/11/2019
	1 Sample(s) Required between 5/19/2019 and 5/25/2019
	1 Sample(s) Required between 6/2/2019 and 6/8/2019
	1 Sample(s) Required between 6/16/2019 and 6/22/2019
	1 Sample(s) Required between 6/30/2019 and 7/6/2019
	1 Sample(s) Required between 7/14/2019 and 7/20/2019
	1 Sample(s) Required between 7/28/2019 and 8/3/2019
	1 Sample(s) Required between 8/11/2019 and 8/17/2019
	1 Sample(s) Required between 8/25/2019 and 8/31/2019
	1 Sample(s) Required between 9/8/2019 and 9/14/2019
	1 Sample(s) Required between 9/22/2019 and 9/28/2019
1 Sample(s) Required between 10/6/2019 and 10/12/2019	
1 Sample(s) Required between 10/20/2019 and 10/26/2019	
1 Sample(s) Required between 11/3/2019 and 11/9/2019	
1 Sample(s) Required between 11/17/2019 and 11/23/2019	
1 Sample(s) Required between 12/1/2019 and 12/7/2019	
1 Sample(s) Required between 12/15/2019 and 12/21/2019	

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.



OH8100611 VAN WERT CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: VAN WERT CITY DISTRIBUTION	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	--------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM (TCR) - 3100	10 Sample(s) Required between 1/1/2019 and 1/31/2019
	10 Sample(s) Required between 2/1/2019 and 2/28/2019
	10 Sample(s) Required between 3/1/2019 and 3/31/2019
	10 Sample(s) Required between 4/1/2019 and 4/30/2019
	10 Sample(s) Required between 5/1/2019 and 5/31/2019
	10 Sample(s) Required between 6/1/2019 and 6/30/2019
	10 Sample(s) Required between 7/1/2019 and 7/31/2019
	10 Sample(s) Required between 8/1/2019 and 8/31/2019
	10 Sample(s) Required between 9/1/2019 and 9/30/2019
	10 Sample(s) Required between 10/1/2019 and 10/31/2019
	10 Sample(s) Required between 11/1/2019 and 11/30/2019
	10 Sample(s) Required between 12/1/2019 and 12/31/2019

TOTAL CHLORINE - 1000	10 Sample(s) Required between 1/1/2019 and 1/31/2019
	10 Sample(s) Required between 2/1/2019 and 2/28/2019
	10 Sample(s) Required between 3/1/2019 and 3/31/2019
	10 Sample(s) Required between 4/1/2019 and 4/30/2019
	10 Sample(s) Required between 5/1/2019 and 5/31/2019
	10 Sample(s) Required between 6/1/2019 and 6/30/2019
	10 Sample(s) Required between 7/1/2019 and 7/31/2019
	10 Sample(s) Required between 8/1/2019 and 8/31/2019
	10 Sample(s) Required between 9/1/2019 and 9/30/2019
	10 Sample(s) Required between 10/1/2019 and 10/31/2019
	10 Sample(s) Required between 11/1/2019 and 11/30/2019
	10 Sample(s) Required between 12/1/2019 and 12/31/2019

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: VAN WERT CITY DISTRIBUTION WASTEWATER PLANT GATE HYDRANT 2115	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	-------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2019 and 2/14/2019at: DS201
	Dual Sample Required between 5/8/2019 and 5/14/2019at: DS201
	Dual Sample Required between 8/8/2019 and 8/14/2019at: DS201
	Dual Sample Required between 11/8/2019 and 11/14/2019at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH8100611 VAN WERT CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: **** Consumer Confidence Report (CCR) is due July 1, 2019

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: VAN WERT CITY DISTRIBUTION SOUTH WATER TOWER DRAIN	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2019 and 2/14/2019at: DS202
	Dual Sample Required between 5/8/2019 and 5/14/2019at: DS202
	Dual Sample Required between 8/8/2019 and 8/14/2019at: DS202
	Dual Sample Required between 11/8/2019 and 11/14/2019at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS203	Facility Name: VAN WERT CITY DISTRIBUTION 800 N. WASHINGTON ST.	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	----------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2019 and 2/14/2019at: DS203
	Dual Sample Required between 5/8/2019 and 5/14/2019at: DS203
	Dual Sample Required between 8/8/2019 and 8/14/2019at: DS203
	Dual Sample Required between 11/8/2019 and 11/14/2019at: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: VAN WERT CITY DISTRIBUTION BURT/CABLE HYDRANT 2089	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2019 and 2/14/2019at: DS204
	Dual Sample Required between 5/8/2019 and 5/14/2019at: DS204
	Dual Sample Required between 8/8/2019 and 8/14/2019at: DS204
	Dual Sample Required between 11/8/2019 and 11/14/2019at: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

OH8100611 VAN WERT CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: VAN WERT CITY DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	-----------------------------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	30 Sample(s) Required between 6/1/2019 and 9/30/2019
-------------------------------	------------------------------------------------------

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH8100712 RIDGEVIEW BEHAVIORAL HOSPITAL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 8159425	Facility Name: RIDGEVIEW BEHAVIORAL HOSPITAL	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2019 and 10/31/2019

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2019 and 10/31/2019

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2019 and 10/31/2019



OH8100712 RIDGEVIEW BEHAVIORAL HOSPITAL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: RIDGEVIEW HOSPITAL DISTRIBUTION
--------------------------	-------------------------------------------------	-------------------------------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019 1 Sample(s) Required between 4/1/2019 and 6/30/2019 1 Sample(s) Required between 7/1/2019 and 9/30/2019 1 Sample(s) Required between 10/1/2019 and 12/31/2019

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: RIDGEVIEW HOSPITAL DISTRIBUTION 17872 LINCOLN HWY, MIDDLE POINT
--------------------------	-------------------------------------------------	-------------------------------------------------------------------------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2019 and 9/30/2019at: DS201

Sample for all the analytes listed below:
1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: RIDGEVIEW HOSPITAL DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs
--------------------------	-------------------------------------------------	----------------------------------------------------------------------------------------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2019 and 9/30/2019

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH8100911 WILLSHIRE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 8159426	Facility Name: WILLSHIRE VILLAGE	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2019 and 10/31/2019
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2019 and 10/31/2019
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2019 and 10/31/2019



Effective Date: 01/01/2019

2019 DISTRIBUTION SCHEDULE

OH8100911 WILLSHIRE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: WILLSHIRE VILLAGE DISTRIBUTION SYSTEM	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	-------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 1/31/2019 1 Sample(s) Required between 2/1/2019 and 2/28/2019 1 Sample(s) Required between 3/1/2019 and 3/31/2019 1 Sample(s) Required between 4/1/2019 and 4/30/2019 1 Sample(s) Required between 5/1/2019 and 5/31/2019 1 Sample(s) Required between 6/1/2019 and 6/30/2019 1 Sample(s) Required between 7/1/2019 and 7/31/2019 1 Sample(s) Required between 8/1/2019 and 8/31/2019 1 Sample(s) Required between 9/1/2019 and 9/30/2019 1 Sample(s) Required between 10/1/2019 and 10/31/2019 1 Sample(s) Required between 11/1/2019 and 11/30/2019 1 Sample(s) Required between 12/1/2019 and 12/31/2019
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2019 and 1/31/2019 1 Sample(s) Required between 2/1/2019 and 2/28/2019 1 Sample(s) Required between 3/1/2019 and 3/31/2019 1 Sample(s) Required between 4/1/2019 and 4/30/2019 1 Sample(s) Required between 5/1/2019 and 5/31/2019 1 Sample(s) Required between 6/1/2019 and 6/30/2019 1 Sample(s) Required between 7/1/2019 and 7/31/2019 1 Sample(s) Required between 8/1/2019 and 8/31/2019 1 Sample(s) Required between 9/1/2019 and 9/30/2019 1 Sample(s) Required between 10/1/2019 and 10/31/2019 1 Sample(s) Required between 11/1/2019 and 11/30/2019 1 Sample(s) Required between 12/1/2019 and 12/31/2019

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: WILLSHIRE VILLAGE DISTRIBUTION SYSTEM 18182 STATE ROUTE 49	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	--------------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2019 and 9/30/2019at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH8100911 WILLSHIRE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2019**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: WILLSHIRE VILLAGE DISTRIBUTION SYSTEM 103 HOGAN ST	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2019 and 9/30/2019at: DS202
-------------------------	--------------------------------------------------------------

- Sample for all the analytes listed below:
- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
 - 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: WILLSHIRE VILLAGE DISTRIBUTION SYSTEM Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	----------------------------------------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2019 and 9/30/2019
-------------------------------	-----------------------------------------------------

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH8130612 BROOKSIDE DAIRY & CONVENIENCE STORE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BROOKSIDE DAIRY DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

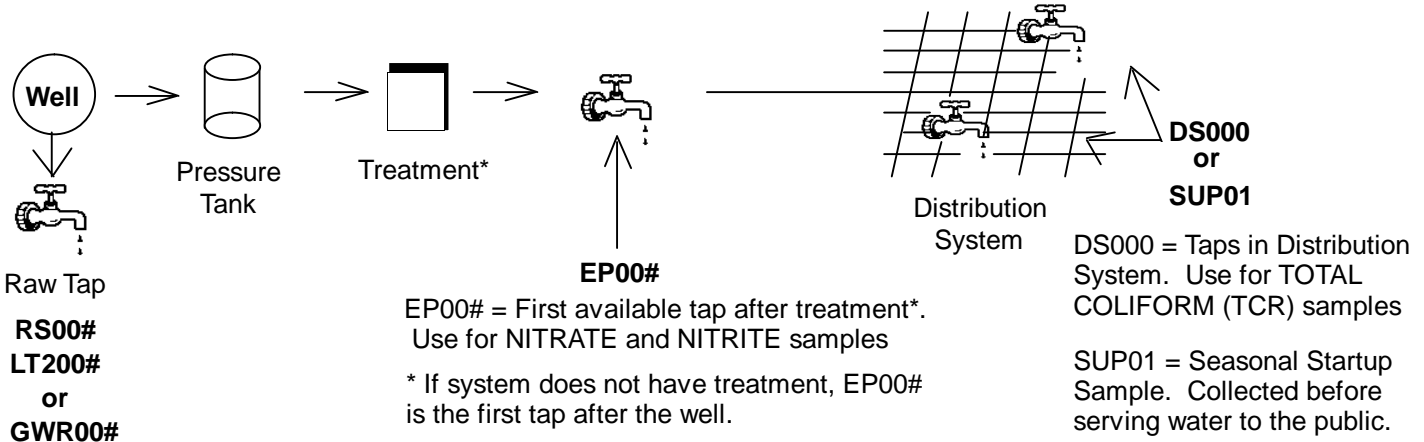

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8130612 BROOKSIDE DAIRY & CONVENIENCE STORE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 8159428	Facility Name: BROOKSIDE DAIRY
Location SMP ID: EP001	Facility Source: Ground Water
Facility Class: CLASS A	

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

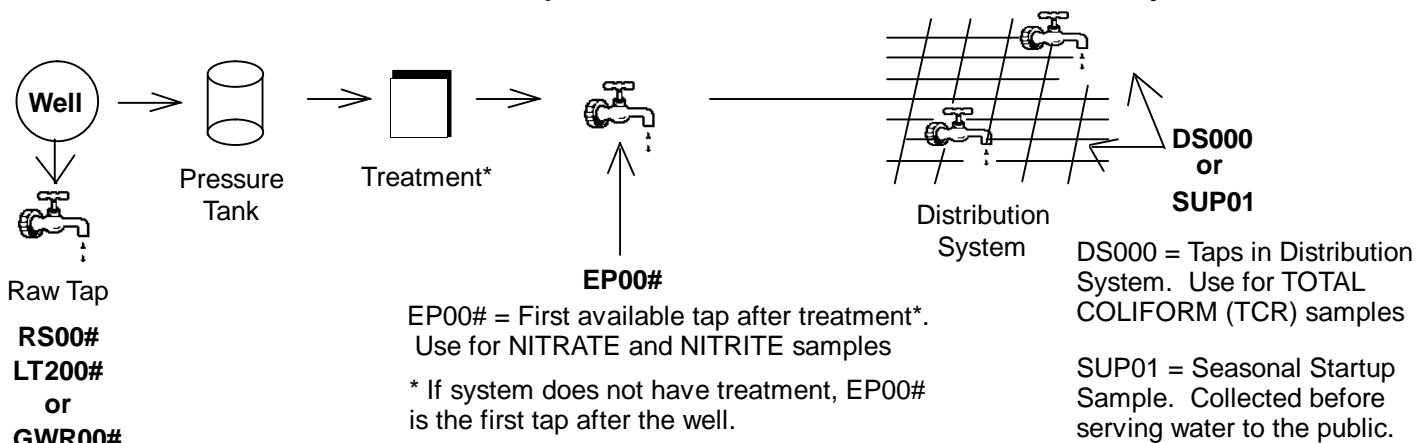

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8131112 VAN WERT CINEMAS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: VAN WERT CINEMAS DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

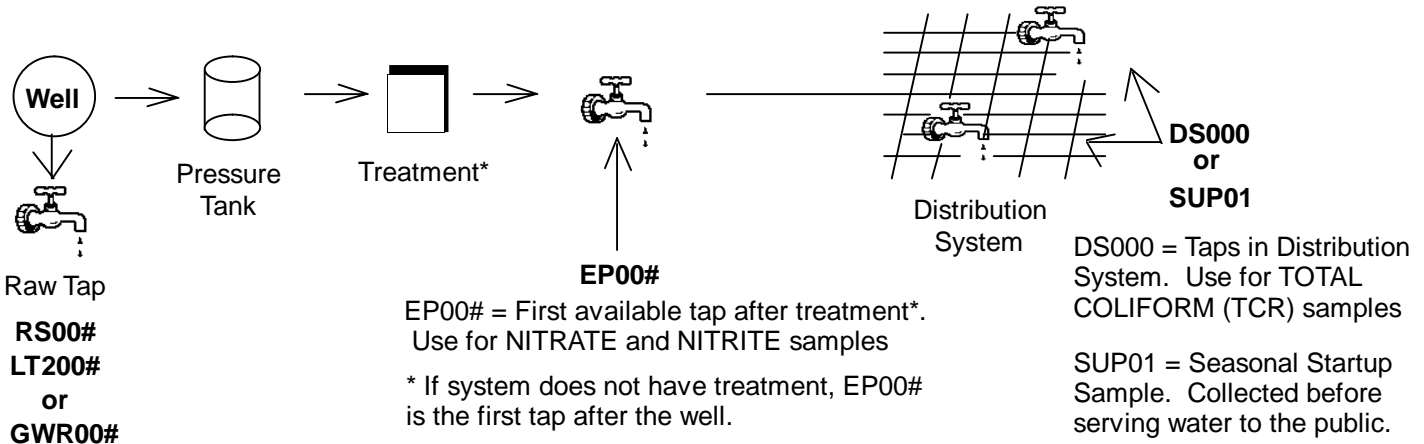

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8131112 VAN WERT CINEMAS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159432** Facility Name: **VAN WERT CINEMAS**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

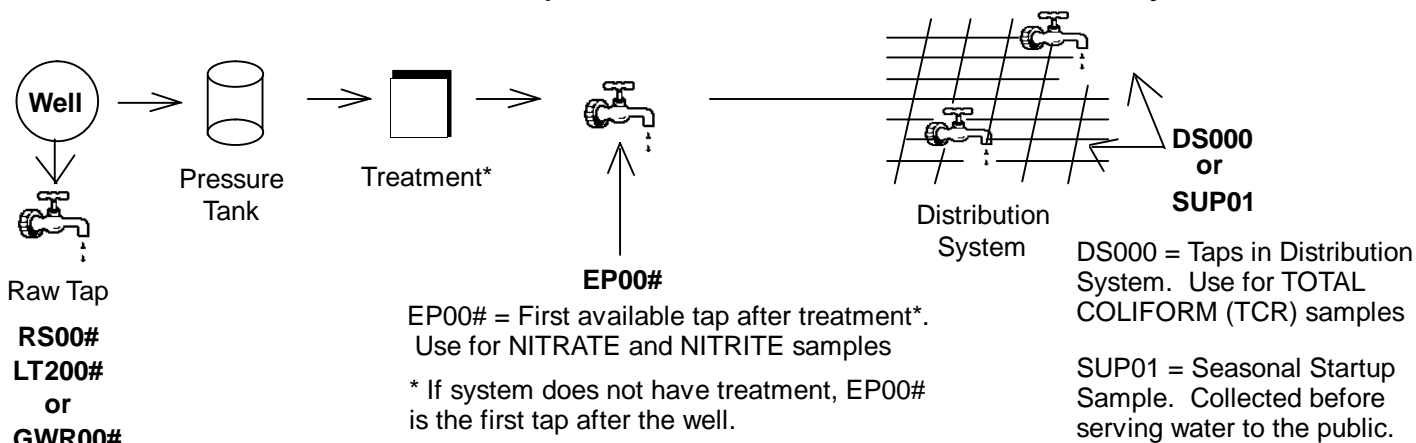

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8131212 RAMBLERS ROOST RESTAURANT & TRUCK STOP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: RAMBLERS ROOST DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

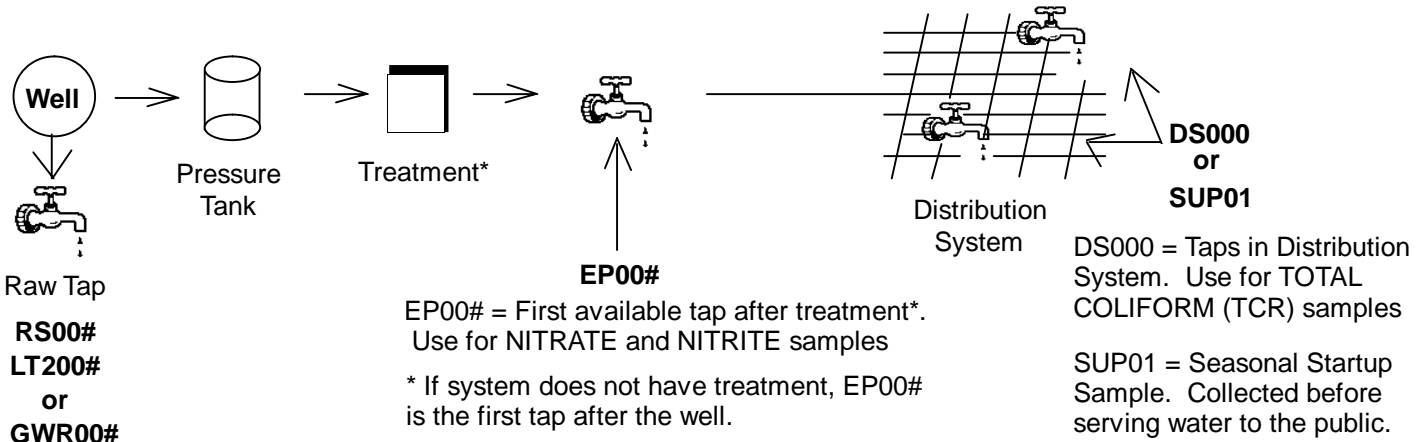

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8131212 RAMBLERS ROOST RESTAURANT & TRUCK STOP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159433** Facility Name: **RAMBLERS ROOST**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

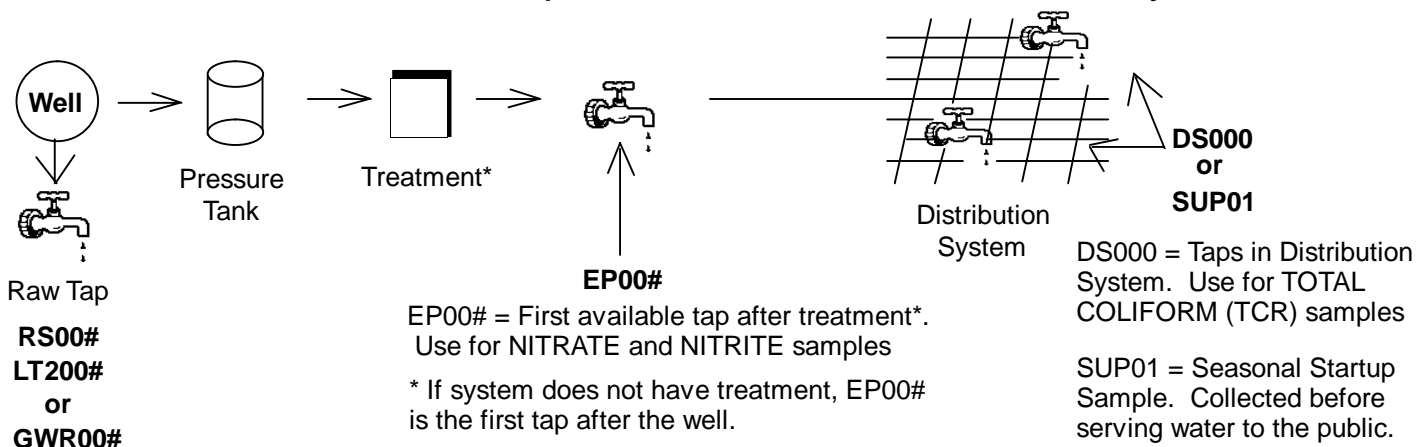

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8131312 COUNTRYSIDE CHAPEL UM CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: COUNTRYSIDE CHAPEL UM DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

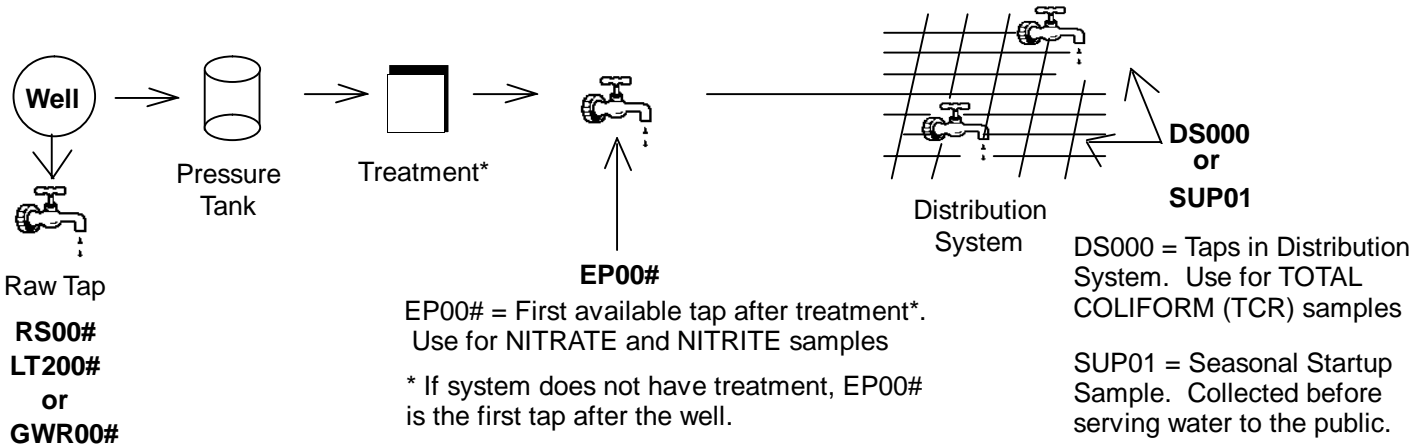

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8131312 COUNTRYSIDE CHAPEL UM CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159434** Facility Name: **COUNTRYSIDE CHAPEL UM**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

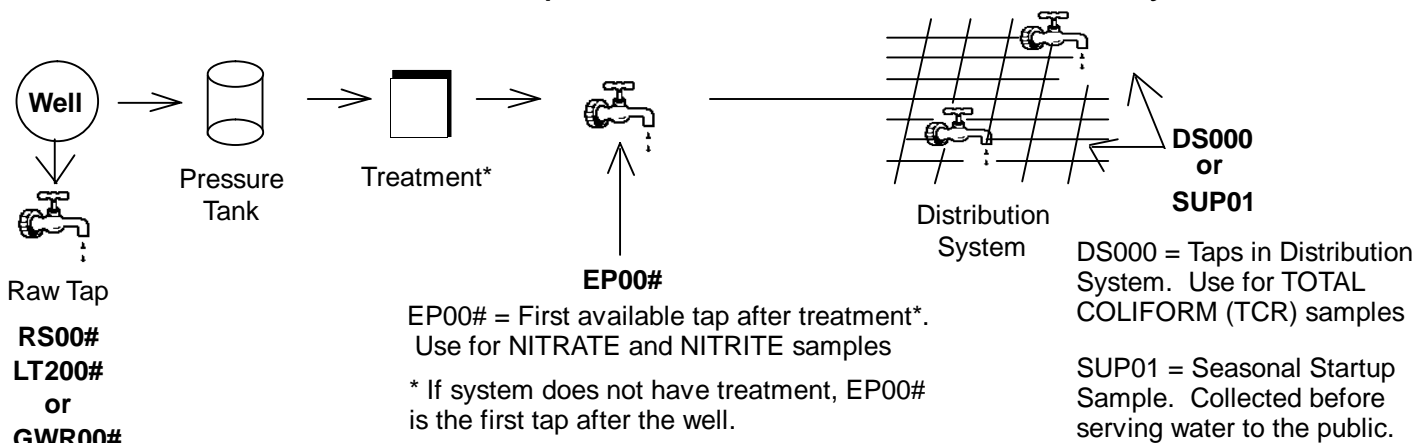

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8131712 E & R TRAILER SALES

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: E AND R TRAILER SALES DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

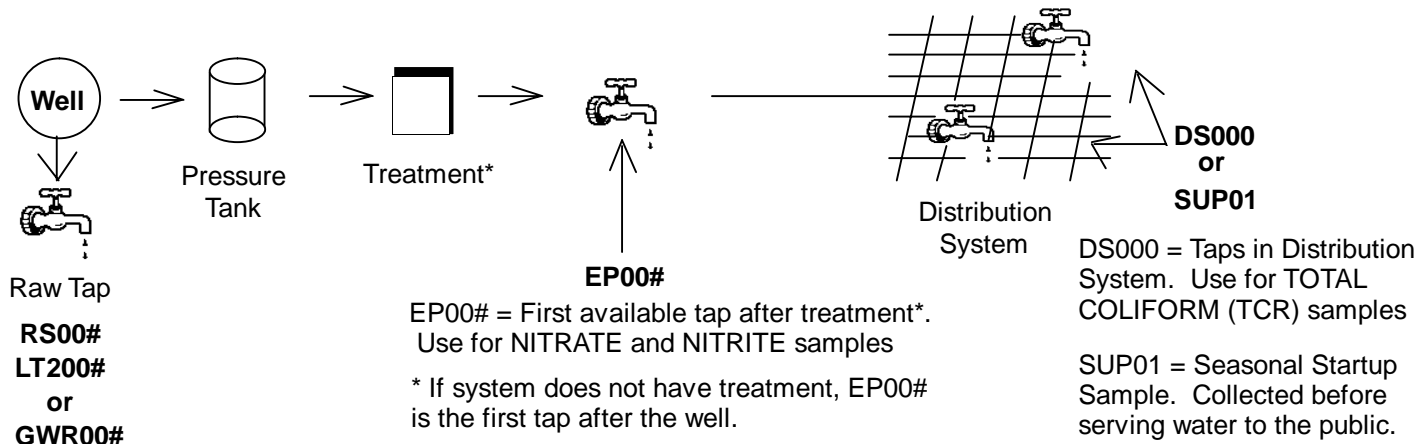

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8131712 E & R TRAILER SALES

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159436** Facility Name: **E AND R TRAILER SALES**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

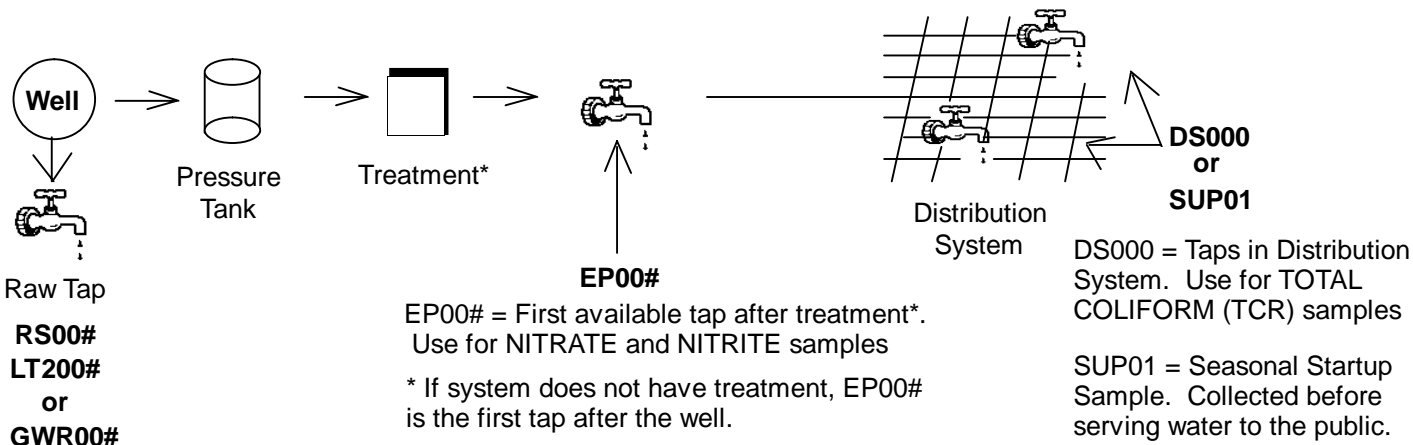

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8131812 YMCA OF VAN WERT COUNTY

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HICKORY STICKS GOLF CLUB DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

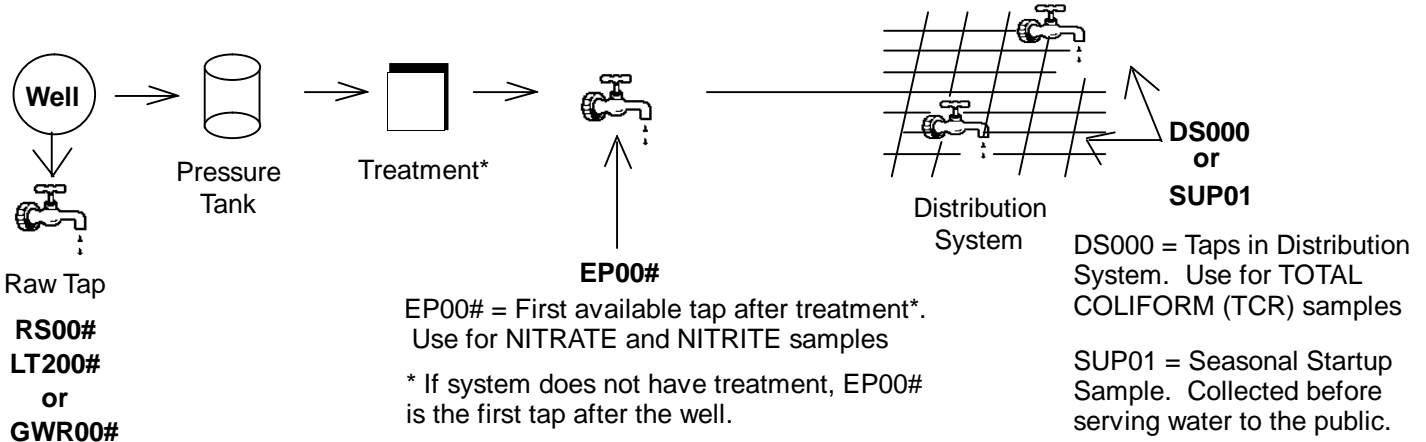

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8131812 YMCA OF VAN WERT COUNTY

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159437** Facility Name: **HICKORY STICKS GOLF CLUB**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

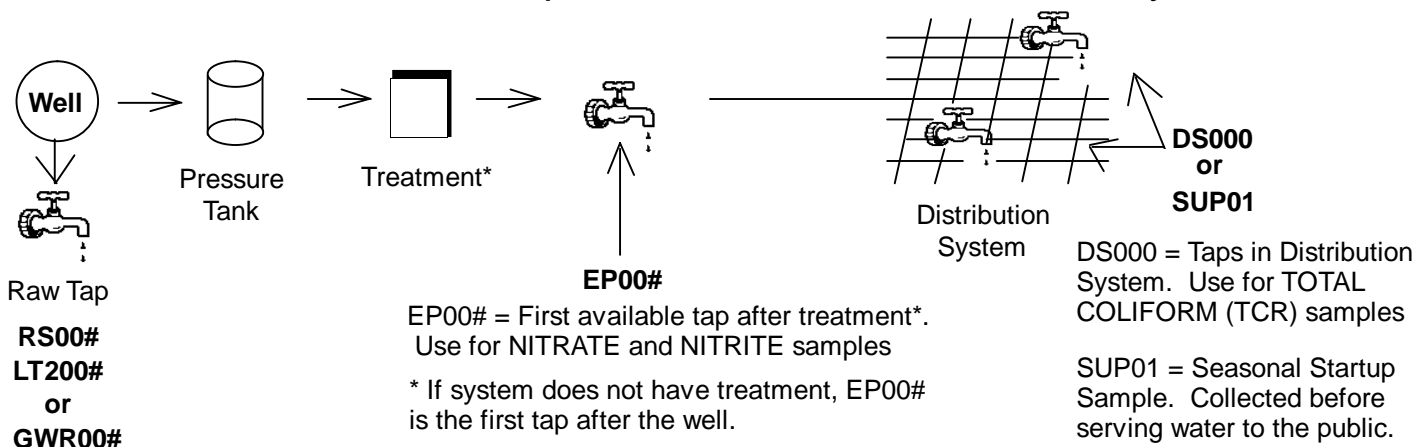

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8132312 FIRST BAPTIST CHURCH - VAN WERT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: FIRST BAPTIST CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

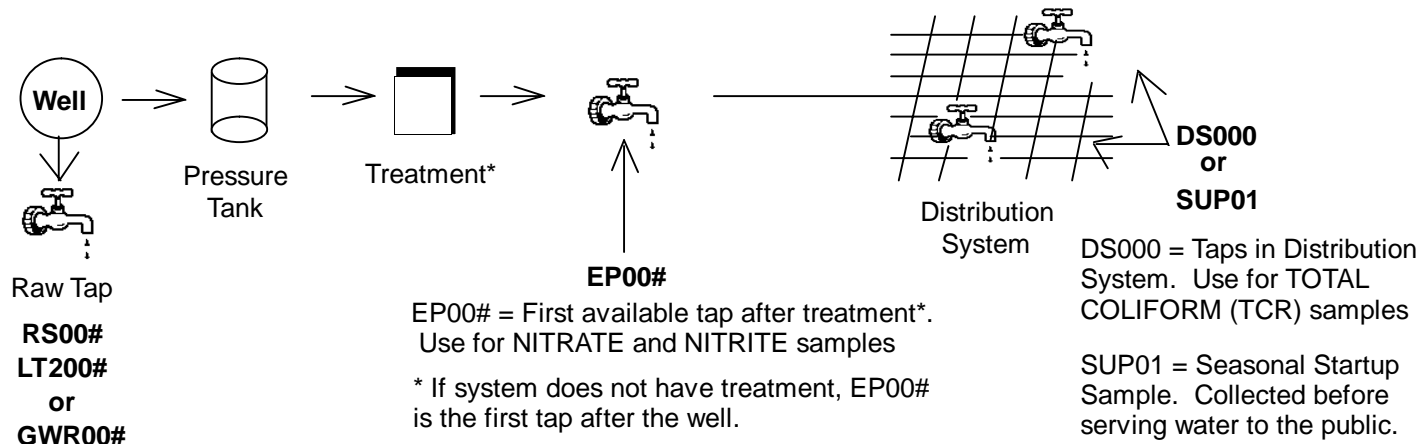

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8132312 FIRST BAPTIST CHURCH - VAN WERT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159440** Facility Name: **FIRST BAPTIST CHURCH**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

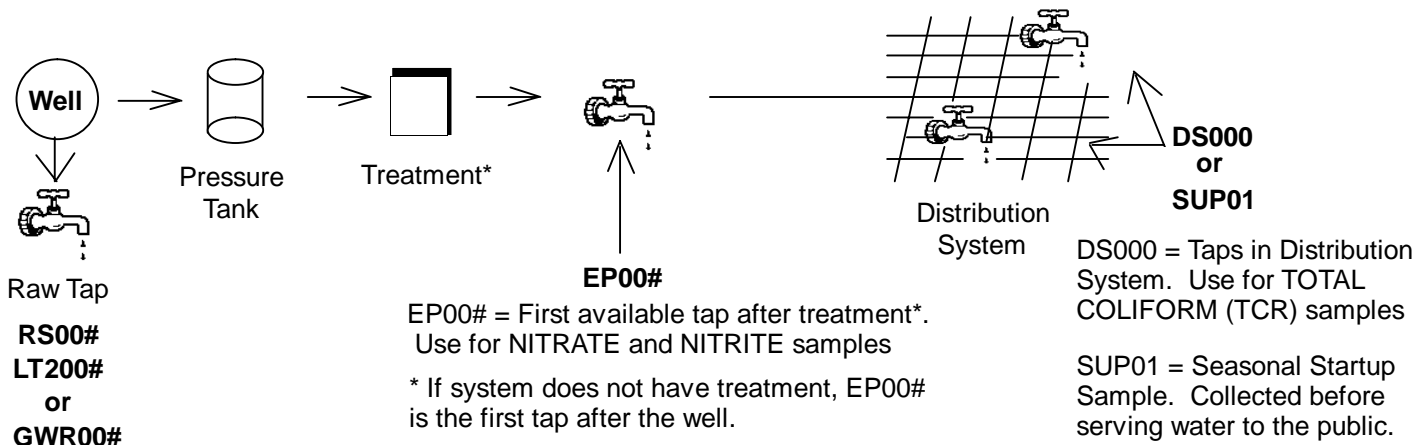

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8133012 HUGGY BEAR CAMPGROUND PHASE I

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HUGGY BEAR CAMPGROUND DISTRIBUTION
Location SMP ID: SUP01	Facility Source: Ground Water

Chemicals


Monitoring Requirements

TOTAL COLIFORM - SEASONAL STARTUP

At least 1 negative Total Coliform
Bacteria sample prior to serving
water to the public

**** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.****

Where to Collect Samples For a Small Public Water System

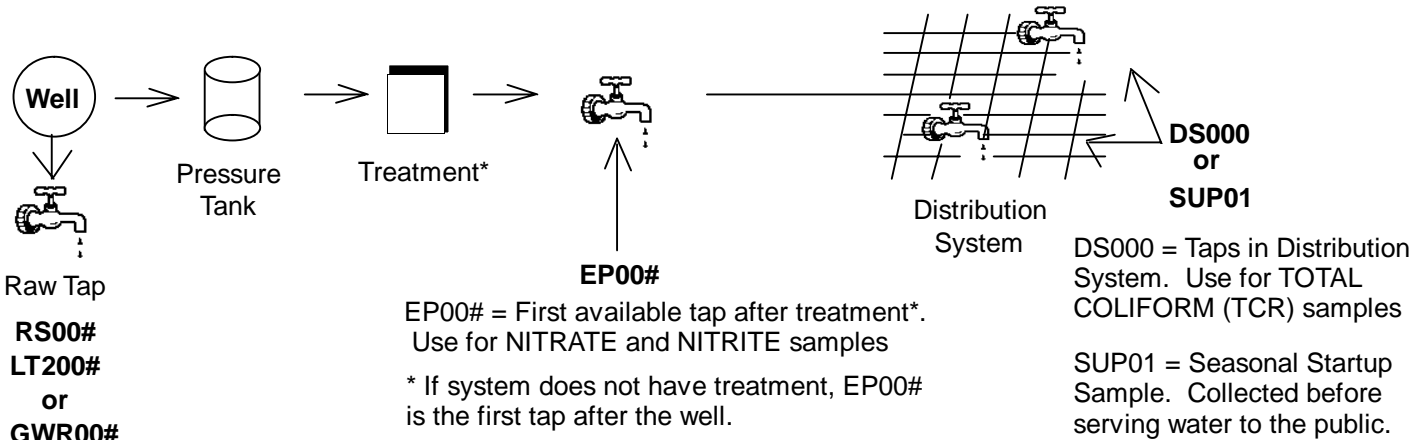

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8133012 HUGGY BEAR CAMPGROUND PHASE I

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HUGGY BEAR CAMPGROUND DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/15/2019 and 4/30/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/15/2019

Where to Collect Samples For a Small Public Water System

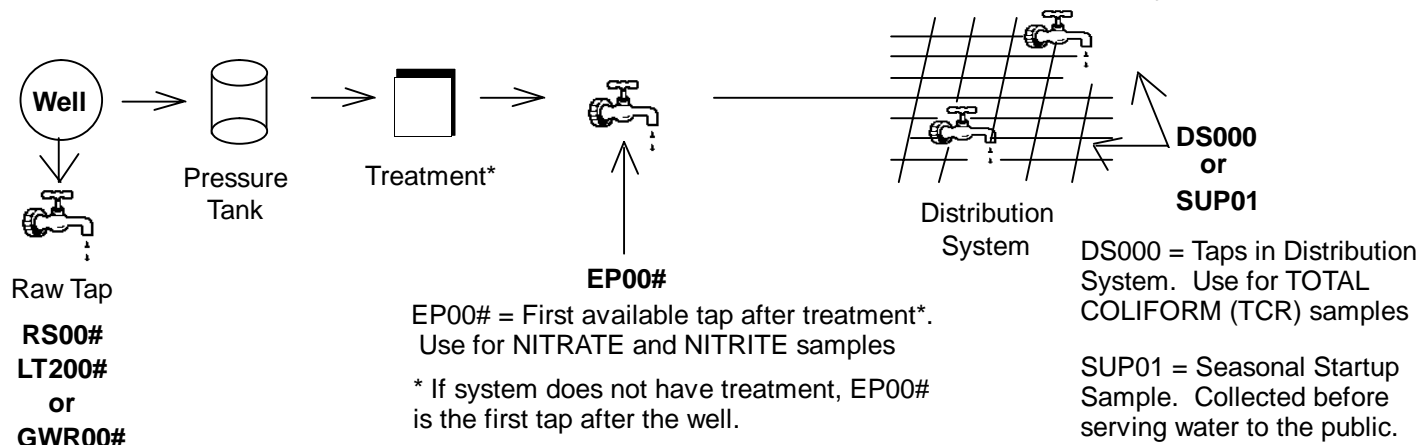

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8133012 HUGGY BEAR CAMPGROUND PHASE I

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159443** Facility Name: **HUGGY BEAR CAMPGROUND**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

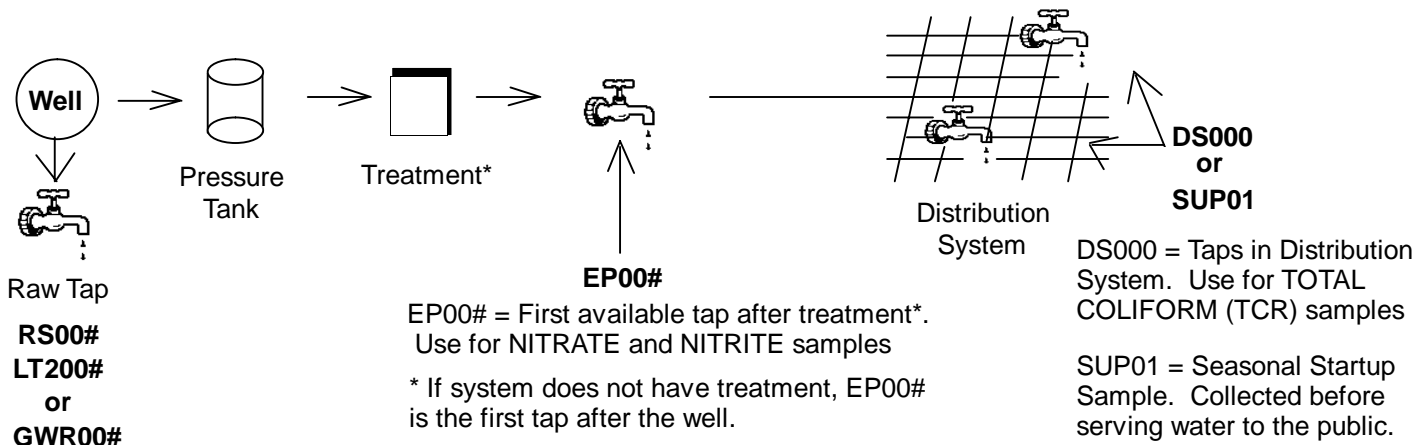

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8133912 TIMBERWOODS CAMPING RESORT

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: TIMBERWOODS CAMPING RESORT DISTRIBUTION
Location SMP ID: SUP01	Facility Source: Ground Water

Chemicals


Monitoring Requirements

TOTAL COLIFORM - SEASONAL STARTUP

At least 1 negative Total Coliform
Bacteria sample prior to serving
water to the public

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

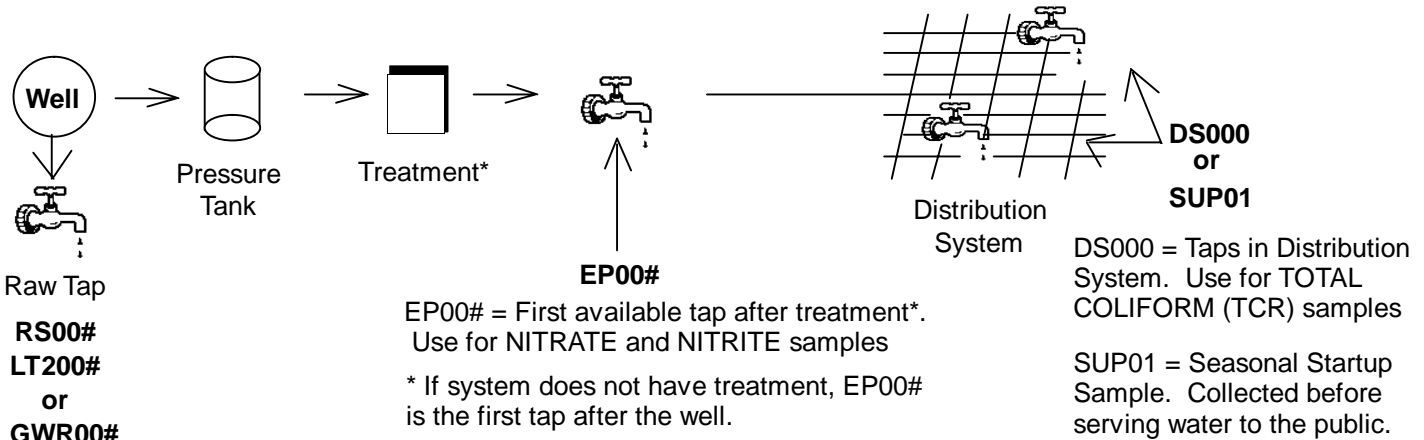

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8133912 TIMBERWOODS CAMPING RESORT

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: TIMBERWOODS CAMPING RESORT DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/5/2019 and 4/30/2019
	1 Sample(s) Required between 5/1/2019 and 5/31/2019
	1 Sample(s) Required between 6/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 7/31/2019
	1 Sample(s) Required between 8/1/2019 and 8/31/2019
	1 Sample(s) Required between 9/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

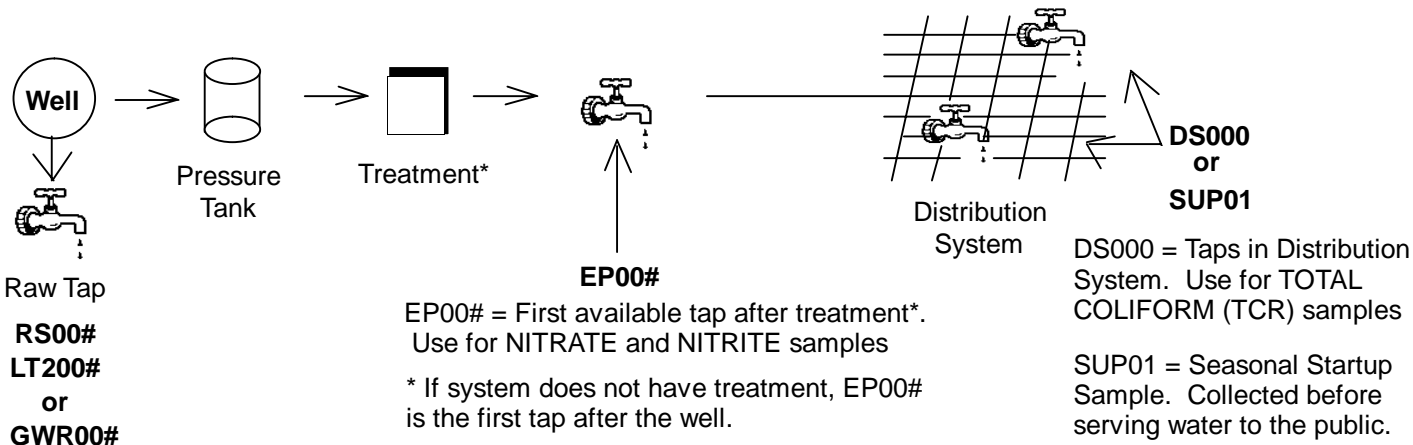

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8133912 TIMBERWOODS CAMPING RESORT

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159447** Facility Name: **TIMBERWOODS CAMPING RESORT**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

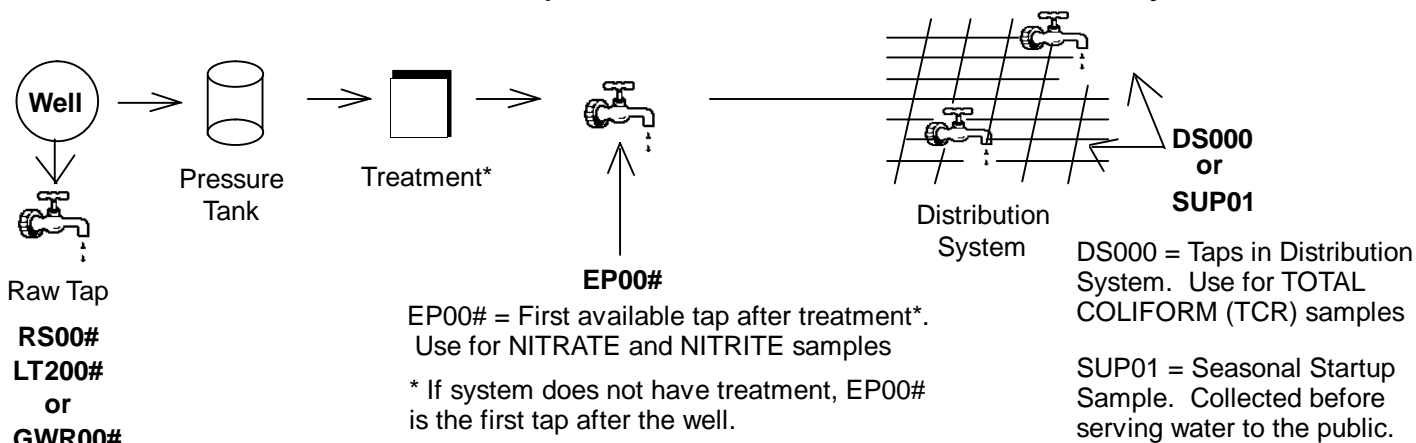

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH8134212 COOPER FARMS COOKED MEATS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 8159449	Facility Name: COOPER FARMS COOKED MEATS VAN WERT	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2019 and 10/31/2019

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2019 and 10/31/2019

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2019 and 10/31/2019



Effective Date: 04/19/2019

2019 DISTRIBUTION SCHEDULE

OH8134212 COOPER FARMS COOKED MEATS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **COOPER FOODS PROCESSED M DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2019 and 3/31/2019
1 Sample(s) Required between 4/1/2019 and 6/30/2019
1 Sample(s) Required between 7/1/2019 and 9/30/2019
1 Sample(s) Required between 10/1/2019 and 12/31/2019

TOTAL CHLORINE - 1000
1 Sample(s) Required between 1/1/2019 and 3/31/2019
1 Sample(s) Required between 4/1/2019 and 6/30/2019
1 Sample(s) Required between 7/1/2019 and 9/30/2019
1 Sample(s) Required between 10/1/2019 and 12/31/2019

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **COOPER FOODS PROCESSED M DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS201** TEST KITCHEN SINK

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2019 and 9/30/2019at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location Facility ID: **DS1** Facility Name: **COOPER FOODS PROCESSED M DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS202** CRS KITCHEN SINK

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2019 and 9/30/2019at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location Facility ID: **DS1** Facility Name: **COOPER FOODS PROCESSED M DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **LC###** Refer to your Lead and Copper plan for SMP IDs

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

OH8134312 REDEEMER LUTHERAN CHURCH-CONVOY

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: REDEEMER LUTHERAN CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

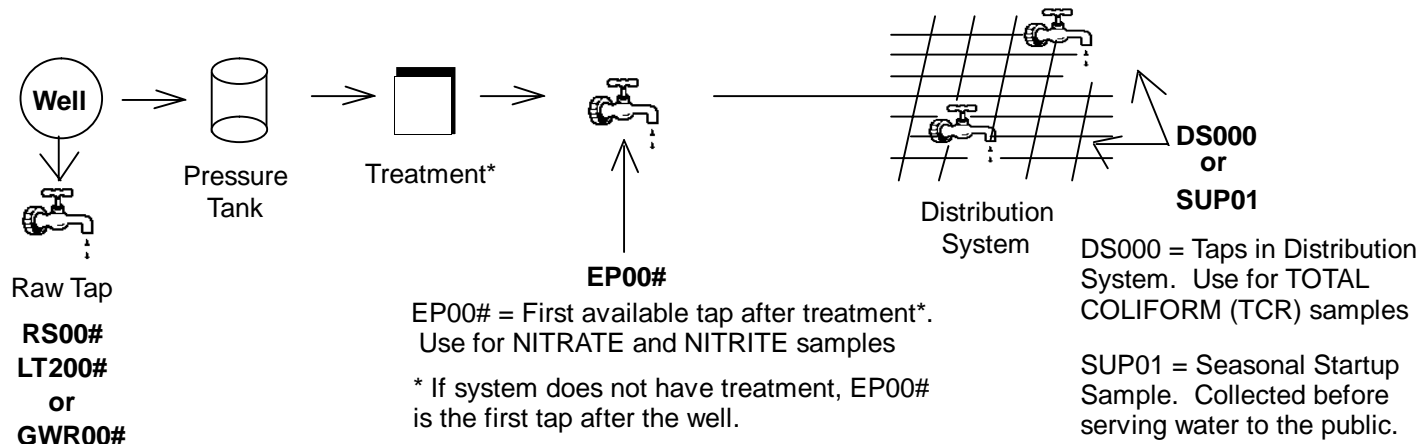

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8134312 REDEEMER LUTHERAN CHURCH-CONVOY

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159450** Facility Name: **REDEEMER LUTHERAN CHURCH**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

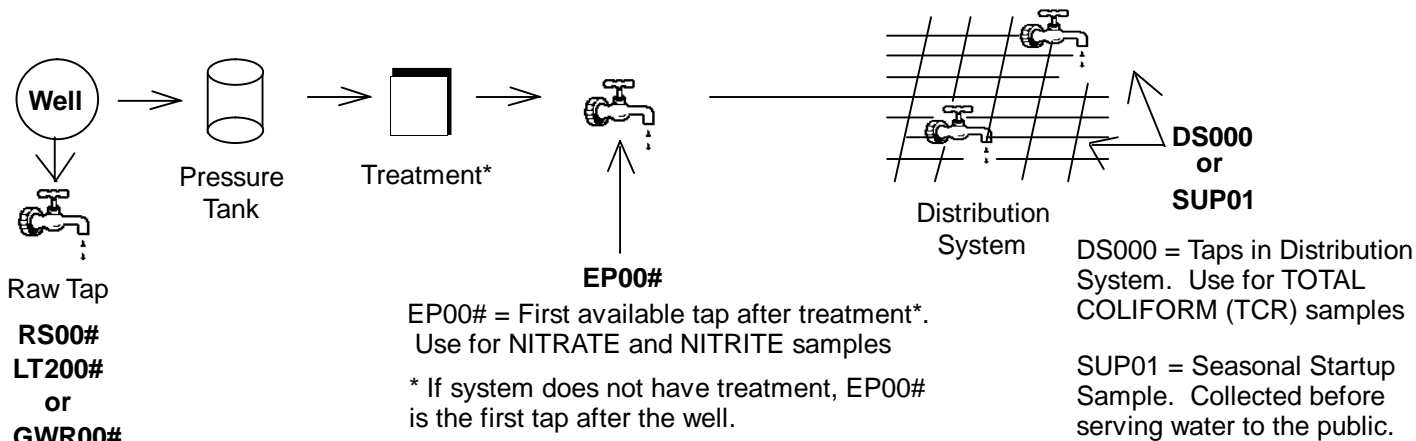

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8134712 ST PAULS REFORMED CHURCH IN AMERICA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ST PAULS REFORMD CH AMERICA DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

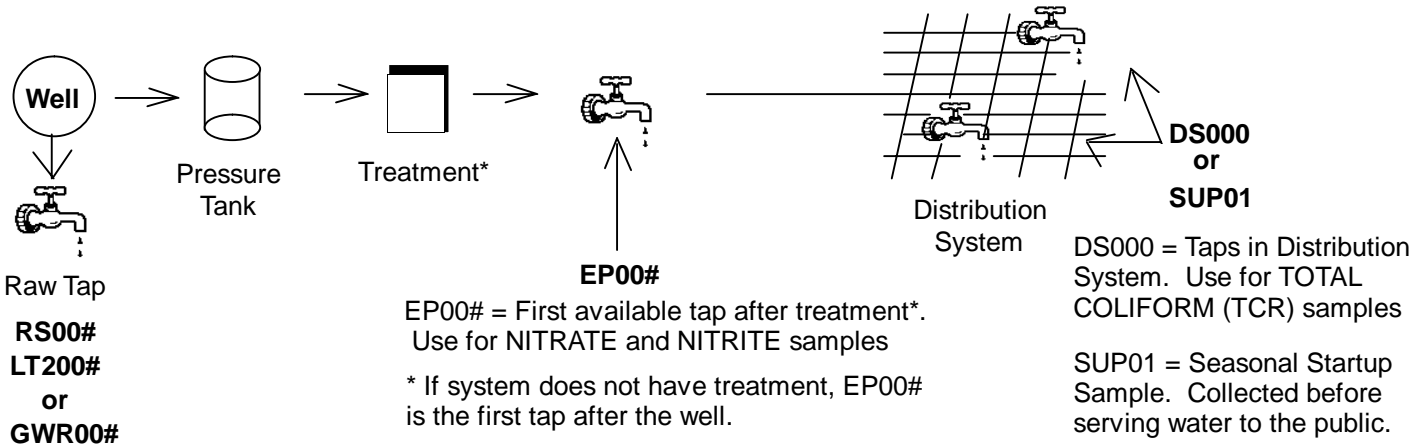

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8134712 ST PAULS REFORMED CHURCH IN AMERICA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 8159451	Facility Name: SAINT PAULS REFORMED CHURCH AMERICA
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

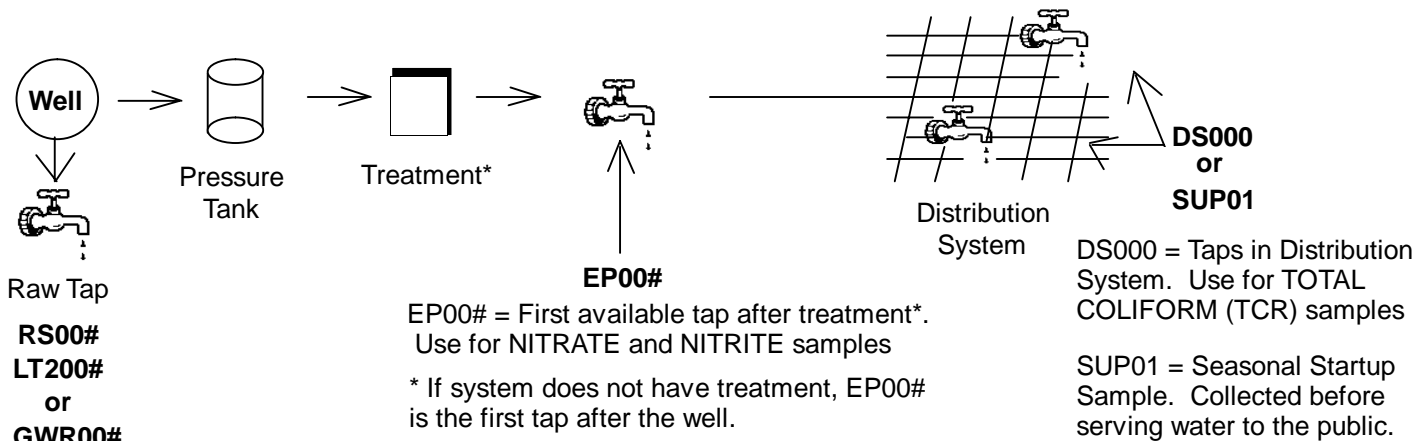

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8134812 ST THOMAS LUTHERAN CHURCH-VAN WERT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ST THOMAS LUTHERAN CH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

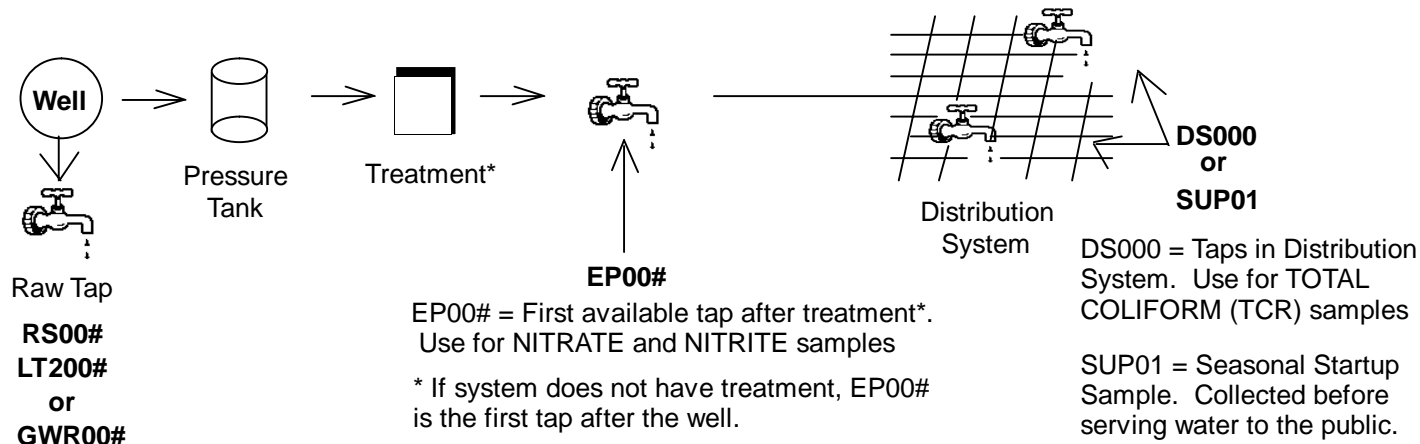

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8134812 ST THOMAS LUTHERAN CHURCH-VAN WERT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 8159452	Facility Name: SAINT THOMAS LUTHERAN CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

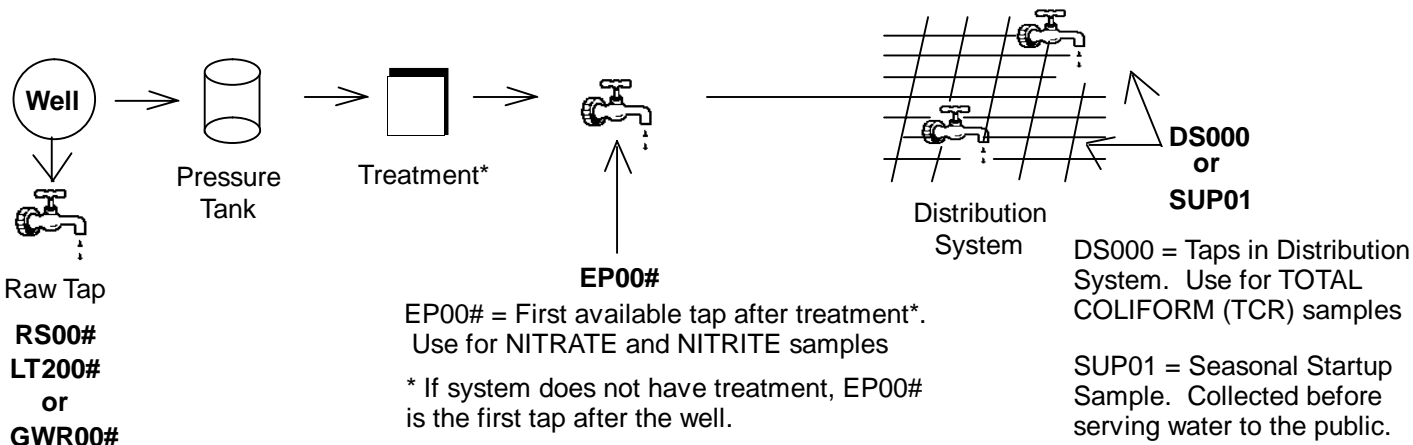

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8134912 SALEM UNITED PRESBYTERIAN CH-VENEDOCIA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: SALEM PRESBYTERIAN CH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

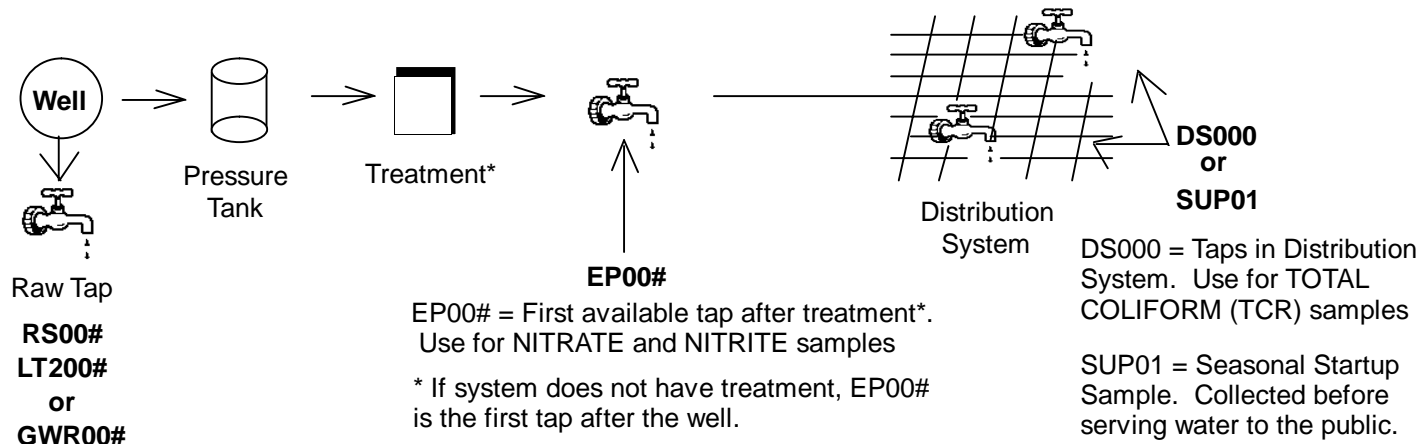

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8134912 SALEM UNITED PRESBYTERIAN CH-VENEDOCIA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 8159453 Facility Name: SALEM PRESBYTERIAN CHURCH

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

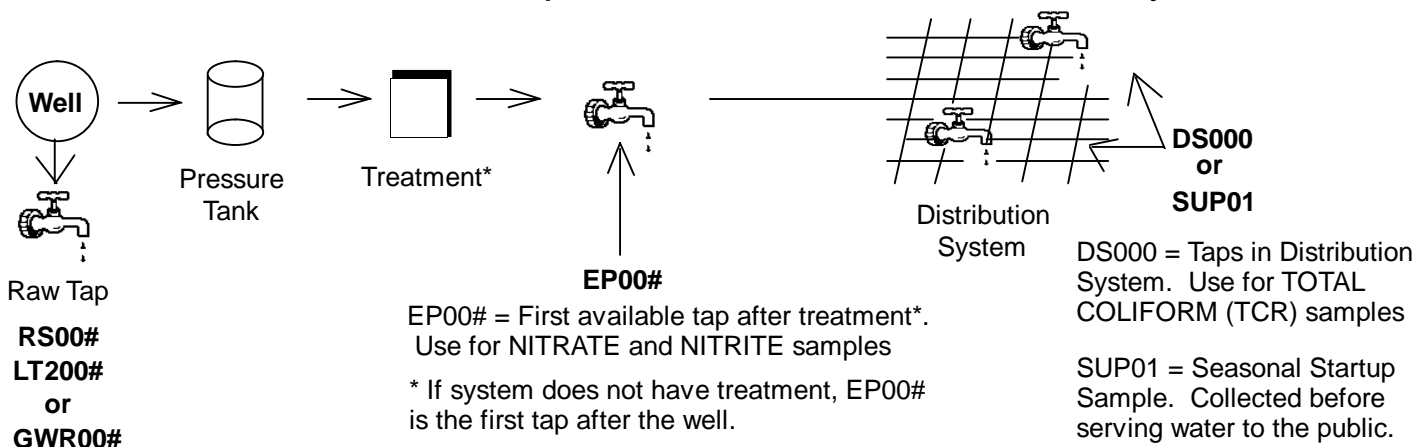

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8135312 VAN-DEL DRIVE-IN

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: VAN-DEL DRIVE-IN DISTRIBUTION
Location SMP ID: SUP01	Facility Source: Ground Water

Chemicals


Monitoring Requirements

TOTAL COLIFORM - SEASONAL STARTUP

At least 1 negative Total Coliform
Bacteria sample prior to serving
water to the public

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

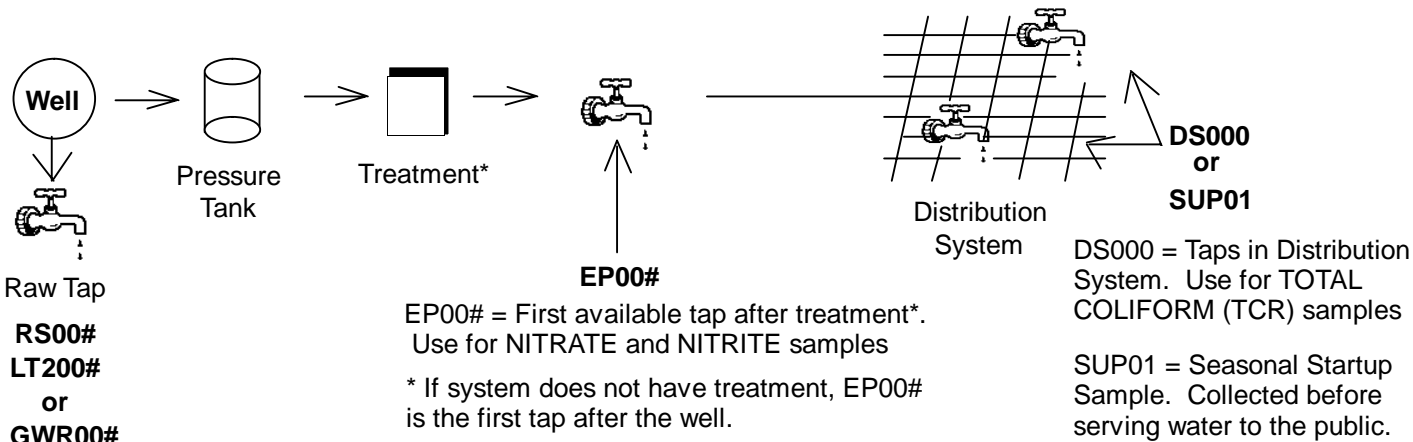

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8135312 VAN-DEL DRIVE-IN

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1**

Facility Name: **VAN-DEL DRIVE-IN DISTRIBUTION**

Location SMP ID: **DS000**

Facility Source: **Ground Water**

Chemicals


Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 4/19/2019 and 6/30/2019

1 Sample(s) Required between 7/1/2019 and 9/30/2019

Where to Collect Samples For a Small Public Water System

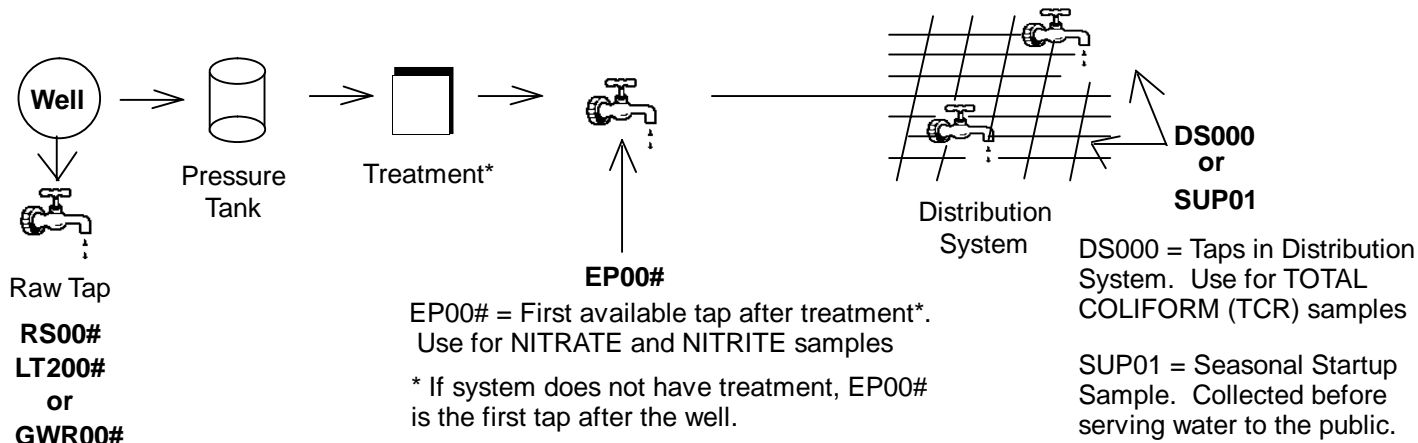

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8135312 VAN-DEL DRIVE-IN

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159455** Facility Name: **VAN-DEL DRIVE-IN**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

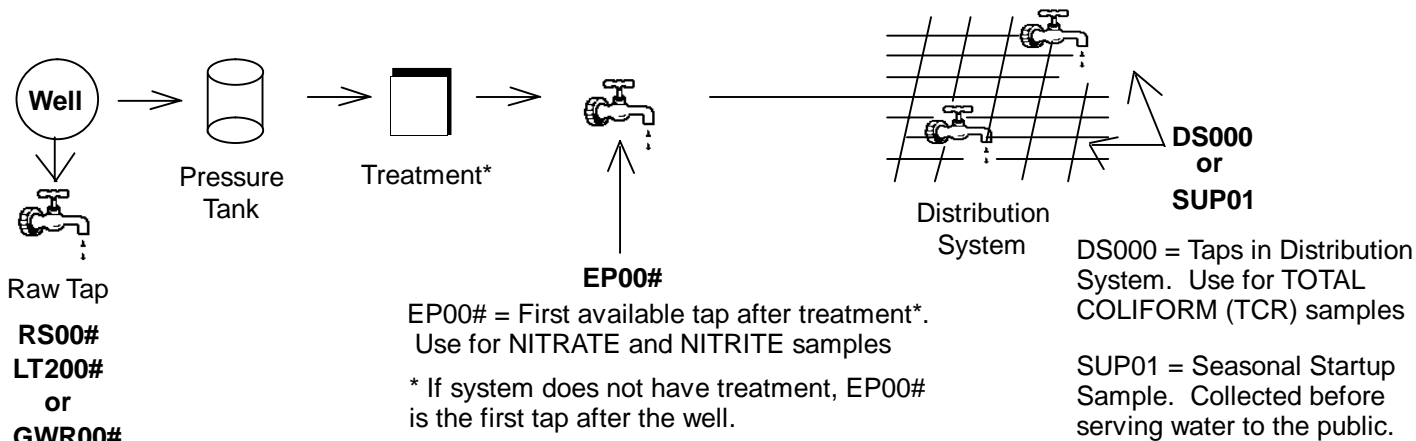

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8136512 WREN RESTAURANT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: WREN RESTAURANT DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

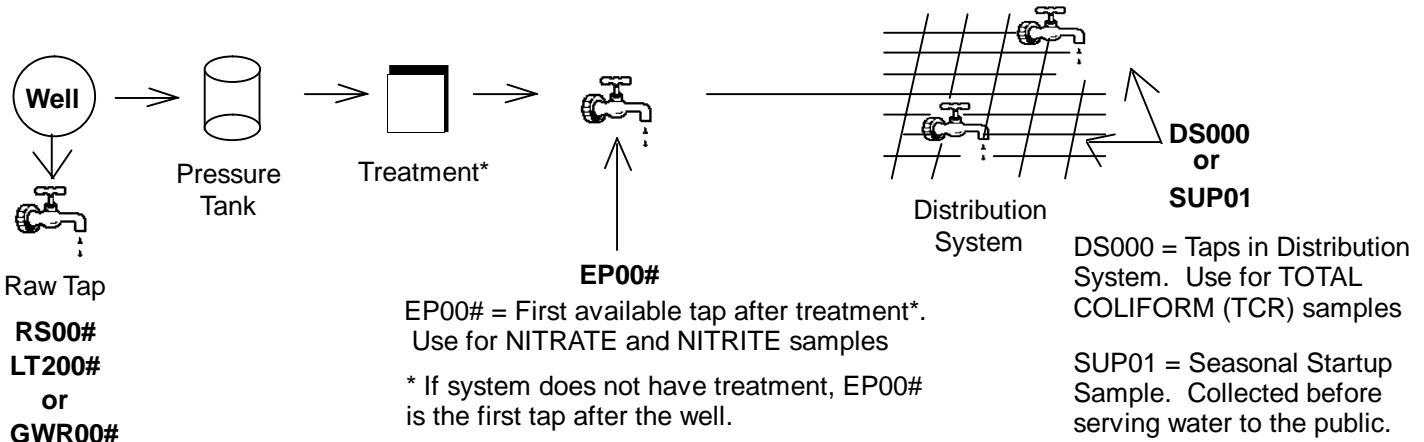

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8136512 WREN RESTAURANT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159458** Facility Name: **WREN RESTAURANT**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

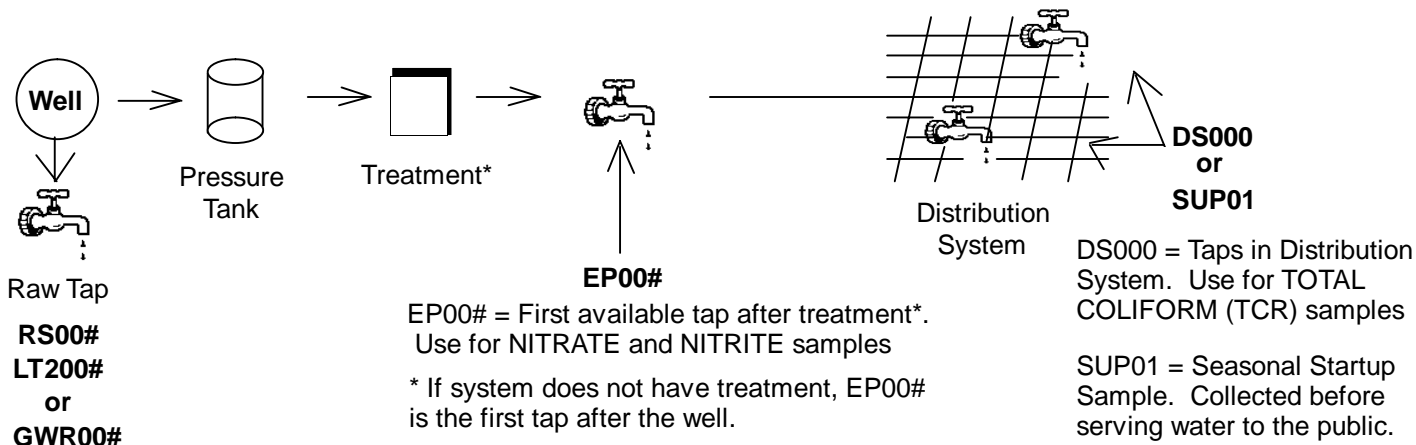

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8136612 ODOT REST AREA 1-27 EB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ODOT-REST AREA 1-27 DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

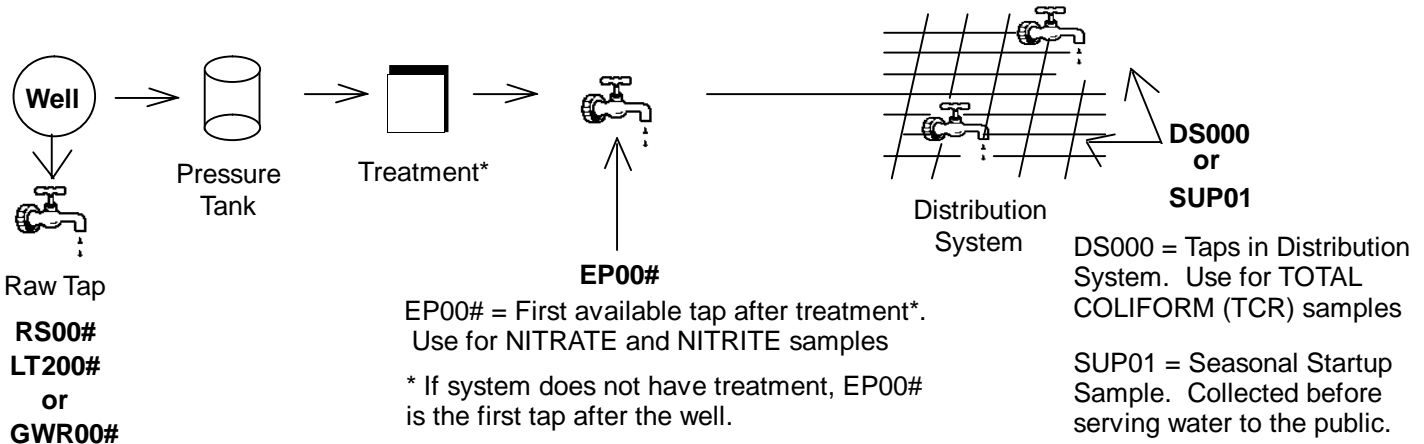

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8136612 ODOT REST AREA 1-27 EB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 8159459	Facility Name: ODOT REST AREA 1-27
Location SMP ID: EP001	Facility Source: Ground Water
Facility Class: CLASS A	

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

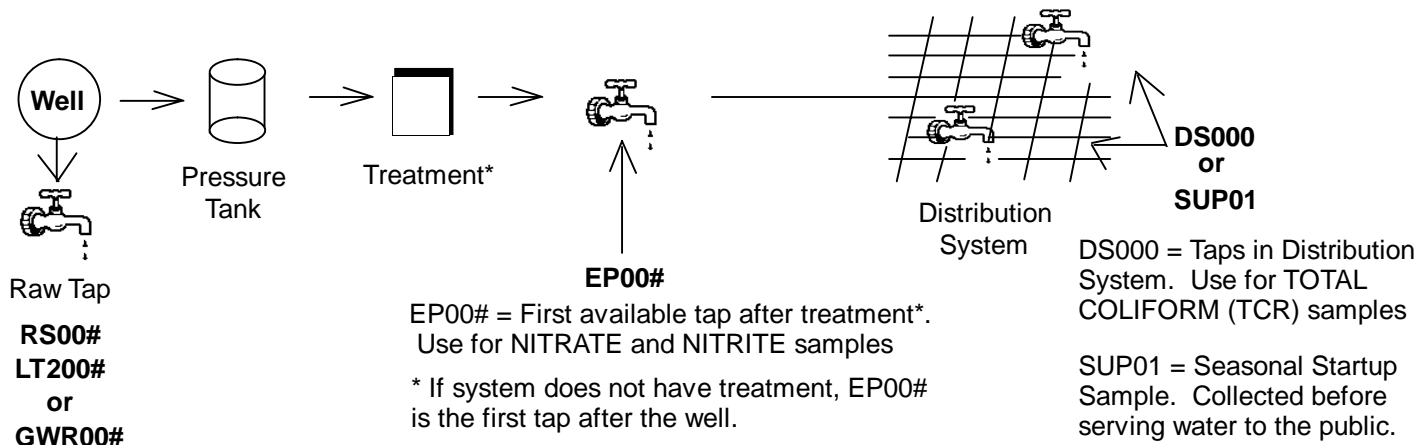

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8136712 ODOT REST AREA 1-28 WB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ODOT REST AREA 1-28 DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

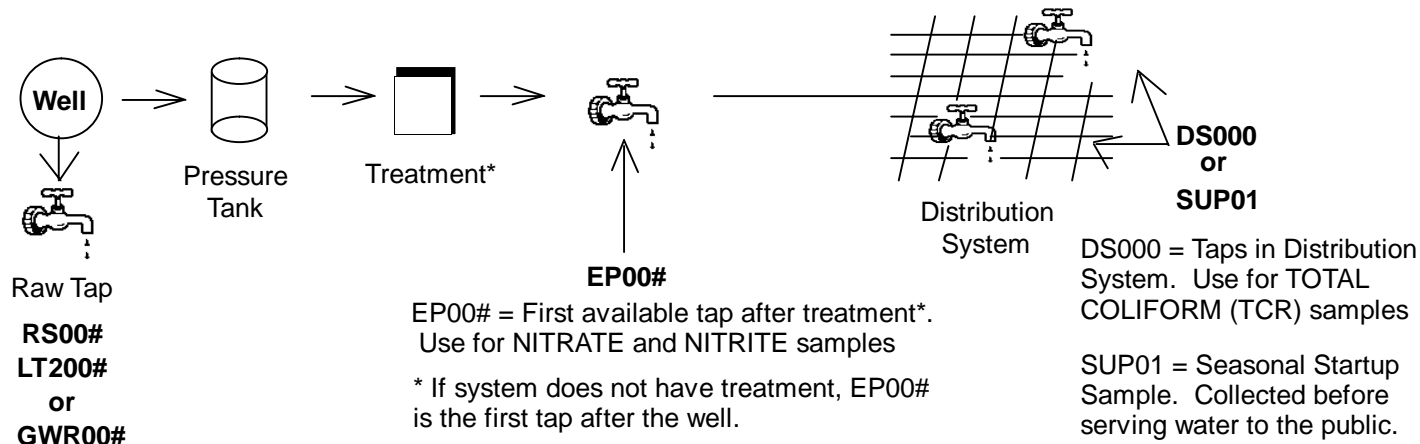

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8136712 ODOT REST AREA 1-28 WB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 8159460	Facility Name: ODOT REST AREA 1-28
Location SMP ID: EP001	Facility Source: Ground Water
Facility Class: CLASS A	

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

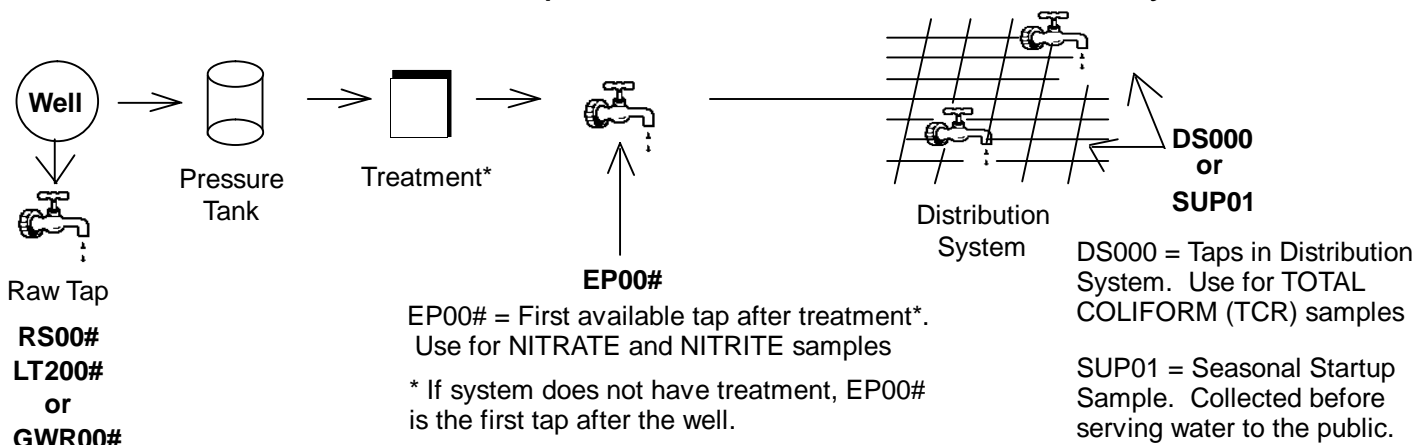

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8136912 HUGGY BEAR CAMPGROUND PHASE II

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HUGGY BEAR CAMPGROUND PH DISTRIBUTION
Location SMP ID: SUP01	Facility Source: Ground Water

Chemicals


Monitoring Requirements

TOTAL COLIFORM - SEASONAL STARTUP

At least 1 negative Total Coliform
Bacteria sample prior to serving
water to the public

**** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.****

Where to Collect Samples For a Small Public Water System

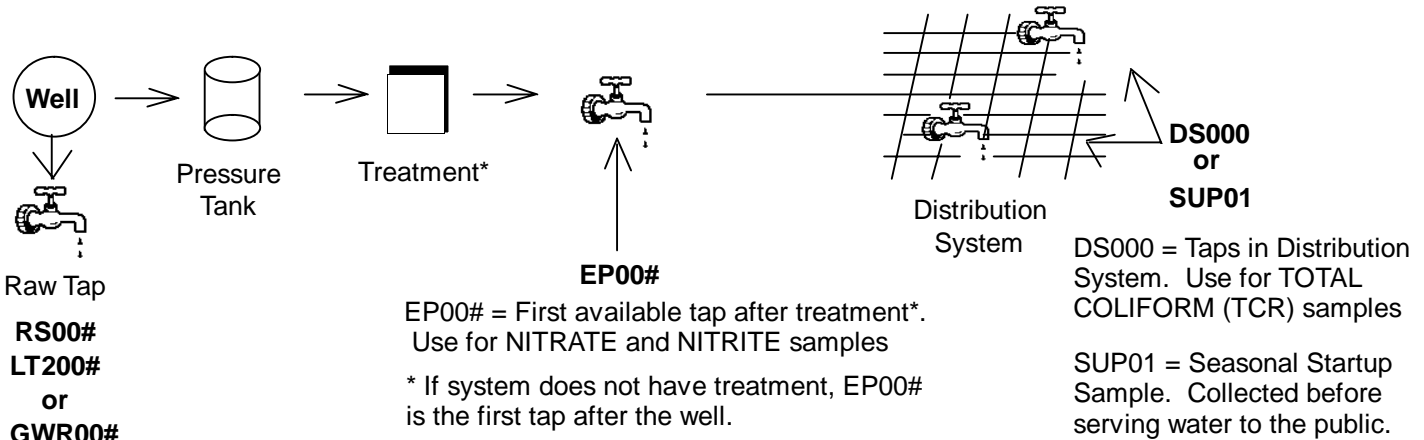

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8136912 HUGGY BEAR CAMPGROUND PHASE II

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8159462** Facility Name: **HUGGY BEAR CAMPGROUND PHASE II**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

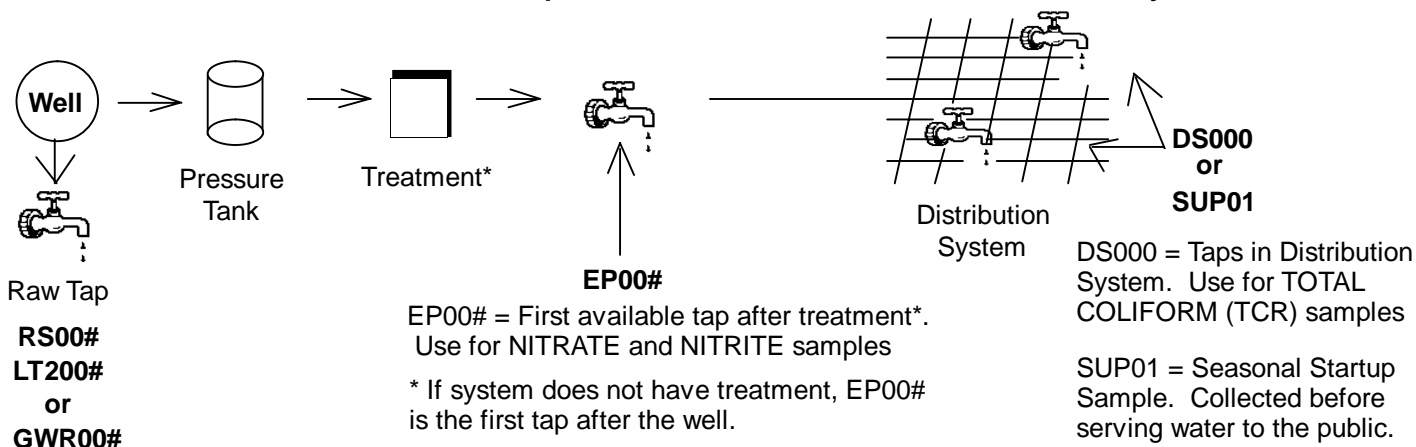

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8137012 CAMP CLAY - YMCA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CAMP CLAY YMCA DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

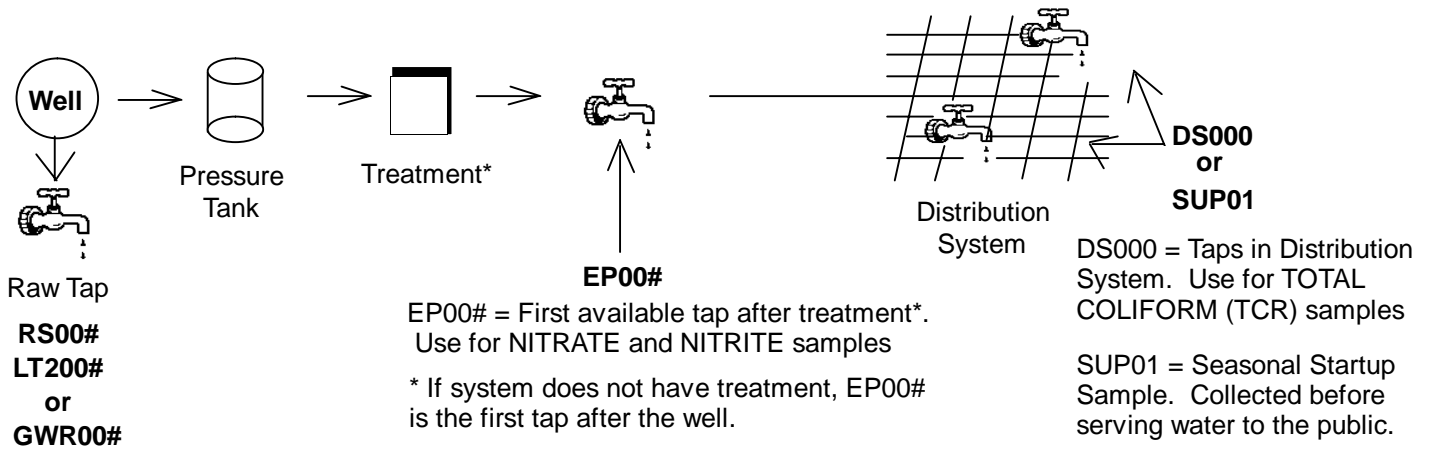

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8137012 CAMP CLAY - YMCA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8160968** Facility Name: **CAMP CLAY-YMCA**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

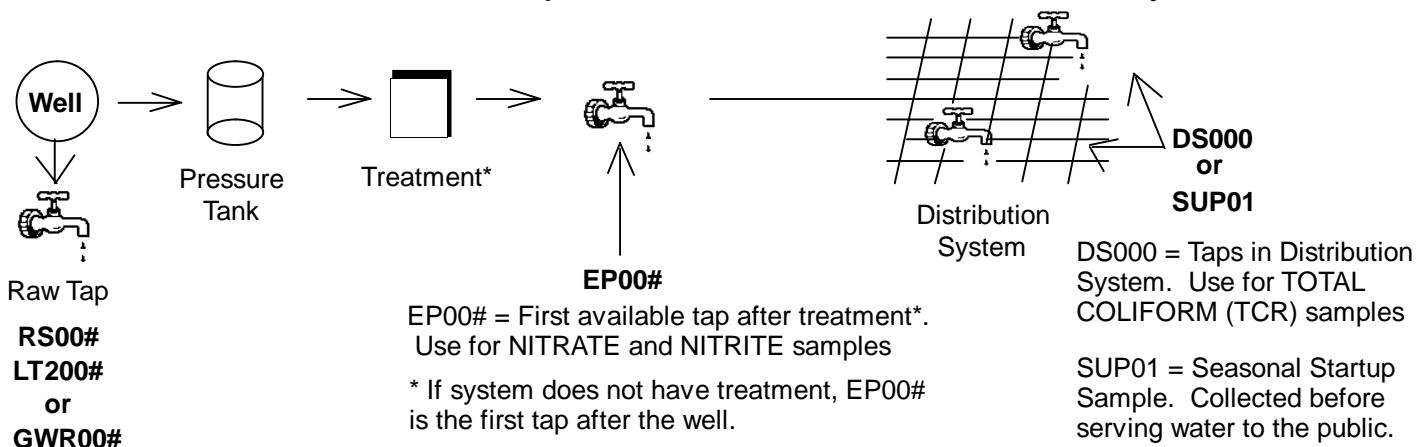

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8137112 NORTH UNION UNITED METH CH - VAN WERT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: NORTH UNION UNITED METHODIST CHURCH DIST
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

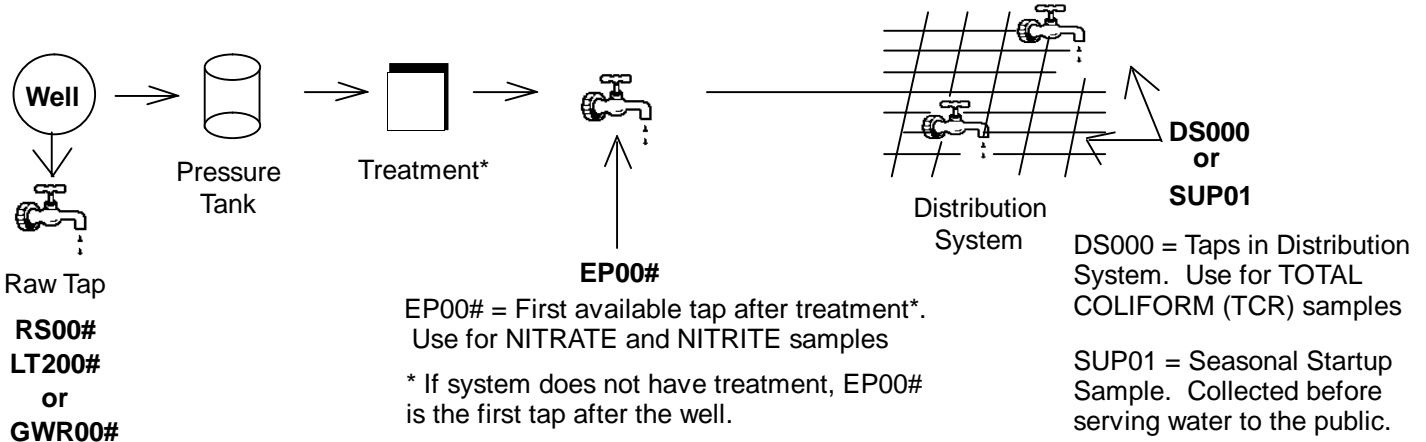

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8137112 NORTH UNION UNITED METH CH - VAN WERT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 8160969	Facility Name: NORTH UNION UNITED METHODIST CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

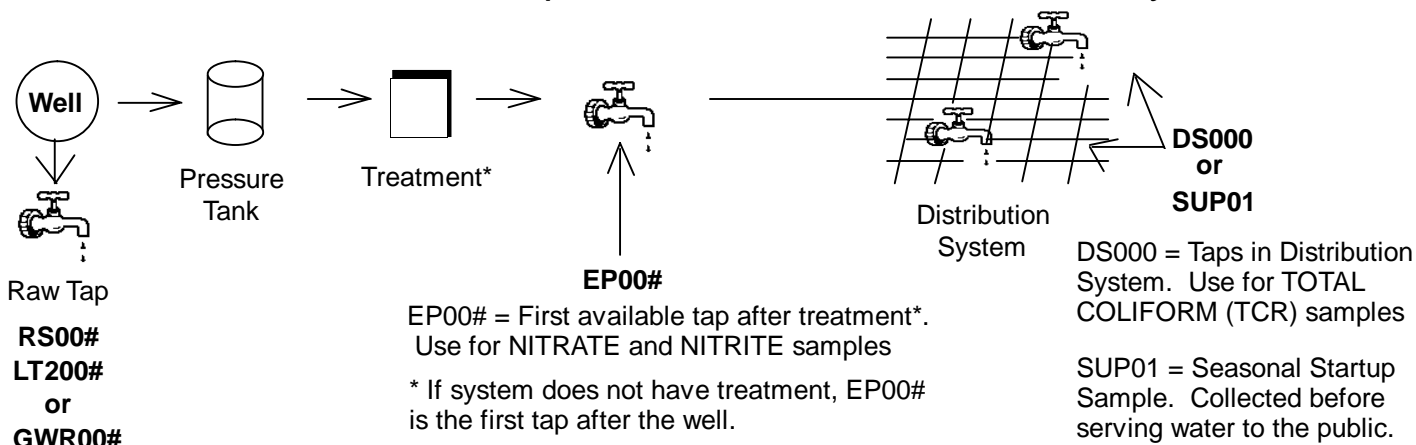

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH8137212 LINCOLNVIEW K-12 SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 8162231	Facility Name: LINCOLNVIEW K-12 SCHOOL	Facility Class: CLASS 1
	SMP ID: EP002	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2019 and 10/31/2019

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2019 and 10/31/2019

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2019 and 10/31/2019



OH8137212 LINCOLNVIEW K-12 SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: LINCOLNVIEW K-12 SCHOOL DISTRIBUTION	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019 1 Sample(s) Required between 4/1/2019 and 6/30/2019 1 Sample(s) Required between 7/1/2019 and 9/30/2019 1 Sample(s) Required between 10/1/2019 and 12/31/2019
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2019 and 3/31/2019 1 Sample(s) Required between 4/1/2019 and 6/30/2019 1 Sample(s) Required between 7/1/2019 and 9/30/2019 1 Sample(s) Required between 10/1/2019 and 12/31/2019

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: LINCOLNVIEW K-12 SCHOOL DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	----------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2019 and 9/30/2019at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: LINCOLNVIEW K-12 SCHOOL DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	----------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2019 and 9/30/2019at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: LINCOLNVIEW K-12 SCHOOL DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	---------------------------------------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2019 and 9/30/2019

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH8137312 CAMP CLAY YMCA- NATURE CENTER

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CAMP CLAY NATURE CENTER DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

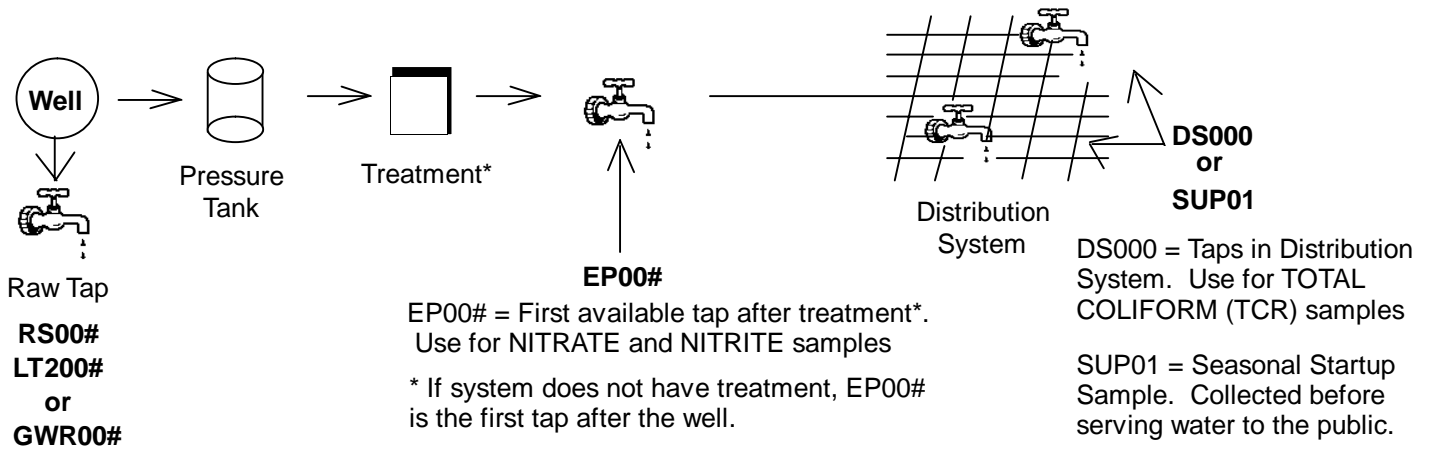

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8137312 CAMP CLAY YMCA- NATURE CENTER

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8161496** Facility Name: **CAMP CLAY NATURE CENTER**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

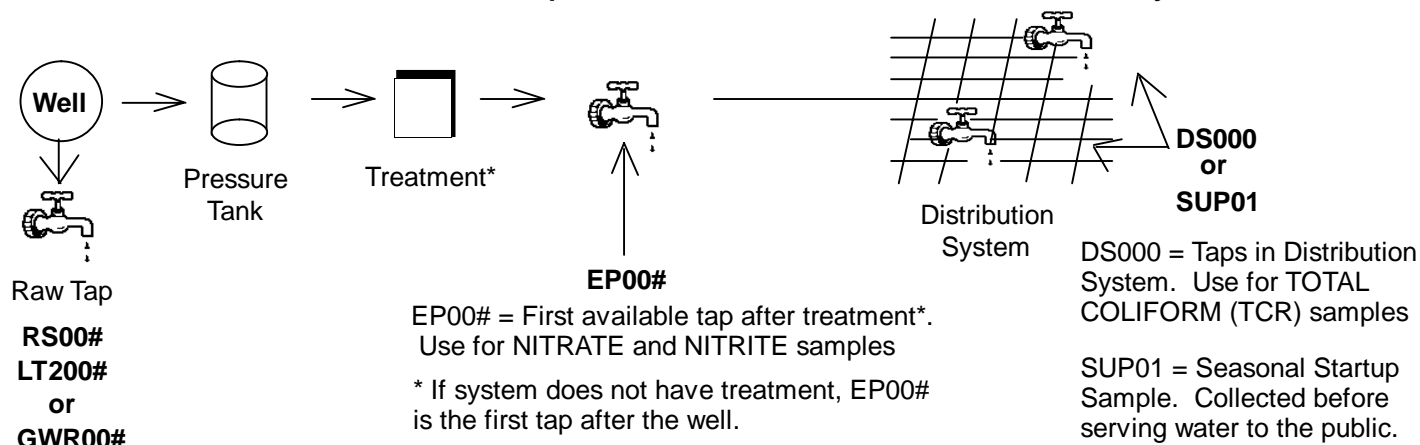

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8137412 KINGSLEY UNITED METHODIST CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: KINGSLEY UNITED METHODIST CHURCH DISTRIB
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

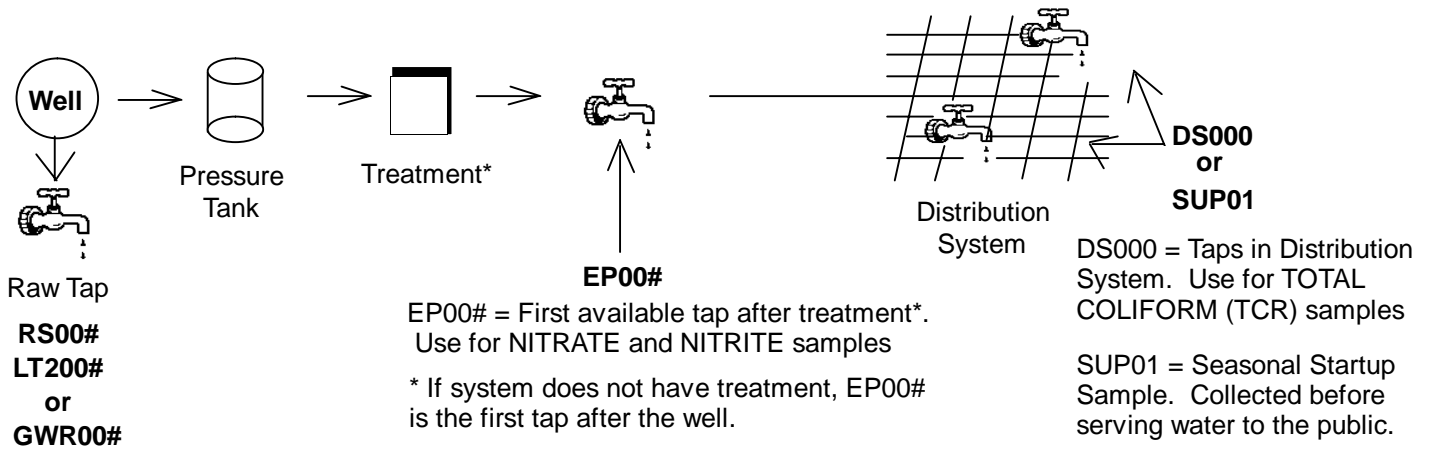

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8137412 KINGSLEY UNITED METHODIST CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 8161533	Facility Name: KINGLSEY UNITED METHODIST CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

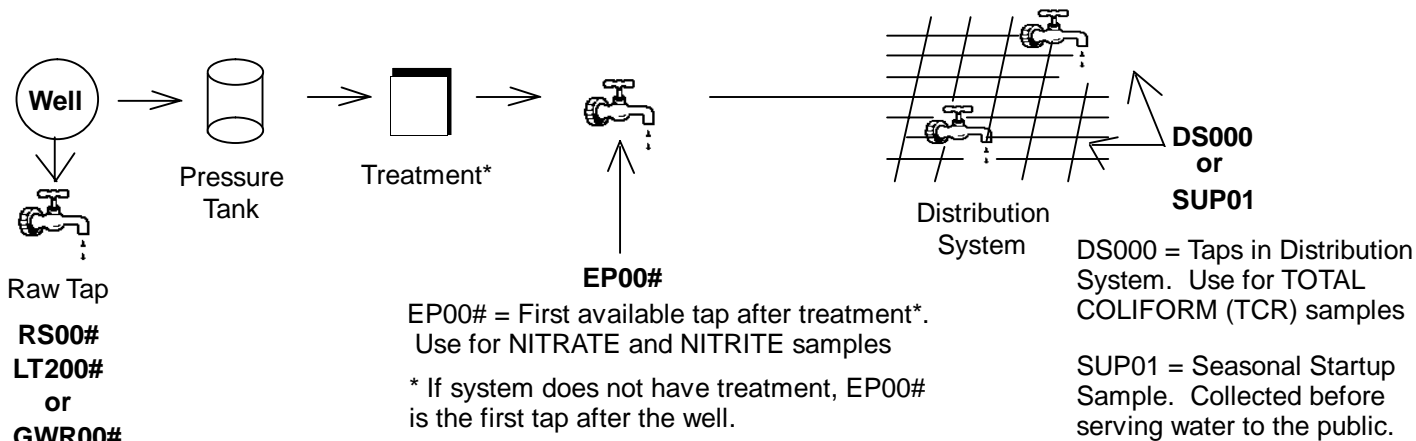

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8137512 HUGGY BEAR CAMPGROUND PHASE III

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HUGGY BEAR CAMPGROUND PHASE III DIST
Location SMP ID: SUP01	Facility Source: Ground Water

Chemicals


Monitoring Requirements

TOTAL COLIFORM - SEASONAL STARTUP

At least 1 negative Total Coliform
Bacteria sample prior to serving
water to the public

***** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.*****

Where to Collect Samples For a Small Public Water System

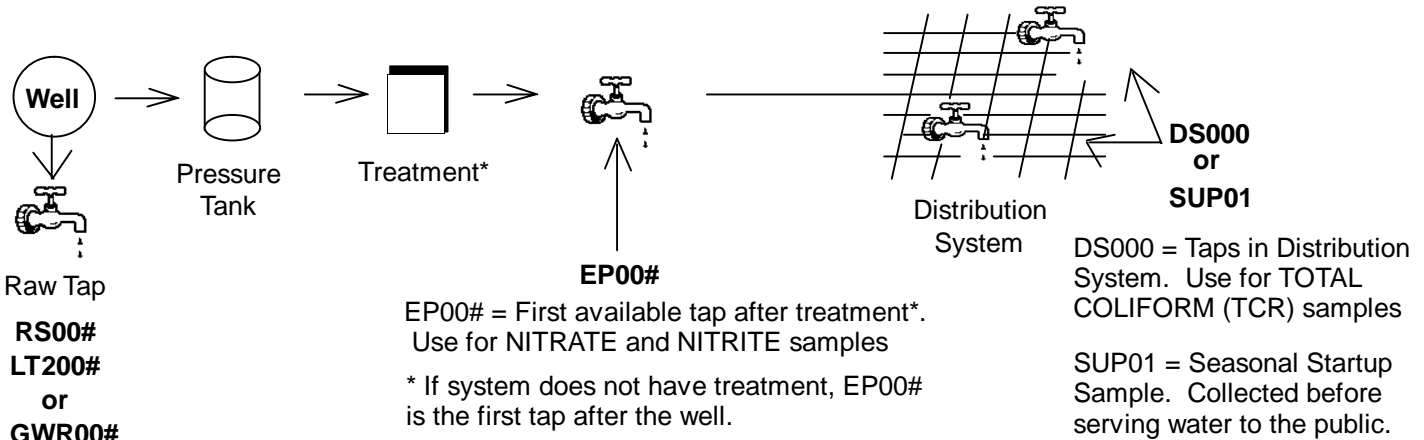

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8137512 HUGGY BEAR CAMPGROUND PHASE III

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HUGGY BEAR CAMPGROUND PHASE III DIST
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between 1/1/2019 and 3/31/2019

Where to Collect Samples For a Small Public Water System

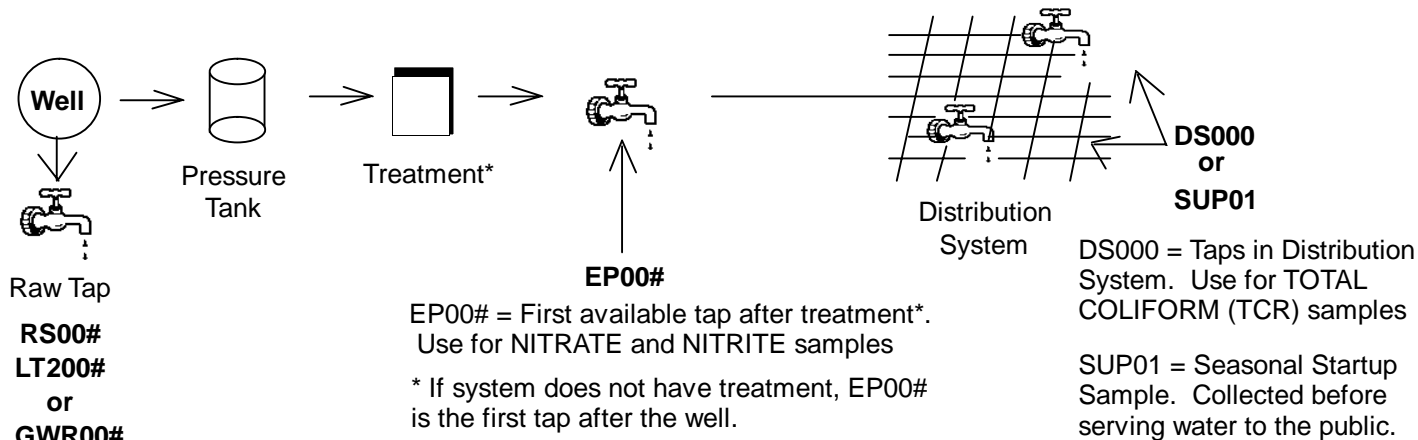

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8137512 HUGGY BEAR CAMPGROUND PHASE III

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8162083** Facility Name: **HUGGY BEAR CAMPGROUND PHASE III**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals

Monitoring Requirements


NITRITE - 1041

Not Required

NITRATE - 1040

1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

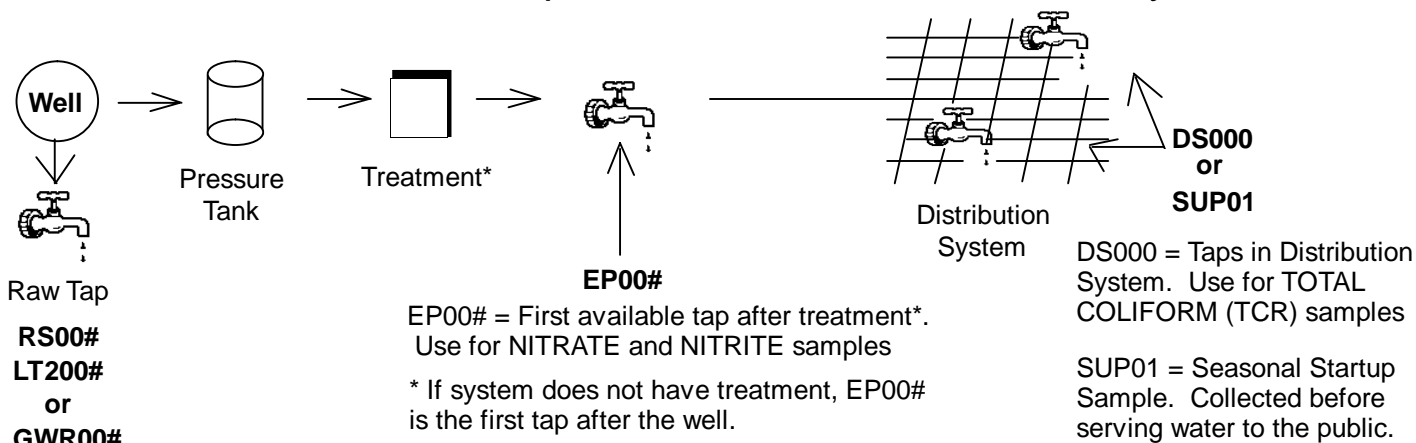

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8138012 LINCOLNVIEW BIBLE BOARD

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LINCOLNVIEW BIBLE BOARD DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2019 and 3/31/2019
	1 Sample(s) Required between 4/1/2019 and 6/30/2019
	1 Sample(s) Required between 7/1/2019 and 9/30/2019
	1 Sample(s) Required between 10/1/2019 and 12/31/2019

Where to Collect Samples For a Small Public Water System

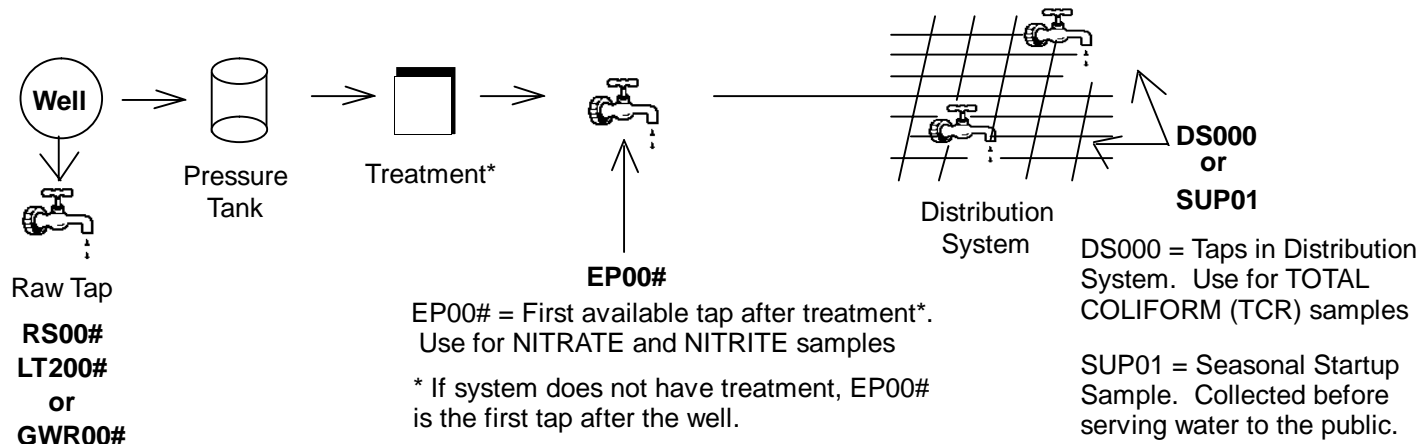

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH8138012 LINCOLNVIEW BIBLE BOARD

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **8162462** Facility Name: **LINCOLNVIEW BIBLE BOARD**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2019 and 10/31/2019

Where to Collect Samples For a Small Public Water System

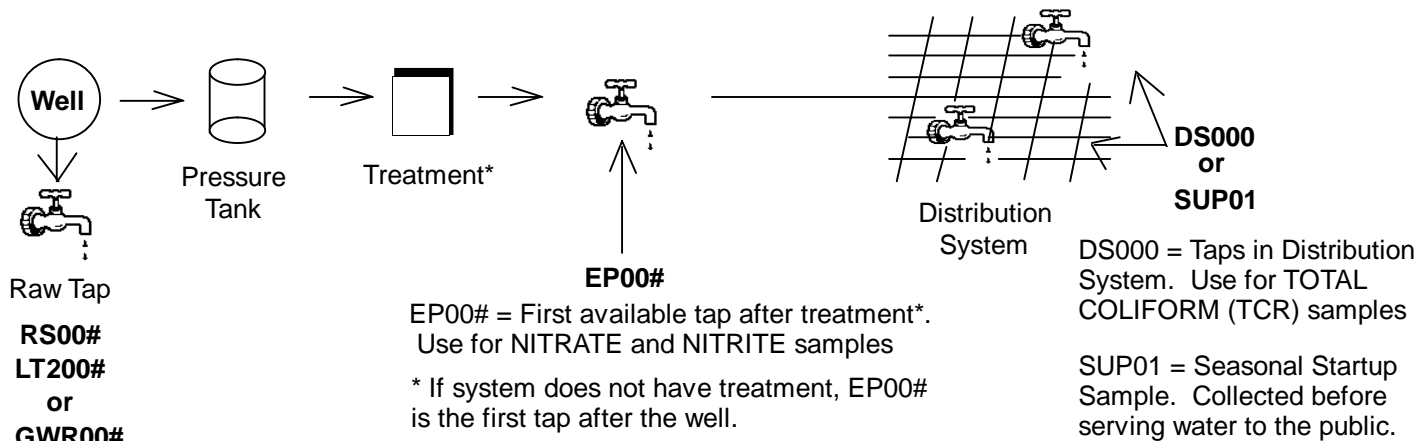

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!