



OH2400012 VILLAGE OF BLOOMINGBURG

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 2454040	Facility Name: BLOOMINGBURG PWS	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements	
ARSENIC - 1005	1 Sample(s) Required between	1/1/2020 and 3/31/2020
	1 Sample(s) Required between	4/1/2020 and 6/30/2020
	1 Sample(s) Required between	7/1/2020 and 9/30/2020
	1 Sample(s) Required between	10/1/2020 and 12/31/2020
INORGANICS	1 Sample(s) Required between	6/1/2020 and 10/31/2020
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024		
FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL		
NITRITE - 1041	1 Sample(s) Required between	1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between	1/1/2020 and 5/31/2020
RADIOLOGICALS	1 Sample(s) Required between	6/1/2020 and 10/31/2020
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002 RADIUM-228 - 4030		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2020 and 5/31/2020
<i>Sample for all the analytes listed below:</i>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	6/1/2020 and 10/31/2020



OH2400012 VILLAGE OF BLOOMINGBURG

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location Facility ID: **DS1** Facility Name: **BLOOMINGBURG, VILLAGE OF DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS000**

Chemicals Monitoring Requirements

ASBESTOS - 1094 1 Sample(s) Required between 6/1/2020 and 10/31/2020

Collect one sample at a tap served by asbestos-cement pipe. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2020 and 1/31/2020
1 Sample(s) Required between 2/1/2020 and 2/29/2020
1 Sample(s) Required between 3/1/2020 and 3/31/2020
1 Sample(s) Required between 4/1/2020 and 4/30/2020
1 Sample(s) Required between 5/1/2020 and 5/31/2020
1 Sample(s) Required between 6/1/2020 and 6/30/2020
1 Sample(s) Required between 7/1/2020 and 7/31/2020
1 Sample(s) Required between 8/1/2020 and 8/31/2020
1 Sample(s) Required between 9/1/2020 and 9/30/2020
1 Sample(s) Required between 10/1/2020 and 10/31/2020
1 Sample(s) Required between 11/1/2020 and 11/30/2020
1 Sample(s) Required between 12/1/2020 and 12/31/2020

TOTAL CHLORINE - 1000
1 Sample(s) Required between 1/1/2020 and 1/31/2020
1 Sample(s) Required between 2/1/2020 and 2/29/2020
1 Sample(s) Required between 3/1/2020 and 3/31/2020
1 Sample(s) Required between 4/1/2020 and 4/30/2020
1 Sample(s) Required between 5/1/2020 and 5/31/2020
1 Sample(s) Required between 6/1/2020 and 6/30/2020
1 Sample(s) Required between 7/1/2020 and 7/31/2020
1 Sample(s) Required between 8/1/2020 and 8/31/2020
1 Sample(s) Required between 9/1/2020 and 9/30/2020
1 Sample(s) Required between 10/1/2020 and 10/31/2020
1 Sample(s) Required between 11/1/2020 and 11/30/2020
1 Sample(s) Required between 12/1/2020 and 12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location Facility ID: **DS1** Facility Name: **BLOOMINGBURG, VILLAGE OF DISTRIBUTION** Facility Class: **CLASS 1**
SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2020 and 9/30/2020 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH2400012 VILLAGE OF BLOOMINGBURG

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: BLOOMINGBURG, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	-----------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2020 and 9/30/2020 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: BLOOMINGBURG, VILLAGE OF DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	----------------------------------------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2020 and 9/30/2020

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH2400112 FAYETTE CO.-CULPEPPER SUBDIVISION

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: FAYETTE CO.CULPEPPER DISTRIBUTION	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	---------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 1/31/2020
	1 Sample(s) Required between 2/1/2020 and 2/29/2020
	1 Sample(s) Required between 3/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 4/30/2020
	1 Sample(s) Required between 5/1/2020 and 5/31/2020
	1 Sample(s) Required between 6/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 7/31/2020
	1 Sample(s) Required between 8/1/2020 and 8/31/2020
	1 Sample(s) Required between 9/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 10/31/2020
	1 Sample(s) Required between 11/1/2020 and 11/30/2020
	1 Sample(s) Required between 12/1/2020 and 12/31/2020

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2020 and 1/31/2020
	1 Sample(s) Required between 2/1/2020 and 2/29/2020
	1 Sample(s) Required between 3/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 4/30/2020
	1 Sample(s) Required between 5/1/2020 and 5/31/2020
	1 Sample(s) Required between 6/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 7/31/2020
	1 Sample(s) Required between 8/1/2020 and 8/31/2020
	1 Sample(s) Required between 9/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 10/31/2020
	1 Sample(s) Required between 11/1/2020 and 11/30/2020
	1 Sample(s) Required between 12/1/2020 and 12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: FAYETTE CO.CULPEPPER DISTRIBUTION 825 LESLIE TRACE	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 3/8/2020 and 3/14/2020 at: DS201
	Dual Sample Required between 6/8/2020 and 6/14/2020 at: DS201
	Dual Sample Required between 9/8/2020 and 9/14/2020 at: DS201
	Dual Sample Required between 12/8/2020 and 12/14/2020 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2020

2020 DISTRIBUTION SCHEDULE

OH2400112 FAYETTE CO.-CULPEPPER SUBDIVISION

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: FAYETTE CO.CULPEPPER DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	------------------------------------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 1/1/2020 and 6/30/2020 10 Sample(s) Required between 7/1/2020 and 12/31/2020

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



Effective Date: 01/01/2020

2020 ENTRY POINT SCHEDULE

OH2400612 JEFFERSONVILLE VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 2454044 SMP ID: EP001	Facility Name: JEFFERSONVILLE PWS Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	-----------------------------------------------------	----------------------------------------------------------------------------------	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	6/1/2020 and 10/31/2020
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	1 Sample(s) Required between	1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between	1/1/2020 and 5/31/2020
RADIOLOGICALS	Not Required	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2020 and 5/31/2020
<i>Sample for all the analytes listed below:</i>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	6/1/2020 and 10/31/2020



OH2400612 JEFFERSONVILLE VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: JEFFERSONVILLE, VILLAGE DISTRIBUTION	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

ASBESTOS - 1094	1 Sample(s) Required between 6/1/2020 and 10/31/2020
-----------------	------------------------------------------------------

Collect one sample at a tap served by asbestos-cement pipe. Due to limited Laboratory capacity and a 48 hour filtering requirement, contact your lab early in the monitoring period to schedule a sampling date.

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2020 and 1/31/2020
	2 Sample(s) Required between 2/1/2020 and 2/29/2020
	2 Sample(s) Required between 3/1/2020 and 3/31/2020
	2 Sample(s) Required between 4/1/2020 and 4/30/2020
	2 Sample(s) Required between 5/1/2020 and 5/31/2020
	2 Sample(s) Required between 6/1/2020 and 6/30/2020
	2 Sample(s) Required between 7/1/2020 and 7/31/2020
	2 Sample(s) Required between 8/1/2020 and 8/31/2020
	2 Sample(s) Required between 9/1/2020 and 9/30/2020
	2 Sample(s) Required between 10/1/2020 and 10/31/2020
	2 Sample(s) Required between 11/1/2020 and 11/30/2020
	2 Sample(s) Required between 12/1/2020 and 12/31/2020

TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2020 and 1/31/2020
	2 Sample(s) Required between 2/1/2020 and 2/29/2020
	2 Sample(s) Required between 3/1/2020 and 3/31/2020
	2 Sample(s) Required between 4/1/2020 and 4/30/2020
	2 Sample(s) Required between 5/1/2020 and 5/31/2020
	2 Sample(s) Required between 6/1/2020 and 6/30/2020
	2 Sample(s) Required between 7/1/2020 and 7/31/2020
	2 Sample(s) Required between 8/1/2020 and 8/31/2020
	2 Sample(s) Required between 9/1/2020 and 9/30/2020
	2 Sample(s) Required between 10/1/2020 and 10/31/2020
	2 Sample(s) Required between 11/1/2020 and 11/30/2020
	2 Sample(s) Required between 12/1/2020 and 12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: JEFFERSONVILLE, VILLAGE DISTRIBUTION 42 COLONIAL DR	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	-------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2020 and 9/30/2020 at: DS201
-------------------------	---------------------------------------------------------------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH2400612 JEFFERSONVILLE VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: JEFFERSONVILLE, VILLAGE DISTRIBUTION 9935 ST RT 41	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	------------------------------------------------------------------------------------	--------------------------------

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2020 and 9/30/2020 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: JEFFERSONVILLE, VILLAGE DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	---------------------------------------------------------------------------------------------------------------------	--------------------------------

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022

10 Sample(s) Required between 6/1/2020 and 9/30/2020

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.



OH2400714 WASHINGTON COURT HOUSE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 2454045	Facility Name: WASHINGTON COURT HOUSE PWS	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	1/1/2020 and 5/31/2020
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	1 Sample(s) Required between	1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between	1/1/2020 and 1/31/2020
	1 Sample(s) Required between	2/1/2020 and 2/29/2020
	1 Sample(s) Required between	3/1/2020 and 3/31/2020
	1 Sample(s) Required between	4/1/2020 and 4/30/2020
	1 Sample(s) Required between	5/1/2020 and 5/31/2020
	1 Sample(s) Required between	6/1/2020 and 6/30/2020
	1 Sample(s) Required between	7/1/2020 and 7/31/2020
	1 Sample(s) Required between	8/1/2020 and 8/31/2020
	1 Sample(s) Required between	9/1/2020 and 9/30/2020
	1 Sample(s) Required between	10/1/2020 and 10/31/2020
	1 Sample(s) Required between	11/1/2020 and 11/30/2020
	1 Sample(s) Required between	12/1/2020 and 12/31/2020
RADIOLOGICALS	1 Sample(s) Required between	6/1/2020 and 10/31/2020
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002 RADIUM-228 - 4030		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	4/1/2020 and 6/30/2020
<i>Sample for all the analytes listed below:</i>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	1/1/2020 and 5/31/2020



Effective Date: 04/17/2020

2020 ENTRY POINT SCHEDULE

OH2400714 WASHINGTON COURT HOUSE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 2454045	Facility Name: WASHINGTON COURT HOUSE PWS
Location	SMP ID: EP001/LT2001	Facility Source: Surface Water
		Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals

Monitoring Requirements

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY*

Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.

**Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*



OH2400714 WASHINGTON COURT HOUSE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 2454045	Facility Name: WASHINGTON COURT HOUSE PWS
Location	SMP ID: LT2001	Facility Source: Surface Water
		Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/29/2019 and 1/4/2020
	1 Sample(s) Required between 1/12/2020 and 1/18/2020
	1 Sample(s) Required between 1/26/2020 and 2/1/2020
	1 Sample(s) Required between 2/9/2020 and 2/15/2020
	1 Sample(s) Required between 2/23/2020 and 2/29/2020
	1 Sample(s) Required between 3/8/2020 and 3/14/2020
	1 Sample(s) Required between 3/22/2020 and 3/28/2020
	1 Sample(s) Required between 4/5/2020 and 4/11/2020
	1 Sample(s) Required between 4/19/2020 and 4/25/2020
	1 Sample(s) Required between 5/3/2020 and 5/9/2020
	1 Sample(s) Required between 5/17/2020 and 5/23/2020
	1 Sample(s) Required between 5/31/2020 and 6/6/2020
	1 Sample(s) Required between 6/14/2020 and 6/20/2020
	1 Sample(s) Required between 6/28/2020 and 7/4/2020
	1 Sample(s) Required between 7/12/2020 and 7/18/2020
	1 Sample(s) Required between 7/26/2020 and 8/1/2020
	1 Sample(s) Required between 8/9/2020 and 8/15/2020
	1 Sample(s) Required between 8/23/2020 and 8/29/2020
	1 Sample(s) Required between 9/6/2020 and 9/12/2020
	1 Sample(s) Required between 9/20/2020 and 9/26/2020
1 Sample(s) Required between 10/4/2020 and 10/10/2020	
1 Sample(s) Required between 10/18/2020 and 10/24/2020	
1 Sample(s) Required between 11/1/2020 and 11/7/2020	
1 Sample(s) Required between 11/15/2020 and 11/21/2020	
1 Sample(s) Required between 11/29/2020 and 12/5/2020	
1 Sample(s) Required between 12/13/2020 and 12/19/2020	

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.



OH2400714 WASHINGTON COURT HOUSE PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: WASHINGTON COURT HOUSE DISTRIBUTION	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	-----------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

TOTAL COLIFORM (TCR) - 3100	15 Sample(s) Required between 1/1/2020 and 1/31/2020
	15 Sample(s) Required between 2/1/2020 and 2/29/2020
	15 Sample(s) Required between 3/1/2020 and 3/31/2020
	15 Sample(s) Required between 4/1/2020 and 4/30/2020
	15 Sample(s) Required between 5/1/2020 and 5/31/2020
	15 Sample(s) Required between 6/1/2020 and 6/30/2020
	15 Sample(s) Required between 7/1/2020 and 7/31/2020
	15 Sample(s) Required between 8/1/2020 and 8/31/2020
	15 Sample(s) Required between 9/1/2020 and 9/30/2020
	15 Sample(s) Required between 10/1/2020 and 10/31/2020
	15 Sample(s) Required between 11/1/2020 and 11/30/2020
	15 Sample(s) Required between 12/1/2020 and 12/31/2020

TOTAL CHLORINE - 1000	15 Sample(s) Required between 1/1/2020 and 1/31/2020
	15 Sample(s) Required between 2/1/2020 and 2/29/2020
	15 Sample(s) Required between 3/1/2020 and 3/31/2020
	15 Sample(s) Required between 4/1/2020 and 4/30/2020
	15 Sample(s) Required between 5/1/2020 and 5/31/2020
	15 Sample(s) Required between 6/1/2020 and 6/30/2020
	15 Sample(s) Required between 7/1/2020 and 7/31/2020
	15 Sample(s) Required between 8/1/2020 and 8/31/2020
	15 Sample(s) Required between 9/1/2020 and 9/30/2020
	15 Sample(s) Required between 10/1/2020 and 10/31/2020
	15 Sample(s) Required between 11/1/2020 and 11/30/2020
	15 Sample(s) Required between 12/1/2020 and 12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: WASHINGTON COURT HOUSE DISTRIBUTION 1551 ROBINSON ROAD	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	----------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2020 and 2/14/2020 at: DS201
	Dual Sample Required between 5/8/2020 and 5/14/2020 at: DS201
	Dual Sample Required between 8/8/2020 and 8/14/2020 at: DS201
	Dual Sample Required between 11/8/2020 and 11/14/2020 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH2400714 WASHINGTON COURT HOUSE PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: WASHINGTON COURT HOUSE DISTRIBUTION 810 HIGHLAND AVENUE	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	-----------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2020 and 2/14/2020 at: DS202
	Dual Sample Required between 5/8/2020 and 5/14/2020 at: DS202
	Dual Sample Required between 8/8/2020 and 8/14/2020 at: DS202
	Dual Sample Required between 11/8/2020 and 11/14/2020 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: WASHINGTON COURT HOUSE DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	--------------------------------------------------------------------------------------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------



Effective Date: 01/01/2020

2020 ENTRY POINT SCHEDULE

OH2400912 RANCH OF OPPORTUNITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 2454046	Facility Name: RANCH OF OPPORTUNITY	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	6/1/2020 and 10/31/2020
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	1 Sample(s) Required between	1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between	1/1/2020 and 5/31/2020
RADIOLOGICALS	1 Sample(s) Required between	6/1/2020 and 10/31/2020
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002 RADIUM-228 - 4030		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	1/1/2020 and 5/31/2020
<i>Sample for all the analytes listed below:</i>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	6/1/2020 and 10/31/2020



OH2400912 RANCH OF OPPORTUNITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: RANCH OF OPPORTUNITY DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 1/31/2020
	1 Sample(s) Required between 2/1/2020 and 2/29/2020
	1 Sample(s) Required between 3/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 4/30/2020
	1 Sample(s) Required between 5/1/2020 and 5/31/2020
	1 Sample(s) Required between 6/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 7/31/2020
	1 Sample(s) Required between 8/1/2020 and 8/31/2020
	1 Sample(s) Required between 9/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 10/31/2020
	1 Sample(s) Required between 11/1/2020 and 11/30/2020
	1 Sample(s) Required between 12/1/2020 and 12/31/2020

Sampling Location	Facility ID: DS1	Facility Name: RANCH OF OPPORTUNITY DISTRIBUTION
	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2020 and 9/30/2020 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1	Facility Name: RANCH OF OPPORTUNITY DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required

OH2430012 ODOT REST AREA 6-9 PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **ODOT REST AREA 6-9 DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

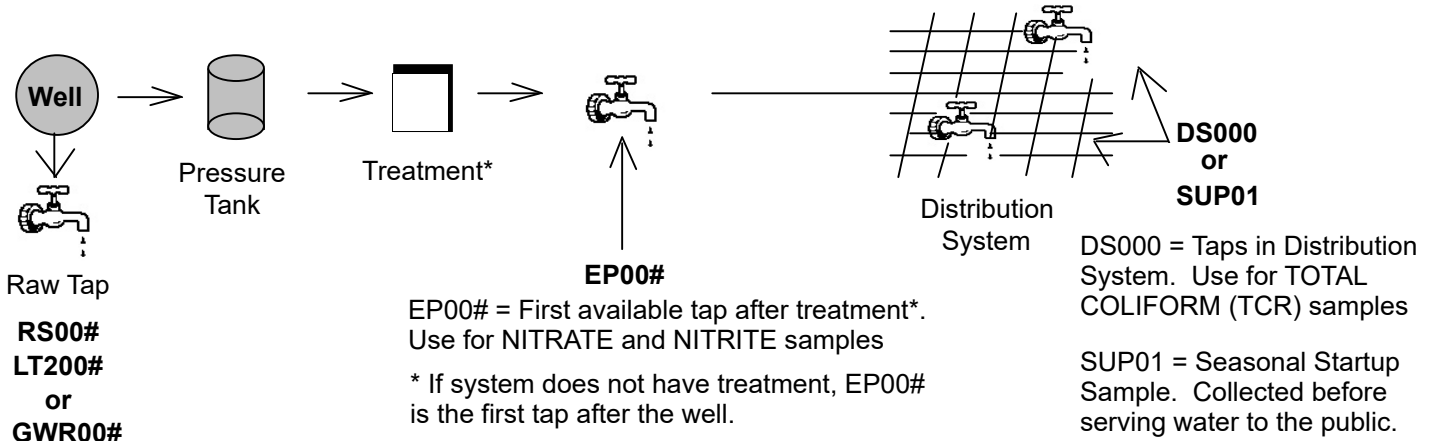

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2430012 ODOT REST AREA 6-9 PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 2454048	Facility Name: ODOT REST AREA 6-9	
Location SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between 1/1/2020 and 5/31/2020

Where to Collect Samples For a Small Public Water System

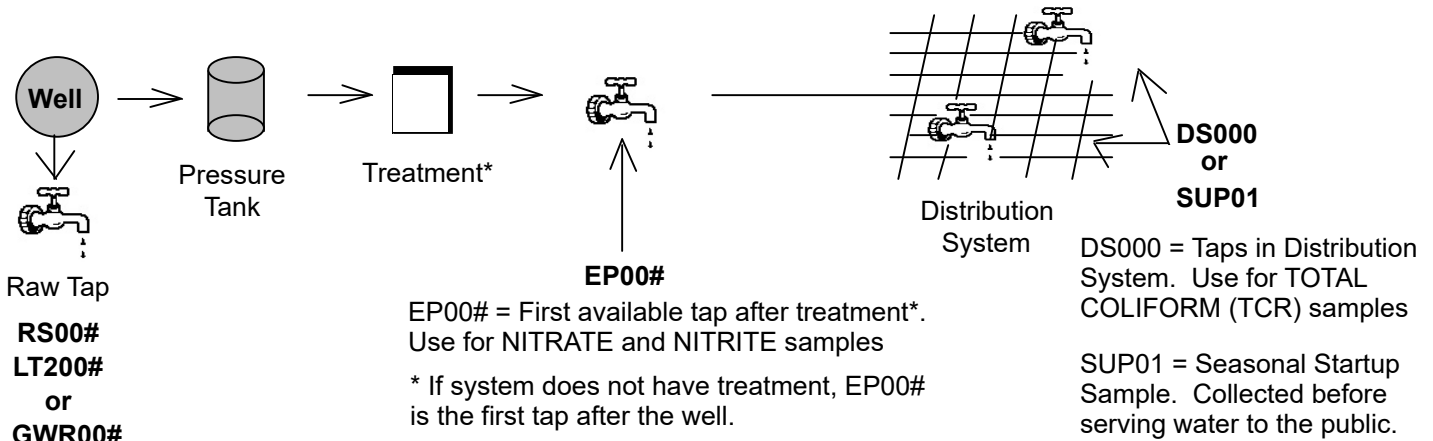

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2430112 ODOT REST AREA 6-10 PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ODOT REST AREA 6-10 DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2430112 ODOT REST AREA 6-10 PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 2454049	Facility Name: ODOT REST AREA 6-10	
Location SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between 1/1/2020 and 5/31/2020

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2430612 BUCKEYE HILLS COUNTRY CLUB INC

System Type: Transient Noncommunity

Operating Period: 3/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **BUCKEYE HILLS COUNTRY CL DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

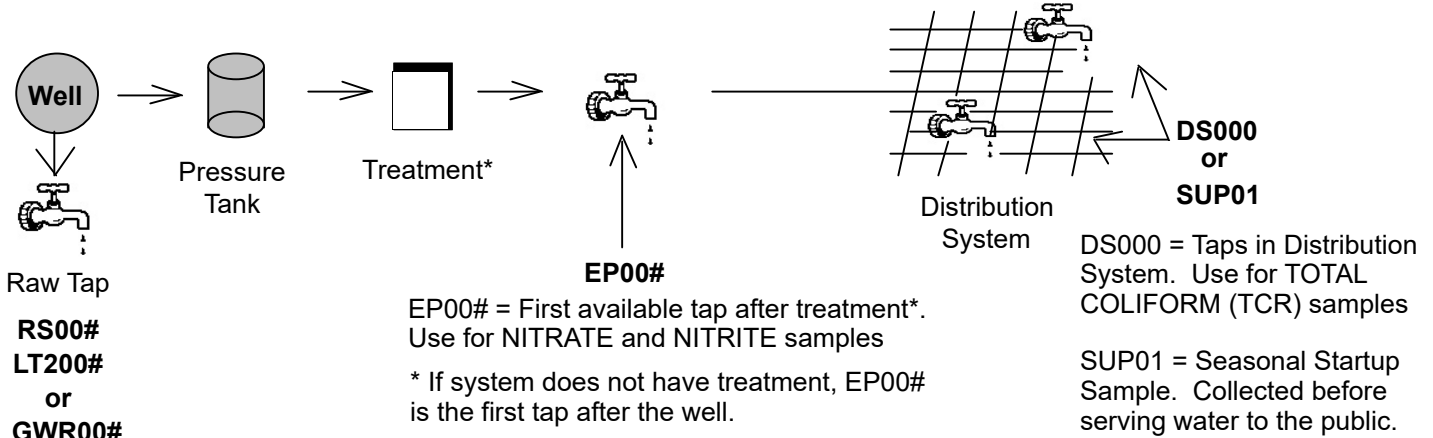

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2430612 BUCKEYE HILLS COUNTRY CLUB INC

System Type: Transient Noncommunity

Operating Period: 3/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BUCKEYE HILLS COUNTRY CL DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 3/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 11/30/2020

Where to Collect Samples For a Small Public Water System

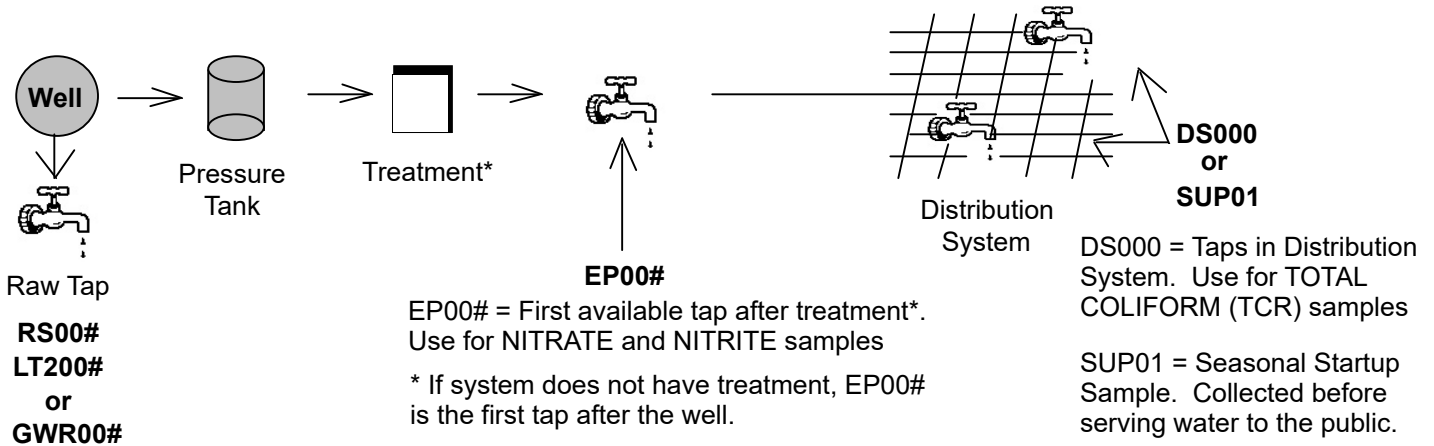

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2430612 BUCKEYE HILLS COUNTRY CLUB INC

System Type: Transient Noncommunity

Operating Period: 3/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 2454050 Facility Name: BUCKEYE HILLS COUNTRY CLUB
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between 1/1/2020 and 5/31/2020

Where to Collect Samples For a Small Public Water System

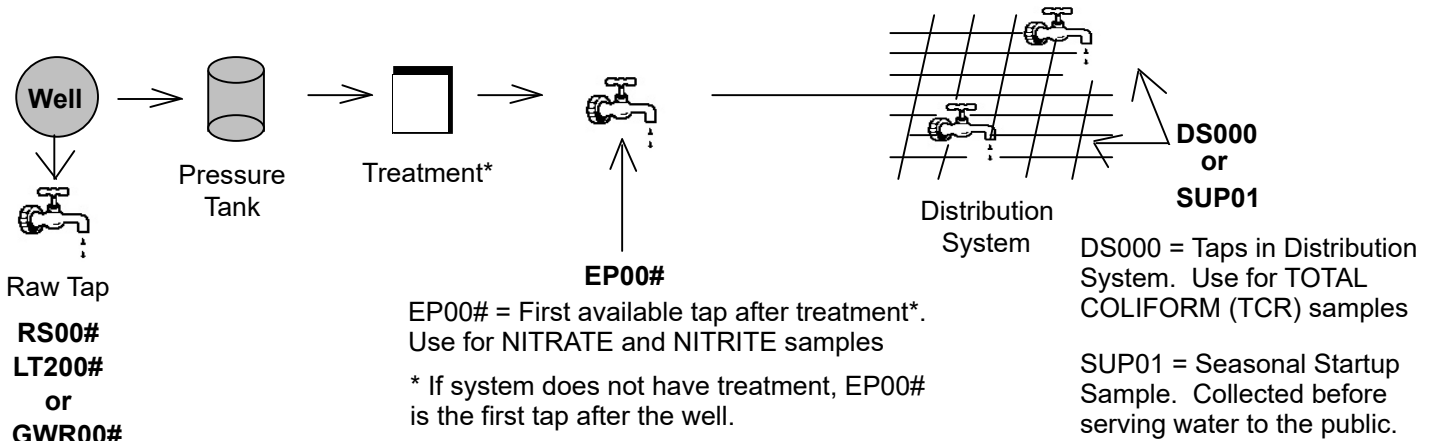

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2435612 WALNUT LAKE CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **WALNUT LAKE CAMPGROUND DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

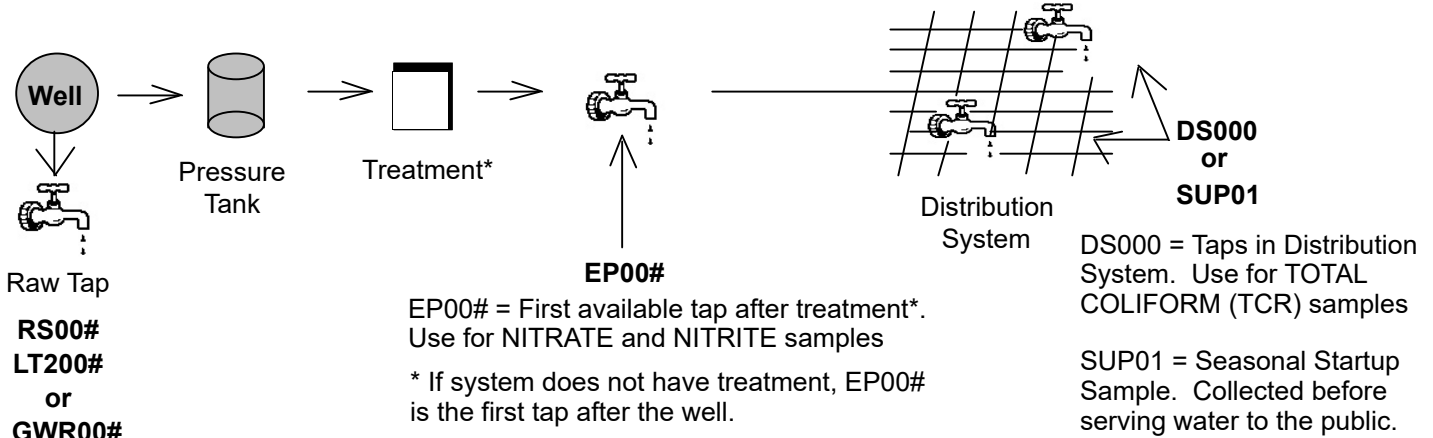

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2435612 WALNUT LAKE CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: WALNUT LAKE CAMPGROUND DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2020 and 6/30/2020 1 Sample(s) Required between 7/1/2020 and 9/15/2020

Where to Collect Samples For a Small Public Water System

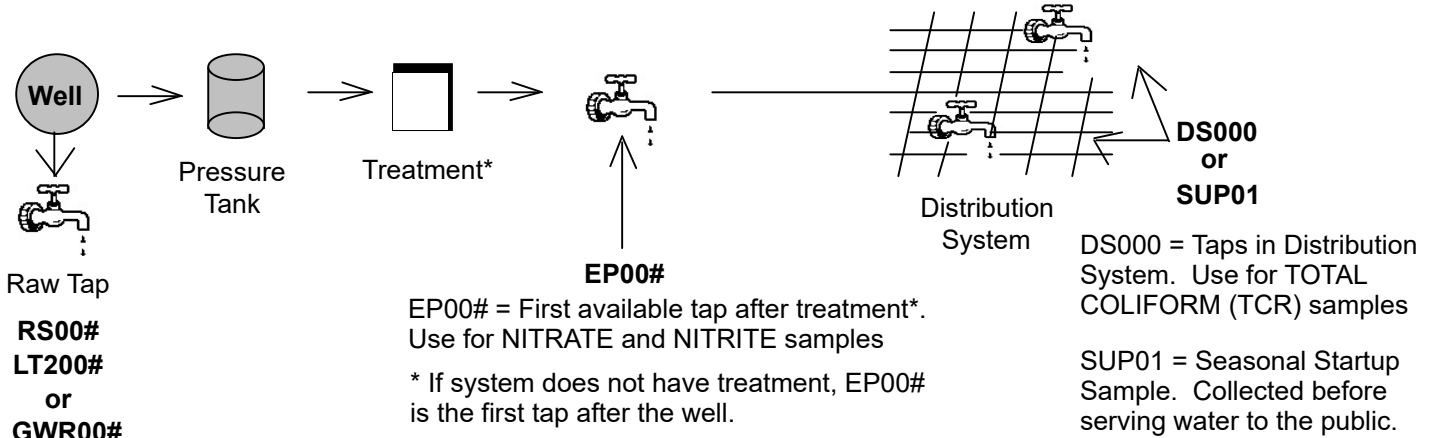

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2435612 WALNUT LAKE CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 2454064	Facility Name: WALNUT LAKE CAMPGROUND	
Location SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between 1/1/2020 and 5/31/2020

Where to Collect Samples For a Small Public Water System

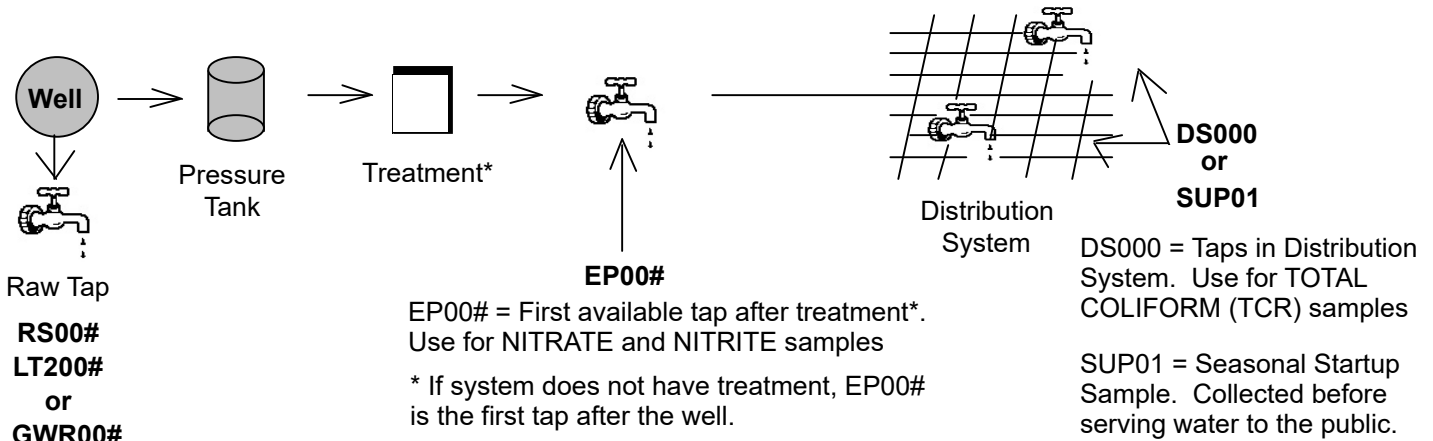

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2020

2020 ENTRY POINT SCHEDULE

OH2437412 I-71 & SR-35 PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 2454071 SMP ID: EP001	Facility Name: I-71 & ST RTE 35 PWS Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	-----------------------------------------------------	----------------------------------------------------------------------------------------	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020

Chemicals	Monitoring Requirements
INORGANICS <i>Sample for all the analytes listed below:</i> ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	1 Sample(s) Required between 6/1/2020 and 10/31/2020
NITRITE - 1041	1 Sample(s) Required between 1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between 1/1/2020 and 5/31/2020
RADIOLOGICALS <i>Sample for all the analytes listed below:</i> GROSS ALPHA - 4002 RADIUM-228 - 4030	1 Sample(s) Required between 6/1/2020 and 10/31/2020
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 <i>Sample for all the analytes listed below:</i> ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	1 Sample(s) Required between 1/1/2020 and 5/31/2020
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH2437412 I-71 & SR-35 PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: I-71 & SR-35 PWS DIST	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	-------------------------------------------------	--------------------------------

Chemicals Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2020 and 1/31/2020
	1 Sample(s) Required between	2/1/2020 and 2/29/2020
	1 Sample(s) Required between	3/1/2020 and 3/31/2020
	1 Sample(s) Required between	4/1/2020 and 4/30/2020
	1 Sample(s) Required between	5/1/2020 and 5/31/2020
	1 Sample(s) Required between	6/1/2020 and 6/30/2020
	1 Sample(s) Required between	7/1/2020 and 7/31/2020
	1 Sample(s) Required between	8/1/2020 and 8/31/2020
	1 Sample(s) Required between	9/1/2020 and 9/30/2020
	1 Sample(s) Required between	10/1/2020 and 10/31/2020
	1 Sample(s) Required between	11/1/2020 and 11/30/2020
	1 Sample(s) Required between	12/1/2020 and 12/31/2020

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2020 and 1/31/2020
	1 Sample(s) Required between	2/1/2020 and 2/29/2020
	1 Sample(s) Required between	3/1/2020 and 3/31/2020
	1 Sample(s) Required between	4/1/2020 and 4/30/2020
	1 Sample(s) Required between	5/1/2020 and 5/31/2020
	1 Sample(s) Required between	6/1/2020 and 6/30/2020
	1 Sample(s) Required between	7/1/2020 and 7/31/2020
	1 Sample(s) Required between	8/1/2020 and 8/31/2020
	1 Sample(s) Required between	9/1/2020 and 9/30/2020
	1 Sample(s) Required between	10/1/2020 and 10/31/2020
	1 Sample(s) Required between	11/1/2020 and 11/30/2020
	1 Sample(s) Required between	12/1/2020 and 12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: I-71 & SR-35 PWS DIST ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	-----------------------------------------------------------------------------	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2020 and 9/30/2020 at: DS201
-------------------------	------------------------------	----------------------------------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH2437412 I-71 & SR-35 PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: I-71 & SR-35 PWS DIST ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	-----------------------------------------------------------------------------	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 7/1/2020 and 9/30/2020 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: I-71 & SR-35 PWS DIST Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	-------------------------------------------------	----------------------------------------------------------------------------------------------------------	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2020 and 9/30/2020

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH2438112 MAYER FARM EQUIPMENT PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: MAYER FARM EQUIPMENT DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2438112 MAYER FARM EQUIPMENT PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 2461531 Facility Name: MAYER FARM EQUIPMENT

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between 1/1/2020 and 5/31/2020

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2438312 CARTER LUMBER PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **CARTER LUMBER 22-20 DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2438312 CARTER LUMBER PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 2461567 Facility Name: CARTER LUMBER
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between 1/1/2020 and 5/31/2020

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2438512 UNITY FELLOWSHIP CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: UNITY FELLOWSHIP CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2438512 UNITY FELLOWSHIP CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 2462074 Facility Name: UNITY FELLOWSHIP CHURCH
Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between 1/1/2020 and 5/31/2020

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2438713 HOLLAND PYKE FARMS PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH2438713 HOLLAND PYKE FARMS PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 2462353 Facility Name: HOLLAND PYKE FARMS

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 1/1/2020 and 5/31/2020
NITRATE - 1040	1 Sample(s) Required between 1/1/2020 and 5/31/2020

Where to Collect Samples For a Small Public Water System



Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!