

OH5900112 CARDINGTON VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5956758 SMP ID: EP001	Facility Name: CARDINGTON WTP Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2020 and 10/31/2020
<u>Sample for all the analytes listed below:</u>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required

Effective Date: 01/01/2020

OH5900112 CARDINGTON VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: CARDINGTON DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements		
ASBESTOS - 1094	Not Required		
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between	1/1/2020 and	1/31/2020
	2 Sample(s) Required between	2/1/2020 and	2/29/2020
	2 Sample(s) Required between	3/1/2020 and	3/31/2020
	2 Sample(s) Required between	4/1/2020 and	4/30/2020
	2 Sample(s) Required between	5/1/2020 and	5/31/2020
	2 Sample(s) Required between	6/1/2020 and	6/30/2020
	2 Sample(s) Required between	7/1/2020 and	7/31/2020
	2 Sample(s) Required between	8/1/2020 and	8/31/2020
	2 Sample(s) Required between	9/1/2020 and	9/30/2020
	2 Sample(s) Required between	10/1/2020 and	10/31/2020
	2 Sample(s) Required between	11/1/2020 and	11/30/2020
	2 Sample(s) Required between	12/1/2020 and	12/31/2020
TOTAL CHLORINE - 1000	2 Sample(s) Required between	1/1/2020 and	1/31/2020
	2 Sample(s) Required between	2/1/2020 and	2/29/2020
	2 Sample(s) Required between	3/1/2020 and	3/31/2020
	2 Sample(s) Required between	4/1/2020 and	4/30/2020
	2 Sample(s) Required between	5/1/2020 and	5/31/2020
	2 Sample(s) Required between	6/1/2020 and	6/30/2020
	2 Sample(s) Required between	7/1/2020 and	7/31/2020
	2 Sample(s) Required between	8/1/2020 and	8/31/2020
	2 Sample(s) Required between	9/1/2020 and	9/30/2020
	2 Sample(s) Required between	10/1/2020 and	10/31/2020
	2 Sample(s) Required between	11/1/2020 and	11/30/2020
	2 Sample(s) Required between	12/1/2020 and	12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: CARDINGTON DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements		
DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2020 and	9/30/2020at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Effective Date: 01/01/2020

OH5900112 CARDINGTON VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: CARDINGTON DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2020 and 9/30/2020 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: CARDINGTON DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

10 Sample(s) Required between 6/1/2020 and 9/30/2020

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH5900412 M & H MHP, LLC

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5956761 SMP ID: EP001	Facility Name: M & H MHP WTP Facility Source: Ground Water	Facility Class: CLASS A
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2020 and 10/31/2020
<u>Sample for all the analytes listed below:</u>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required

Effective Date: 01/01/2020

OH5900412 M & H MHP, LLC

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1	Facility Name: M & H MHP DIST
	SMP ID: DS000	

Chemicals**Monitoring Requirements**

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2020	and	1/31/2020
	1 Sample(s) Required between	2/1/2020	and	2/29/2020
	1 Sample(s) Required between	3/1/2020	and	3/31/2020
	1 Sample(s) Required between	4/1/2020	and	4/30/2020
	1 Sample(s) Required between	5/1/2020	and	5/31/2020
	1 Sample(s) Required between	6/1/2020	and	6/30/2020
	1 Sample(s) Required between	7/1/2020	and	7/31/2020
	1 Sample(s) Required between	8/1/2020	and	8/31/2020
	1 Sample(s) Required between	9/1/2020	and	9/30/2020
	1 Sample(s) Required between	10/1/2020	and	10/31/2020
	1 Sample(s) Required between	11/1/2020	and	11/30/2020
	1 Sample(s) Required between	12/1/2020	and	12/31/2020

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2020	and	1/31/2020
	1 Sample(s) Required between	2/1/2020	and	2/29/2020
	1 Sample(s) Required between	3/1/2020	and	3/31/2020
	1 Sample(s) Required between	4/1/2020	and	4/30/2020
	1 Sample(s) Required between	5/1/2020	and	5/31/2020
	1 Sample(s) Required between	6/1/2020	and	6/30/2020
	1 Sample(s) Required between	7/1/2020	and	7/31/2020
	1 Sample(s) Required between	8/1/2020	and	8/31/2020
	1 Sample(s) Required between	9/1/2020	and	9/30/2020
	1 Sample(s) Required between	10/1/2020	and	10/31/2020
	1 Sample(s) Required between	11/1/2020	and	11/30/2020
	1 Sample(s) Required between	12/1/2020	and	12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: M & H MHP DIST
	SMP ID: DS201	7117 COUNTY ROAD 59

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2020	and	9/30/2020	at: DS201
-------------------------	------------------------------	----------	-----	-----------	-----------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Effective Date: 01/01/2020

2020 DISTRIBUTION SCHEDULE

OH5900412 M & H MHP, LLC

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: M & H MHP DIST
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022

Not Required

OH5900512 LAKEVIEW ESTATES MHC

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5956762 SMP ID: EP001	Facility Name: LAKEVIEW ESTATES MHC Facility Source: Ground Water	Facility Class: CLASS A
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2020 and 10/31/2020
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required

Effective Date: 01/01/2020

OH5900512 LAKEVIEW ESTATES MHC

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1	Facility Name: LAKEVIEW ESTATES MHC DIST
	SMP ID: DS000	

Chemicals**Monitoring Requirements**

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2020	and	1/31/2020
	1 Sample(s) Required between	2/1/2020	and	2/29/2020
	1 Sample(s) Required between	3/1/2020	and	3/31/2020
	1 Sample(s) Required between	4/1/2020	and	4/30/2020
	1 Sample(s) Required between	5/1/2020	and	5/31/2020
	1 Sample(s) Required between	6/1/2020	and	6/30/2020
	1 Sample(s) Required between	7/1/2020	and	7/31/2020
	1 Sample(s) Required between	8/1/2020	and	8/31/2020
	1 Sample(s) Required between	9/1/2020	and	9/30/2020
	1 Sample(s) Required between	10/1/2020	and	10/31/2020
	1 Sample(s) Required between	11/1/2020	and	11/30/2020
	1 Sample(s) Required between	12/1/2020	and	12/31/2020

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2020	and	1/31/2020
	1 Sample(s) Required between	2/1/2020	and	2/29/2020
	1 Sample(s) Required between	3/1/2020	and	3/31/2020
	1 Sample(s) Required between	4/1/2020	and	4/30/2020
	1 Sample(s) Required between	5/1/2020	and	5/31/2020
	1 Sample(s) Required between	6/1/2020	and	6/30/2020
	1 Sample(s) Required between	7/1/2020	and	7/31/2020
	1 Sample(s) Required between	8/1/2020	and	8/31/2020
	1 Sample(s) Required between	9/1/2020	and	9/30/2020
	1 Sample(s) Required between	10/1/2020	and	10/31/2020
	1 Sample(s) Required between	11/1/2020	and	11/30/2020
	1 Sample(s) Required between	12/1/2020	and	12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: LAKEVIEW ESTATES MHC DIST
	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2020	and	9/30/2020	at: DS201
-------------------------	------------------------------	----------	-----	-----------	-----------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH5900512 LAKEVIEW ESTATES MHC

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: LAKEVIEW ESTATES MHC DIST
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2020 and 9/30/2020
-------------------------------	---

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH5900712 MT GILEAD VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5956763 SMP ID: EP001	Facility Name: MT GILEAD WTP Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements	
ARSENIC - 1005	1 Sample(s) Required between	1/1/2020 and 3/31/2020
	1 Sample(s) Required between	4/1/2020 and 6/30/2020
	1 Sample(s) Required between	7/1/2020 and 9/30/2020
	1 Sample(s) Required between	10/1/2020 and 12/31/2020
INORGANICS	Not Required	
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	6/1/2020 and 10/31/2020
RADIOLOGICALS	Not Required	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	6/1/2020 and 10/31/2020
<u>Sample for all the analytes listed below:</u>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required	

Effective Date: 01/01/2020

OH5900712 MT GILEAD VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MT GILEAD DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements		
ASBESTOS - 1094	Not Required		
TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Required between	1/1/2020 and	1/31/2020
	4 Sample(s) Required between	2/1/2020 and	2/29/2020
	4 Sample(s) Required between	3/1/2020 and	3/31/2020
	4 Sample(s) Required between	4/1/2020 and	4/30/2020
	4 Sample(s) Required between	5/1/2020 and	5/31/2020
	4 Sample(s) Required between	6/1/2020 and	6/30/2020
	4 Sample(s) Required between	7/1/2020 and	7/31/2020
	4 Sample(s) Required between	8/1/2020 and	8/31/2020
	4 Sample(s) Required between	9/1/2020 and	9/30/2020
	4 Sample(s) Required between	10/1/2020 and	10/31/2020
	4 Sample(s) Required between	11/1/2020 and	11/30/2020
	4 Sample(s) Required between	12/1/2020 and	12/31/2020
TOTAL CHLORINE - 1000	4 Sample(s) Required between	1/1/2020 and	1/31/2020
	4 Sample(s) Required between	2/1/2020 and	2/29/2020
	4 Sample(s) Required between	3/1/2020 and	3/31/2020
	4 Sample(s) Required between	4/1/2020 and	4/30/2020
	4 Sample(s) Required between	5/1/2020 and	5/31/2020
	4 Sample(s) Required between	6/1/2020 and	6/30/2020
	4 Sample(s) Required between	7/1/2020 and	7/31/2020
	4 Sample(s) Required between	8/1/2020 and	8/31/2020
	4 Sample(s) Required between	9/1/2020 and	9/30/2020
	4 Sample(s) Required between	10/1/2020 and	10/31/2020
	4 Sample(s) Required between	11/1/2020 and	11/30/2020
	4 Sample(s) Required between	12/1/2020 and	12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MT GILEAD DISTRIBUTION 900 ORCHARD DRIVE	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements		
DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2020 and	9/30/2020at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Effective Date: 01/01/2020

OH5900712 MT GILEAD VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: MT GILEAD DISTRIBUTION 165 FAIRWAY LANE	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2020 and 9/30/2020 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: MT GILEAD DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

20 Sample(s) Required between 6/1/2020 and 9/30/2020

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH5901012 CANDLEWOOD LAKE ASSOCIATION INC

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5956765 SMP ID: EP001	Facility Name: CANDLEWOOD LAKE WTP Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements	
ARSENIC - 1005	1 Sample(s) Required between	1/1/2020 and 3/31/2020
	1 Sample(s) Required between	4/1/2020 and 6/30/2020
	1 Sample(s) Required between	7/1/2020 and 9/30/2020
	1 Sample(s) Required between	10/1/2020 and 12/31/2020
INORGANICS	Not Required	
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	6/1/2020 and 10/31/2020
RADIOLOGICALS	Not Required	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	6/1/2020 and 10/31/2020
<u>Sample for all the analytes listed below:</u>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required	

Effective Date: 01/01/2020

OH5901012 CANDLEWOOD LAKE ASSOCIATION INC

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1	Facility Name: CANDLEWOOD LAKE ASSN INC DISTRIBUTIOI	Facility Class: CLASS 1
	SMP ID: DS000		

Chemicals**Monitoring Requirements**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2020 and 1/31/2020
	2 Sample(s) Required between 2/1/2020 and 2/29/2020
	2 Sample(s) Required between 3/1/2020 and 3/31/2020
	2 Sample(s) Required between 4/1/2020 and 4/30/2020
	2 Sample(s) Required between 5/1/2020 and 5/31/2020
	2 Sample(s) Required between 6/1/2020 and 6/30/2020
	2 Sample(s) Required between 7/1/2020 and 7/31/2020
	2 Sample(s) Required between 8/1/2020 and 8/31/2020
	2 Sample(s) Required between 9/1/2020 and 9/30/2020
	2 Sample(s) Required between 10/1/2020 and 10/31/2020
	2 Sample(s) Required between 11/1/2020 and 11/30/2020
	2 Sample(s) Required between 12/1/2020 and 12/31/2020

TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2020 and 1/31/2020
	2 Sample(s) Required between 2/1/2020 and 2/29/2020
	2 Sample(s) Required between 3/1/2020 and 3/31/2020
	2 Sample(s) Required between 4/1/2020 and 4/30/2020
	2 Sample(s) Required between 5/1/2020 and 5/31/2020
	2 Sample(s) Required between 6/1/2020 and 6/30/2020
	2 Sample(s) Required between 7/1/2020 and 7/31/2020
	2 Sample(s) Required between 8/1/2020 and 8/31/2020
	2 Sample(s) Required between 9/1/2020 and 9/30/2020
	2 Sample(s) Required between 10/1/2020 and 10/31/2020
	2 Sample(s) Required between 11/1/2020 and 11/30/2020
	2 Sample(s) Required between 12/1/2020 and 12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: CANDLEWOOD LAKE ASSN INC DISTRIBUTIOI	Facility Class: CLASS 1
	SMP ID: DS201	ADDRESS NOT KNOWN	

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2020 and 9/30/2020 at: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Effective Date: 01/01/2020

OH5901012 CANDLEWOOD LAKE ASSOCIATION INC

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: CANDLEWOOD LAKE ASSN INC DISTRIBUTIOI ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2020 and 9/30/2020 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: CANDLEWOOD LAKE ASSN INC DISTRIBUTIOI Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

10 Sample(s) Required between 6/1/2020 and 9/30/2020

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

Effective Date: 01/01/2020

OH5931712 CLEARFORK MARINA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **CLEARFORK MARINA DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

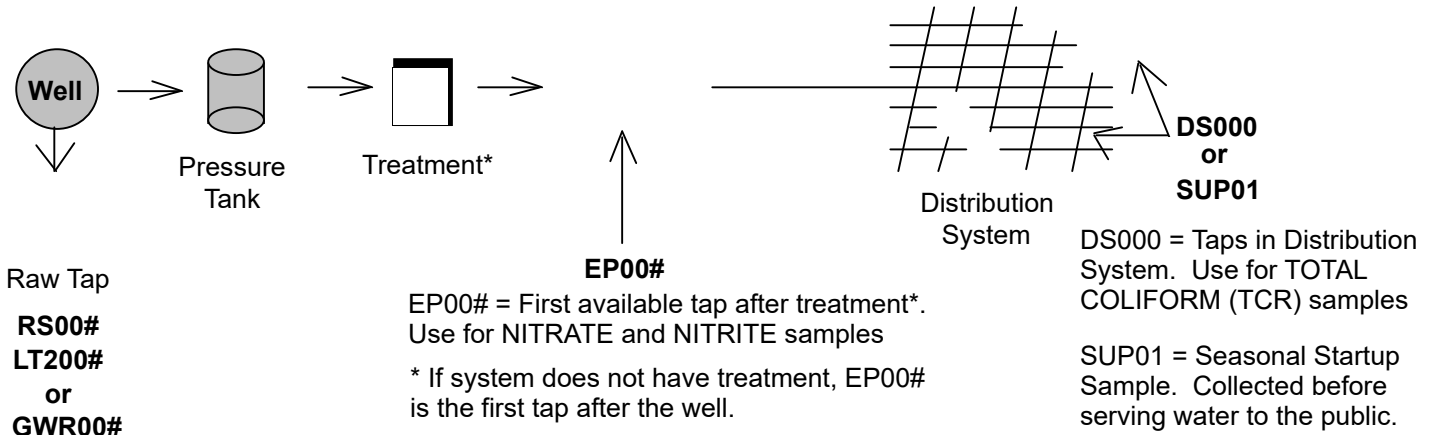

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5931712 CLEARFORK MARINA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5956768 Facility Name: CLEARFORK MARINA

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

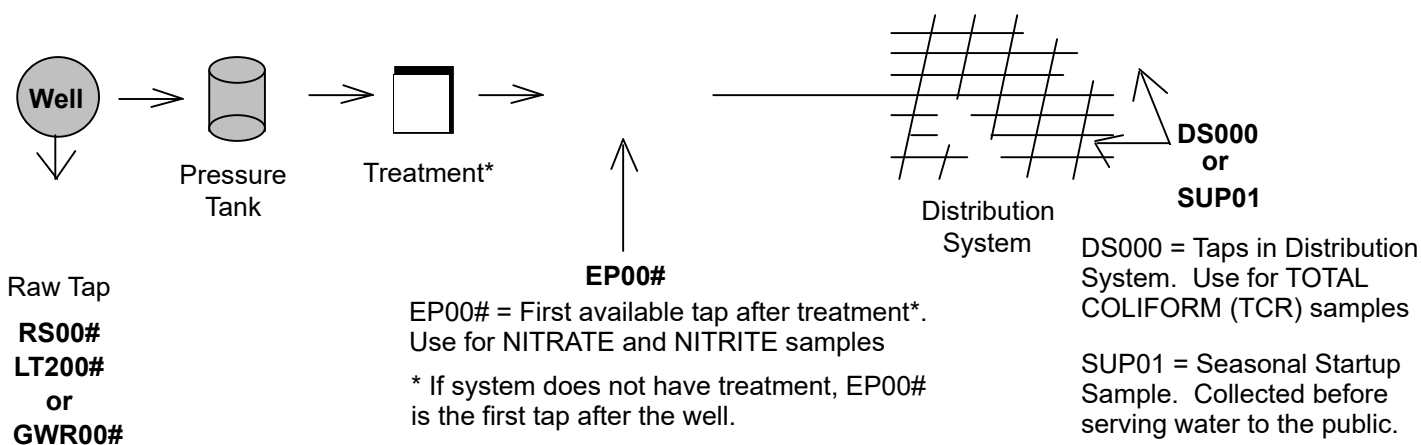

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5931812 CLEARFORK CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **CLEARFORK CAMPGROUND DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

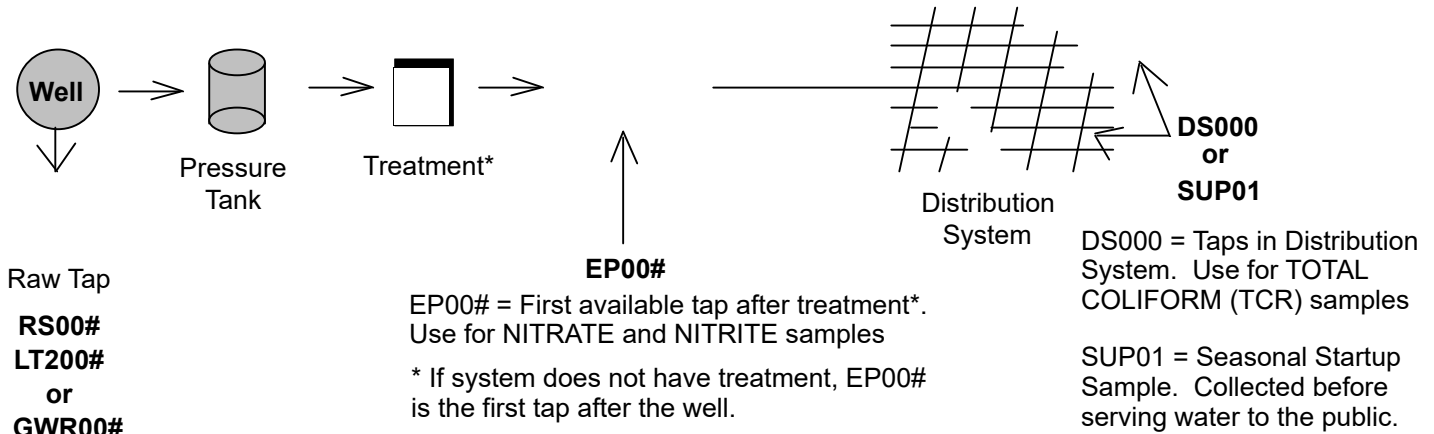

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5931812 CLEARFORK CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CLEARFORK CAMPGROUND DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/15/2020 and 4/30/2020
	1 Sample(s) Required between 5/1/2020 and 5/31/2020
	1 Sample(s) Required between 6/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 7/31/2020
	1 Sample(s) Required between 8/1/2020 and 8/31/2020
	1 Sample(s) Required between 9/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

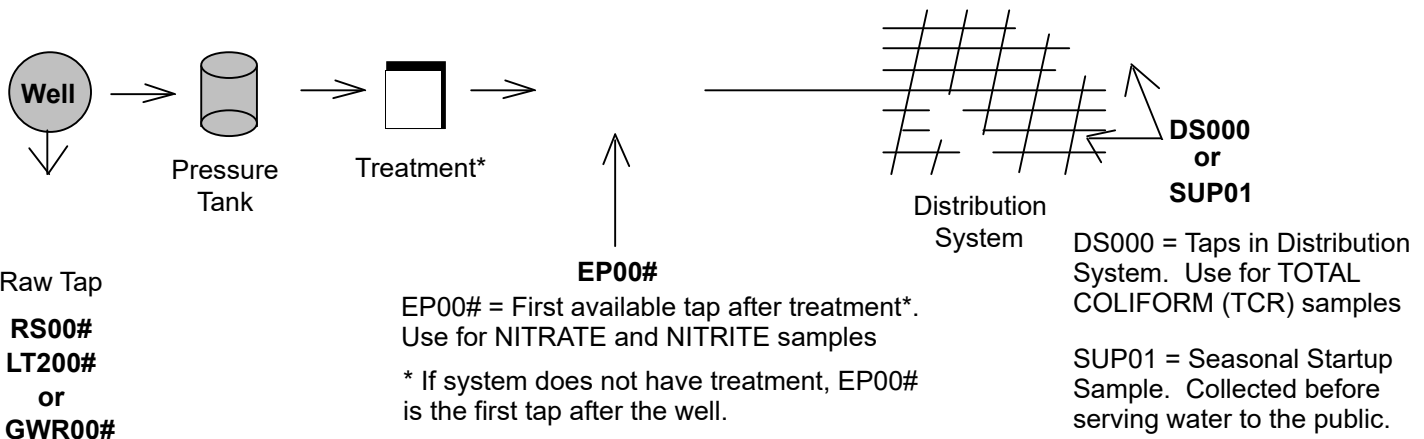

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5931812 CLEARFORK CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5956769** Facility Name: **CLEARFORK CAMPGROUND**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

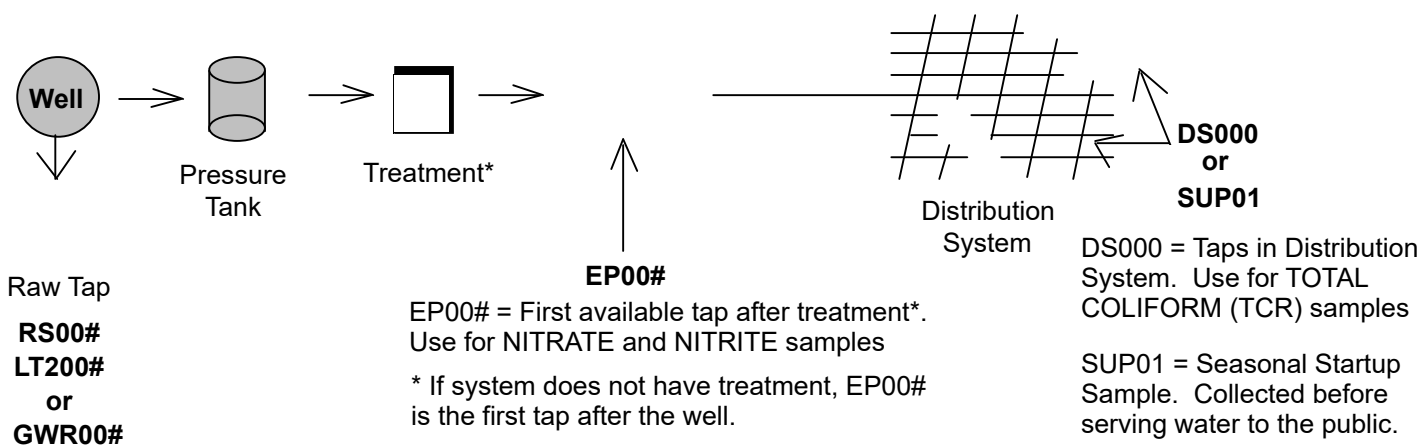

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5935712 MID-OHIO SPORTS MAINTENANCE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **MID-OHIO SPORTS MAINTENANCE DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

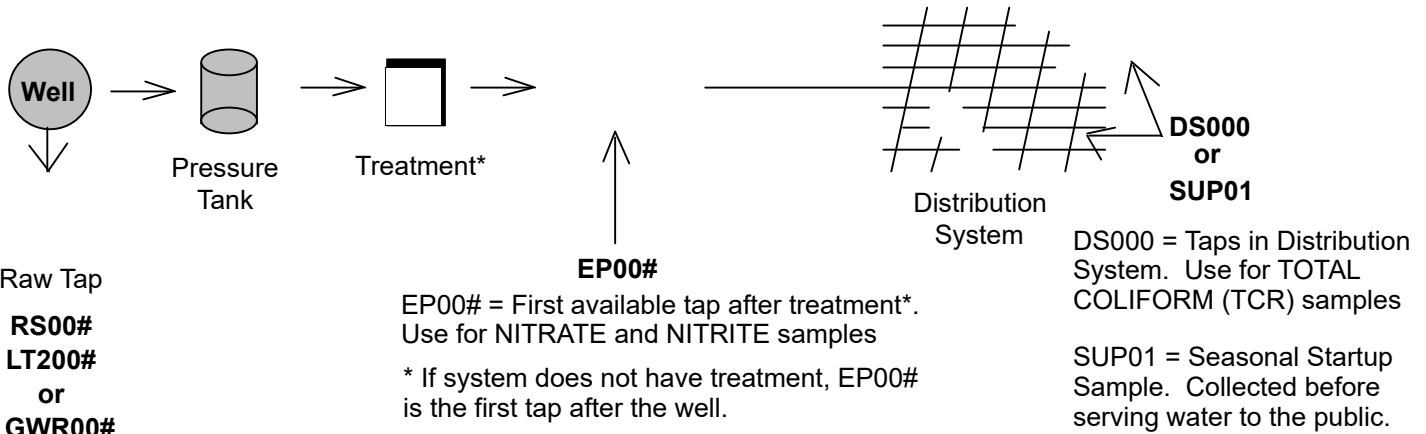

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5935712 MID-OHIO SPORTS MAINTENANCE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: MID-OHIO SPORTS MAINTENANCE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2020 and 6/30/2020 1 Sample(s) Required between 7/1/2020 and 9/15/2020

Where to Collect Samples For a Small Public Water System

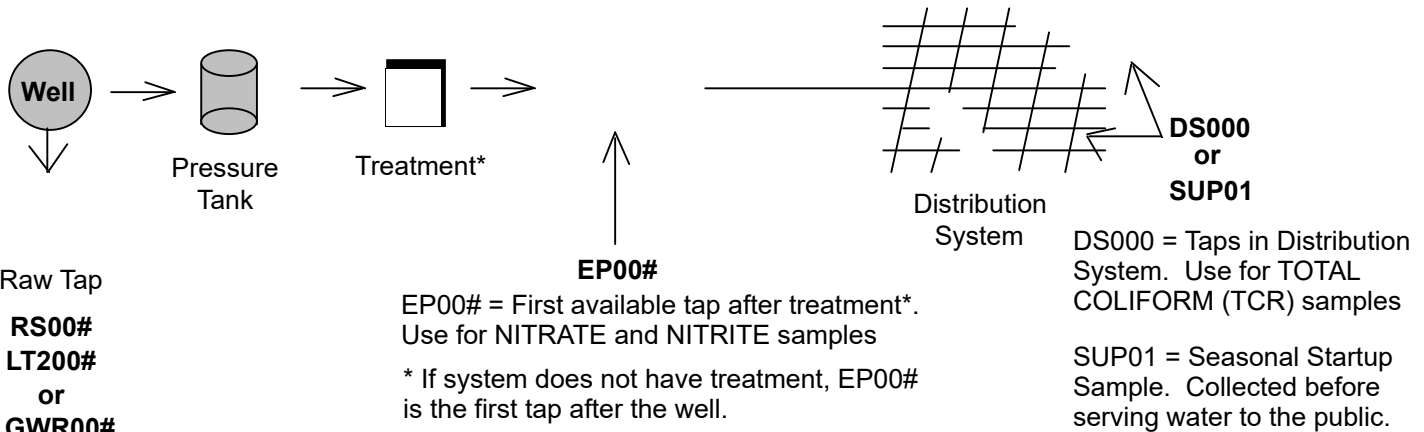

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5935712 MID-OHIO SPORTS MAINTENANCE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5956779 Facility Name: MID-OHIO SPORTS MAINTENANCE

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

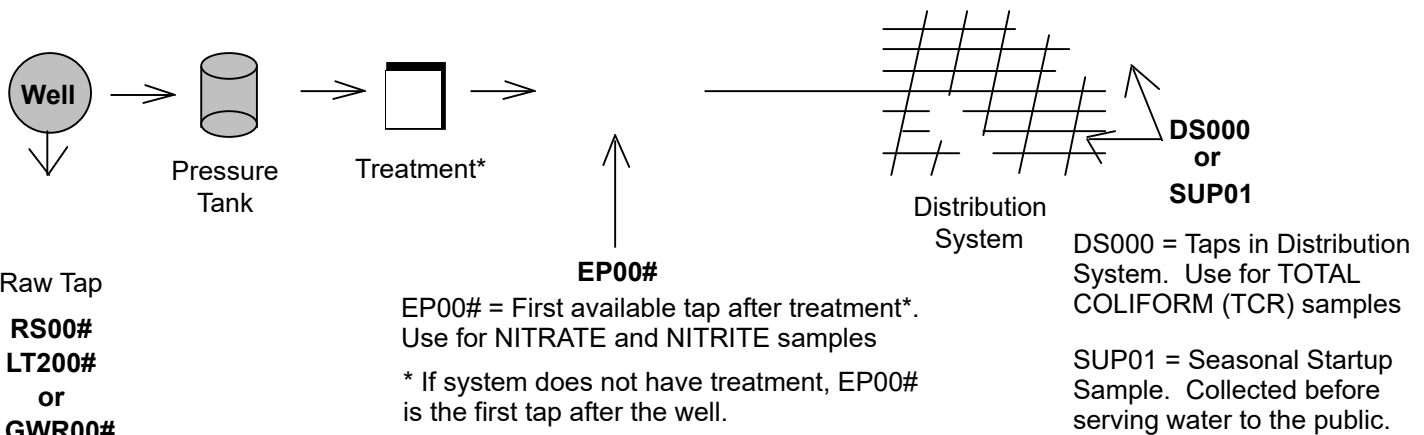

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5935812 MID-OHIO SPORTS TOWER

System Type: Transient Noncommunity

Operating Period: 5/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **MID-OHIO SPORTS/TOWER DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

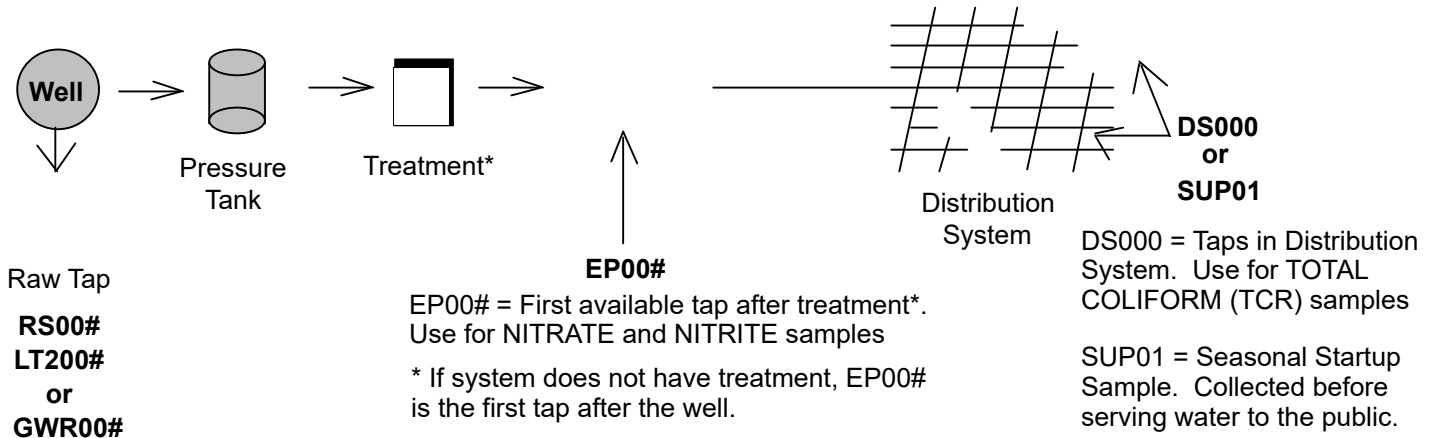

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5935812 MID-OHIO SPORTS TOWER

System Type: Transient Noncommunity

Operating Period: 5/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: MID-OHIO SPORTS/TOWER DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2020 and 6/30/2020 1 Sample(s) Required between 7/1/2020 and 9/15/2020

Where to Collect Samples For a Small Public Water System

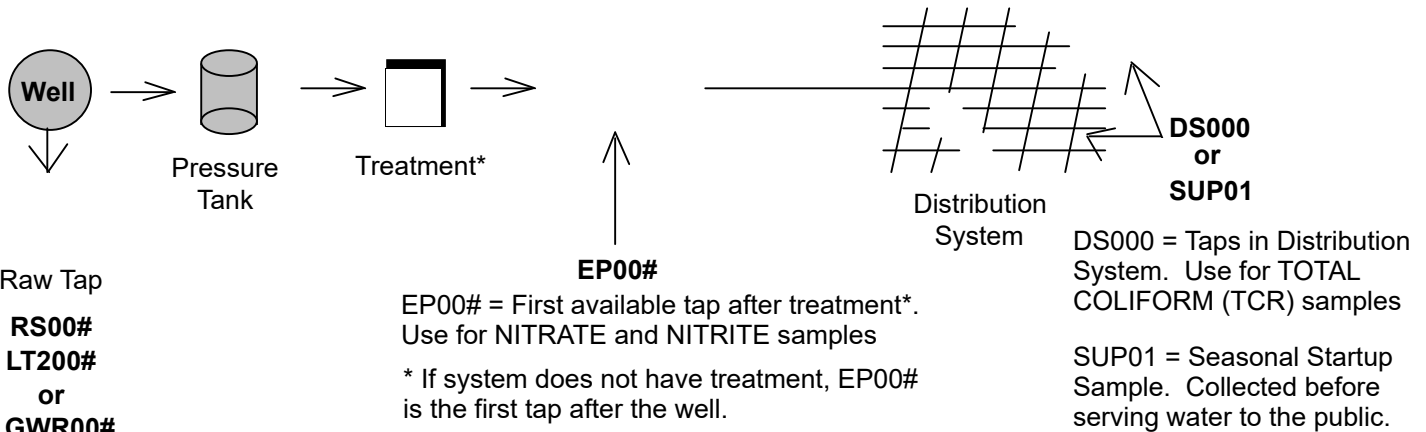

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5935812 MID-OHIO SPORTS TOWER

System Type: Transient Noncommunity

Operating Period: 5/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5956780** Facility Name: **MID-OHIO SPORTS/TOWER**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

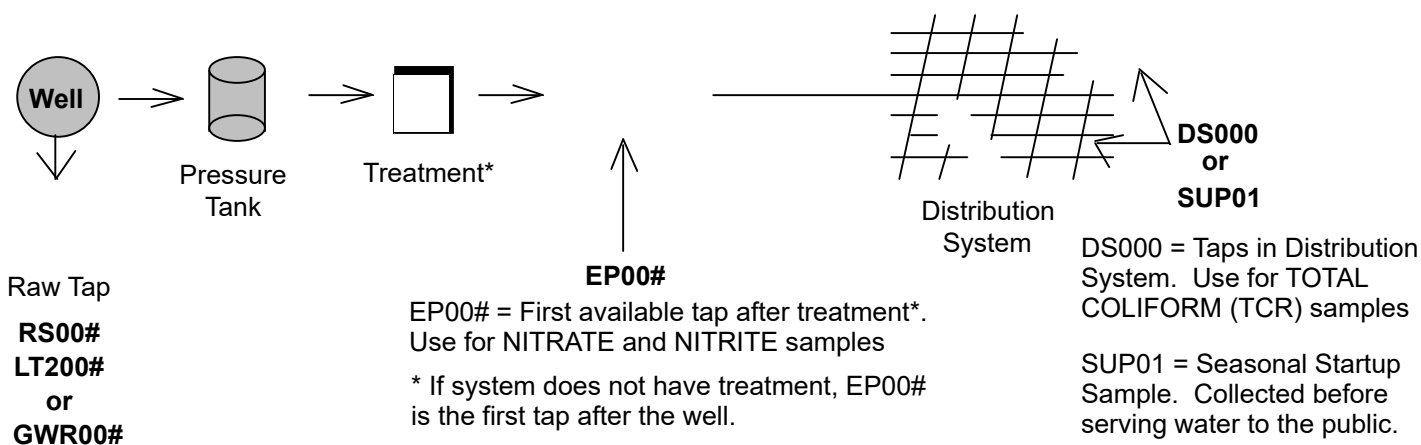

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5936212 NORTHMOR ADMINISTRATIVE OFFICE

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 5956783	Facility Name: NORTHMOR ADMINISTRATIVE OFFICE
Location	SMP ID: EP001	Facility Source: Ground Water Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2020 and 10/31/2020
<u>Sample for all the analytes listed below:</u>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required

Effective Date: 01/01/2020

OH5936212 NORTHMOR ADMINISTRATIVE OFFICE

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: NORTHMOR ADMIN. OFFICE DISTRIBUTION
--------------------------	---	---

Chemicals**Monitoring Requirements**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: NORTHMOR ADMIN. OFFICE DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs
--------------------------	---	--

Chemicals**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2020 and 9/30/2020
-------------------------------	---

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

Effective Date: 01/01/2020

OH5936712 PLEASANT GROVE CHURCH OF CHRIST

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **PLEASANT GROVE CHURCH OF DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

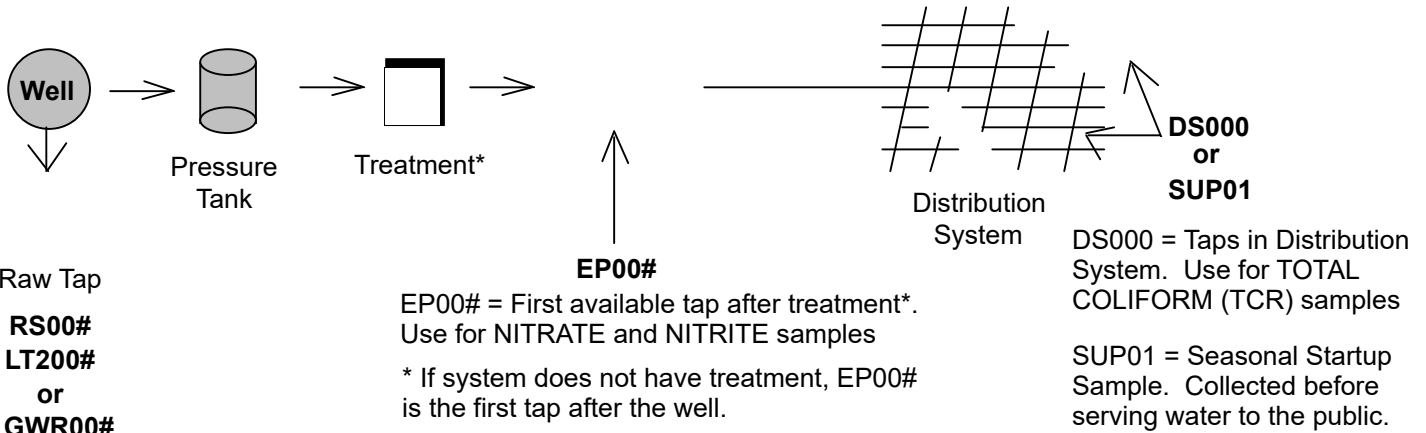

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5936712 PLEASANT GROVE CHURCH OF CHRIST

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5956788 Facility Name: PLEASANT GROVE CHURCH OF CHRST

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

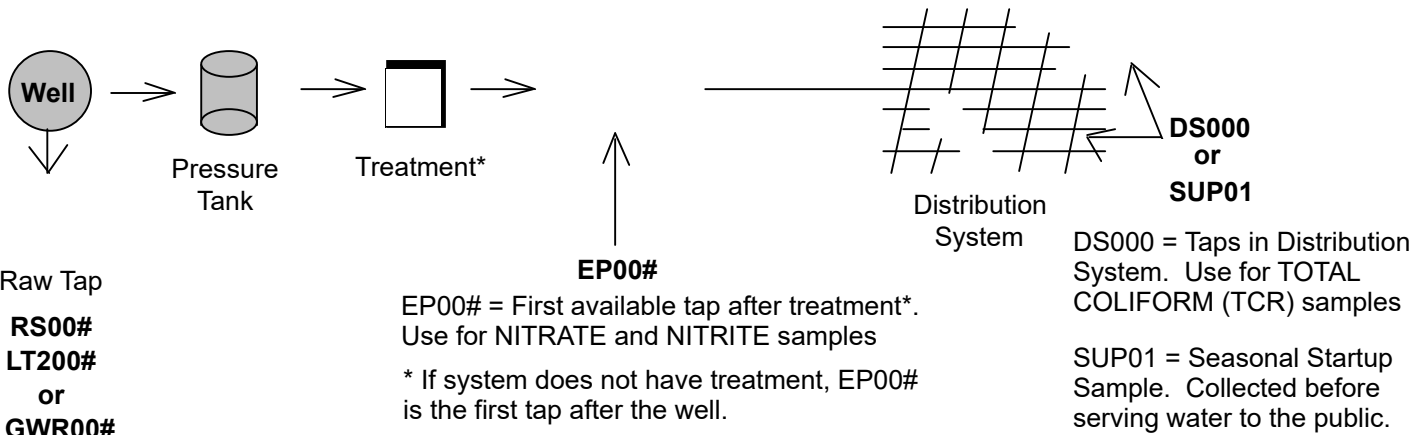

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5941222 SYCAMORE CREEK GOLF COURSE LODGE PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: SYCAMORE CREEK GOLF COURSE LODG DIST
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 1/31/2020
	1 Sample(s) Required between 2/1/2020 and 2/29/2020
	1 Sample(s) Required between 3/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 4/30/2020
	1 Sample(s) Required between 5/1/2020 and 5/31/2020
	1 Sample(s) Required between 6/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 7/31/2020
	1 Sample(s) Required between 8/1/2020 and 8/31/2020
	1 Sample(s) Required between 9/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 10/31/2020
	1 Sample(s) Required between 11/1/2020 and 11/30/2020
	1 Sample(s) Required between 12/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

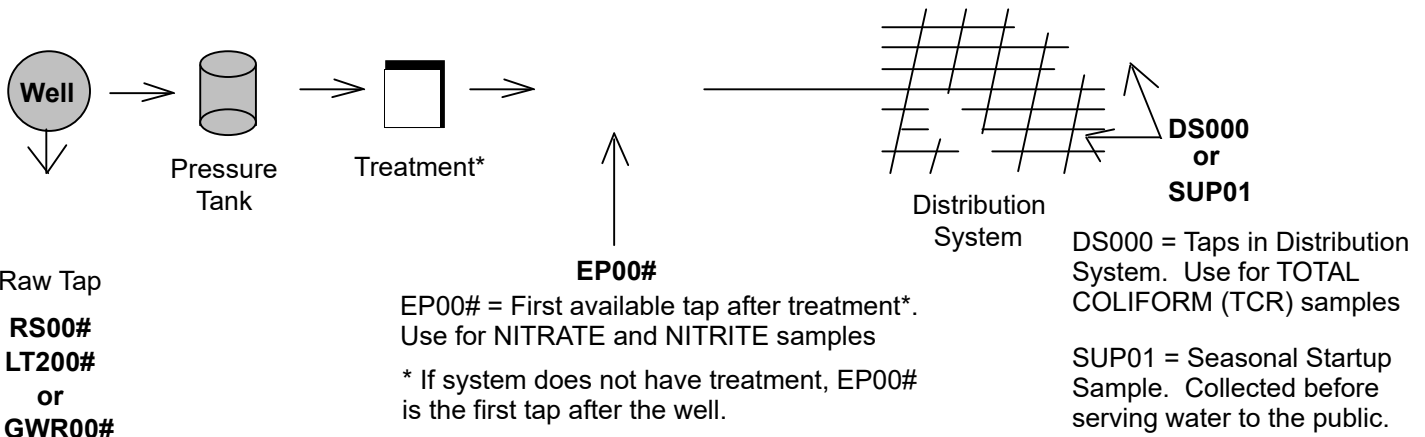

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5941222 SYCAMORE CREEK GOLF COURSE LODGE PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5956805 Facility Name: SYCAMORE CREEK GOLF COURSE LODGE

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

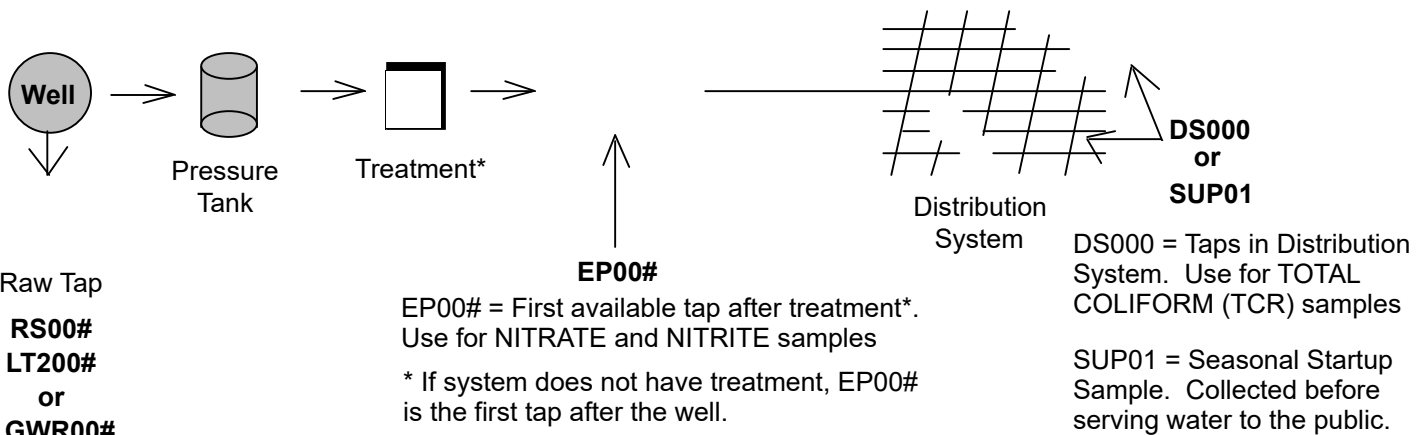

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5941912 GRANT GALBRAITH MD, INC. PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **GRANT GALBRAITH MD, INC. DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

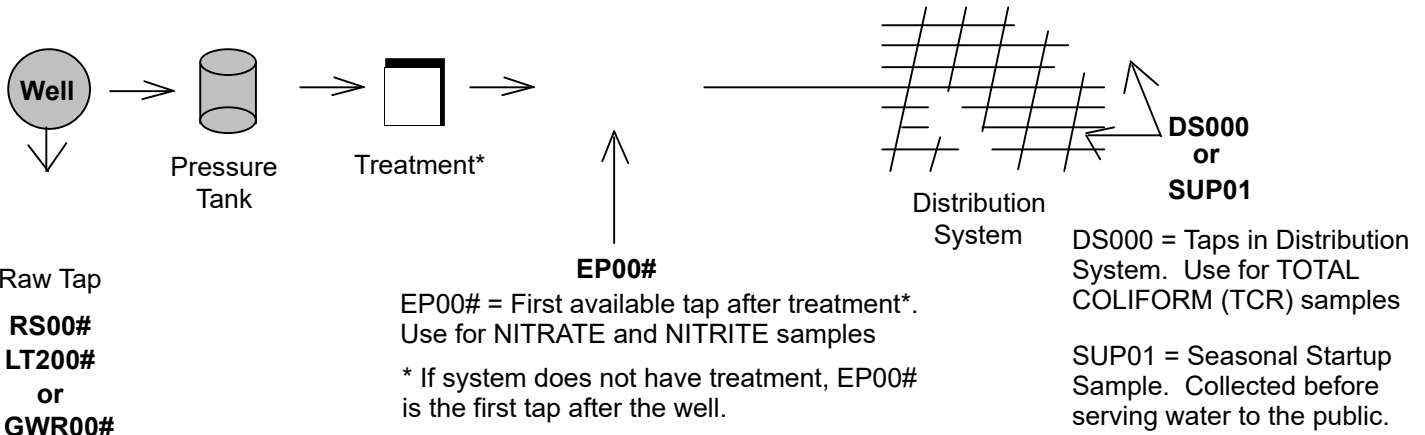

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5941912 GRANT GALBRAITH MD, INC. PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5961626 Facility Name: GRANT GALBRAITH MD, INC.

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

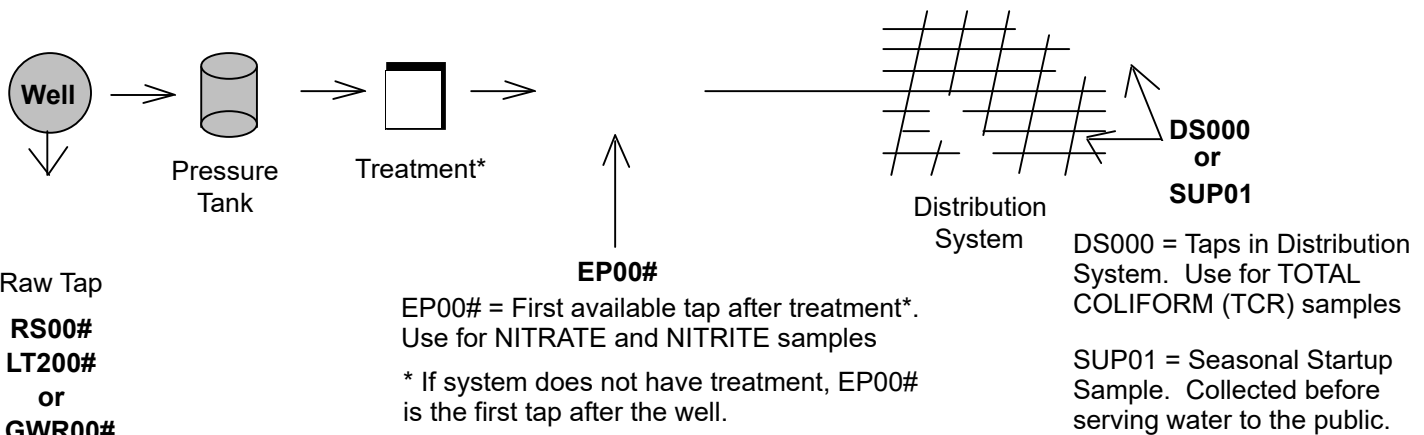

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5942012 NORTHFIELD MEDICAL BLDG PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: NORTHFIELD MEDICAL BLDG DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

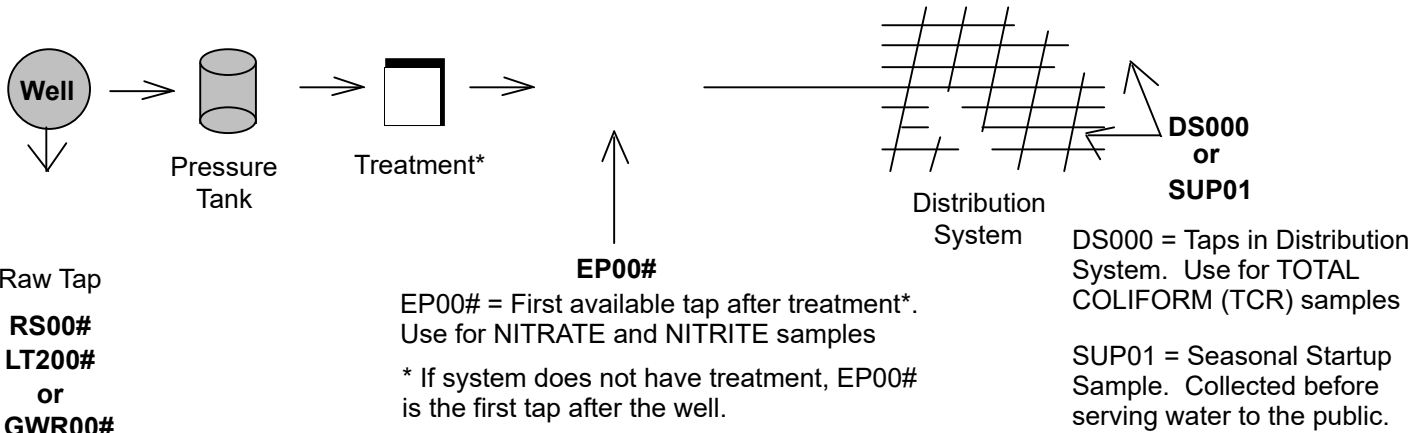

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5942012 NORTHFIELD MEDICAL BLDG PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5961627 Facility Name: NORTHFIELD MEDICAL BLDG

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

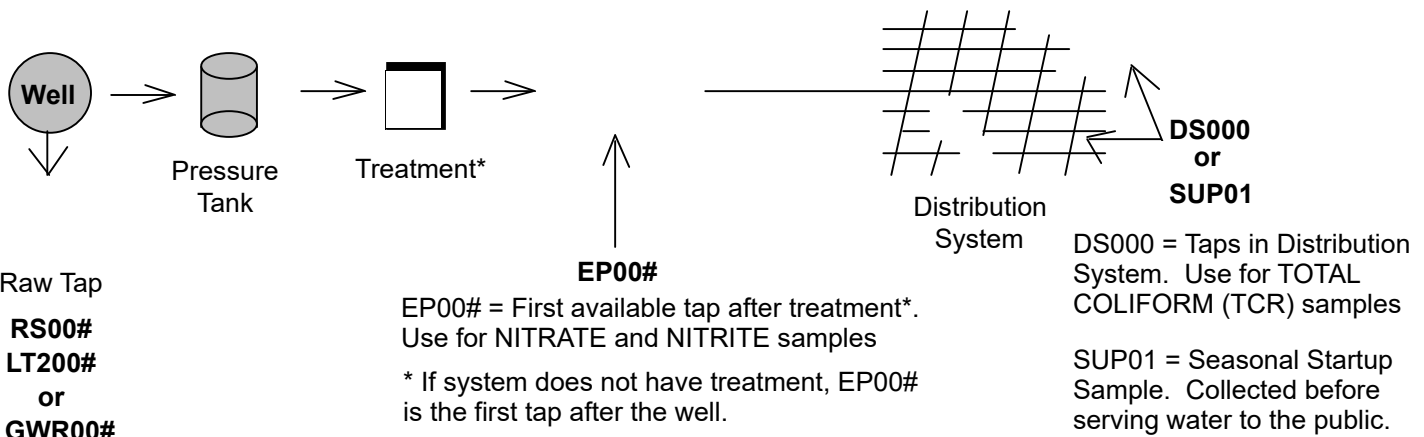

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5942212 FRESH FAITH COMMUNITY CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **FRESH FAITH COMM CHURCH DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

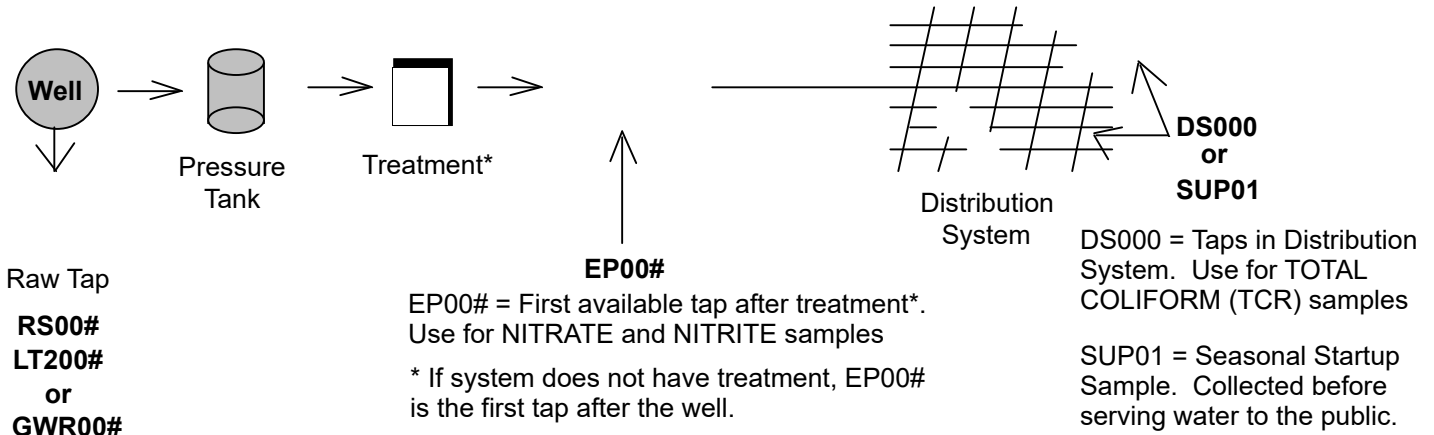

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5942212 FRESH FAITH COMMUNITY CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5962148 Facility Name: FRESH FAITH COMMUNITY CHURCH

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

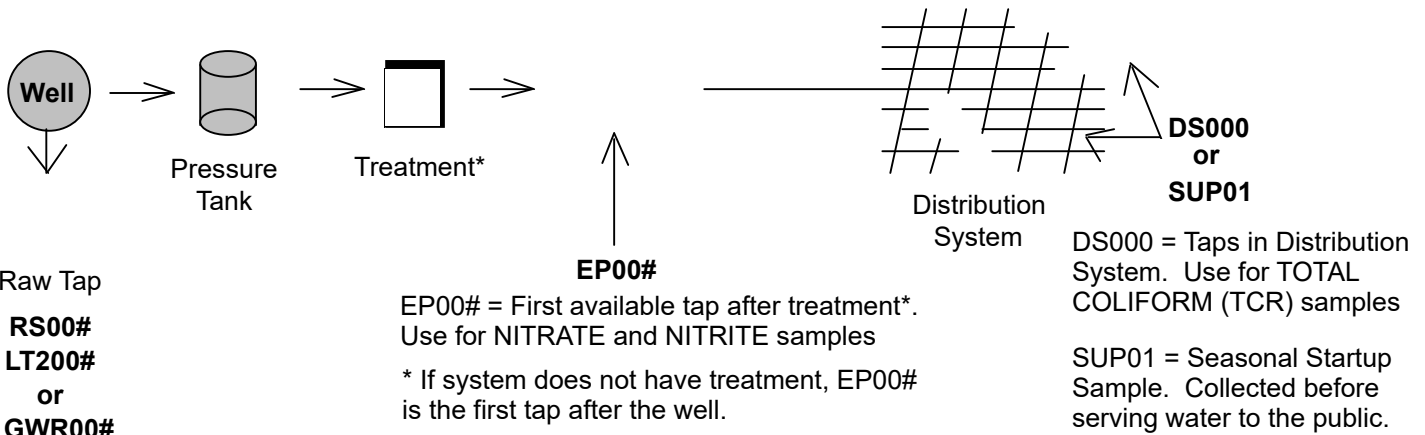

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5942612 HIGHLAND PIZZA AND ICE CREAM PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **HIGHLAND PIZZA AND ICE CREAM DISTRIBUTIO**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

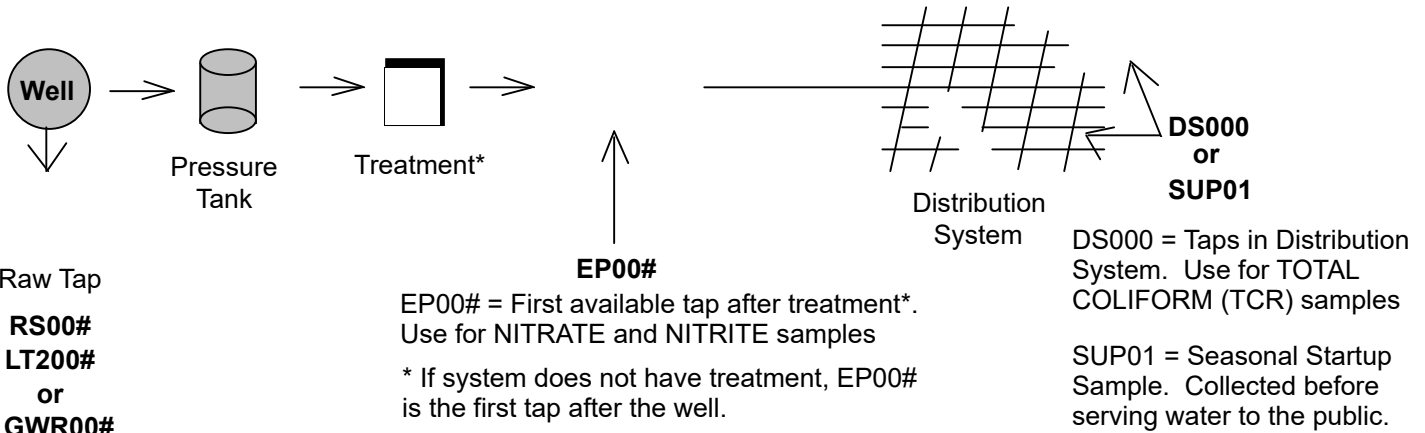

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5942612 HIGHLAND PIZZA AND ICE CREAM PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5962265 Facility Name: HIGHLAND PIZZA AND ICE CREAM

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

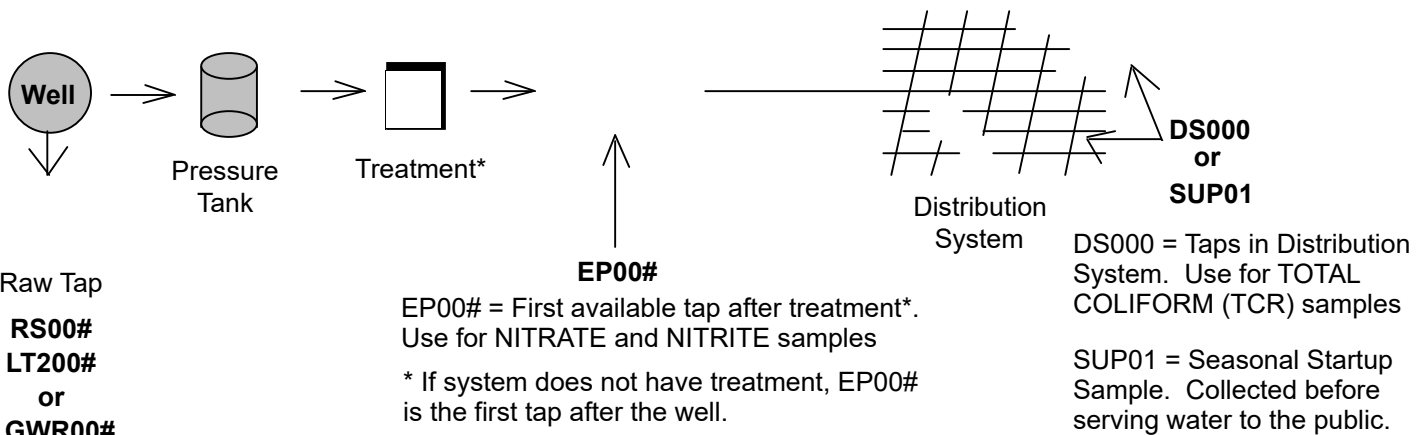

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5942712 NORTHMOR SCHOOL PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5962375	Facility Name: NORTHMOR SCHOOL	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2020 and 3/31/2020 1 Sample(s) Required between 4/1/2020 and 6/30/2020 1 Sample(s) Required between 7/1/2020 and 9/30/2020 1 Sample(s) Required between 10/1/2020 and 12/31/2020
INORGANICS	1 Sample(s) Required between 6/1/2020 and 10/31/2020
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2020 and 10/31/2020
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required

Effective Date: 01/01/2020

OH5942712 NORTHMOR SCHOOL PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: NORTHMOR SCHOOL DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements		
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between	1/1/2020	and 1/31/2020
	2 Sample(s) Required between	2/1/2020	and 2/29/2020
	2 Sample(s) Required between	3/1/2020	and 3/31/2020
	2 Sample(s) Required between	4/1/2020	and 4/30/2020
	2 Sample(s) Required between	5/1/2020	and 5/31/2020
	2 Sample(s) Required between	6/1/2020	and 6/30/2020
	2 Sample(s) Required between	7/1/2020	and 7/31/2020
	2 Sample(s) Required between	8/1/2020	and 8/31/2020
	2 Sample(s) Required between	9/1/2020	and 9/30/2020
	2 Sample(s) Required between	10/1/2020	and 10/31/2020
	2 Sample(s) Required between	11/1/2020	and 11/30/2020
	2 Sample(s) Required between	12/1/2020	and 12/31/2020

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: NORTHMOR SCHOOL DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements		
DISINFECTION BYPRODUCTS	Dual Sample Required between	1/8/2020	and 1/14/2020at: DS201
	Dual Sample Required between	4/8/2020	and 4/14/2020at: DS201
	Dual Sample Required between	7/8/2020	and 7/14/2020at: DS201
	Dual Sample Required between	10/8/2020	and 10/14/2020at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: NORTHMOR SCHOOL DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements		
DISINFECTION BYPRODUCTS	Dual Sample Required between	1/8/2020	and 1/14/2020at: DS202
	Dual Sample Required between	4/8/2020	and 4/14/2020at: DS202
	Dual Sample Required between	7/8/2020	and 7/14/2020at: DS202
	Dual Sample Required between	10/8/2020	and 10/14/2020at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH5942712 NORTHMOR SCHOOL PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: NORTHMOR SCHOOL DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2020 and 9/30/2020
-------------------------------	--

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH5942713 CARDINGTON LINCOLN HIGH SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	------------------------------------	--------------------------------

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020 1 Sample(s) Required between 4/1/2020 and 6/30/2020 1 Sample(s) Required between 7/1/2020 and 9/30/2020 1 Sample(s) Required between 10/1/2020 and 12/31/2020

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2020 and 9/30/2020at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2020 and 9/30/2020at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2020 and 9/30/2020

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

Effective Date: 01/01/2020

OH5942714 MID-OHIO SPORTS INFIELD PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

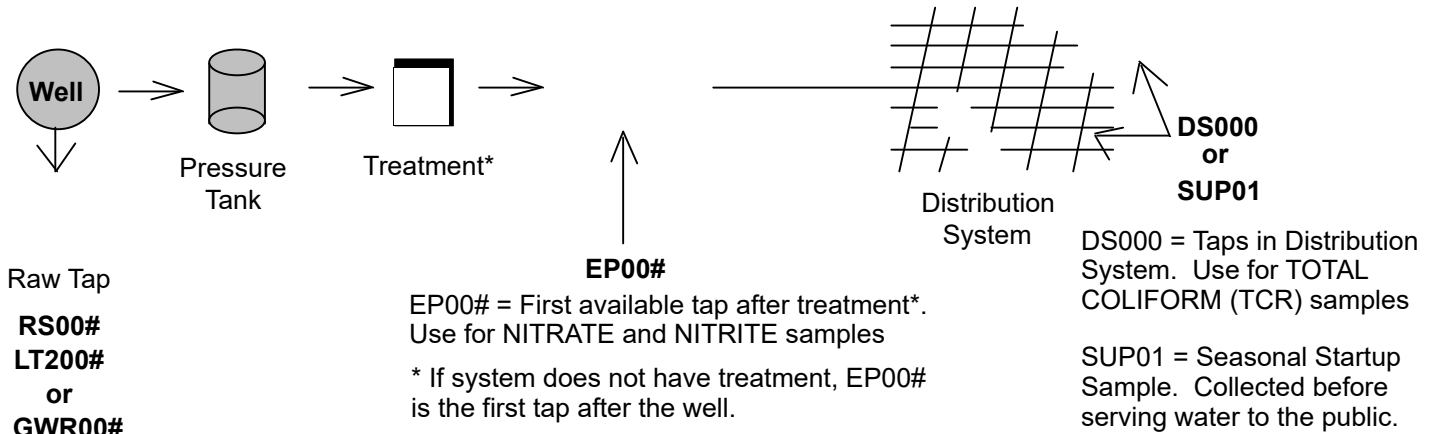

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 04/17/2020

OH5942714 MID-OHIO SPORTS INFIELD PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: DISTRIBUTION

Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2020 and 6/30/2020 1 Sample(s) Required between 7/1/2020 and 9/15/2020

Where to Collect Samples For a Small Public Water System

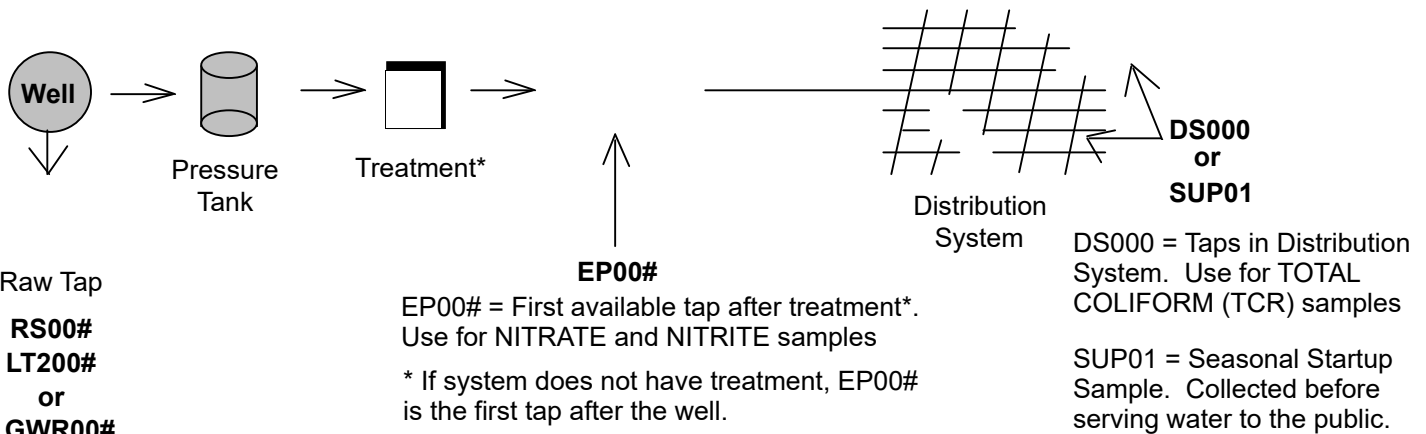

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5942714 MID-OHIO SPORTS INFIELD PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5962377 Facility Name: MID-OHIO SPORTS INFIELD

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

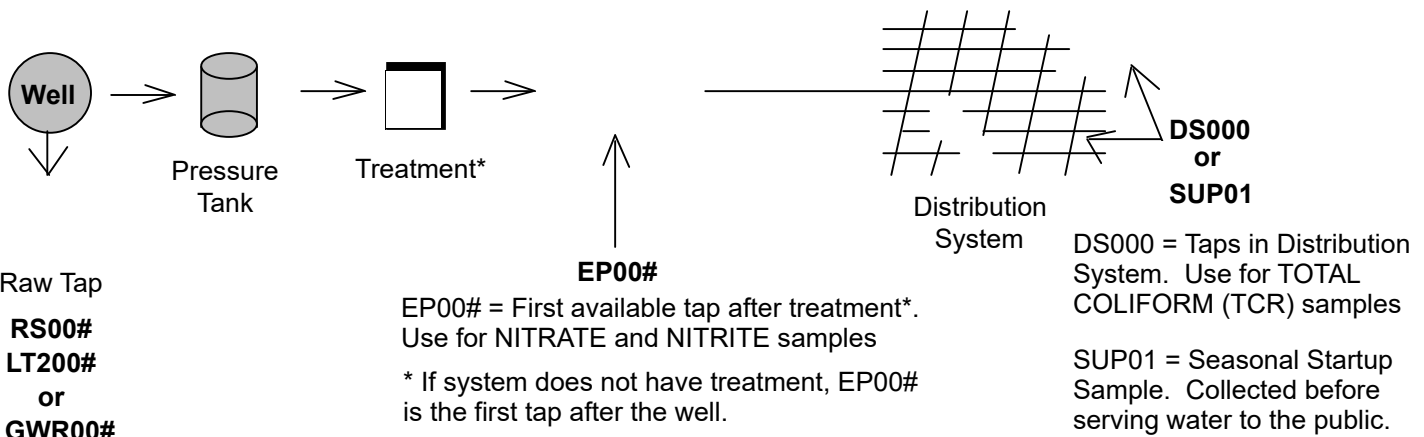

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/17/2020

OH5942715 DOLLAR GENERAL MANSFIELD SR 97-19557

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **DS000** Facility Source:

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

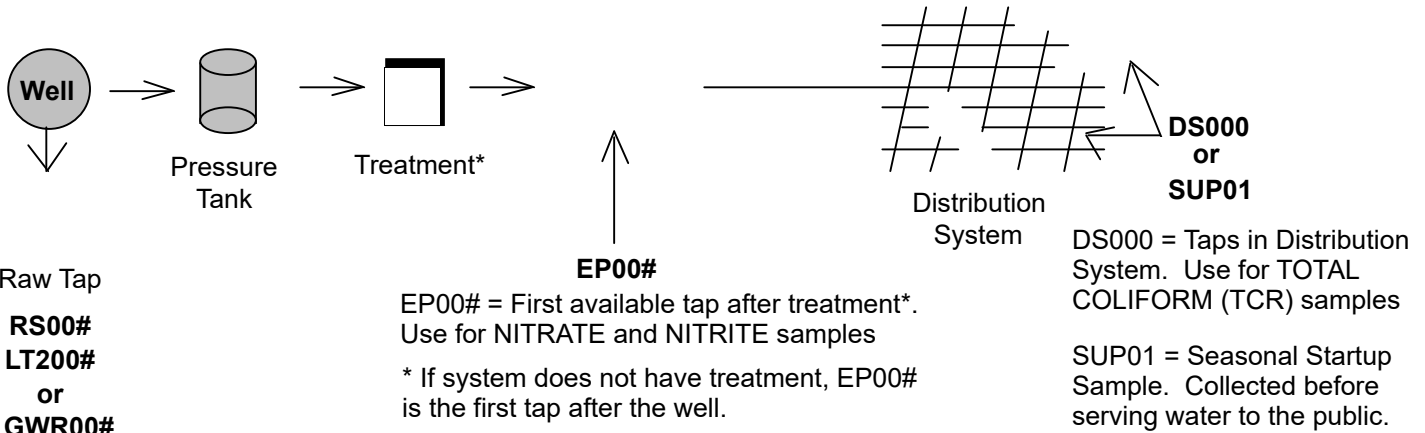

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH5942715 DOLLAR GENERAL MANSFIELD SR 97-19557

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5962738 Facility Name: DOLLAR GENERAL MANSFIELD SR97 PLANT

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

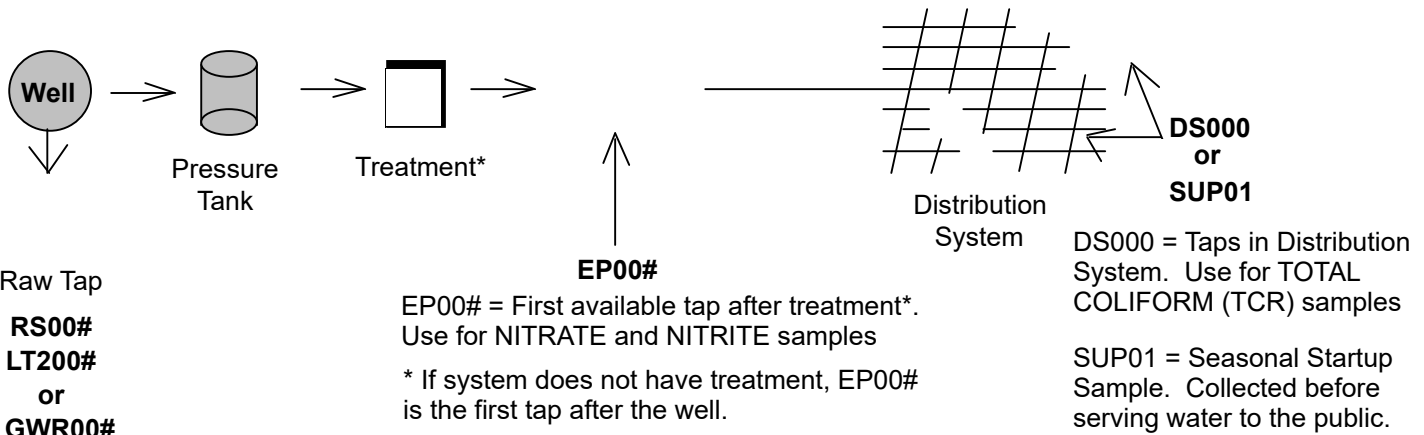

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 02/14/2020

OH5942716 DOLLAR GENERAL #20433 - SHAUCK MANSFIELD

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **DS000** Facility Source:

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

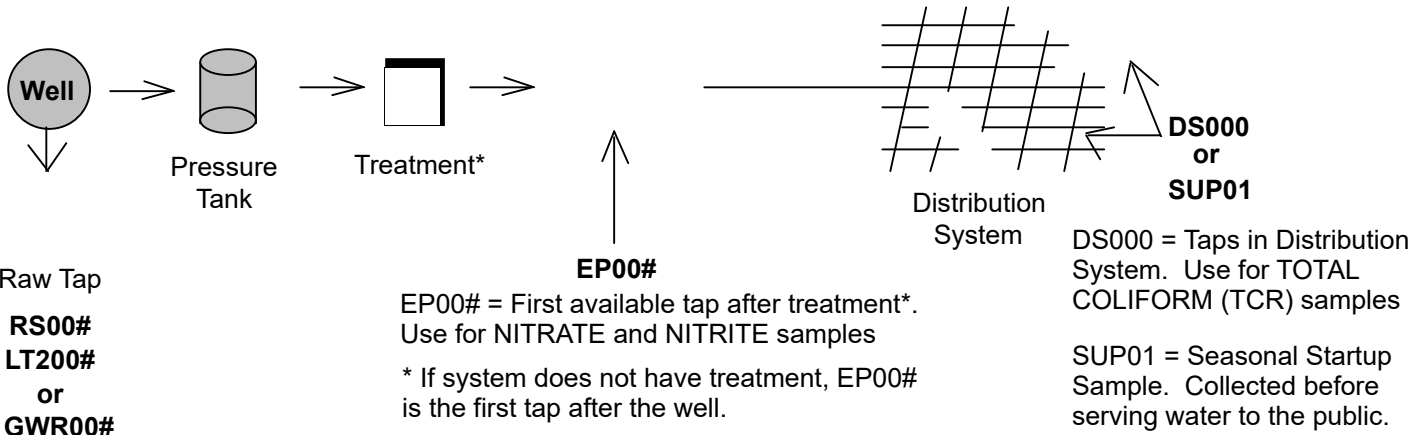

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/17/2020

OH5942716 DOLLAR GENERAL #20433 - SHAUCK MANSFIELD

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5962739 Facility Name: DOLLAR GENERAL SHAUCK PLANT

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

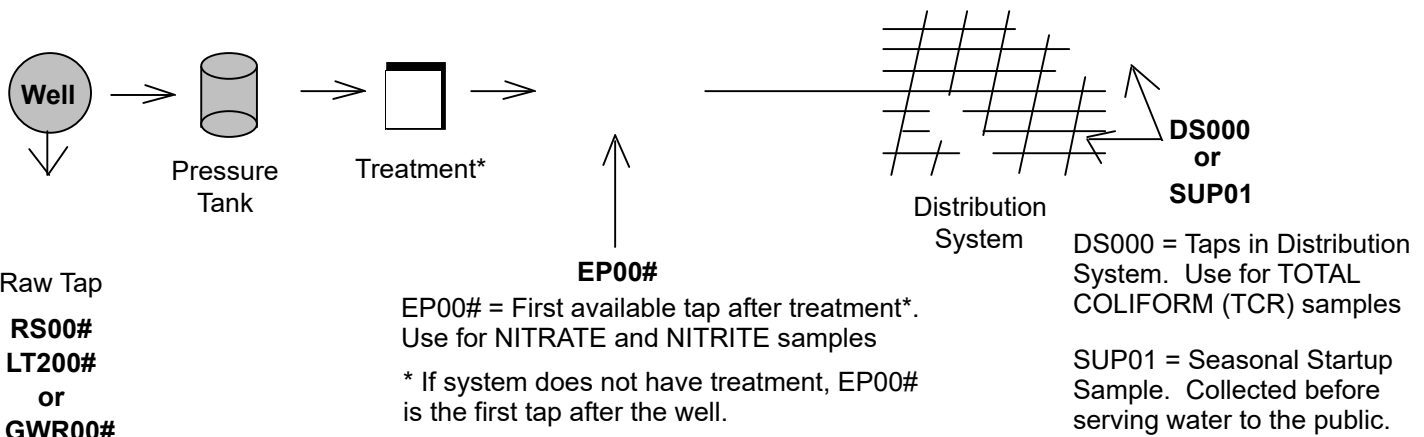

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!