

Effective Date: 01/01/2020

OH6200412 CATAWBA SHORES M H COURT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: CATAWBA SHORES M H COURT DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 1/31/2020
	1 Sample(s) Required between 2/1/2020 and 2/29/2020
	1 Sample(s) Required between 3/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 4/30/2020
	1 Sample(s) Required between 5/1/2020 and 5/31/2020
	1 Sample(s) Required between 6/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 7/31/2020
	1 Sample(s) Required between 8/1/2020 and 8/31/2020
	1 Sample(s) Required between 9/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 10/31/2020
	1 Sample(s) Required between 11/1/2020 and 11/30/2020
	1 Sample(s) Required between 12/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

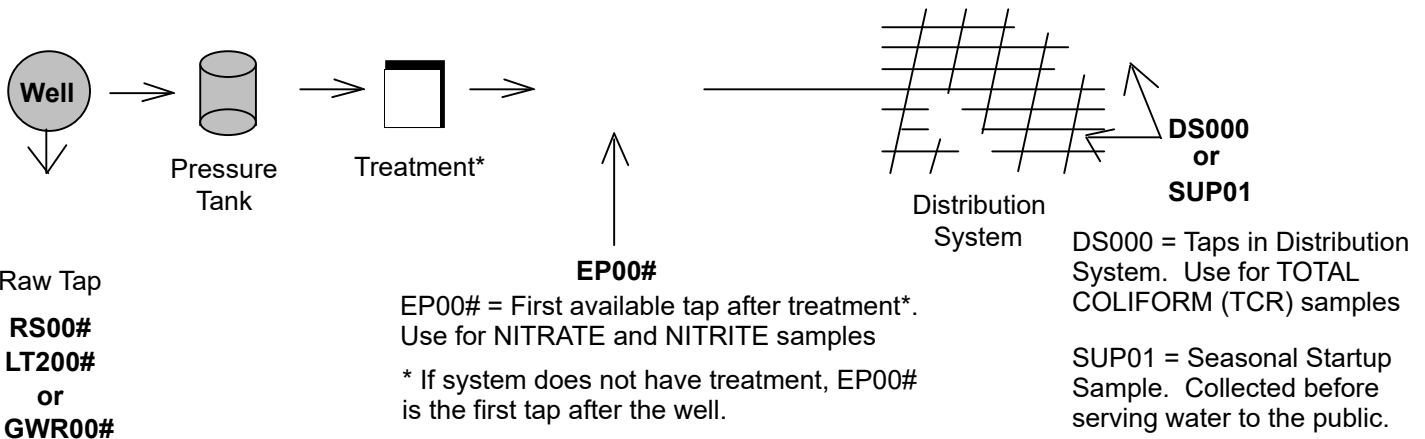

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6200412 CATAWBA SHORES M H COURT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256887 Facility Name: CATAWBA SHORES MHP

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

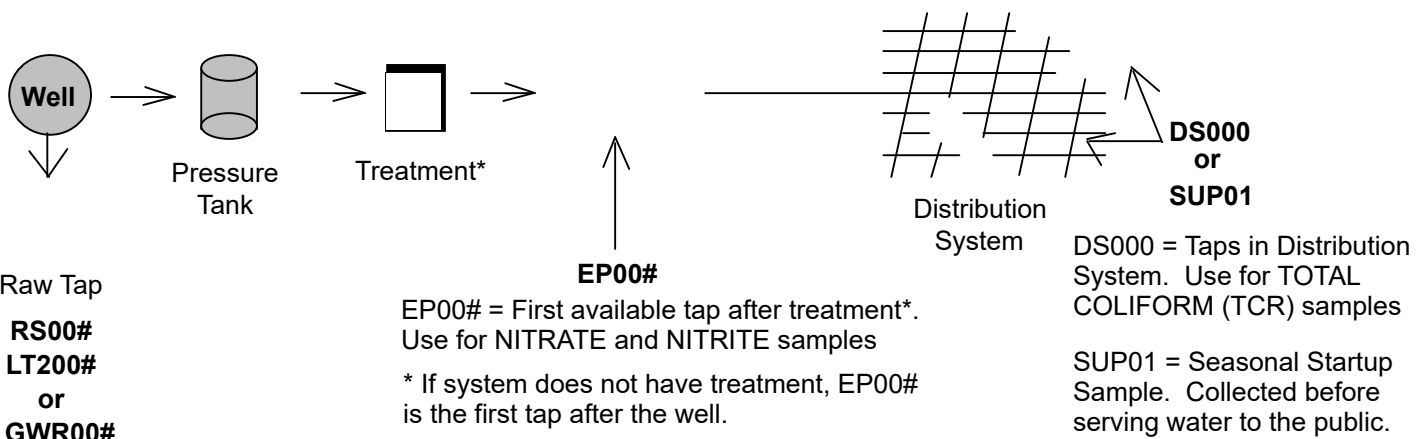

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6200712 ELMORE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6256889 SMP ID: EP001	Facility Name: ELMORE VILLAGE Facility Source: Ground Water	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements	
INORGANICS	Not Required	
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	6/1/2020 and 10/31/2020
RADIOLOGICALS	1 Sample(s) Required between	1/1/2020 and 3/31/2020
	1 Sample(s) Required between	4/1/2020 and 6/30/2020
	1 Sample(s) Required between	7/1/2020 and 9/30/2020
	1 Sample(s) Required between	10/1/2020 and 12/31/2020
<i>Sample for all the analytes listed below:</i>		
GROSS ALPHA - 4002 RADIUM-228 - 4030		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	6/1/2020 and 10/31/2020
<i>Sample for all the analytes listed below:</i>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required	

Effective Date: 01/01/2020

OH6200712 ELMORE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: ELMORE VILLAGE DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
ASBESTOS - 1094	Not Required
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2020 and 1/31/2020 2 Sample(s) Required between 2/1/2020 and 2/29/2020 2 Sample(s) Required between 3/1/2020 and 3/31/2020 2 Sample(s) Required between 4/1/2020 and 4/30/2020 2 Sample(s) Required between 5/1/2020 and 5/31/2020 2 Sample(s) Required between 6/1/2020 and 6/30/2020 2 Sample(s) Required between 7/1/2020 and 7/31/2020 2 Sample(s) Required between 8/1/2020 and 8/31/2020 2 Sample(s) Required between 9/1/2020 and 9/30/2020 2 Sample(s) Required between 10/1/2020 and 10/31/2020 2 Sample(s) Required between 11/1/2020 and 11/30/2020 2 Sample(s) Required between 12/1/2020 and 12/31/2020
TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2020 and 1/31/2020 2 Sample(s) Required between 2/1/2020 and 2/29/2020 2 Sample(s) Required between 3/1/2020 and 3/31/2020 2 Sample(s) Required between 4/1/2020 and 4/30/2020 2 Sample(s) Required between 5/1/2020 and 5/31/2020 2 Sample(s) Required between 6/1/2020 and 6/30/2020 2 Sample(s) Required between 7/1/2020 and 7/31/2020 2 Sample(s) Required between 8/1/2020 and 8/31/2020 2 Sample(s) Required between 9/1/2020 and 9/30/2020 2 Sample(s) Required between 10/1/2020 and 10/31/2020 2 Sample(s) Required between 11/1/2020 and 11/30/2020 2 Sample(s) Required between 12/1/2020 and 12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: ELMORE VILLAGE DISTRIBUTION 805 OHIO AVE	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2020 and 9/30/2020 at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Effective Date: 01/01/2020

OH6200712 ELMORE VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: ELMORE VILLAGE DISTRIBUTION 633 STATE ST	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 7/1/2020 and 9/30/2020 at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: ELMORE VILLAGE DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

10 Sample(s) Required between 6/1/2020 and 9/30/2020

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

Effective Date: 01/01/2020

OH6201003 GENOA VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: GENOA VILLAGE DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements		
TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Required between	1/1/2020	and 1/31/2020
	3 Sample(s) Required between	2/1/2020	and 2/29/2020
	3 Sample(s) Required between	3/1/2020	and 3/31/2020
	3 Sample(s) Required between	4/1/2020	and 4/30/2020
	3 Sample(s) Required between	5/1/2020	and 5/31/2020
	3 Sample(s) Required between	6/1/2020	and 6/30/2020
	3 Sample(s) Required between	7/1/2020	and 7/31/2020
	3 Sample(s) Required between	8/1/2020	and 8/31/2020
	3 Sample(s) Required between	9/1/2020	and 9/30/2020
	3 Sample(s) Required between	10/1/2020	and 10/31/2020
	3 Sample(s) Required between	11/1/2020	and 11/30/2020
	3 Sample(s) Required between	12/1/2020	and 12/31/2020
TOTAL CHLORINE - 1000	3 Sample(s) Required between	1/1/2020	and 1/31/2020
	3 Sample(s) Required between	2/1/2020	and 2/29/2020
	3 Sample(s) Required between	3/1/2020	and 3/31/2020
	3 Sample(s) Required between	4/1/2020	and 4/30/2020
	3 Sample(s) Required between	5/1/2020	and 5/31/2020
	3 Sample(s) Required between	6/1/2020	and 6/30/2020
	3 Sample(s) Required between	7/1/2020	and 7/31/2020
	3 Sample(s) Required between	8/1/2020	and 8/31/2020
	3 Sample(s) Required between	9/1/2020	and 9/30/2020
	3 Sample(s) Required between	10/1/2020	and 10/31/2020
	3 Sample(s) Required between	11/1/2020	and 11/30/2020
	3 Sample(s) Required between	12/1/2020	and 12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: GENOA VILLAGE DISTRIBUTION 3998 EDINBOURGH CT. GENOA	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements		
DISINFECTION BYPRODUCTS	Dual Sample Required between	1/8/2020	and 1/14/2020at: DS201
	Dual Sample Required between	4/8/2020	and 4/14/2020at: DS201
	Dual Sample Required between	7/8/2020	and 7/14/2020at: DS201
	Dual Sample Required between	10/8/2020	and 10/14/2020at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH6201003 GENOA VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: **** Consumer Confidence Report (CCR) is due July 1, 2020

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: GENOA VILLAGE DISTRIBUTION 22038 W. ST. RT. 579 WILLISTON	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 1/8/2020 and 1/14/2020at: DS202
	Dual Sample Required between 4/8/2020 and 4/14/2020at: DS202
	Dual Sample Required between 7/8/2020 and 7/14/2020at: DS202
	Dual Sample Required between 10/8/2020 and 10/14/2020at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: GENOA VILLAGE DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2020 and 9/30/2020

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH6201212 GREEN VALLEY MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6256894 SMP ID: EP001	Facility Name: GREEN VALLEY MHP Facility Source: Ground Water	Facility Class: CLASS A
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2020 and 10/31/2020
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required

Effective Date: 01/01/2020

OH6201212 GREEN VALLEY MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1	Facility Name: GREEN VALLEY MHP DISTRIBUTION
	SMP ID: DS000	

Chemicals**Monitoring Requirements**

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2020	and	1/31/2020
	1 Sample(s) Required between	2/1/2020	and	2/29/2020
	1 Sample(s) Required between	3/1/2020	and	3/31/2020
	1 Sample(s) Required between	4/1/2020	and	4/30/2020
	1 Sample(s) Required between	5/1/2020	and	5/31/2020
	1 Sample(s) Required between	6/1/2020	and	6/30/2020
	1 Sample(s) Required between	7/1/2020	and	7/31/2020
	1 Sample(s) Required between	8/1/2020	and	8/31/2020
	1 Sample(s) Required between	9/1/2020	and	9/30/2020
	1 Sample(s) Required between	10/1/2020	and	10/31/2020
	1 Sample(s) Required between	11/1/2020	and	11/30/2020
	1 Sample(s) Required between	12/1/2020	and	12/31/2020

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2020	and	1/31/2020
	1 Sample(s) Required between	2/1/2020	and	2/29/2020
	1 Sample(s) Required between	3/1/2020	and	3/31/2020
	1 Sample(s) Required between	4/1/2020	and	4/30/2020
	1 Sample(s) Required between	5/1/2020	and	5/31/2020
	1 Sample(s) Required between	6/1/2020	and	6/30/2020
	1 Sample(s) Required between	7/1/2020	and	7/31/2020
	1 Sample(s) Required between	8/1/2020	and	8/31/2020
	1 Sample(s) Required between	9/1/2020	and	9/30/2020
	1 Sample(s) Required between	10/1/2020	and	10/31/2020
	1 Sample(s) Required between	11/1/2020	and	11/30/2020
	1 Sample(s) Required between	12/1/2020	and	12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: GREEN VALLEY MHP DISTRIBUTION
	SMP ID: DS201	LOT #29 (2.0)

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2020	and	9/30/2020	at: DS201
-------------------------	------------------------------	----------	-----	-----------	-----------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH6201212 GREEN VALLEY MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: GREEN VALLEY MHP DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2020 and 9/30/2020
-------------------------------	---

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

OH6201312 GREENWOOD MOBILE HOME PK

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6256895 SMP ID: EP001	Facility Name: GREENWOOD MHP Facility Source: Ground Water	Facility Class: CLASS A
--------------------------	---	---	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2020 and 10/31/2020
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required

Effective Date: 01/01/2020

OH6201312 GREENWOOD MOBILE HOME PK

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1	Facility Name: GREENWOOD MOBILE HOME PK DISTRIBUTIC
	SMP ID: DS000	

Chemicals**Monitoring Requirements**

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2020	and	1/31/2020
	1 Sample(s) Required between	2/1/2020	and	2/29/2020
	1 Sample(s) Required between	3/1/2020	and	3/31/2020
	1 Sample(s) Required between	4/1/2020	and	4/30/2020
	1 Sample(s) Required between	5/1/2020	and	5/31/2020
	1 Sample(s) Required between	6/1/2020	and	6/30/2020
	1 Sample(s) Required between	7/1/2020	and	7/31/2020
	1 Sample(s) Required between	8/1/2020	and	8/31/2020
	1 Sample(s) Required between	9/1/2020	and	9/30/2020
	1 Sample(s) Required between	10/1/2020	and	10/31/2020
	1 Sample(s) Required between	11/1/2020	and	11/30/2020
	1 Sample(s) Required between	12/1/2020	and	12/31/2020

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2020	and	1/31/2020
	1 Sample(s) Required between	2/1/2020	and	2/29/2020
	1 Sample(s) Required between	3/1/2020	and	3/31/2020
	1 Sample(s) Required between	4/1/2020	and	4/30/2020
	1 Sample(s) Required between	5/1/2020	and	5/31/2020
	1 Sample(s) Required between	6/1/2020	and	6/30/2020
	1 Sample(s) Required between	7/1/2020	and	7/31/2020
	1 Sample(s) Required between	8/1/2020	and	8/31/2020
	1 Sample(s) Required between	9/1/2020	and	9/30/2020
	1 Sample(s) Required between	10/1/2020	and	10/31/2020
	1 Sample(s) Required between	11/1/2020	and	11/30/2020
	1 Sample(s) Required between	12/1/2020	and	12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: GREENWOOD MOBILE HOME PK DISTRIBUTIC
	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2020	and	9/30/2020	at: DS201
-------------------------	------------------------------	----------	-----	-----------	-----------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Effective Date: 01/01/2020

2020 DISTRIBUTION SCHEDULE

OH6201312 GREENWOOD MOBILE HOME PK

System Type: Community

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: GREENWOOD MOBILE HOME PK DISTRIBUTIC
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022

Not Required

Effective Date: 01/01/2020

OH6201911 LAKE ERIE UTILITIES COMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LAKE ERIE UTILITIES COMP DISTRIBUTION
Location SMP ID: DS000	Facility Source: Surface Water
	Facility Class: CLASS 1

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Required between 1/1/2020 and 1/31/2020
	4 Sample(s) Required between 2/1/2020 and 2/29/2020
	4 Sample(s) Required between 3/1/2020 and 3/31/2020
	4 Sample(s) Required between 4/1/2020 and 4/30/2020
	4 Sample(s) Required between 5/1/2020 and 5/31/2020
	4 Sample(s) Required between 6/1/2020 and 6/30/2020
	4 Sample(s) Required between 7/1/2020 and 7/31/2020
	4 Sample(s) Required between 8/1/2020 and 8/31/2020
	4 Sample(s) Required between 9/1/2020 and 9/30/2020
	4 Sample(s) Required between 10/1/2020 and 10/31/2020
	4 Sample(s) Required between 11/1/2020 and 11/30/2020
	4 Sample(s) Required between 12/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

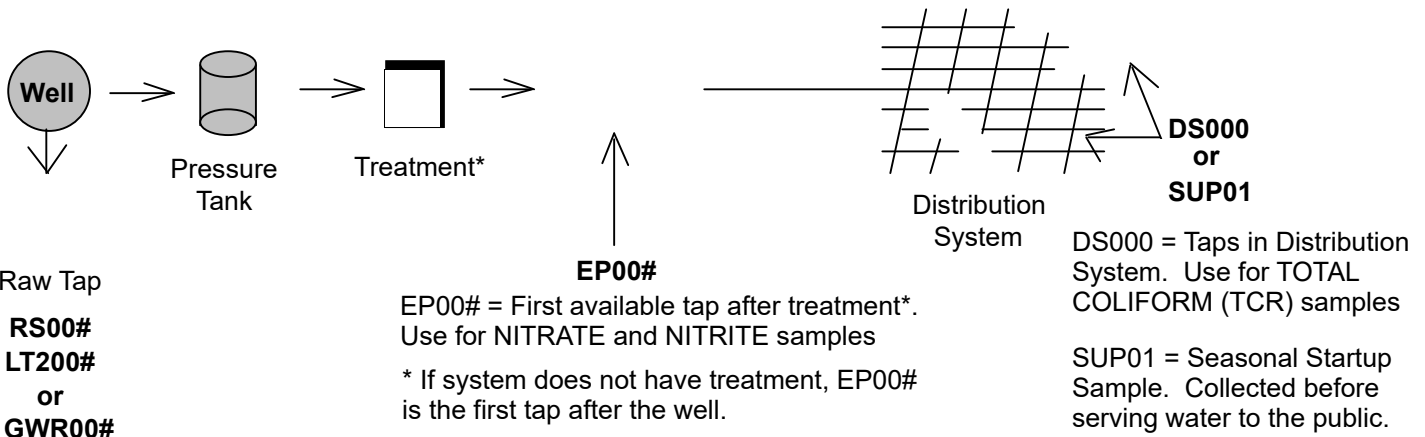

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6201911 LAKE ERIE UTILITIES COMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6262096	Facility Name: LAKE ERIE UTILITIES CO 2
Location SMP ID: LT2001	Facility Source: Surface Water
	Facility Class: CLASS 3

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/29/2019 and 1/4/2020
	1 Sample(s) Required between 1/12/2020 and 1/18/2020
	1 Sample(s) Required between 1/26/2020 and 2/1/2020
	1 Sample(s) Required between 2/9/2020 and 2/15/2020
	1 Sample(s) Required between 2/23/2020 and 2/29/2020
	1 Sample(s) Required between 3/8/2020 and 3/14/2020
	1 Sample(s) Required between 3/22/2020 and 3/28/2020
	1 Sample(s) Required between 4/5/2020 and 4/11/2020
	1 Sample(s) Required between 4/19/2020 and 4/25/2020
	1 Sample(s) Required between 5/3/2020 and 5/9/2020
	1 Sample(s) Required between 5/17/2020 and 5/23/2020
	1 Sample(s) Required between 5/31/2020 and 6/6/2020
	1 Sample(s) Required between 6/14/2020 and 6/20/2020
	1 Sample(s) Required between 6/28/2020 and 7/4/2020
	1 Sample(s) Required between 7/12/2020 and 7/18/2020
	1 Sample(s) Required between 7/26/2020 and 8/1/2020
	1 Sample(s) Required between 8/9/2020 and 8/15/2020
	1 Sample(s) Required between 8/23/2020 and 8/29/2020
	1 Sample(s) Required between 9/6/2020 and 9/12/2020
	1 Sample(s) Required between 9/20/2020 and 9/26/2020
1 Sample(s) Required between 10/4/2020 and 10/10/2020	
1 Sample(s) Required between 10/18/2020 and 10/24/2020	
1 Sample(s) Required between 11/1/2020 and 11/7/2020	
1 Sample(s) Required between 11/15/2020 and 11/21/2020	
1 Sample(s) Required between 11/29/2020 and 12/5/2020	

Effective Date: 01/01/2020

OH6201911 LAKE ERIE UTILITIES COMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE


Sampling Facility ID: 6262096	Facility Name: LAKE ERIE UTILITIES CO 2	
Location SMP ID: LT2001	Facility Source: Surface Water	Facility Class: CLASS 3

Chemicals**Monitoring Requirements**

CYANOBACTERIA SCREENING

1 Sample(s) Required between 12/13/2020 and 12/19/2020

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 and must be collected at the same time as the raw total microcystins sample. SAMPLES MUST BE SHIPPED OVERNIGHT ON ICE ON THE DAY OF COLLECTION AND ARRIVE AT OHIO EPA DIVISION OF ENVIRONMENTAL SERVICES (DES) BY NOON MONDAY THROUGH THURSDAY ONLY! If lab capacity is found to be adequate, cyanobacteria screening samples will no longer be analyzed, free of charge, by Ohio EPA DES beginning June 1, 2017.

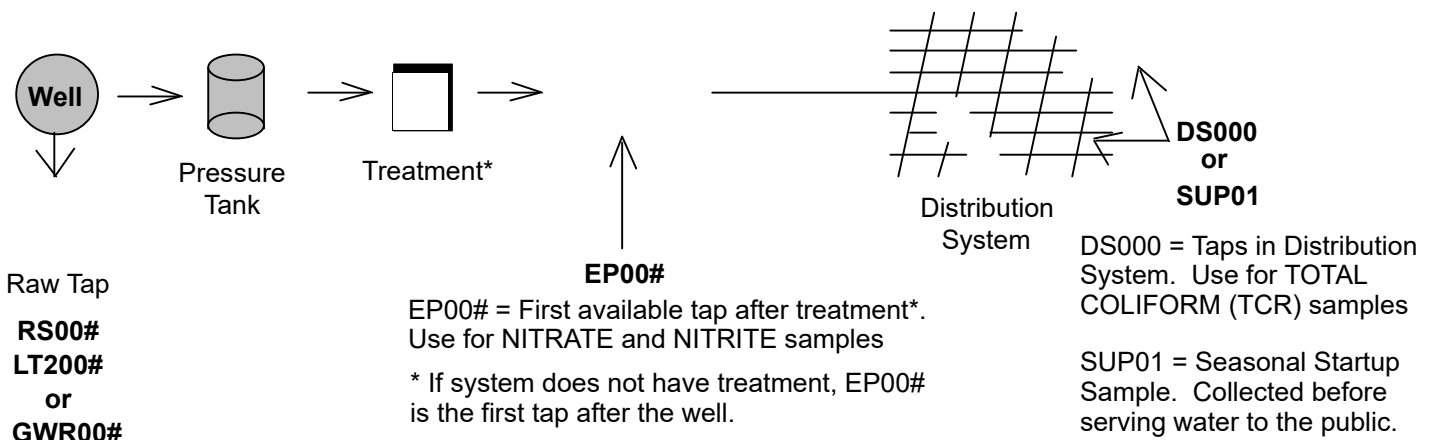Where to Collect Samples For a Small Public Water System

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6201911 LAKE ERIE UTILITIES COMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6262096	Facility Name: LAKE ERIE UTILITIES CO 2
Location SMP ID: EP002/LT200	Facility Source: Surface Water
Facility Class: CLASS 3	


Chemicals**Monitoring Requirements**

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY*

Total microcystins sample set refers to one raw source water sample at LT200# and one finished water sample at EP00#. A week is defined as Sunday through Saturday.

**Weekly sampling unless requirements for seasonal reduced monitoring are met (November through April). Biweekly raw seasonal reduced monitoring must be conducted at the same time as cyanobacteria screening sample. Any microcystins detection during seasonal reduced monitoring triggers collection of raw and finished samples within 24 hours and a return to weekly monitoring at both raw and finished sample points. For questions about seasonal reduced monitoring please contact your Ohio EPA District Office HAB Coordinator.*

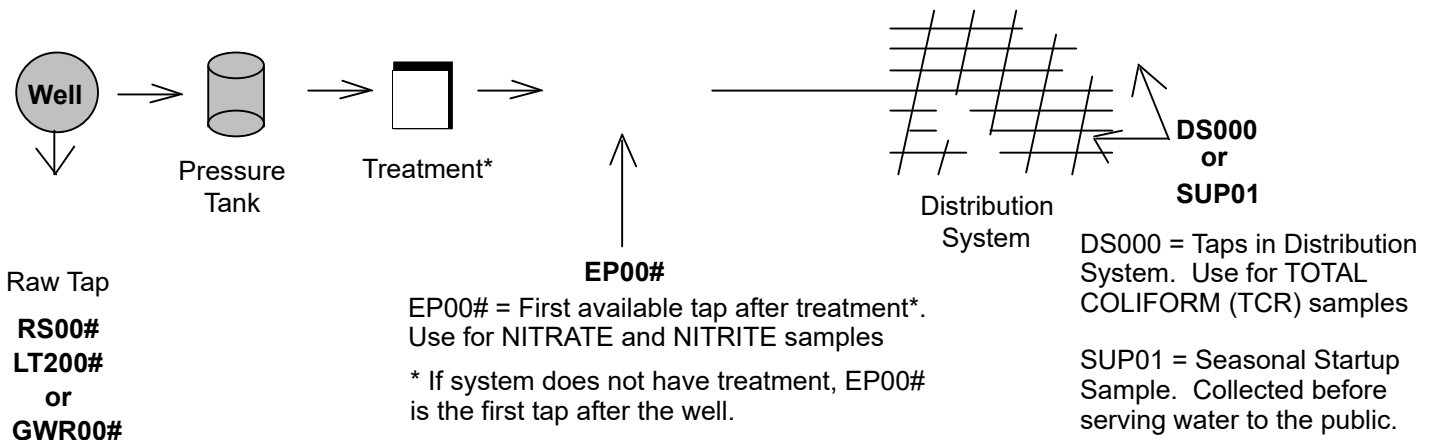Where to Collect Samples For a Small Public Water System

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6201911 LAKE ERIE UTILITIES COMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6262096	Facility Name: LAKE ERIE UTILITIES CO 2
Location SMP ID: EP002	Facility Source: Surface Water Facility Class: CLASS 3

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2020 and 1/31/2020 1 Sample(s) Required between 2/1/2020 and 2/29/2020 1 Sample(s) Required between 3/1/2020 and 3/31/2020 1 Sample(s) Required between 4/1/2020 and 4/30/2020 1 Sample(s) Required between 5/1/2020 and 5/31/2020 1 Sample(s) Required between 6/1/2020 and 6/30/2020 1 Sample(s) Required between 7/1/2020 and 7/31/2020 1 Sample(s) Required between 8/1/2020 and 8/31/2020 1 Sample(s) Required between 9/1/2020 and 9/30/2020 1 Sample(s) Required between 10/1/2020 and 10/31/2020 1 Sample(s) Required between 11/1/2020 and 11/30/2020

Effective Date: 01/01/2020

OH6201911 LAKE ERIE UTILITIES COMP

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6262096	Facility Name: LAKE ERIE UTILITIES CO 2	
Location SMP ID: EP002	Facility Source: Surface Water	Facility Class: CLASS 3

Chemicals	Monitoring Requirements
NITRATE - 1040	1 Sample(s) Required between 12/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

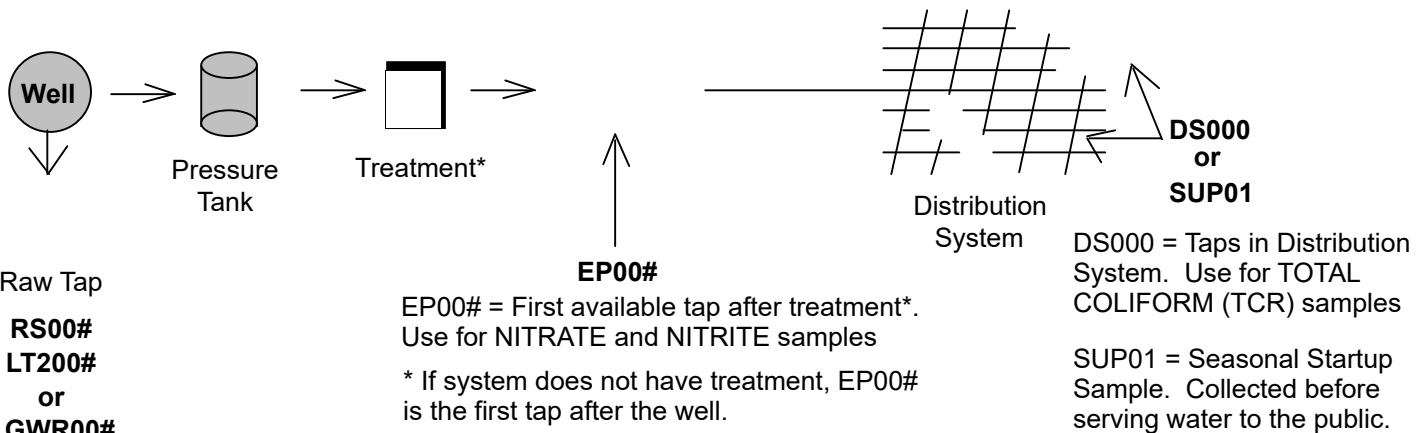

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6202411 MARBLEHEAD VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6256904	Facility Name: MARBLEHEAD VILLAGE	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements	
INORGANICS	1 Sample(s) Required between	6/1/2020 and 10/31/2020
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020		
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	1/1/2020 and 1/31/2020
	1 Sample(s) Required between	2/1/2020 and 2/29/2020
	1 Sample(s) Required between	3/1/2020 and 3/31/2020
	1 Sample(s) Required between	4/1/2020 and 4/30/2020
	1 Sample(s) Required between	5/1/2020 and 5/31/2020
	1 Sample(s) Required between	6/1/2020 and 6/30/2020
	1 Sample(s) Required between	7/1/2020 and 7/31/2020
	1 Sample(s) Required between	8/1/2020 and 8/31/2020
	1 Sample(s) Required between	9/1/2020 and 9/30/2020
	1 Sample(s) Required between	10/1/2020 and 10/31/2020
	1 Sample(s) Required between	11/1/2020 and 11/30/2020
	1 Sample(s) Required between	12/1/2020 and 12/31/2020
RADIOLOGICALS	Not Required	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	4/1/2020 and 6/30/2020
<i>Sample for all the analytes listed below:</i>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	6/1/2020 and 10/31/2020
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between	1/1/2020 and 1/31/2020
	1 Paired Sample Set Required between	2/1/2020 and 2/29/2020
	1 Paired Sample Set Required between	3/1/2020 and 3/31/2020
	1 Paired Sample Set Required between	4/1/2020 and 4/30/2020
	1 Paired Sample Set Required between	5/1/2020 and 5/31/2020
	1 Paired Sample Set Required between	6/1/2020 and 6/30/2020
	1 Paired Sample Set Required between	7/1/2020 and 7/31/2020
	1 Paired Sample Set Required between	8/1/2020 and 8/31/2020
	1 Paired Sample Set Required between	9/1/2020 and 9/30/2020
	1 Paired Sample Set Required between	10/1/2020 and 10/31/2020
	1 Paired Sample Set Required between	11/1/2020 and 11/30/2020
	1 Paired Sample Set Required between	12/1/2020 and 12/31/2020

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.

Effective Date: 01/01/2020

OH6202411 MARBLEHEAD VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6256904	Facility Name: MARBLEHEAD VILLAGE	
Location	SMP ID: EP001/LT2001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****Chemicals****Monitoring Requirements**

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY*

*Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.***Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*

Effective Date: 01/01/2020

OH6202411 MARBLEHEAD VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6256904	Facility Name: MARBLEHEAD VILLAGE	
Location	SMP ID: LT2001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/29/2019 and 1/4/2020
	1 Sample(s) Required between 1/12/2020 and 1/18/2020
	1 Sample(s) Required between 1/26/2020 and 2/1/2020
	1 Sample(s) Required between 2/9/2020 and 2/15/2020
	1 Sample(s) Required between 2/23/2020 and 2/29/2020
	1 Sample(s) Required between 3/8/2020 and 3/14/2020
	1 Sample(s) Required between 3/22/2020 and 3/28/2020
	1 Sample(s) Required between 4/5/2020 and 4/11/2020
	1 Sample(s) Required between 4/19/2020 and 4/25/2020
	1 Sample(s) Required between 5/3/2020 and 5/9/2020
	1 Sample(s) Required between 5/17/2020 and 5/23/2020
	1 Sample(s) Required between 5/31/2020 and 6/6/2020
	1 Sample(s) Required between 6/14/2020 and 6/20/2020
	1 Sample(s) Required between 6/28/2020 and 7/4/2020
	1 Sample(s) Required between 7/12/2020 and 7/18/2020
	1 Sample(s) Required between 7/26/2020 and 8/1/2020
	1 Sample(s) Required between 8/9/2020 and 8/15/2020
	1 Sample(s) Required between 8/23/2020 and 8/29/2020
	1 Sample(s) Required between 9/6/2020 and 9/12/2020
	1 Sample(s) Required between 9/20/2020 and 9/26/2020
	1 Sample(s) Required between 10/4/2020 and 10/10/2020
	1 Sample(s) Required between 10/18/2020 and 10/24/2020
	1 Sample(s) Required between 11/1/2020 and 11/7/2020
	1 Sample(s) Required between 11/15/2020 and 11/21/2020
	1 Sample(s) Required between 11/29/2020 and 12/5/2020
	1 Sample(s) Required between 12/13/2020 and 12/19/2020

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.

Effective Date: 01/01/2020

OH6202411 MARBLEHEAD VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MARBLEHEAD VILLAGE DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals**Monitoring Requirements**

TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Required between	1/1/2020	and	1/31/2020
	4 Sample(s) Required between	2/1/2020	and	2/29/2020
	4 Sample(s) Required between	3/1/2020	and	3/31/2020
	4 Sample(s) Required between	4/1/2020	and	4/30/2020
	4 Sample(s) Required between	5/1/2020	and	5/31/2020
	4 Sample(s) Required between	6/1/2020	and	6/30/2020
	4 Sample(s) Required between	7/1/2020	and	7/31/2020
	4 Sample(s) Required between	8/1/2020	and	8/31/2020
	4 Sample(s) Required between	9/1/2020	and	9/30/2020
	4 Sample(s) Required between	10/1/2020	and	10/31/2020
	4 Sample(s) Required between	11/1/2020	and	11/30/2020
	4 Sample(s) Required between	12/1/2020	and	12/31/2020

TOTAL CHLORINE - 1000	4 Sample(s) Required between	1/1/2020	and	1/31/2020
	4 Sample(s) Required between	2/1/2020	and	2/29/2020
	4 Sample(s) Required between	3/1/2020	and	3/31/2020
	4 Sample(s) Required between	4/1/2020	and	4/30/2020
	4 Sample(s) Required between	5/1/2020	and	5/31/2020
	4 Sample(s) Required between	6/1/2020	and	6/30/2020
	4 Sample(s) Required between	7/1/2020	and	7/31/2020
	4 Sample(s) Required between	8/1/2020	and	8/31/2020
	4 Sample(s) Required between	9/1/2020	and	9/30/2020
	4 Sample(s) Required between	10/1/2020	and	10/31/2020
	4 Sample(s) Required between	11/1/2020	and	11/30/2020
	4 Sample(s) Required between	12/1/2020	and	12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MARBLEHEAD VILLAGE DISTRIBUTION 10269 E BAYSHORE RD	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between	2/1/2020	and	2/7/2020	at: DS201
	Dual Sample Required between	5/1/2020	and	5/7/2020	at: DS201
	Dual Sample Required between	8/1/2020	and	8/7/2020	at: DS201
	Dual Sample Required between	11/1/2020	and	11/7/2020	at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH6202411 MARBLEHEAD VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: **** Consumer Confidence Report (CCR) is due July 1, 2020

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: MARBLEHEAD VILLAGE DISTRIBUTION 113 LAKE BREEZE CIRCLE	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2020 and 2/7/2020at: DS202
	Dual Sample Required between 5/1/2020 and 5/7/2020at: DS202
	Dual Sample Required between 8/1/2020 and 8/7/2020at: DS202
	Dual Sample Required between 11/1/2020 and 11/7/2020at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: MARBLEHEAD VILLAGE DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2020 and 9/30/2020

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

Effective Date: 01/01/2020

OH6202603 OAK HARBOR VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1	Facility Name: OAK HARBOR VILLAGE DISTRIBUTION SYSTE	Facility Class: CLASS 1
	SMP ID: DS000		

Chemicals**Monitoring Requirements**

ASBESTOS - 1094

Not Required

TOTAL COLIFORM (TCR) - 3100

5 Sample(s) Required between	1/1/2020	and	1/31/2020
5 Sample(s) Required between	2/1/2020	and	2/29/2020
5 Sample(s) Required between	3/1/2020	and	3/31/2020
5 Sample(s) Required between	4/1/2020	and	4/30/2020
5 Sample(s) Required between	5/1/2020	and	5/31/2020
5 Sample(s) Required between	6/1/2020	and	6/30/2020
5 Sample(s) Required between	7/1/2020	and	7/31/2020
5 Sample(s) Required between	8/1/2020	and	8/31/2020
5 Sample(s) Required between	9/1/2020	and	9/30/2020
5 Sample(s) Required between	10/1/2020	and	10/31/2020
5 Sample(s) Required between	11/1/2020	and	11/30/2020
5 Sample(s) Required between	12/1/2020	and	12/31/2020

TOTAL CHLORINE - 1000

5 Sample(s) Required between	1/1/2020	and	1/31/2020
5 Sample(s) Required between	2/1/2020	and	2/29/2020
5 Sample(s) Required between	3/1/2020	and	3/31/2020
5 Sample(s) Required between	4/1/2020	and	4/30/2020
5 Sample(s) Required between	5/1/2020	and	5/31/2020
5 Sample(s) Required between	6/1/2020	and	6/30/2020
5 Sample(s) Required between	7/1/2020	and	7/31/2020
5 Sample(s) Required between	8/1/2020	and	8/31/2020
5 Sample(s) Required between	9/1/2020	and	9/30/2020
5 Sample(s) Required between	10/1/2020	and	10/31/2020
5 Sample(s) Required between	11/1/2020	and	11/30/2020
5 Sample(s) Required between	12/1/2020	and	12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: OAK HARBOR VILLAGE DISTRIBUTION SYSTE	Facility Class: CLASS 1
	SMP ID: DS201	9735 W. SR 163	

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between	2/1/2020	and	2/7/2020	at: DS201
Dual Sample Required between	5/1/2020	and	5/7/2020	at: DS201
Dual Sample Required between	8/1/2020	and	8/7/2020	at: DS201

OH6202603 OAK HARBOR VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: OAK HARBOR VILLAGE DISTRIBUTION SYSTE	Facility Class: CLASS 1
	SMP ID: DS201	9735 W. SR 163	

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS Dual Sample Required between 11/1/2020 and 11/7/2020at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1	Facility Name: OAK HARBOR VILLAGE DISTRIBUTION SYSTE	Facility Class: CLASS 1
	SMP ID: DS202	601 N. BENTON ST.	

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

Dual Sample Required between 2/1/2020 and 2/7/2020at: DS202

Dual Sample Required between 5/1/2020 and 5/7/2020at: DS202

Dual Sample Required between 8/1/2020 and 8/7/2020at: DS202

Dual Sample Required between 11/1/2020 and 11/7/2020at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1	Facility Name: OAK HARBOR VILLAGE DISTRIBUTION SYSTE	Facility Class: CLASS 1
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs	

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

Effective Date: 01/01/2020

OH6203211 PORT CLINTON CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1	Facility Name: PORT CLINTON CITY DISTRIBUTION SYSTEM	Facility Class: CLASS 1
	SMP ID: DS000		

Chemicals**Monitoring Requirements**

ASBESTOS - 1094

Not Required

TOTAL COLIFORM (TCR) - 3100

7 Sample(s) Required between	1/1/2020	and	1/31/2020
7 Sample(s) Required between	2/1/2020	and	2/29/2020
7 Sample(s) Required between	3/1/2020	and	3/31/2020
7 Sample(s) Required between	4/1/2020	and	4/30/2020
7 Sample(s) Required between	5/1/2020	and	5/31/2020
7 Sample(s) Required between	6/1/2020	and	6/30/2020
7 Sample(s) Required between	7/1/2020	and	7/31/2020
7 Sample(s) Required between	8/1/2020	and	8/31/2020
7 Sample(s) Required between	9/1/2020	and	9/30/2020
7 Sample(s) Required between	10/1/2020	and	10/31/2020
7 Sample(s) Required between	11/1/2020	and	11/30/2020
7 Sample(s) Required between	12/1/2020	and	12/31/2020

TOTAL CHLORINE - 1000

7 Sample(s) Required between	1/1/2020	and	1/31/2020
7 Sample(s) Required between	2/1/2020	and	2/29/2020
7 Sample(s) Required between	3/1/2020	and	3/31/2020
7 Sample(s) Required between	4/1/2020	and	4/30/2020
7 Sample(s) Required between	5/1/2020	and	5/31/2020
7 Sample(s) Required between	6/1/2020	and	6/30/2020
7 Sample(s) Required between	7/1/2020	and	7/31/2020
7 Sample(s) Required between	8/1/2020	and	8/31/2020
7 Sample(s) Required between	9/1/2020	and	9/30/2020
7 Sample(s) Required between	10/1/2020	and	10/31/2020
7 Sample(s) Required between	11/1/2020	and	11/30/2020
7 Sample(s) Required between	12/1/2020	and	12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: PORT CLINTON CITY DISTRIBUTION SYSTEM	Facility Class: CLASS 1
	SMP ID: DS201	1868 EAST PERRY ST	

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between	2/1/2020	and	2/7/2020	at: DS201
Dual Sample Required between	5/1/2020	and	5/7/2020	at: DS201
Dual Sample Required between	8/1/2020	and	8/7/2020	at: DS201

OH6203211 PORT CLINTON CITY

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: PORT CLINTON CITY DISTRIBUTION SYSTEM 1868 EAST PERRY ST	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 11/1/2020 and 11/7/2020at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: PORT CLINTON CITY DISTRIBUTION SYSTEM 716 W THIRD ST	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS

Dual Sample Required between 2/1/2020 and 2/7/2020at: DS202

Dual Sample Required between 5/1/2020 and 5/7/2020at: DS202

Dual Sample Required between 8/1/2020 and 8/7/2020at: DS202

Dual Sample Required between 11/1/2020 and 11/7/2020at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: PORT CLINTON CITY DISTRIBUTION SYSTEM Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022

Not Required

OH6203311 PUT-IN-BAY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6256913	Facility Name: PUT-IN-BAY VILLAGE	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements	
BROMATE - 1011	1 Sample(s) Required between	6/1/2020 and 6/30/2020
	1 Sample(s) Required between	7/1/2020 and 7/31/2020
	1 Sample(s) Required between	8/1/2020 and 8/31/2020
	1 Sample(s) Required between	9/1/2020 and 9/30/2020
	1 Sample(s) Required between	10/1/2020 and 10/31/2020
INORGANICS	1 Sample(s) Required between	6/1/2020 and 10/31/2020
<i>Sample for all the analytes listed below:</i>		
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020		
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085		
NITRITE - 1041	Not Required	
NITRATE - 1040	1 Sample(s) Required between	1/1/2020 and 1/31/2020
	1 Sample(s) Required between	2/1/2020 and 2/29/2020
	1 Sample(s) Required between	3/1/2020 and 3/31/2020
	1 Sample(s) Required between	4/1/2020 and 4/30/2020
	1 Sample(s) Required between	5/1/2020 and 5/31/2020
	1 Sample(s) Required between	6/1/2020 and 6/30/2020
	1 Sample(s) Required between	7/1/2020 and 7/31/2020
	1 Sample(s) Required between	8/1/2020 and 8/31/2020
	1 Sample(s) Required between	9/1/2020 and 9/30/2020
	1 Sample(s) Required between	10/1/2020 and 10/31/2020
	1 Sample(s) Required between	11/1/2020 and 11/30/2020
	1 Sample(s) Required between	12/1/2020 and 12/31/2020
RADIOLOGICALS	Not Required	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	4/1/2020 and 6/30/2020
<i>Sample for all the analytes listed below:</i>		
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037		
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	6/1/2020 and 10/31/2020

OH6203311 PUT-IN-BAY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6256913	Facility Name: PUT-IN-BAY VILLAGE	
Location	SMP ID: EP001/LT2001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****Chemicals****Monitoring Requirements**

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY*

*Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.***Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*

Effective Date: 01/01/2020

OH6203311 PUT-IN-BAY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6256913	Facility Name: PUT-IN-BAY VILLAGE	
Location	SMP ID: LT2001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/29/2019 and 1/4/2020
	1 Sample(s) Required between 1/12/2020 and 1/18/2020
	1 Sample(s) Required between 1/26/2020 and 2/1/2020
	1 Sample(s) Required between 2/9/2020 and 2/15/2020
	1 Sample(s) Required between 2/23/2020 and 2/29/2020
	1 Sample(s) Required between 3/8/2020 and 3/14/2020
	1 Sample(s) Required between 3/22/2020 and 3/28/2020
	1 Sample(s) Required between 4/5/2020 and 4/11/2020
	1 Sample(s) Required between 4/19/2020 and 4/25/2020
	1 Sample(s) Required between 5/3/2020 and 5/9/2020
	1 Sample(s) Required between 5/17/2020 and 5/23/2020
	1 Sample(s) Required between 5/31/2020 and 6/6/2020
	1 Sample(s) Required between 6/14/2020 and 6/20/2020
	1 Sample(s) Required between 6/28/2020 and 7/4/2020
	1 Sample(s) Required between 7/12/2020 and 7/18/2020
	1 Sample(s) Required between 7/26/2020 and 8/1/2020
	1 Sample(s) Required between 8/9/2020 and 8/15/2020
	1 Sample(s) Required between 8/23/2020 and 8/29/2020
	1 Sample(s) Required between 9/6/2020 and 9/12/2020
	1 Sample(s) Required between 9/20/2020 and 9/26/2020
	1 Sample(s) Required between 10/4/2020 and 10/10/2020
	1 Sample(s) Required between 10/18/2020 and 10/24/2020
	1 Sample(s) Required between 11/1/2020 and 11/7/2020
	1 Sample(s) Required between 11/15/2020 and 11/21/2020
	1 Sample(s) Required between 11/29/2020 and 12/5/2020
	1 Sample(s) Required between 12/13/2020 and 12/19/2020

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.

Effective Date: 01/01/2020

OH6203311 PUT-IN-BAY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: PUT-IN-BAY VILLAGE DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements		
TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Required between	1/1/2020 and	1/31/2020
	4 Sample(s) Required between	2/1/2020 and	2/29/2020
	4 Sample(s) Required between	3/1/2020 and	3/31/2020
	4 Sample(s) Required between	4/1/2020 and	4/30/2020
	6 Sample(s) Required between	5/1/2020 and	5/31/2020
	6 Sample(s) Required between	6/1/2020 and	6/30/2020
	6 Sample(s) Required between	7/1/2020 and	7/31/2020
	6 Sample(s) Required between	8/1/2020 and	8/31/2020
	6 Sample(s) Required between	9/1/2020 and	9/30/2020
	4 Sample(s) Required between	10/1/2020 and	10/31/2020
	4 Sample(s) Required between	11/1/2020 and	11/30/2020
	4 Sample(s) Required between	12/1/2020 and	12/31/2020
TOTAL CHLORINE - 1000	4 Sample(s) Required between	1/1/2020 and	1/31/2020
	4 Sample(s) Required between	2/1/2020 and	2/29/2020
	4 Sample(s) Required between	3/1/2020 and	3/31/2020
	4 Sample(s) Required between	4/1/2020 and	4/30/2020
	6 Sample(s) Required between	5/1/2020 and	5/31/2020
	6 Sample(s) Required between	6/1/2020 and	6/30/2020
	6 Sample(s) Required between	7/1/2020 and	7/31/2020
	6 Sample(s) Required between	8/1/2020 and	8/31/2020
	6 Sample(s) Required between	9/1/2020 and	9/30/2020
	4 Sample(s) Required between	10/1/2020 and	10/31/2020
	4 Sample(s) Required between	11/1/2020 and	11/30/2020
	4 Sample(s) Required between	12/1/2020 and	12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: PUT-IN-BAY VILLAGE DISTRIBUTION 70 PARK	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements		
DISINFECTION BYPRODUCTS	Dual Sample Required between	3/1/2020 and	3/7/2020at: DS201
	Dual Sample Required between	6/1/2020 and	6/7/2020at: DS201
	Dual Sample Required between	9/1/2020 and	9/7/2020at: DS201
	Dual Sample Required between	12/1/2020 and	12/7/2020at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Effective Date: 01/01/2020

OH6203311 PUT-IN-BAY VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: PUT-IN-BAY VILLAGE DISTRIBUTION 1550 PIB ROAD	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	Dual Sample Required between 3/1/2020 and 3/7/2020at: DS202 Dual Sample Required between 6/1/2020 and 6/7/2020at: DS202 Dual Sample Required between 9/1/2020 and 9/7/2020at: DS202 Dual Sample Required between 12/1/2020 and 12/7/2020at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: PUT-IN-BAY VILLAGE DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between 1/1/2020 and 6/30/2020 20 Sample(s) Required between 7/1/2020 and 12/31/2020

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

Effective Date: 01/01/2020

OH6205011 OTTAWA COUNTY REGIONAL WATER DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6256925	Facility Name: OTTAWA COUNTY REGIONAL WATER DISTRICT	Facility Class: CLASS 4
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****Chemicals****Monitoring Requirements**

INORGANICS 1 Sample(s) Required between 6/1/2020 and 10/31/2020

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2020 and 1/31/2020

1 Sample(s) Required between 2/1/2020 and 2/29/2020

1 Sample(s) Required between 3/1/2020 and 3/31/2020

1 Sample(s) Required between 4/1/2020 and 4/30/2020

1 Sample(s) Required between 5/1/2020 and 5/31/2020

1 Sample(s) Required between 6/1/2020 and 6/30/2020

1 Sample(s) Required between 7/1/2020 and 7/31/2020

1 Sample(s) Required between 8/1/2020 and 8/31/2020

1 Sample(s) Required between 9/1/2020 and 9/30/2020

1 Sample(s) Required between 10/1/2020 and 10/31/2020

1 Sample(s) Required between 11/1/2020 and 11/30/2020

1 Sample(s) Required between 12/1/2020 and 12/31/2020

RADIOLOGICALS Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 4/1/2020 and 6/30/2020

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 4/1/2020 and 6/30/2020

TOTAL ORGANIC CARBON (TOC)

1 Paired Sample Set Required between 1/1/2020 and 1/31/2020

1 Paired Sample Set Required between 2/1/2020 and 2/29/2020

1 Paired Sample Set Required between 3/1/2020 and 3/31/2020

1 Paired Sample Set Required between 4/1/2020 and 4/30/2020

1 Paired Sample Set Required between 5/1/2020 and 5/31/2020

1 Paired Sample Set Required between 6/1/2020 and 6/30/2020

1 Paired Sample Set Required between 7/1/2020 and 7/31/2020

1 Paired Sample Set Required between 8/1/2020 and 8/31/2020

1 Paired Sample Set Required between 9/1/2020 and 9/30/2020

1 Paired Sample Set Required between 10/1/2020 and 10/31/2020

1 Paired Sample Set Required between 11/1/2020 and 11/30/2020

1 Paired Sample Set Required between 12/1/2020 and 12/31/2020

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.

OH6205011 OTTAWA COUNTY REGIONAL WATER DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6256925	Facility Name: OTTAWA COUNTY REGIONAL WATER DISTRICT
Location	SMP ID: EP001/LT2001	Facility Source: Surface Water
		Facility Class: CLASS 4

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****Chemicals****Monitoring Requirements**

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY*

*Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.***Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*

Effective Date: 01/01/2020

OH6205011 OTTAWA COUNTY REGIONAL WATER DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6256925	Facility Name: OTTAWA COUNTY REGIONAL WATER DISTRICT
Location	SMP ID: LT2001	Facility Source: Surface Water
		Facility Class: CLASS 4

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/29/2019 and 1/4/2020
	1 Sample(s) Required between 1/12/2020 and 1/18/2020
	1 Sample(s) Required between 1/26/2020 and 2/1/2020
	1 Sample(s) Required between 2/9/2020 and 2/15/2020
	1 Sample(s) Required between 2/23/2020 and 2/29/2020
	1 Sample(s) Required between 3/8/2020 and 3/14/2020
	1 Sample(s) Required between 3/22/2020 and 3/28/2020
	1 Sample(s) Required between 4/5/2020 and 4/11/2020
	1 Sample(s) Required between 4/19/2020 and 4/25/2020
	1 Sample(s) Required between 5/3/2020 and 5/9/2020
	1 Sample(s) Required between 5/17/2020 and 5/23/2020
	1 Sample(s) Required between 5/31/2020 and 6/6/2020
	1 Sample(s) Required between 6/14/2020 and 6/20/2020
	1 Sample(s) Required between 6/28/2020 and 7/4/2020
	1 Sample(s) Required between 7/12/2020 and 7/18/2020
	1 Sample(s) Required between 7/26/2020 and 8/1/2020
	1 Sample(s) Required between 8/9/2020 and 8/15/2020
	1 Sample(s) Required between 8/23/2020 and 8/29/2020
	1 Sample(s) Required between 9/6/2020 and 9/12/2020
	1 Sample(s) Required between 9/20/2020 and 9/26/2020
	1 Sample(s) Required between 10/4/2020 and 10/10/2020
	1 Sample(s) Required between 10/18/2020 and 10/24/2020
	1 Sample(s) Required between 11/1/2020 and 11/7/2020
	1 Sample(s) Required between 11/15/2020 and 11/21/2020
	1 Sample(s) Required between 11/29/2020 and 12/5/2020
	1 Sample(s) Required between 12/13/2020 and 12/19/2020

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.

Effective Date: 01/17/2020

OH6205011 OTTAWA COUNTY REGIONAL WATER DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: OTTAWA COUNTY REGIONAL DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals**Monitoring Requirements**

TOTAL COLIFORM (TCR) - 3100	20 Sample(s) Required between	1/1/2020	and	1/31/2020
	20 Sample(s) Required between	2/1/2020	and	2/29/2020
	20 Sample(s) Required between	3/1/2020	and	3/31/2020
	20 Sample(s) Required between	4/1/2020	and	4/30/2020
	20 Sample(s) Required between	5/1/2020	and	5/31/2020
	20 Sample(s) Required between	6/1/2020	and	6/30/2020
	20 Sample(s) Required between	7/1/2020	and	7/31/2020
	20 Sample(s) Required between	8/1/2020	and	8/31/2020
	20 Sample(s) Required between	9/1/2020	and	9/30/2020
	20 Sample(s) Required between	10/1/2020	and	10/31/2020
	20 Sample(s) Required between	11/1/2020	and	11/30/2020
	20 Sample(s) Required between	12/1/2020	and	12/31/2020

TOTAL CHLORINE - 1000	20 Sample(s) Required between	1/1/2020	and	1/31/2020
	20 Sample(s) Required between	2/1/2020	and	2/29/2020
	20 Sample(s) Required between	3/1/2020	and	3/31/2020
	20 Sample(s) Required between	4/1/2020	and	4/30/2020
	20 Sample(s) Required between	5/1/2020	and	5/31/2020
	20 Sample(s) Required between	6/1/2020	and	6/30/2020
	20 Sample(s) Required between	7/1/2020	and	7/31/2020
	20 Sample(s) Required between	8/1/2020	and	8/31/2020
	20 Sample(s) Required between	9/1/2020	and	9/30/2020
	20 Sample(s) Required between	10/1/2020	and	10/31/2020
	20 Sample(s) Required between	11/1/2020	and	11/30/2020
	20 Sample(s) Required between	12/1/2020	and	12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: OTTAWA COUNTY REGIONAL DISTRIBUTION DANBURY TOWER	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between	2/1/2020	and	2/7/2020	at: DS201
	Dual Sample Required between	5/1/2020	and	5/7/2020	at: DS201
	Dual Sample Required between	8/1/2020	and	8/7/2020	at: DS201
	Dual Sample Required between	11/1/2020	and	11/7/2020	at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Effective Date: 01/17/2020

OH6205011 OTTAWA COUNTY REGIONAL WATER DISTRICT

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: OTTAWA COUNTY REGIONAL DISTRIBUTION CATAWBA TOWER	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2020 and 2/7/2020	at: DS202
	Dual Sample Required between 5/1/2020 and 5/7/2020	at: DS202
	Dual Sample Required between 8/1/2020 and 8/7/2020	at: DS202
	Dual Sample Required between 11/1/2020 and 11/7/2020	at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS203	Facility Name: OTTAWA COUNTY REGIONAL DISTRIBUTION STATE OF OHIO ST.RT. 2 REST AREA	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2020 and 2/7/2020	at: DS203
	Dual Sample Required between 5/1/2020 and 5/7/2020	at: DS203
	Dual Sample Required between 8/1/2020 and 8/7/2020	at: DS203
	Dual Sample Required between 11/1/2020 and 11/7/2020	at: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: OTTAWA COUNTY REGIONAL DISTRIBUTION 9400 NORTH SHORE BLVD	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between 2/1/2020 and 2/7/2020	at: DS204
	Dual Sample Required between 5/1/2020 and 5/7/2020	at: DS204
	Dual Sample Required between 8/1/2020 and 8/7/2020	at: DS204
	Dual Sample Required between 11/1/2020 and 11/7/2020	at: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: OTTAWA COUNTY REGIONAL DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

OH6205111 CARROLL WATER AND SEWER

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6256927	Facility Name: CARROLL WATER AND SEWER	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements		
BROMATE - 1011	1 Sample(s) Required between	1/1/2020 and	1/31/2020
	1 Sample(s) Required between	2/1/2020 and	2/29/2020
	1 Sample(s) Required between	3/1/2020 and	3/31/2020
	1 Sample(s) Required between	4/1/2020 and	4/30/2020
	1 Sample(s) Required between	5/1/2020 and	5/31/2020
	1 Sample(s) Required between	6/1/2020 and	6/30/2020
	1 Sample(s) Required between	7/1/2020 and	7/31/2020
	1 Sample(s) Required between	8/1/2020 and	8/31/2020
	1 Sample(s) Required between	9/1/2020 and	9/30/2020
	1 Sample(s) Required between	10/1/2020 and	10/31/2020
	1 Sample(s) Required between	11/1/2020 and	11/30/2020
	1 Sample(s) Required between	12/1/2020 and	12/31/2020
INORGANICS	1 Sample(s) Required between	6/1/2020 and	10/31/2020
<i>Sample for all the analytes listed below:</i>			
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020			
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085			
NITRITE - 1041	Not Required		
NITRATE - 1040	1 Sample(s) Required between	1/1/2020 and	1/31/2020
	1 Sample(s) Required between	2/1/2020 and	2/29/2020
	1 Sample(s) Required between	3/1/2020 and	3/31/2020
	1 Sample(s) Required between	4/1/2020 and	4/30/2020
	1 Sample(s) Required between	5/1/2020 and	5/31/2020
	1 Sample(s) Required between	6/1/2020 and	6/30/2020
	1 Sample(s) Required between	7/1/2020 and	7/31/2020
	1 Sample(s) Required between	8/1/2020 and	8/31/2020
	1 Sample(s) Required between	9/1/2020 and	9/30/2020
	1 Sample(s) Required between	10/1/2020 and	10/31/2020
	1 Sample(s) Required between	11/1/2020 and	11/30/2020
	1 Sample(s) Required between	12/1/2020 and	12/31/2020
RADIOLOGICALS	Not Required		
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between	4/1/2020 and	6/30/2020
<i>Sample for all the analytes listed below:</i>			
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037			
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between	10/1/2020 and	12/31/2020
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between	1/1/2020 and	1/31/2020
	1 Paired Sample Set Required between	2/1/2020 and	2/29/2020
	1 Paired Sample Set Required between	3/1/2020 and	3/31/2020
	1 Paired Sample Set Required between	4/1/2020 and	4/30/2020
	1 Paired Sample Set Required between	5/1/2020 and	5/31/2020
	1 Paired Sample Set Required between	6/1/2020 and	6/30/2020
	1 Paired Sample Set Required between	7/1/2020 and	7/31/2020

OH6205111 CARROLL WATER AND SEWER

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6256927	Facility Name: CARROLL WATER AND SEWER	
Location	SMP ID: EP001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements		
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between	8/1/2020 and	8/31/2020
	1 Paired Sample Set Required between	9/1/2020 and	9/30/2020
	1 Paired Sample Set Required between	10/1/2020 and	10/31/2020
	1 Paired Sample Set Required between	11/1/2020 and	11/30/2020
	1 Paired Sample Set Required between	12/1/2020 and	12/31/2020

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.

Effective Date: 01/01/2020

OH6205111 CARROLL WATER AND SEWER

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6256927	Facility Name: CARROLL WATER AND SEWER	
Location	SMP ID: EP001/LT2001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****Chemicals****Monitoring Requirements**

TOTAL MICROCYSTINS

1 Sample Set Required WEEKLY*

*Total microcystins sample set refers to one raw source water sample at LT2001 and one finished water sample at EP001. A week is defined as Sunday through Saturday.***Weekly sampling unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. Reduced monitoring is contingent on a public water system continuing to experience NO raw or finished water total microcystins detections. Any total microcystins detections during routine (weekly) or reduced sampling will trigger additional sampling. Please refer to the website above for specifics on follow-up sampling requirements.*

Effective Date: 01/01/2020

OH6205111 CARROLL WATER AND SEWER

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6256927	Facility Name: CARROLL WATER AND SEWER	
Location	SMP ID: LT2001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020**

Chemicals	Monitoring Requirements
CYANOBACTERIA SCREENING	1 Sample(s) Required between 12/29/2019 and 1/4/2020
	1 Sample(s) Required between 1/12/2020 and 1/18/2020
	1 Sample(s) Required between 1/26/2020 and 2/1/2020
	1 Sample(s) Required between 2/9/2020 and 2/15/2020
	1 Sample(s) Required between 2/23/2020 and 2/29/2020
	1 Sample(s) Required between 3/8/2020 and 3/14/2020
	1 Sample(s) Required between 3/22/2020 and 3/28/2020
	1 Sample(s) Required between 4/5/2020 and 4/11/2020
	1 Sample(s) Required between 4/19/2020 and 4/25/2020
	1 Sample(s) Required between 5/3/2020 and 5/9/2020
	1 Sample(s) Required between 5/17/2020 and 5/23/2020
	1 Sample(s) Required between 5/31/2020 and 6/6/2020
	1 Sample(s) Required between 6/14/2020 and 6/20/2020
	1 Sample(s) Required between 6/28/2020 and 7/4/2020
	1 Sample(s) Required between 7/12/2020 and 7/18/2020
	1 Sample(s) Required between 7/26/2020 and 8/1/2020
	1 Sample(s) Required between 8/9/2020 and 8/15/2020
	1 Sample(s) Required between 8/23/2020 and 8/29/2020
	1 Sample(s) Required between 9/6/2020 and 9/12/2020
	1 Sample(s) Required between 9/20/2020 and 9/26/2020
	1 Sample(s) Required between 10/4/2020 and 10/10/2020
	1 Sample(s) Required between 10/18/2020 and 10/24/2020
	1 Sample(s) Required between 11/1/2020 and 11/7/2020
	1 Sample(s) Required between 11/15/2020 and 11/21/2020
	1 Sample(s) Required between 11/29/2020 and 12/5/2020
	1 Sample(s) Required between 12/13/2020 and 12/19/2020

Cyanobacteria screening sample is to be collected biweekly from raw source water at sample point LT2001 unless requirements for reduced monitoring are met. Current reduced monitoring schedules can be found at <http://epa.ohio.gov/ddagw/HAB.aspx>. As of 12/31/17, all public water systems are responsible for contracting with a lab certified to perform cyanobacteria screening (qPCR). Please review the website for further information pertaining to follow-up sampling requirements for cyanobacteria screening gene detections, and certified labs that can perform analysis.

Effective Date: 01/01/2020

OH6205111 CARROLL WATER AND SEWER

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: CARROLL WATER AND SEWER DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals**Monitoring Requirements**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Required between 1/1/2020 and 1/31/2020
	4 Sample(s) Required between 2/1/2020 and 2/29/2020
	4 Sample(s) Required between 3/1/2020 and 3/31/2020
	4 Sample(s) Required between 4/1/2020 and 4/30/2020
	4 Sample(s) Required between 5/1/2020 and 5/31/2020
	4 Sample(s) Required between 6/1/2020 and 6/30/2020
	4 Sample(s) Required between 7/1/2020 and 7/31/2020
	4 Sample(s) Required between 8/1/2020 and 8/31/2020
	4 Sample(s) Required between 9/1/2020 and 9/30/2020
	4 Sample(s) Required between 10/1/2020 and 10/31/2020
	4 Sample(s) Required between 11/1/2020 and 11/30/2020
	4 Sample(s) Required between 12/1/2020 and 12/31/2020

TOTAL CHLORINE - 1000	4 Sample(s) Required between 1/1/2020 and 1/31/2020
	4 Sample(s) Required between 2/1/2020 and 2/29/2020
	4 Sample(s) Required between 3/1/2020 and 3/31/2020
	4 Sample(s) Required between 4/1/2020 and 4/30/2020
	4 Sample(s) Required between 5/1/2020 and 5/31/2020
	4 Sample(s) Required between 6/1/2020 and 6/30/2020
	4 Sample(s) Required between 7/1/2020 and 7/31/2020
	4 Sample(s) Required between 8/1/2020 and 8/31/2020
	4 Sample(s) Required between 9/1/2020 and 9/30/2020
	4 Sample(s) Required between 10/1/2020 and 10/31/2020
	4 Sample(s) Required between 11/1/2020 and 11/30/2020
	4 Sample(s) Required between 12/1/2020 and 12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: CARROLL WATER AND SEWER DISTRIBUTION 11861 W SALEM CARROLL RD	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2020 and 2/14/2020at: DS201
	Dual Sample Required between 5/8/2020 and 5/14/2020at: DS201
	Dual Sample Required between 8/8/2020 and 8/14/2020at: DS201
	Dual Sample Required between 11/8/2020 and 11/14/2020at: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Effective Date: 01/01/2020

OH6205111 CARROLL WATER AND SEWER

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2020****DISTRIBUTION MONITORING SCHEDULE**

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: CARROLL WATER AND SEWER DISTRIBUTION 11080 W TOUSSAINT E RD	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between 2/8/2020 and 2/14/2020at: DS202
	Dual Sample Required between 5/8/2020 and 5/14/2020at: DS202
	Dual Sample Required between 8/8/2020 and 8/14/2020at: DS202
	Dual Sample Required between 11/8/2020 and 11/14/2020at: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: CARROLL WATER AND SEWER DISTRIBUTION Refer to your Lead and Copper plan for SMP IDs	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

Effective Date: 01/01/2020

OH6230412 BENCHMORE FARMS AMLC 2

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **BENCHMORE FARMS AMLC 2 DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

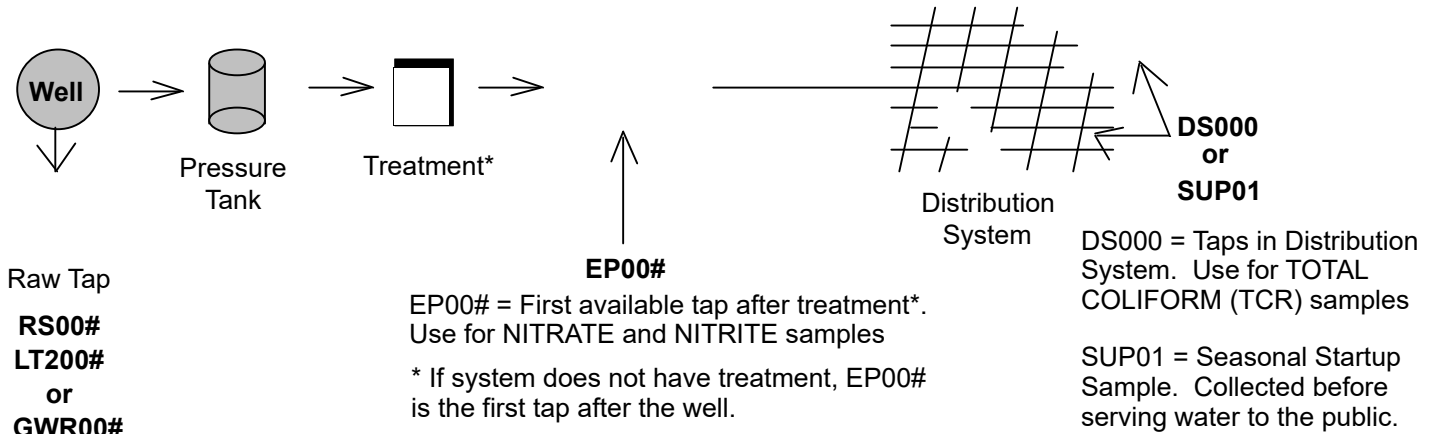

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6230412 BENCHMORE FARMS AMLC 2

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BENCHMORE FARMS AMLC 2 DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 8/21/2020 and 8/31/2020 1 Sample(s) Required between 9/1/2020 and 9/30/2020

Where to Collect Samples For a Small Public Water System

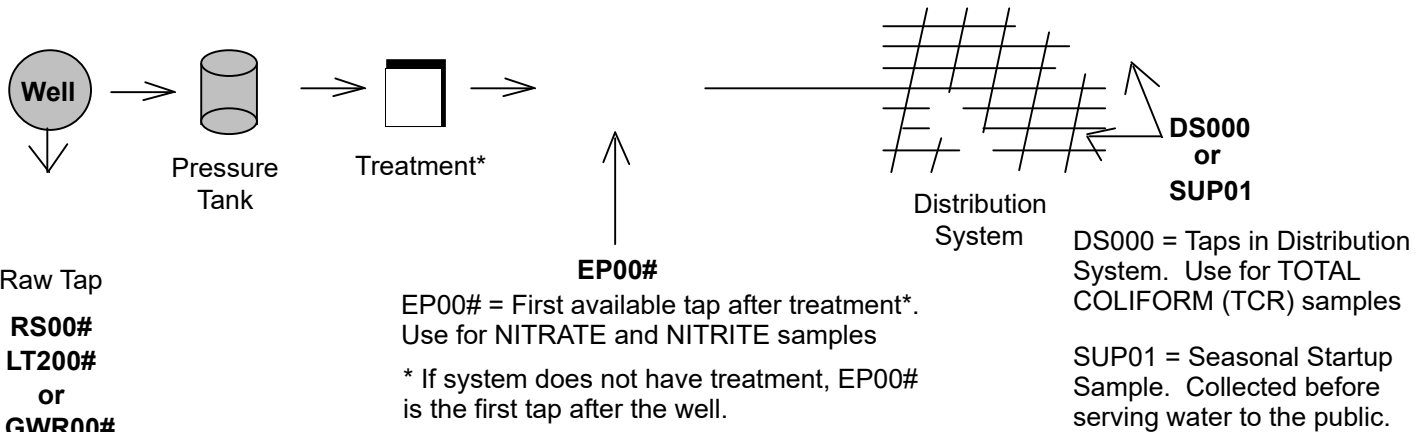

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 08/14/2020

OH6230412 BENCHMORE FARMS AMLC 2

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256928 Facility Name: BENCHMORE FARMS AMLC NO 2

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

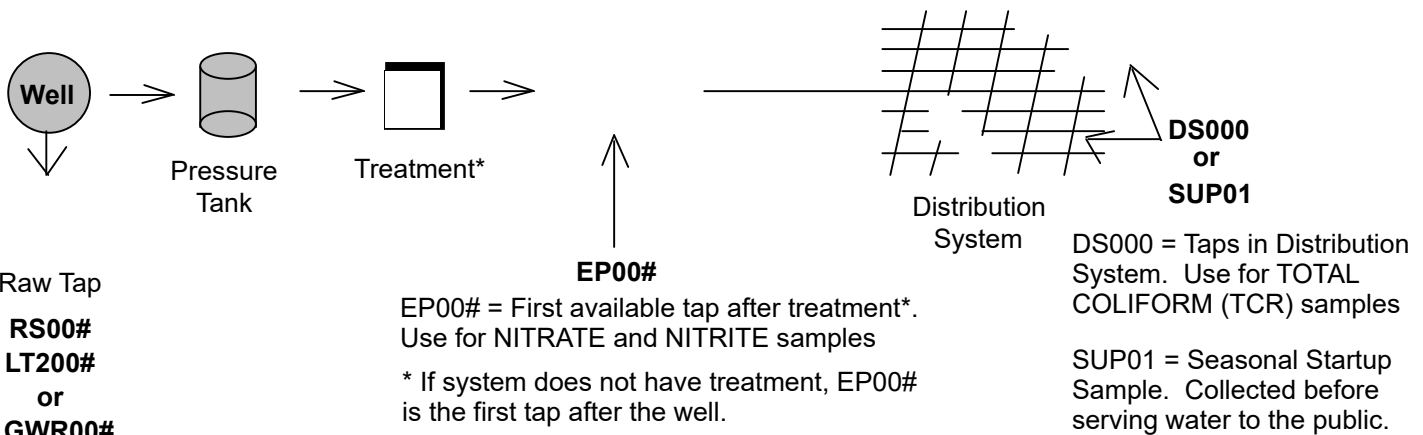

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6230512 BETHEL UNITED BROTHERS CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **BETHEL UNITED BROTHERS C DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

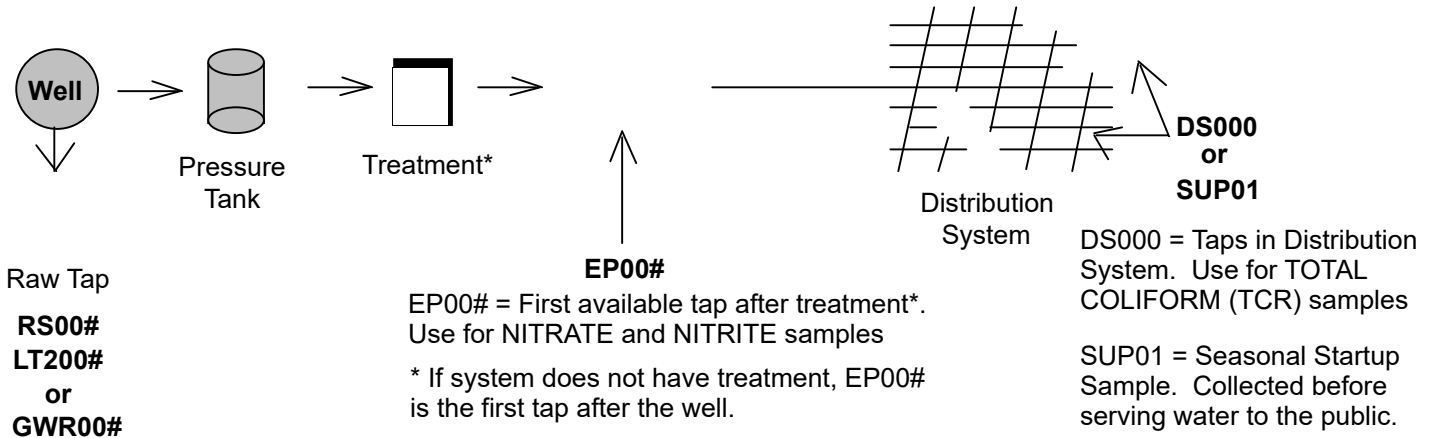

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6230512 BETHEL UNITED BRETHERN CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256929 Facility Name: BETHEL UNITED BRETHERN CHURCH

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

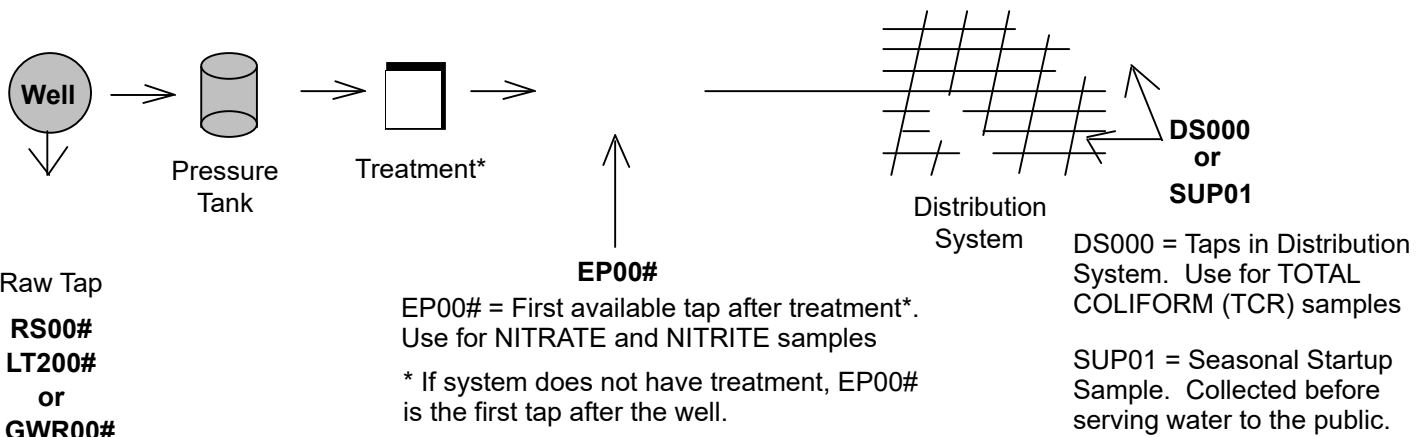

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6230612 BLACKBERRY CORNERS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BLACKBERRY CORNERS DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

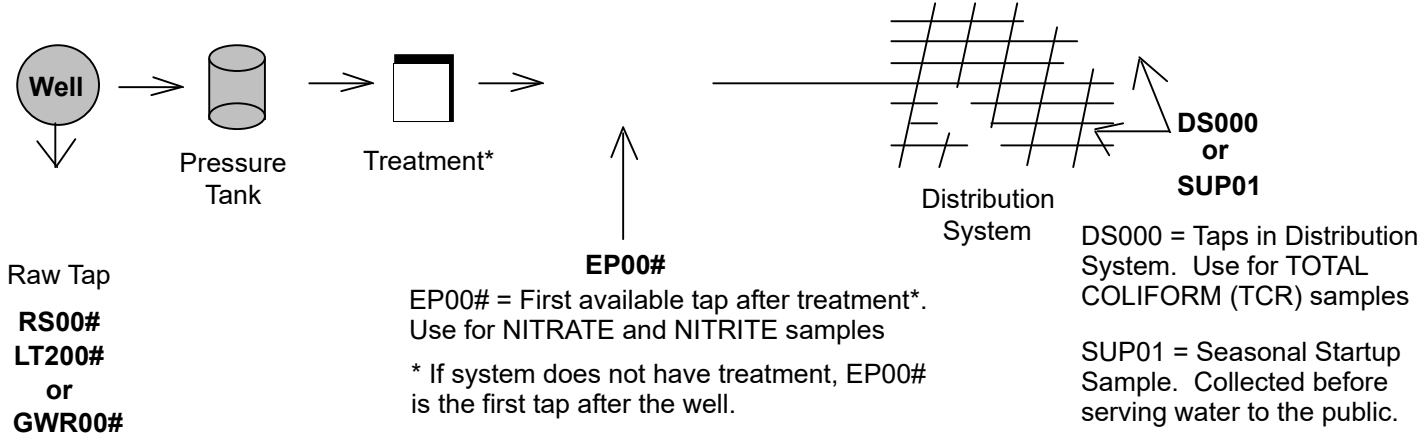

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6230612 BLACKBERRY CORNERS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256930 Facility Name: BLACKBERRY CORNERS

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

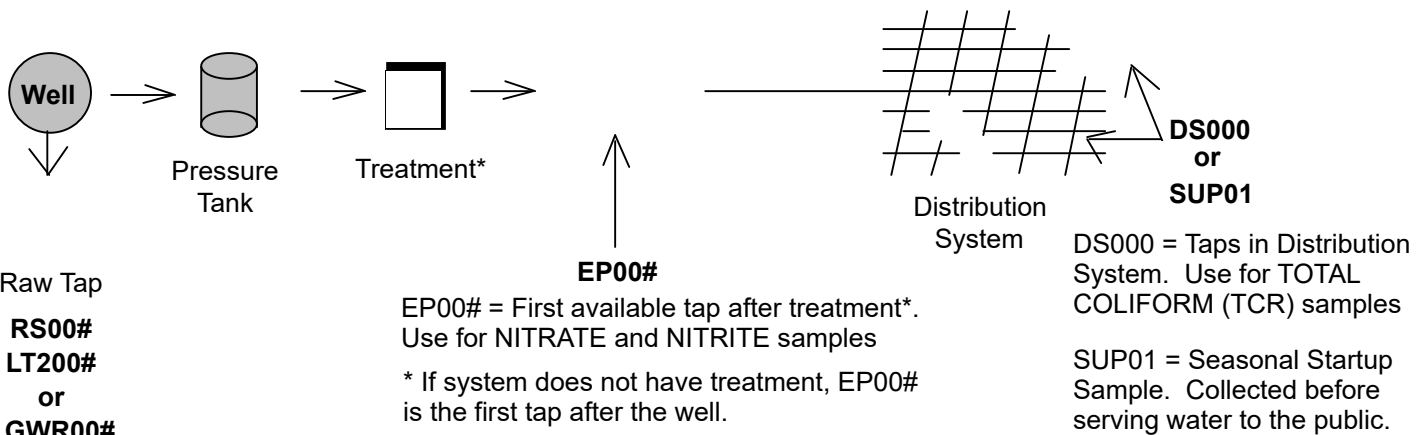

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6230912 ERNESTOS RESTAURANT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **ERNESTOS RESTAURANT DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

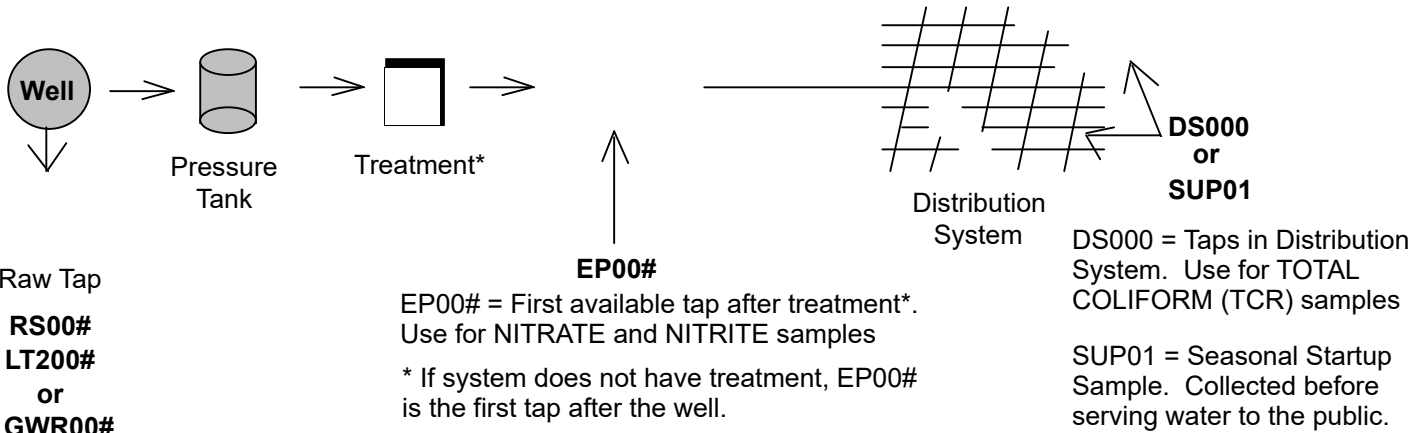

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6230912 ERNESTOS RESTAURANT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256932 Facility Name: ERNESTOS RESTAURANT

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

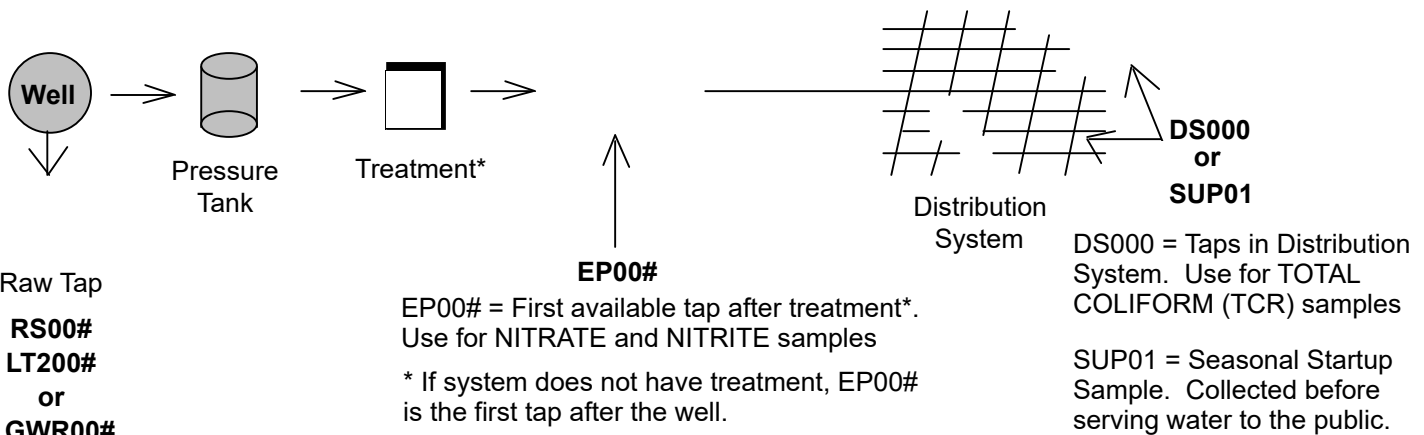

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6232012 COUNTRY KEG RESTAURANT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **COUNTRY KEG, LLC DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

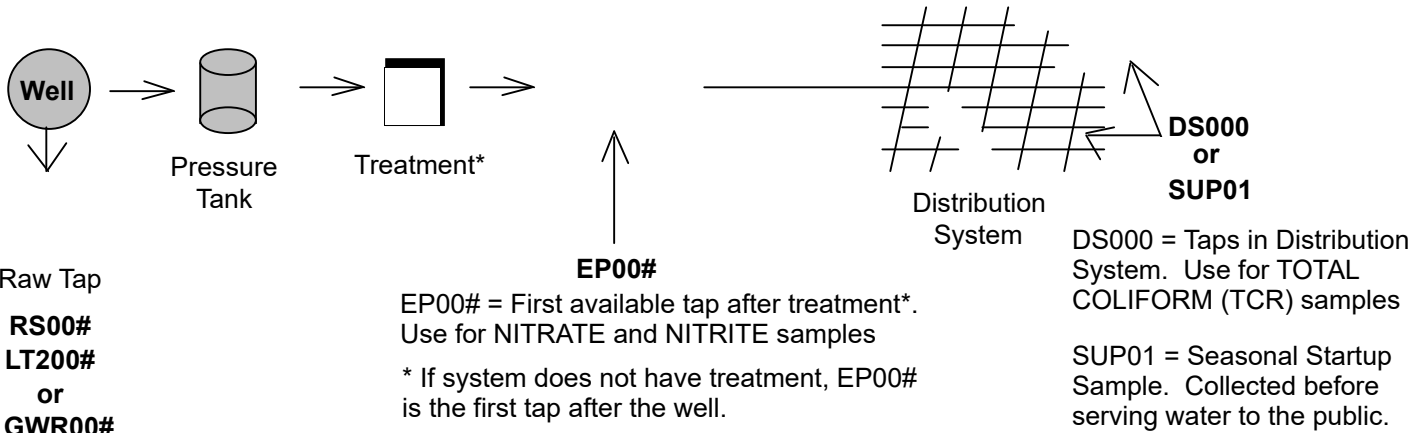

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6232012 COUNTRY KEG RESTAURANT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256941 Facility Name: COUNTRY KEG RESTAURANT

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

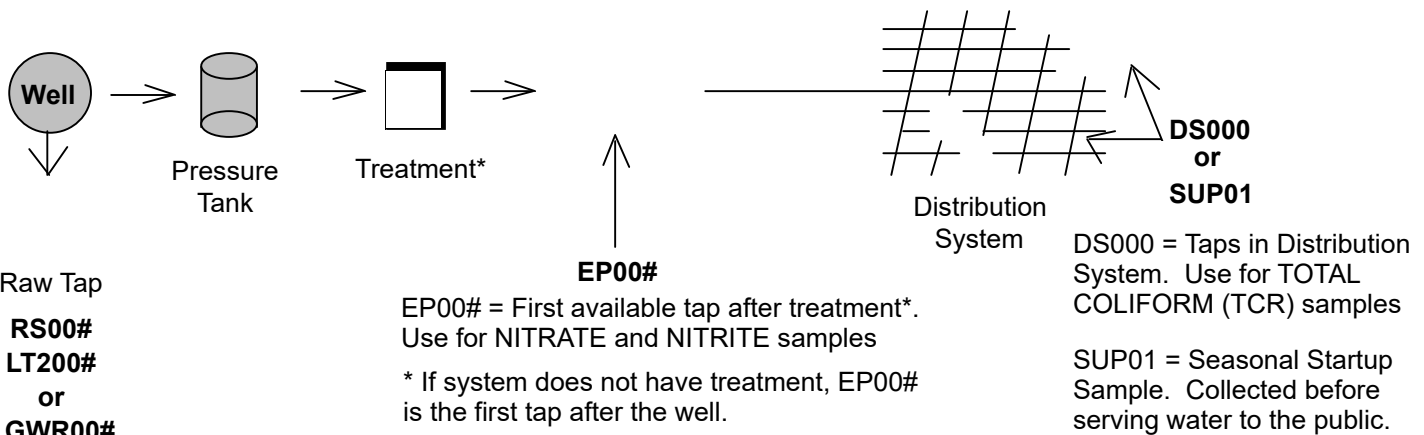

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6232612 HILLE/ROTHERT AMLC

System Type: Transient Noncommunity

Operating Period: 6/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **HILLE/ROTHERT AMLC DISTRIBUTION**
 Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

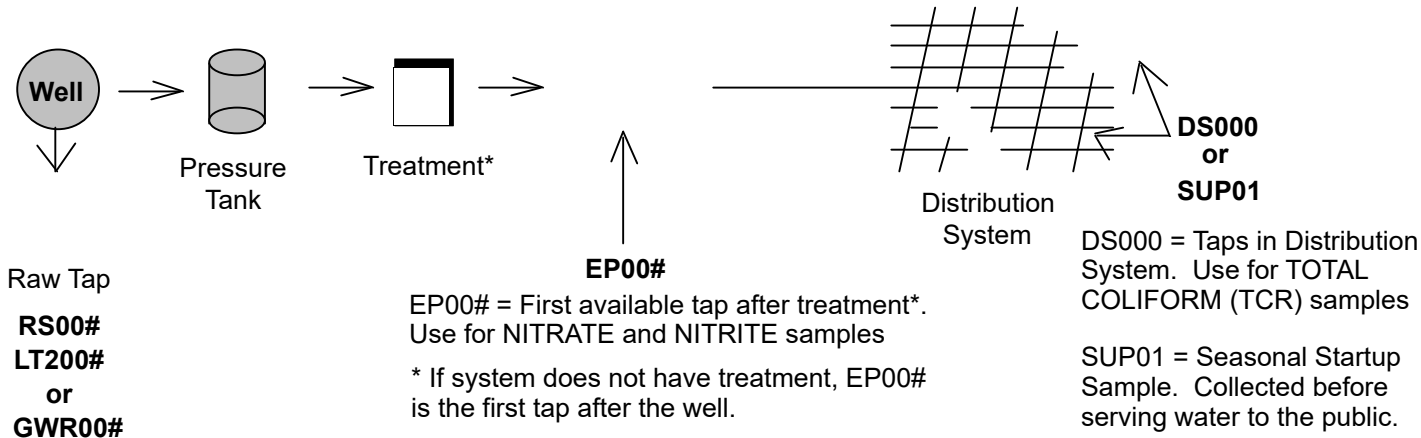

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6232612 HILLE/ROTHERT AMLC

System Type: Transient Noncommunity

Operating Period: 6/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HILLE/ROTHERT AMLC DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 6/15/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 7/31/2020
	1 Sample(s) Required between 8/1/2020 and 8/31/2020
	1 Sample(s) Required between 9/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 10/31/2020
	1 Sample(s) Required between 11/1/2020 and 11/30/2020

Where to Collect Samples For a Small Public Water System

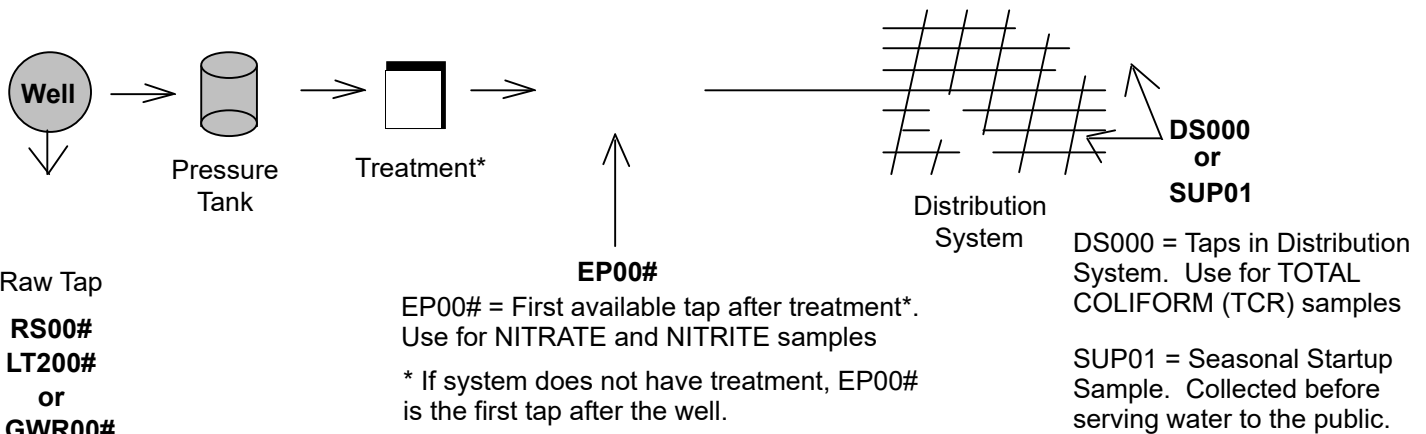

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6232612 HILLE/ROTHERT AMLC

System Type: Transient Noncommunity

Operating Period: 6/1 to 11/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE**Sampling** Facility ID: 6256944 Facility Name: HILLE/ROTHERT AMLC**Location** SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 4/1/2020 and 6/30/2020

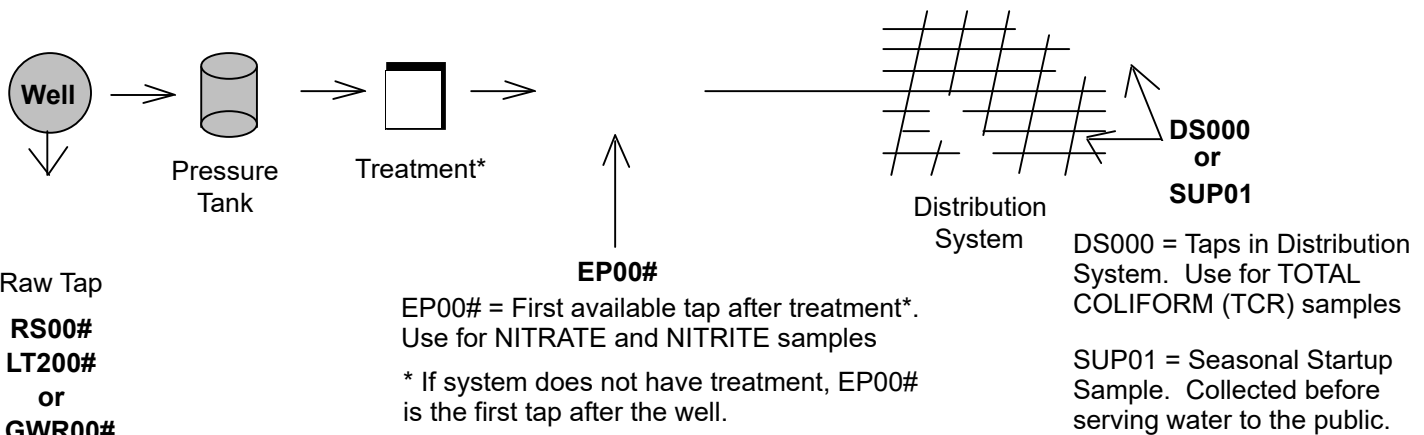Where to Collect Samples For a Small Public Water System

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6233212 TRI MOTOR SALES

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: TRI MOTOR SALES INC. DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

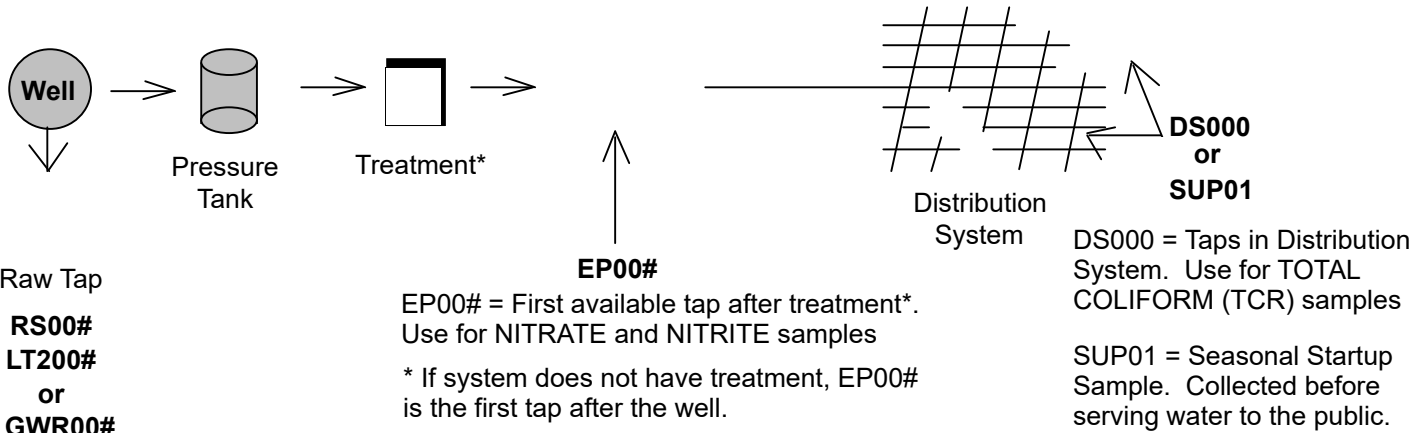

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6233212 TRI MOTOR SALES

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256948 Facility Name: TRI MOTOR SALES INC

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

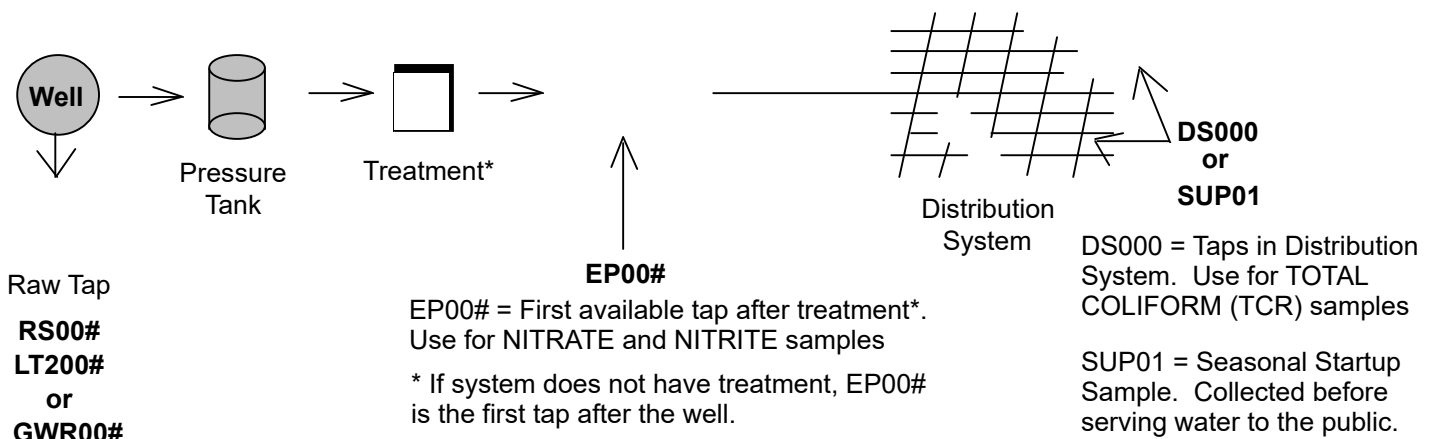

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6233512 GRACE LUTHERAN CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: GRACE LUTHERAN CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

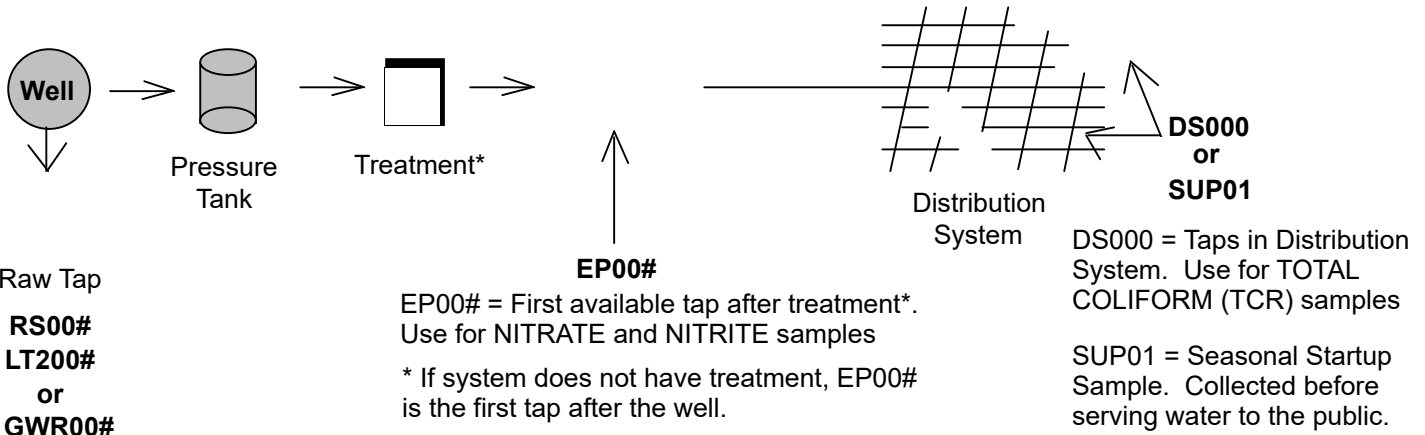

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6233512 GRACE LUTHERAN CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256949 Facility Name: GRACE LUTHERAN CHURCH

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

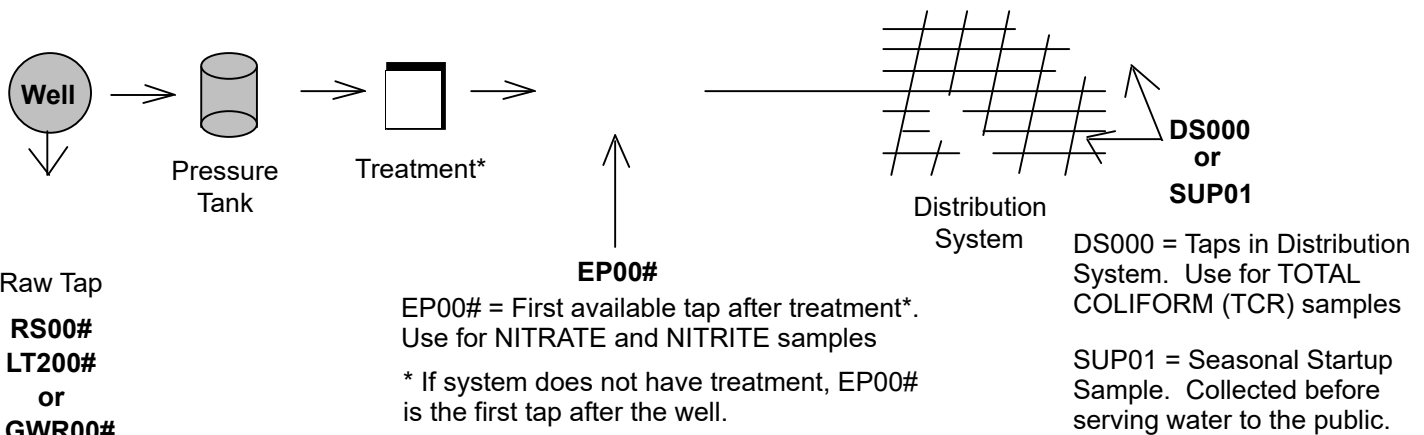

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6233812 NORTH POINT EDUCATION SERVICE CTR OTTAWA

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 6256952	Facility Name: NORTH POINT EDUCATION SERVICE CTR SCHOOL
Location	SMP ID: EP001	Facility Source: Ground Water Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2020 and 10/31/2020
<u>Sample for all the analytes listed below:</u>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required

Effective Date: 01/01/2020

OH6233812 NORTH POINT EDUCATION SERVICE CTR OTTAWA

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

*Ground Water Rule Substantial System***THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.**

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: NORTH POINT EDUCATION SERV DISTRIBUTIC
--------------------------	---	--

Chemicals**Monitoring Requirements**

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: NORTH POINT EDUCATION SERV DISTRIBUTIC ADDRESS NOT KNOWN
--------------------------	---	--

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between 7/1/2020 and 9/30/2020 at: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: LC###	Facility Name: NORTH POINT EDUCATION SERV DISTRIBUTIC Refer to your Lead and Copper plan for SMP IDs
--------------------------	---	---

Chemicals**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

Effective Date: 01/01/2020

OH6234412 LUCKEY HOMESTEAD FARMS AMLC PWS

System Type: Transient Noncommunity

Operating Period: 8/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **LUCKEY HOMESTEAD FARM AM DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

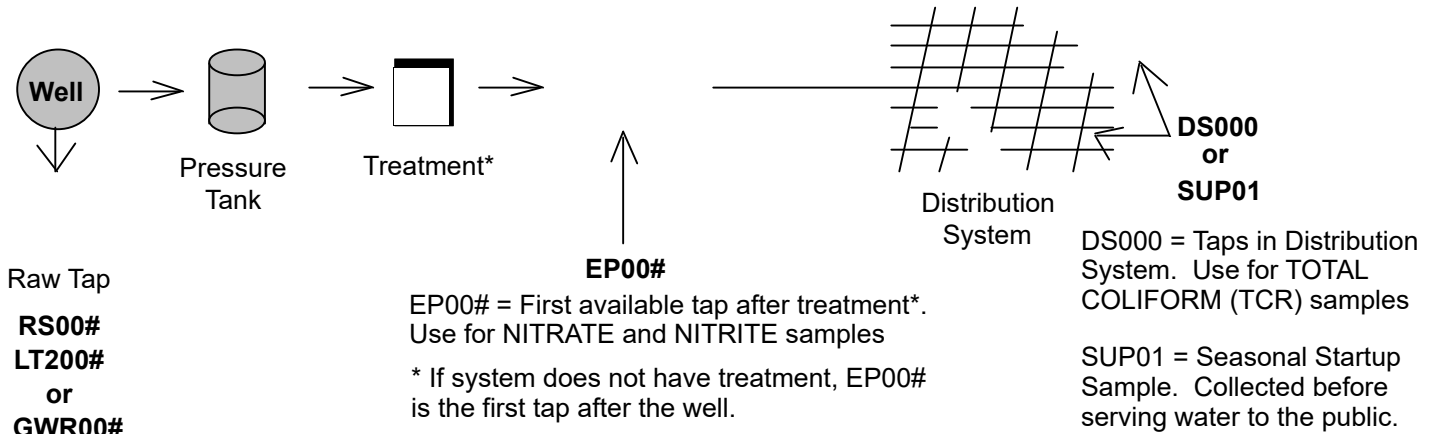

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6234412 LUCKEY HOMESTEAD FARMS AMLC PWS

System Type: Transient Noncommunity

Operating Period: 8/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LUCKEY HOMESTEAD FARM AM DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 8/1/2020 and 8/31/2020 1 Sample(s) Required between 9/1/2020 and 9/30/2020

Where to Collect Samples For a Small Public Water System

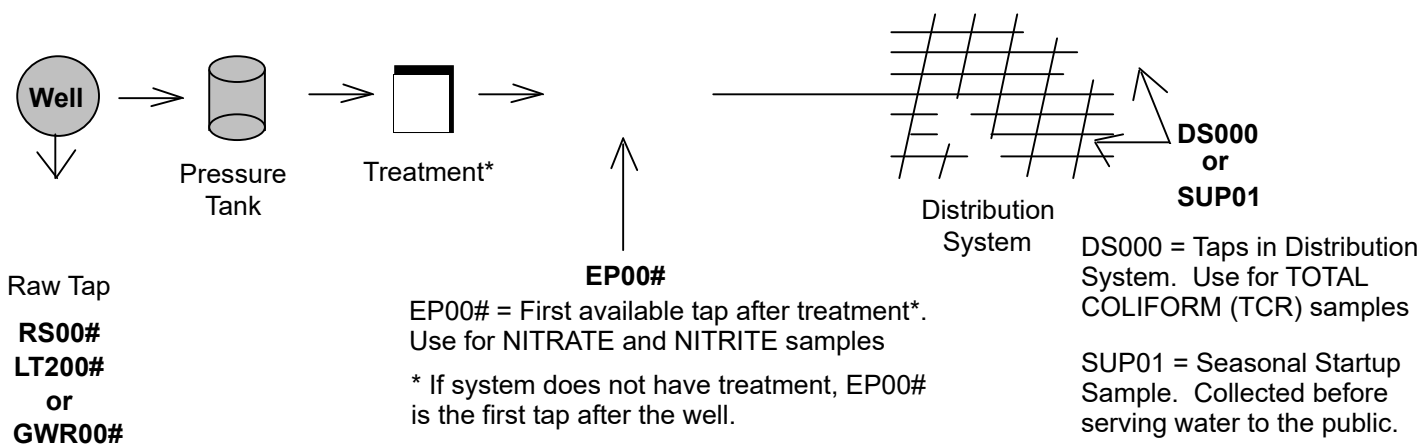

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6234412 LUCKEY HOMESTEAD FARMS AMLC PWS

System Type: Transient Noncommunity

Operating Period: 8/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256955 Facility Name: LUCKEY HOMESTEAD FARMS AMLC

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

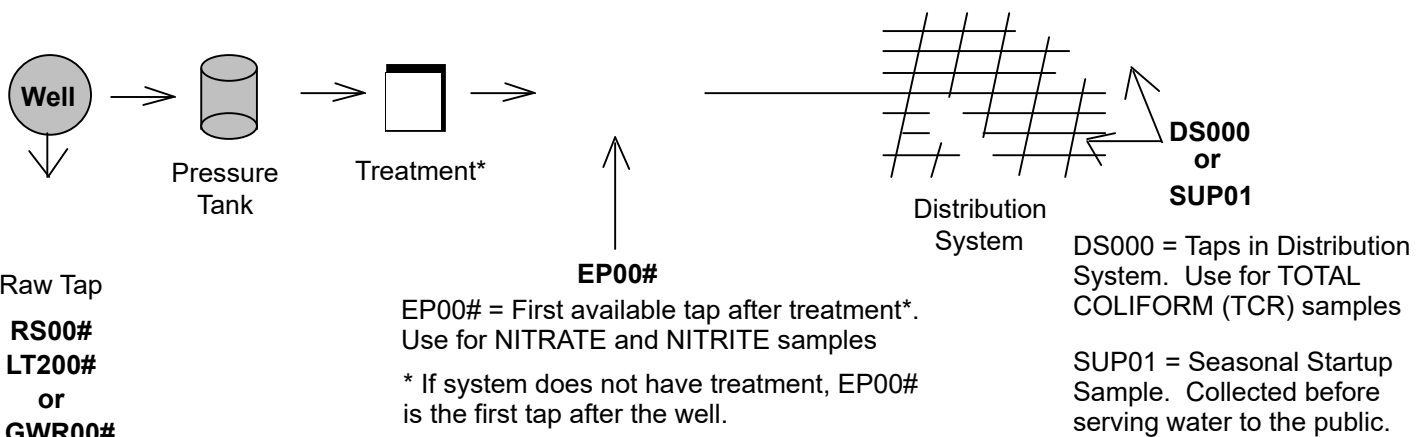

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6235212 KAISERS LIMESTONE TAVERN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **LIMESTONE TAVERN DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

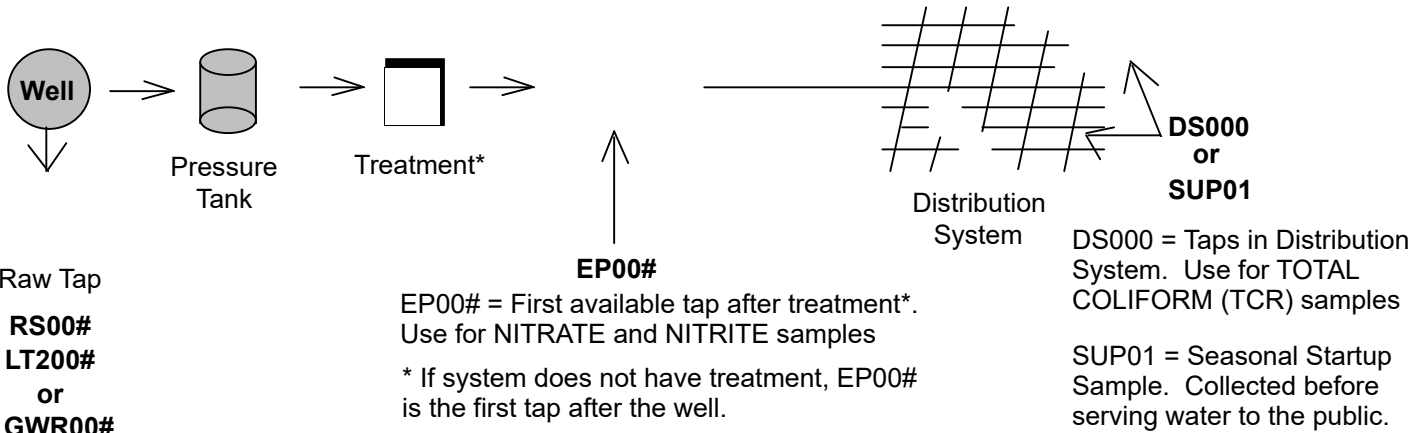

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6235212 KAISERS LIMESTONE TAVERN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256956 Facility Name: LIMESTONE TAVERN

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

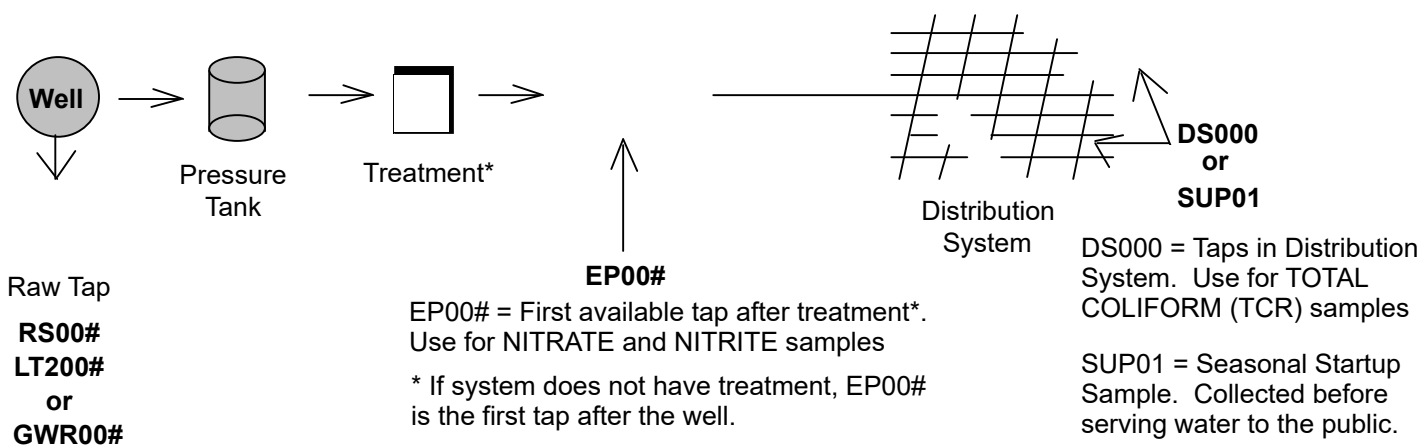

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6237012 ROTHERT AMLC

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **ROTHERT AMLC DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

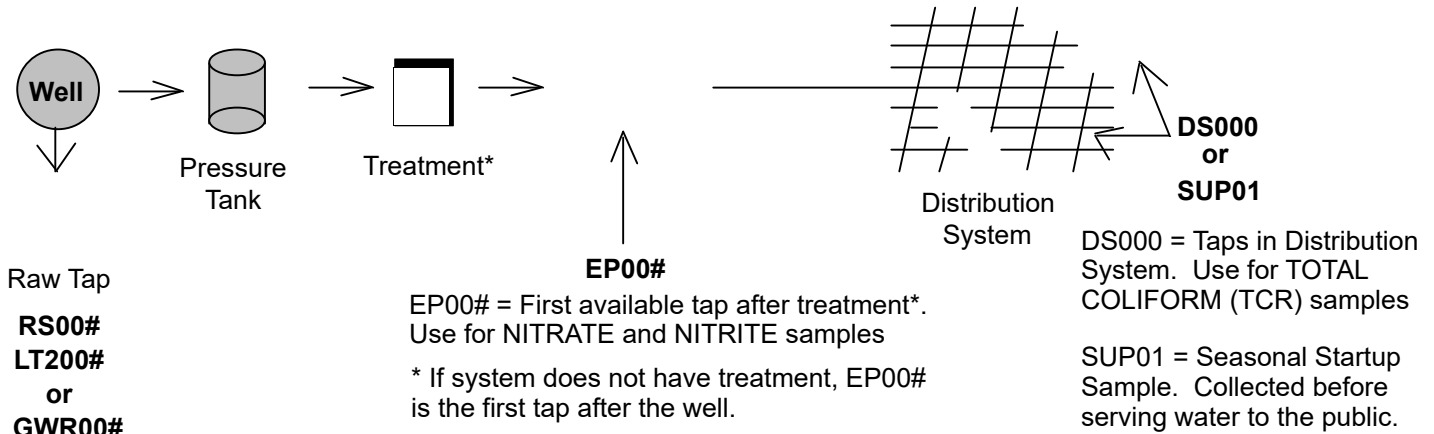

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6237012 ROTHERT AMLC

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: ROTHERT AMLC DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/7/2020 and 4/30/2020
	1 Sample(s) Required between 5/1/2020 and 5/31/2020
	1 Sample(s) Required between 6/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 7/31/2020
	1 Sample(s) Required between 8/1/2020 and 8/31/2020
	1 Sample(s) Required between 9/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

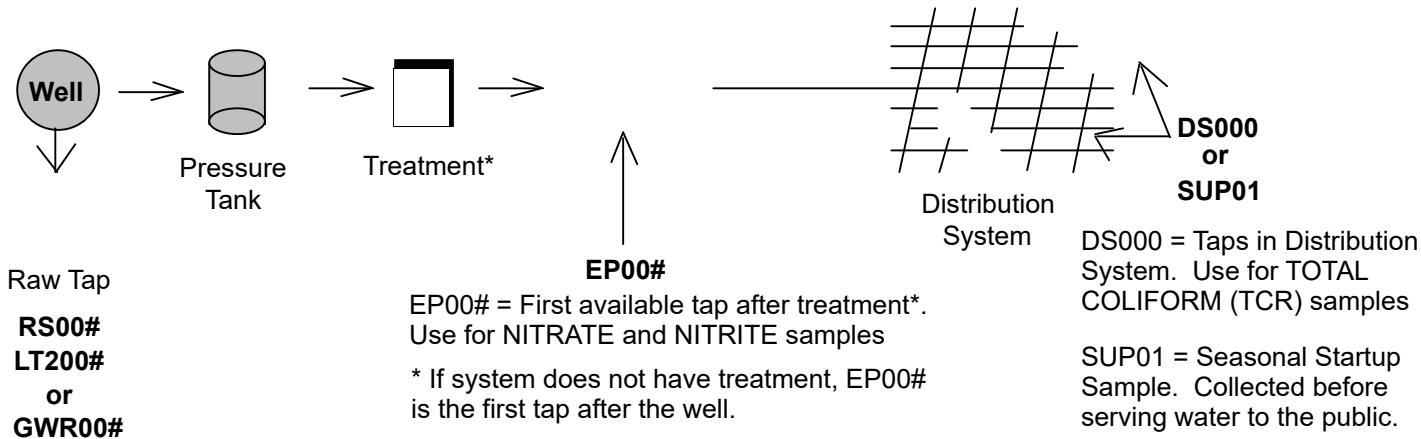

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6237012 ROTHERT AMLC

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **6256965** Facility Name: **ROTHERT AMLC**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 4/1/2020 and 6/30/2020

Where to Collect Samples For a Small Public Water System

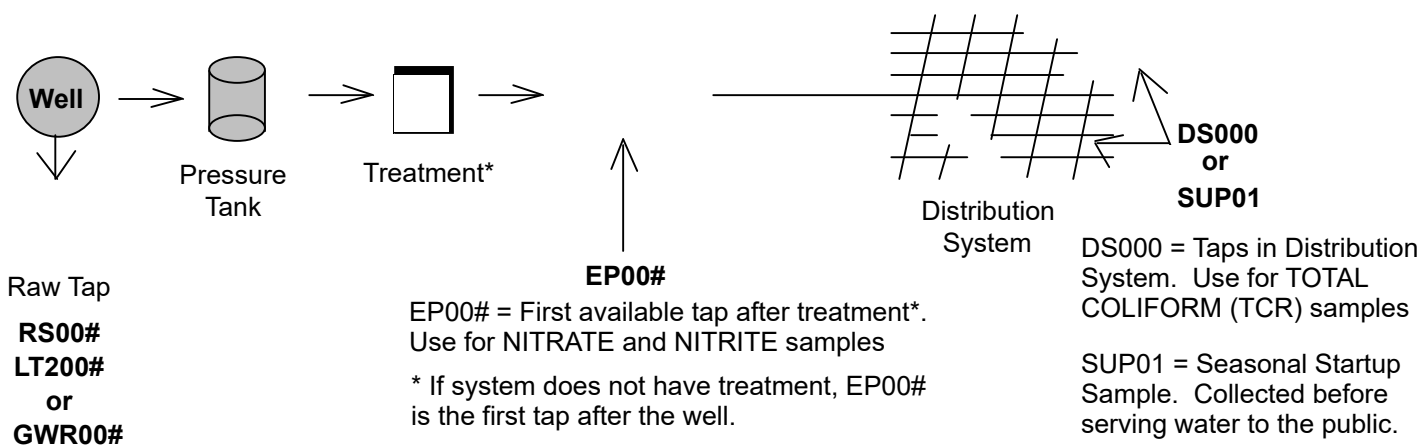

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6238012 ST JOHN LUTHERAN CHURCH ROCKY RIDGE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **ST JOHN LUTHERAN CHURCH DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

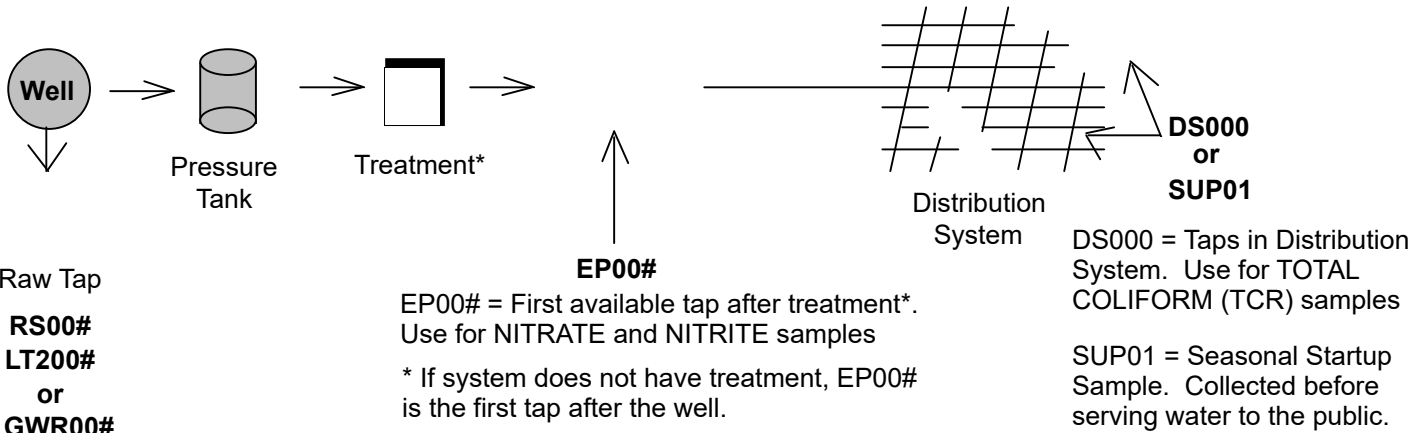

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6238012 ST JOHN LUTHERAN CHURCH ROCKY RIDGE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256970 Facility Name: SAINT JOHN LUTHERAN CHURCH

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

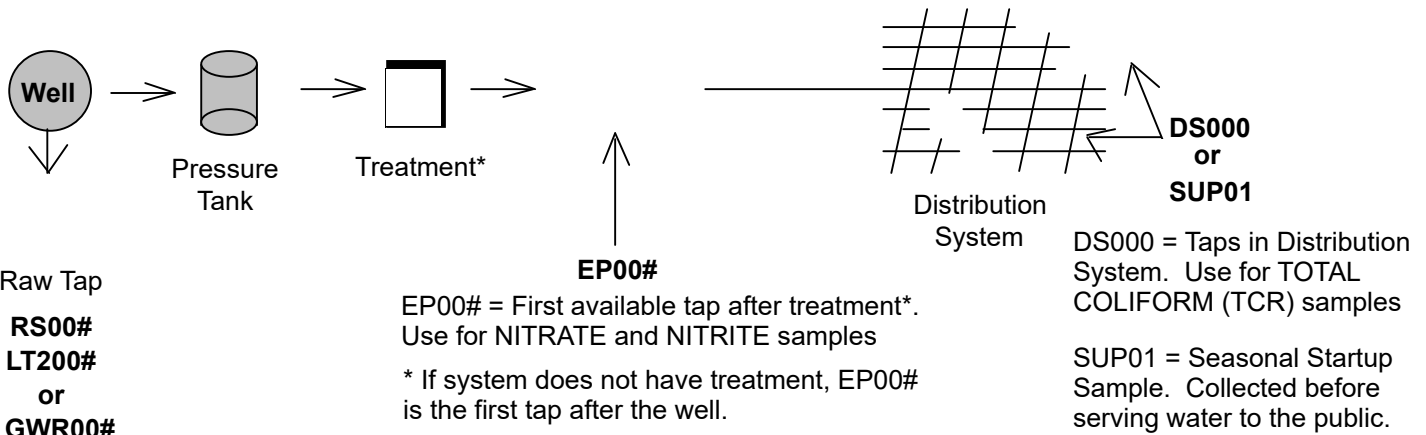

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6238112 ST PETERS LUTHERAN CHURCH/PRESCHOOL

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **ST PETERS LUTHERAN CHURCH & DAYCARE DIST**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

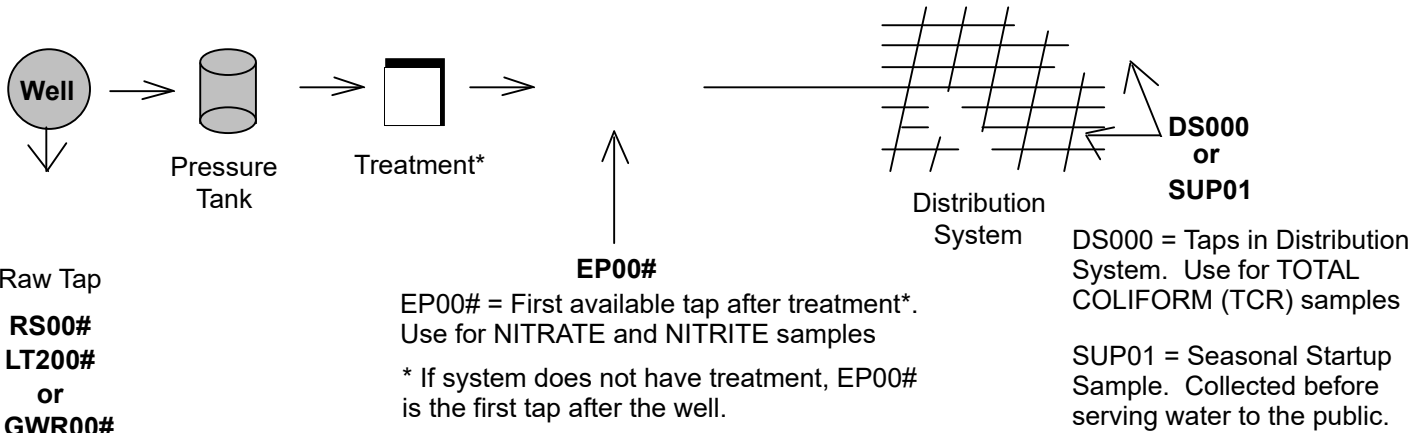

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6238112 ST PETERS LUTHERAN CHURCH/PRESCHOOL

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256971 Facility Name: ST PETERS LUTHERAN CHURCH & DAYCARE

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

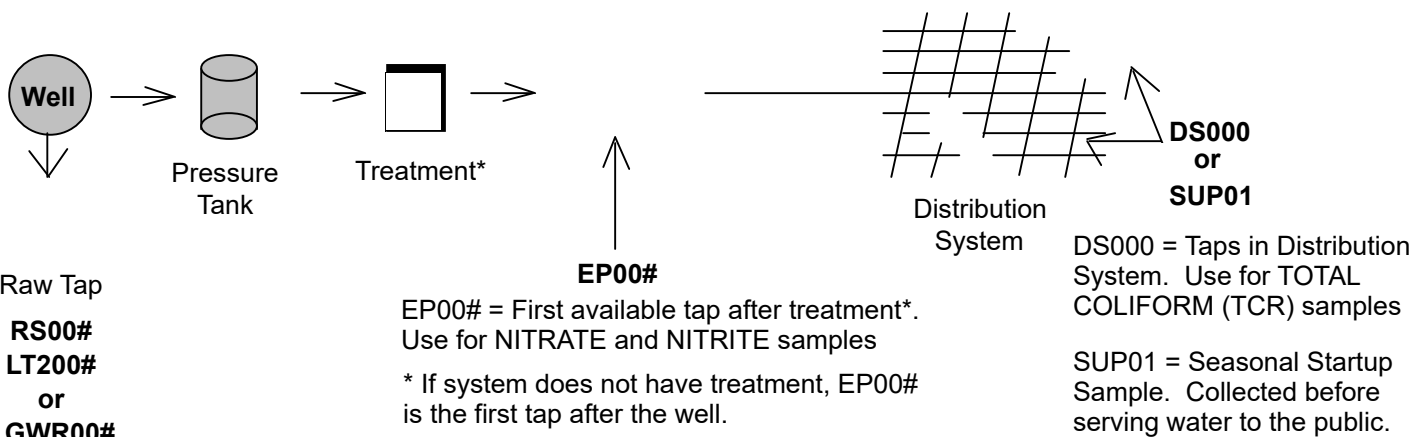

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6238412 CRAZY LADY SALOON

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **CRAZY LADY SALOON DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

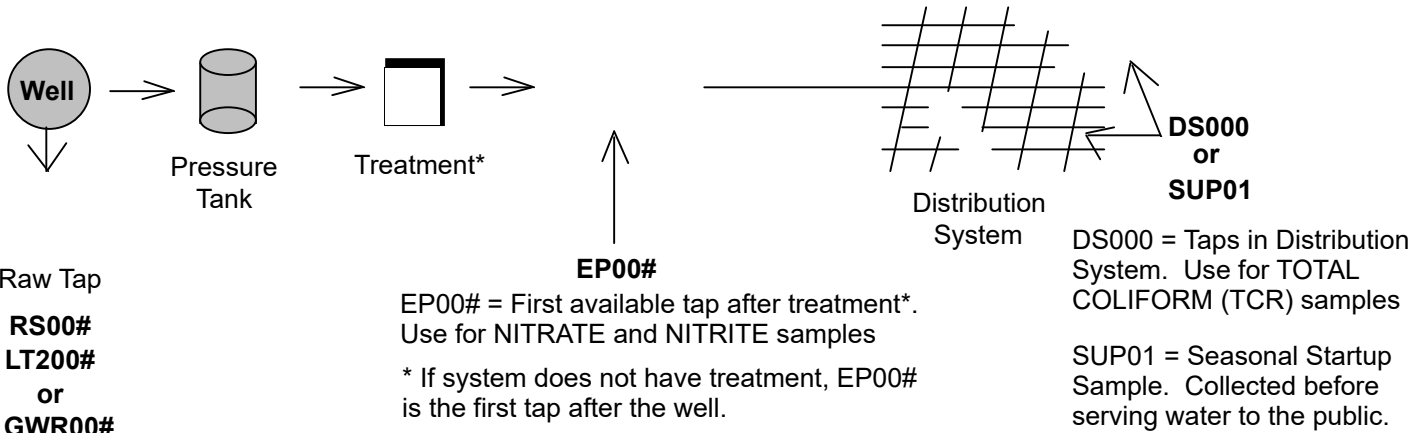

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6238412 CRAZY LADY SALOON

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256972 Facility Name: CRAZY LADY SALOON

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

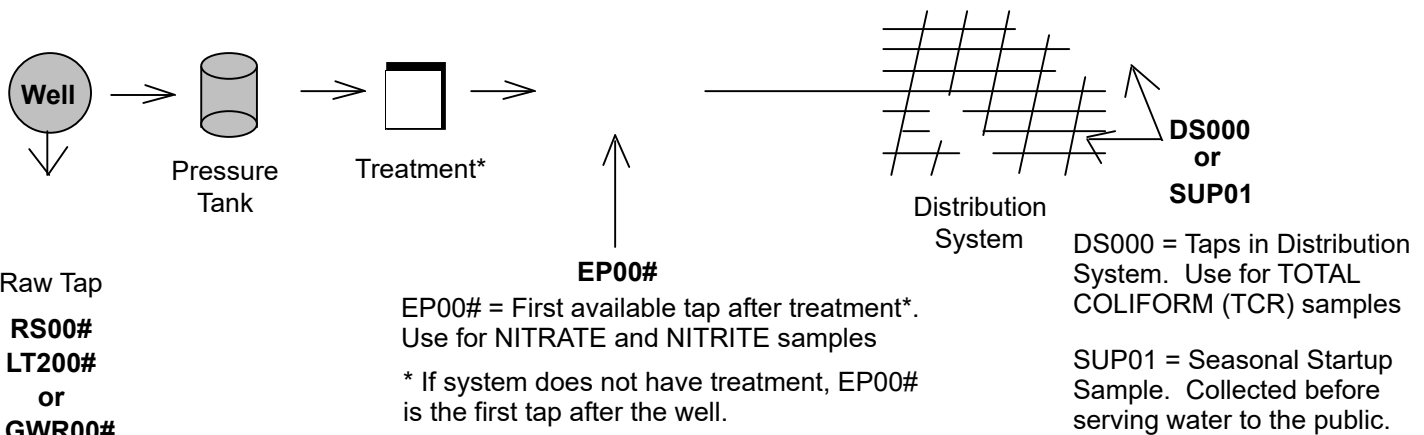

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6238812 BENCH-SCHULTE FARMS AMLC PWS

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **BENCH-SCHULTE FARMS AMLC DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

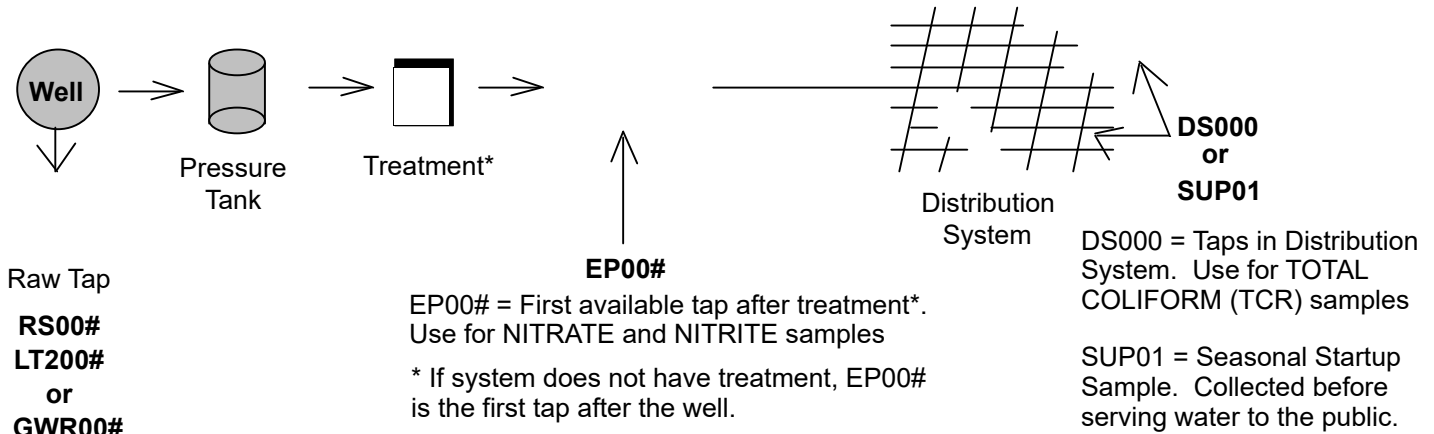

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6238812 BENCH-SCHULTE FARMS AMLC PWS

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BENCH-SCHULTE FARMS AMLC DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 6/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 7/31/2020
	1 Sample(s) Required between 8/1/2020 and 8/31/2020
	1 Sample(s) Required between 9/1/2020 and 9/30/2020

Where to Collect Samples For a Small Public Water System

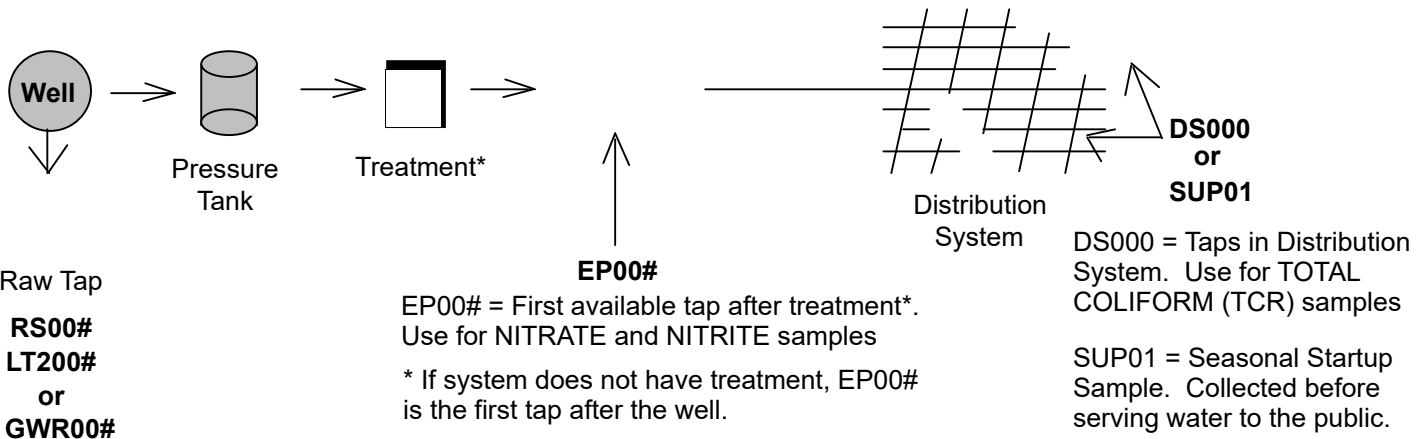

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6238812 BENCH-SCHULTE FARMS AMLC PWS

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256973 Facility Name: SCHULTE AMLC

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

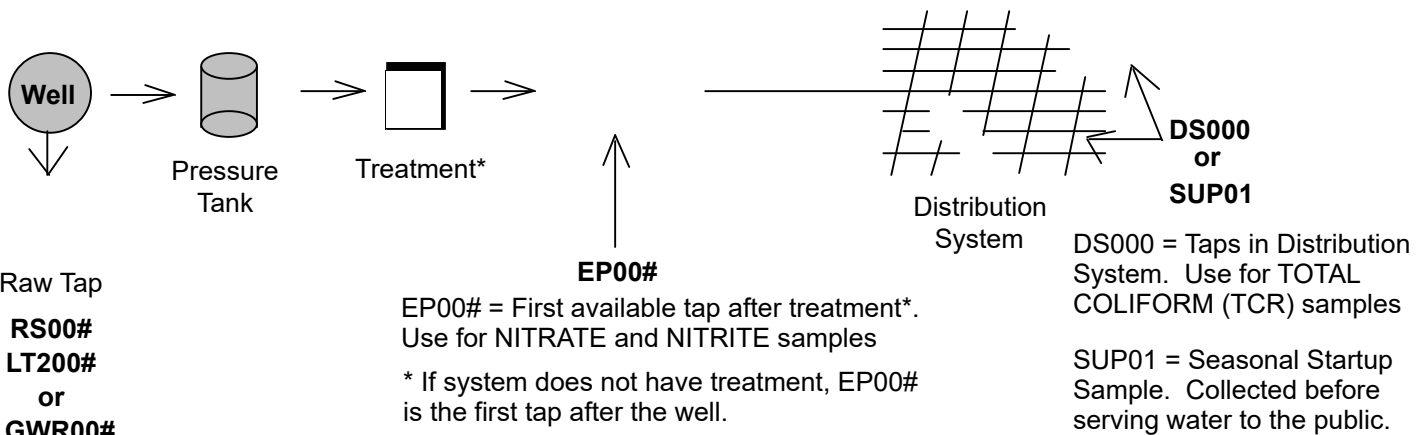

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6240712 CEDARLANE RV PARK

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **CEDARLANE RV PARK DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

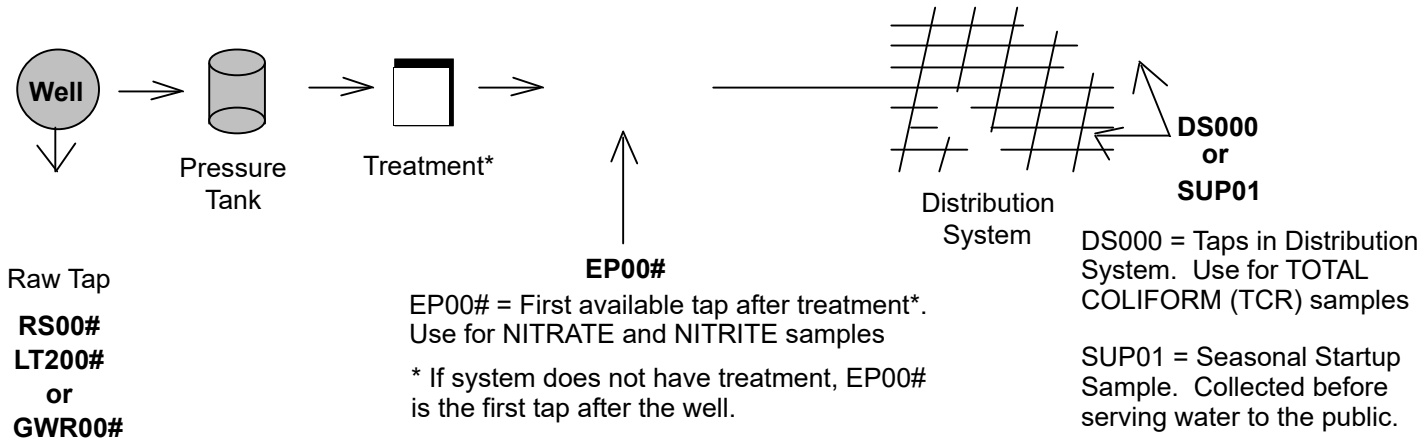

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6240712 CEDARLANE RV PARK

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: CEDARLANE RV PARK DISTRIBUTION
Location SMP ID: DS000 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2020 and 5/31/2020
	1 Sample(s) Required between 6/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 7/31/2020
	1 Sample(s) Required between 8/1/2020 and 8/31/2020
	1 Sample(s) Required between 9/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 10/15/2020

Where to Collect Samples For a Small Public Water System

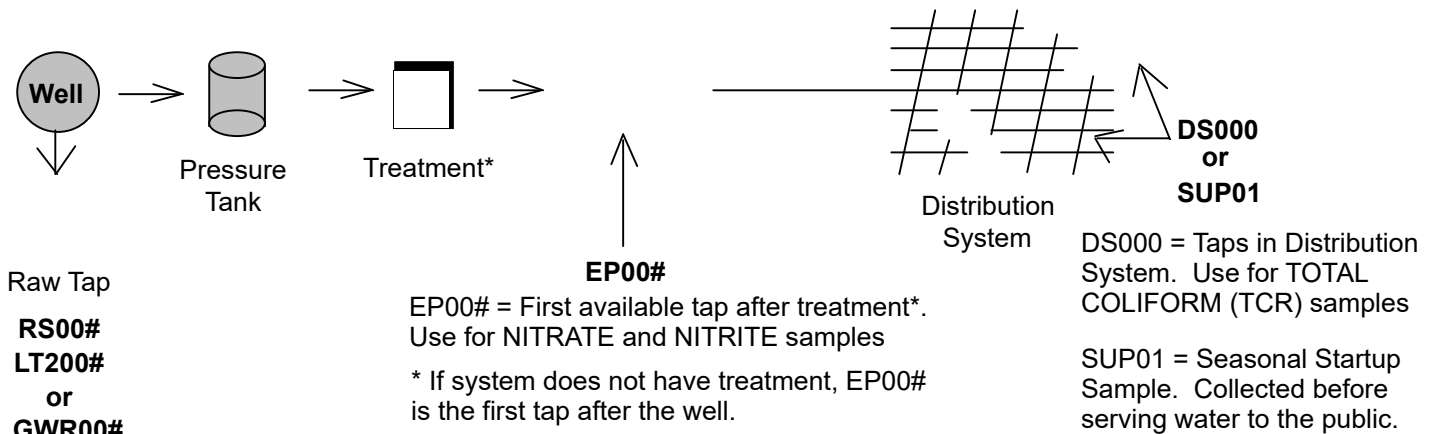

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6240712 CEDARLANE RV PARK

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256980	Facility Name: CEDARLANE CAMPGROUND
Location SMP ID: EP001	Facility Source: Ground Water
	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

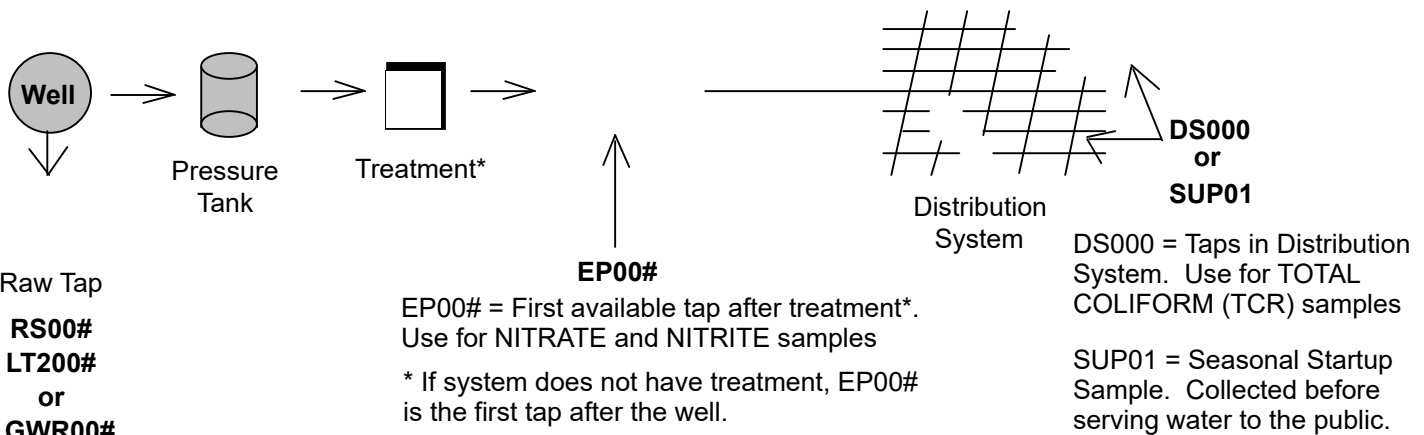

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6241012 CHIPPEWA GOLF CLUB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: CHIPPEWA GOLF CLUB DISTRIBUTION
Location SMP ID: SUP01 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

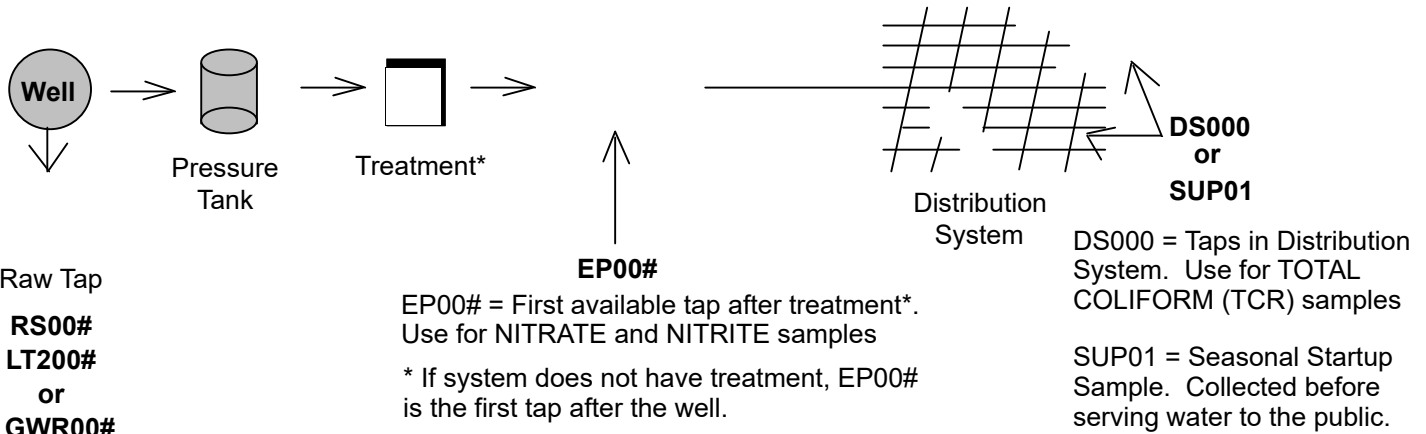

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 06/19/2020

OH6241012 CHIPPEWA GOLF CLUB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CHIPPEWA GOLF CLUB DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

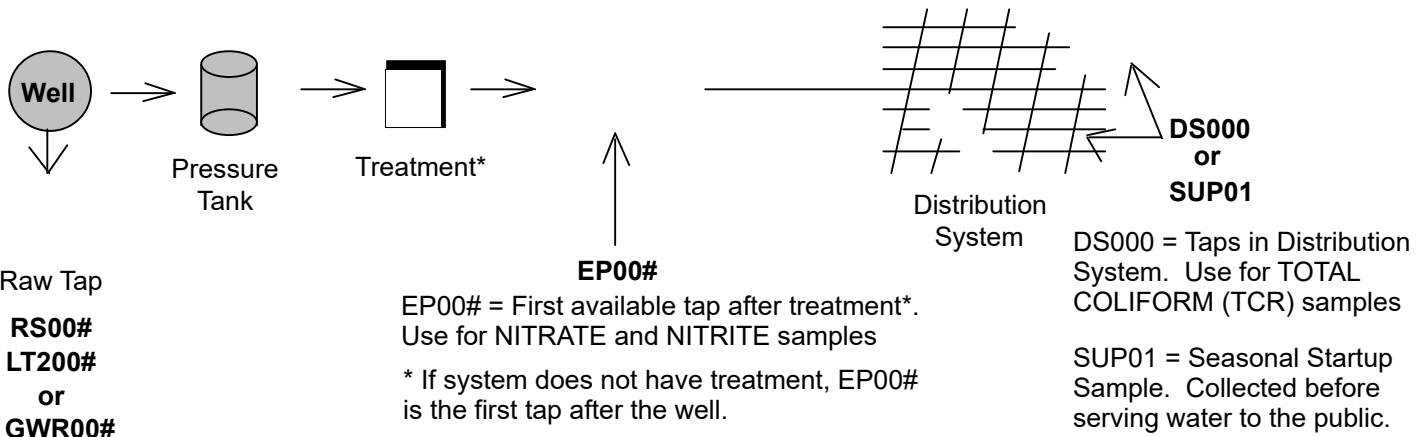

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6241012 CHIPPEWA GOLF CLUB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256981 Facility Name: CHIPPEWA GOLF CLUB

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

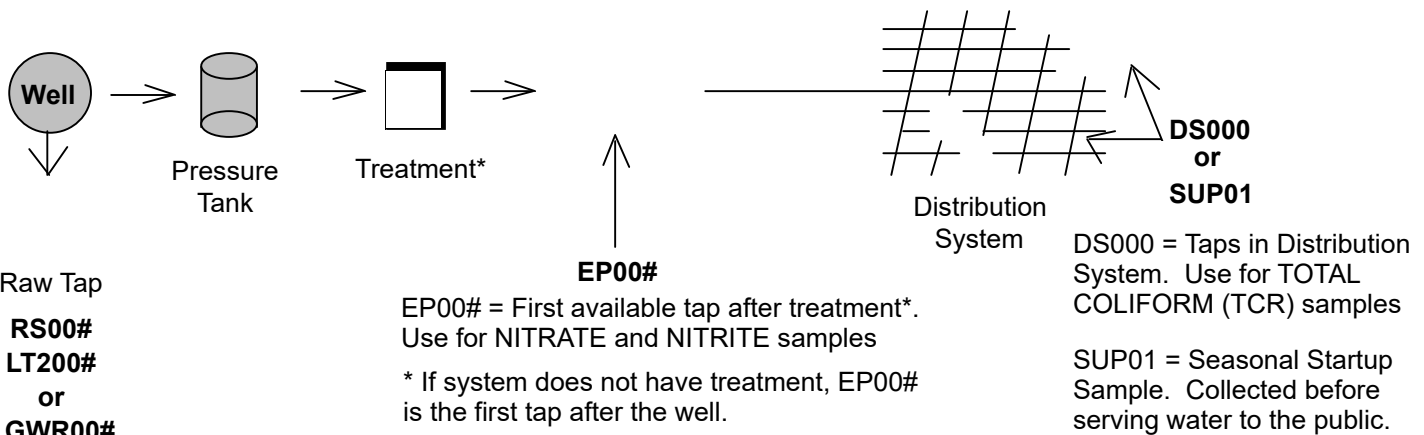

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6242112 HIDDEN HIDEAWAY CAMPGROUND REAR WELL

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **HANKS PLACE-WEST-WELL DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

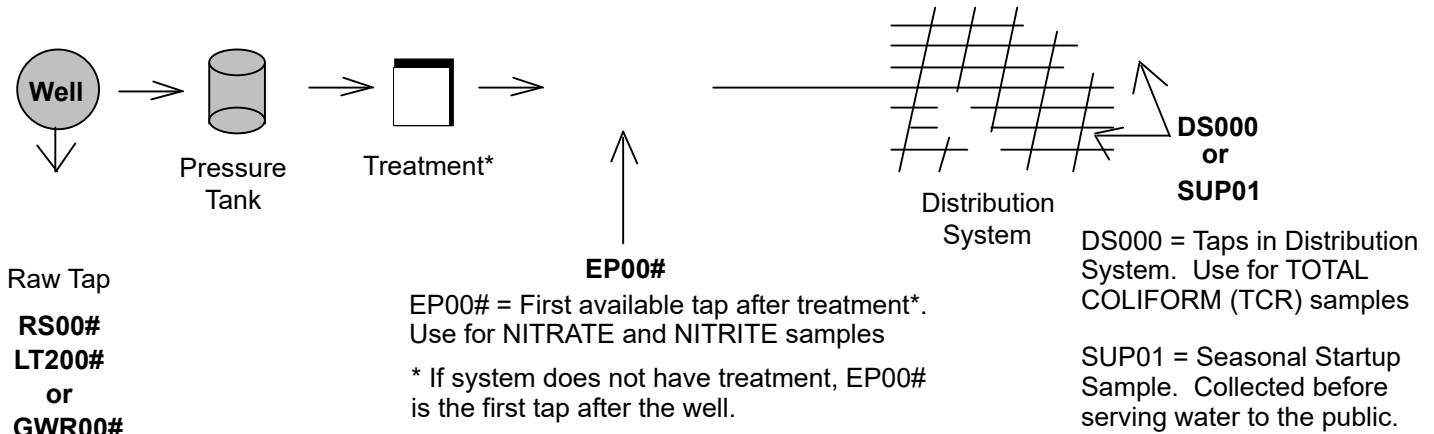

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6242112 HIDDEN HIDEAWAY CAMPGROUND REAR WELL

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HANKS PLACE-WEST-WELL DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2020 and 5/31/2020
	1 Sample(s) Required between 6/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 7/31/2020
	1 Sample(s) Required between 8/1/2020 and 8/31/2020
	1 Sample(s) Required between 9/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 10/15/2020

Where to Collect Samples For a Small Public Water System

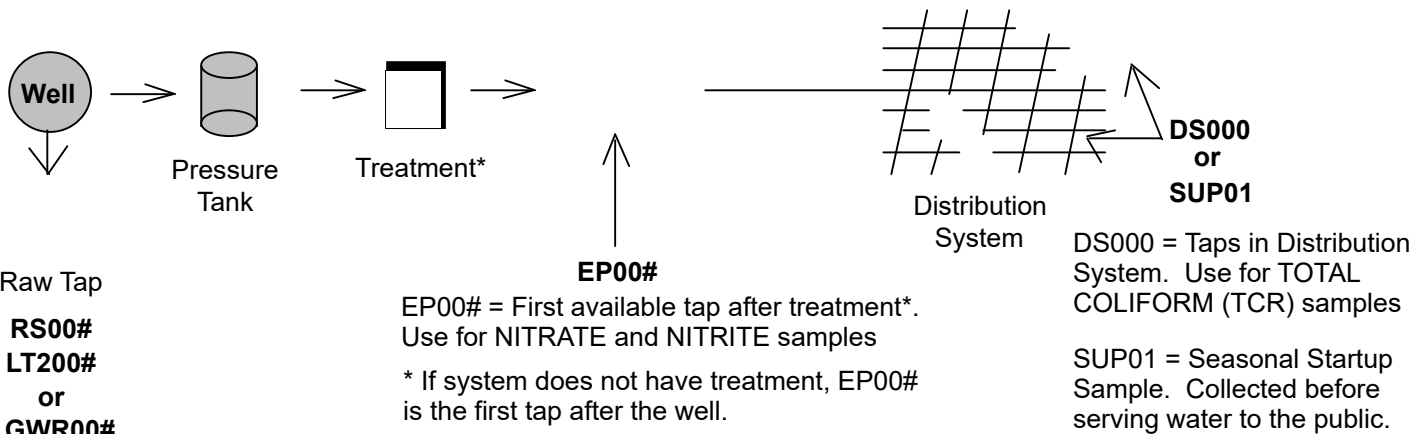

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6242112 HIDDEN HIDEAWAY CAMPGROUND REAR WELL

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256990 Facility Name: HANKS PLACE WEST WELL

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

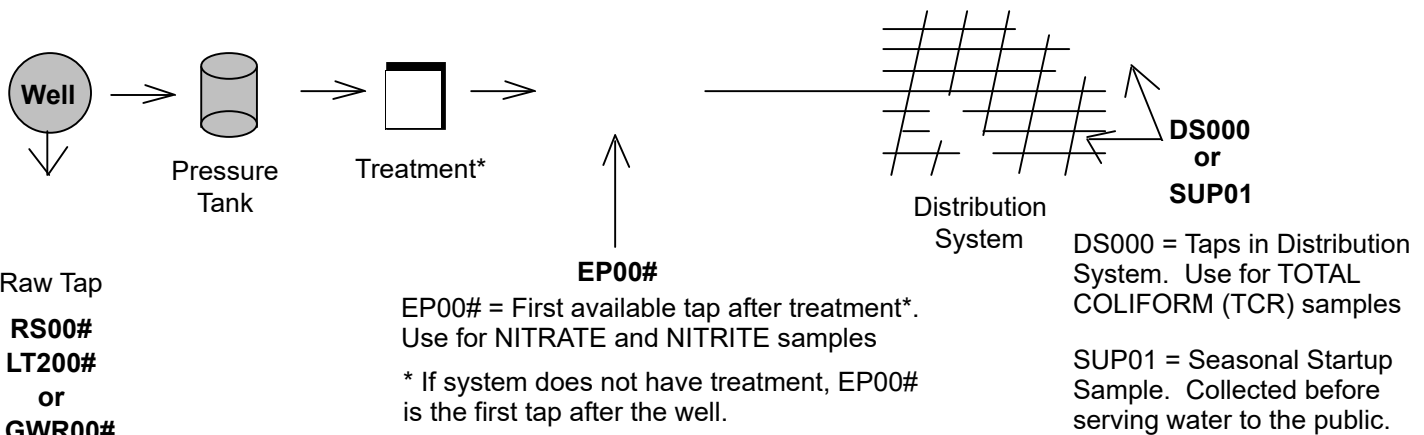

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6242212 HIDDEN HIDEAWAY CAMPGROUND FRONT WELL

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **HANKS PLACE-EAST WELL DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

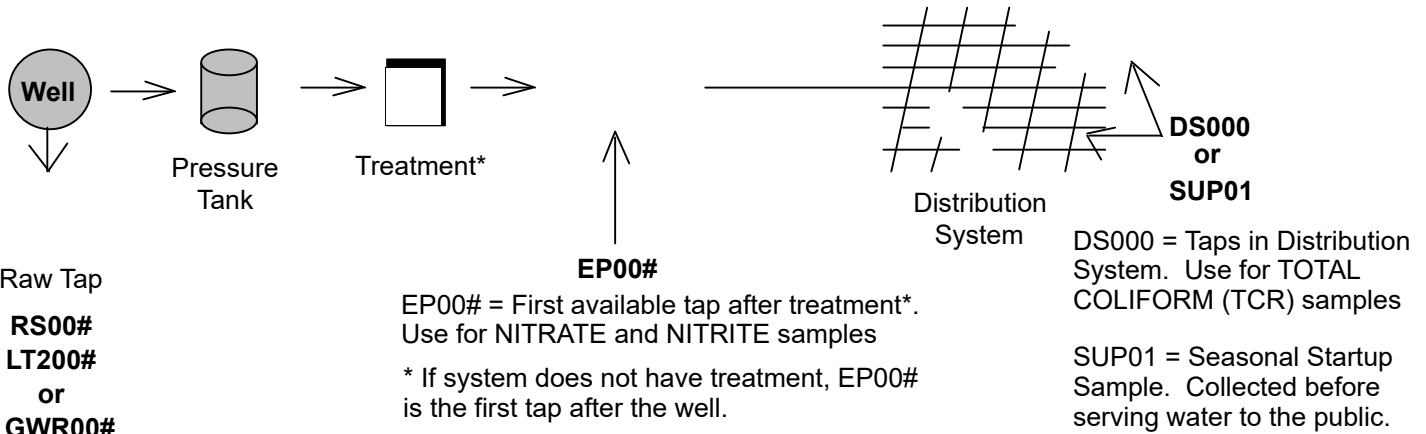

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6242212 HIDDEN HIDEAWAY CAMPGROUND FRONT WELL

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HANKS PLACE-EAST WELL DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2020 and 5/31/2020
	1 Sample(s) Required between 6/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 7/31/2020
	1 Sample(s) Required between 8/1/2020 and 8/31/2020
	1 Sample(s) Required between 9/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 10/15/2020

Where to Collect Samples For a Small Public Water System

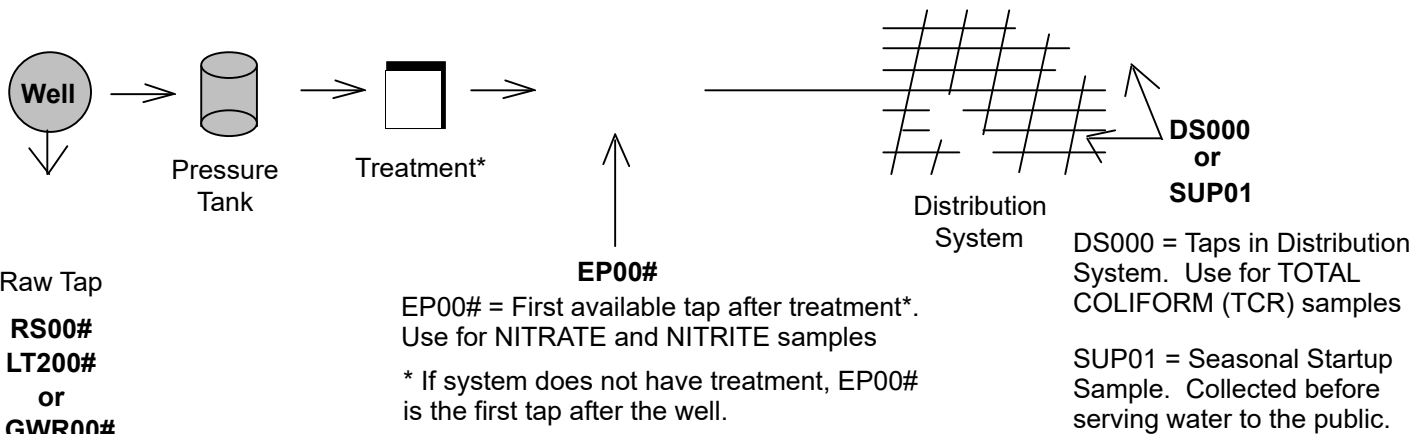

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6242212 HIDDEN HIDEAWAY CAMPGROUND FRONT WELL

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6256991 Facility Name: HANKS PLACE EAST WELL

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

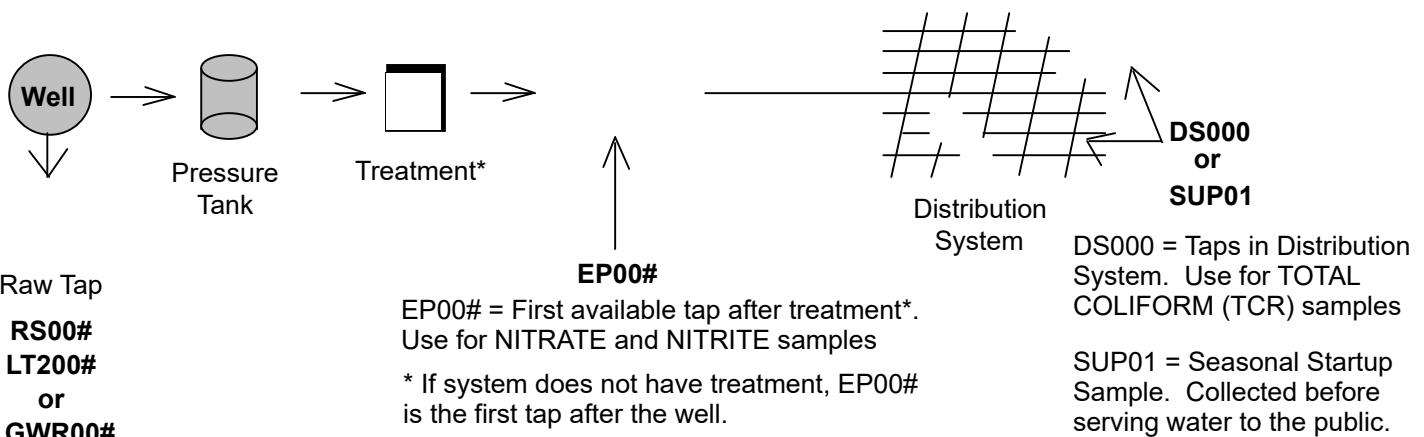

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6245212 SHADE ACRES CAMPGROUND AND RV PARK

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **SHADE ACRES CAMPGROUND & DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

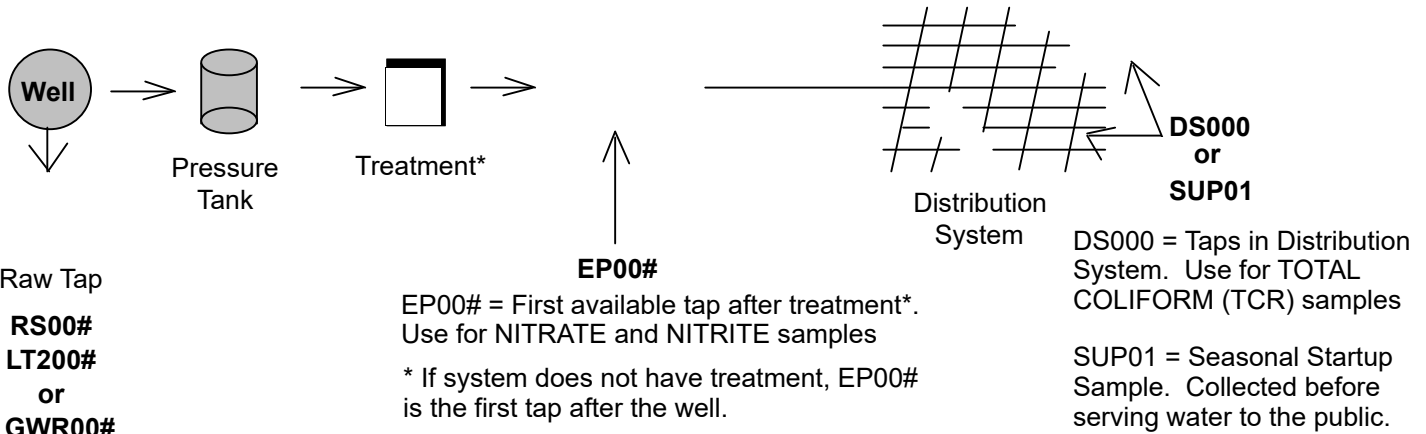

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6245212 SHADE ACRES CAMPGROUND AND RV PARK

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: SHADE ACRES CAMPGROUND & DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/8/2020 and 5/31/2020
	1 Sample(s) Required between 6/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 7/31/2020
	1 Sample(s) Required between 8/1/2020 and 8/31/2020
	1 Sample(s) Required between 9/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 10/15/2020

Where to Collect Samples For a Small Public Water System

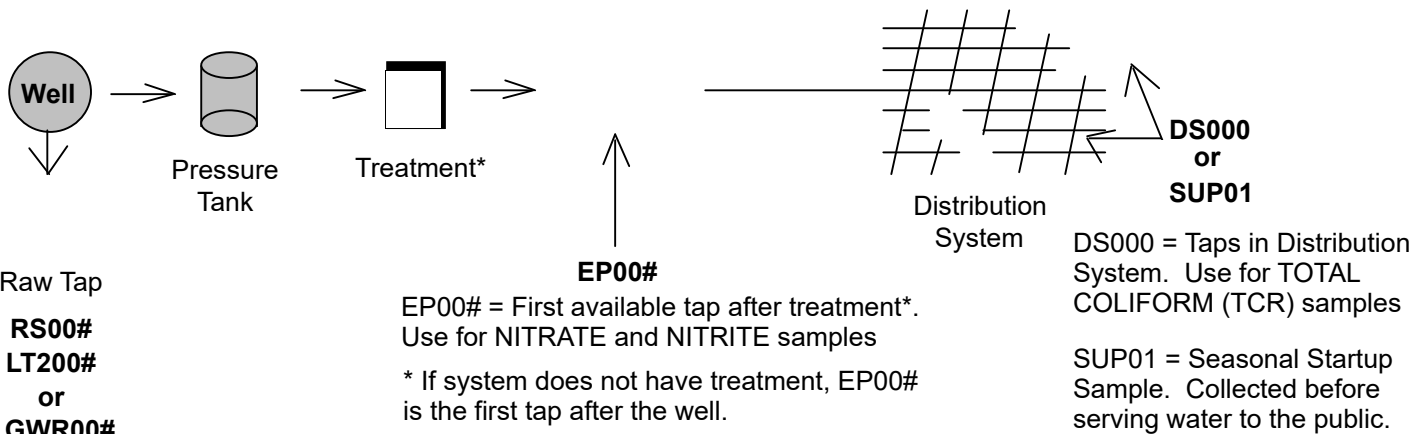

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6245212 SHADE ACRES CAMPGROUND AND RV PARK

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6257010 Facility Name: SHADE ACRES CAMPGROUND & RV PK

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

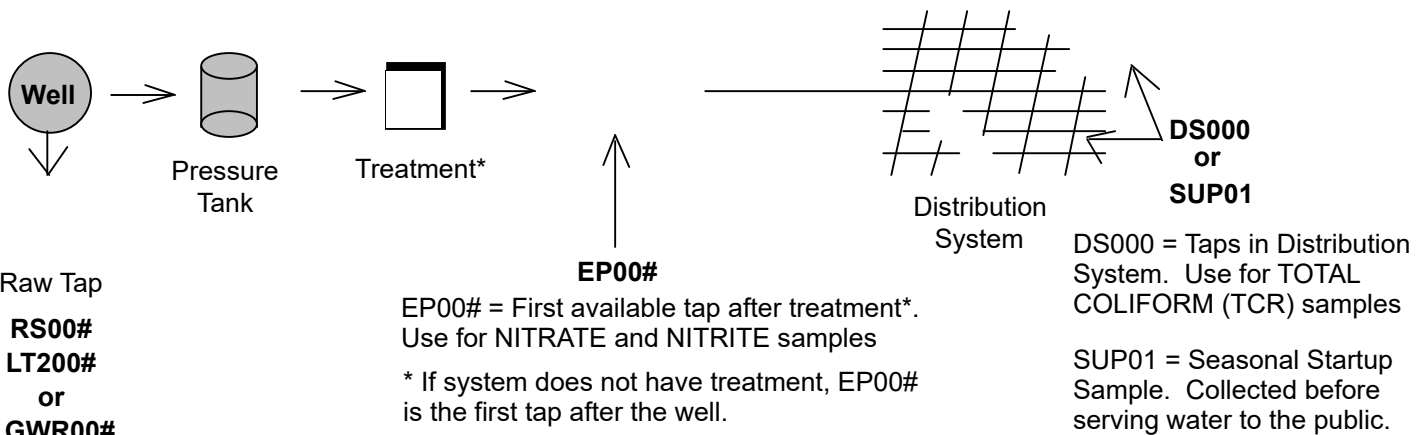

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6246212 SUGAR CREEK GOLF CLUB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: SUGAR CREEK GOLF CLUB DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

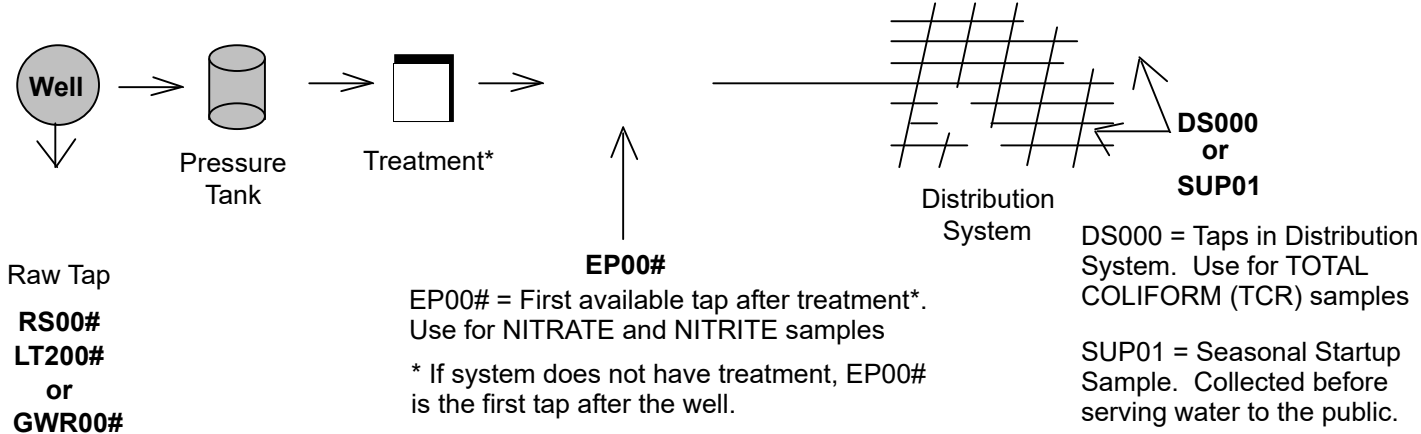

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6246212 SUGAR CREEK GOLF CLUB

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6257015 Facility Name: SUGAR CREEK GOLF CLUB

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

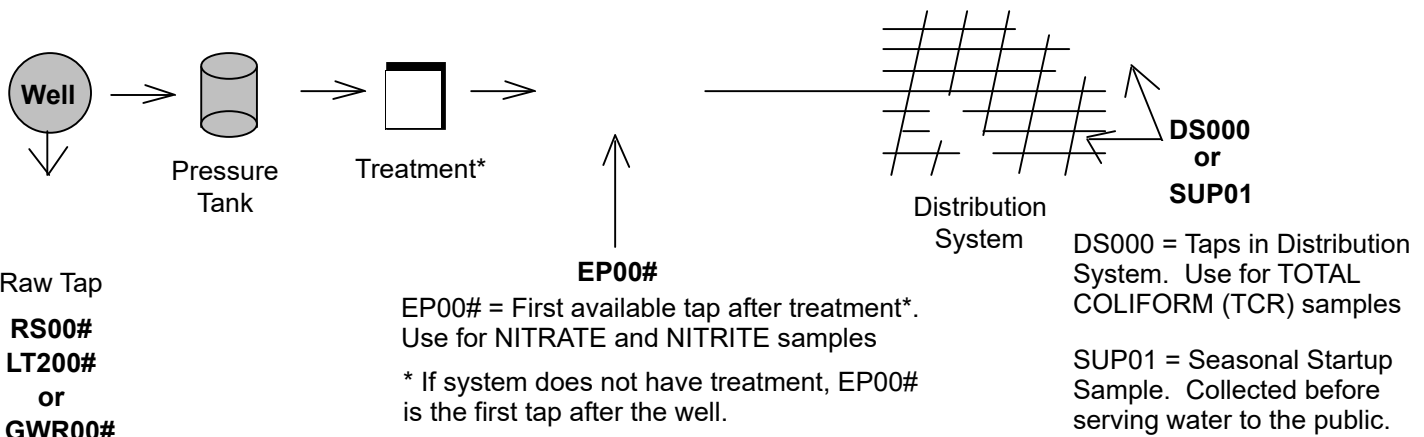

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH6254112 GRAYMONT DOLIME (OH)

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 6257057 SMP ID: EP001	Facility Name: GRAYMONT DOLIME OH INC Facility Source: Ground Water	Facility Class: CLASS A
--------------------------	---	--	--------------------------------

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 6/1/2020 and 10/31/2020
<u>Sample for all the analytes listed below:</u>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required

Effective Date: 01/01/2020

OH6254112 GRAYMONT DOLIME (OH)

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: GRAYMONT DOLIME (OH) INC DISTRIBUTION
	SMP ID: DS000	

Chemicals**Monitoring Requirements**

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2020	and	3/31/2020
	1 Sample(s) Required between	4/1/2020	and	6/30/2020
	1 Sample(s) Required between	7/1/2020	and	9/30/2020
	1 Sample(s) Required between	10/1/2020	and	12/31/2020

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2020	and	3/31/2020
	1 Sample(s) Required between	4/1/2020	and	6/30/2020
	1 Sample(s) Required between	7/1/2020	and	9/30/2020
	1 Sample(s) Required between	10/1/2020	and	12/31/2020

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: GRAYMONT DOLIME (OH) INC DISTRIBUTION
	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS	Dual Sample Required between	7/1/2020	and	9/30/2020	at: DS201
-------------------------	------------------------------	----------	-----	-----------	-----------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1	Facility Name: GRAYMONT DOLIME (OH) INC DISTRIBUTION
	SMP ID: LC###	Refer to your Lead and Copper plan for SMP IDs

Chemicals**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between	6/1/2020	and	9/30/2020
-------------------------------	------------------------------	----------	-----	-----------

Lead consumer notice must be completed no later than two business days after receipt of the sample results. The verification form for consumer notice must be submitted to Ohio EPA no later than five business days after receipt of the sample results. Lead and copper sample monitoring point (SMP) IDs (LC###) must be current and reflect properly tiered sites according to OAC Rule 3745-81-86. Submit lead and copper SMP ID revisions to your Ohio EPA District Office. Forms and templates are available online at <http://epa.ohio.gov/ddagw/pws/leadandcopper.aspx>. For questions contact your Ohio EPA District Office representative.

Effective Date: 01/01/2020

OH6254712 BENCHMORE FARMS AMLC 1

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **BENCHMORE FARMS AMLC 1 DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

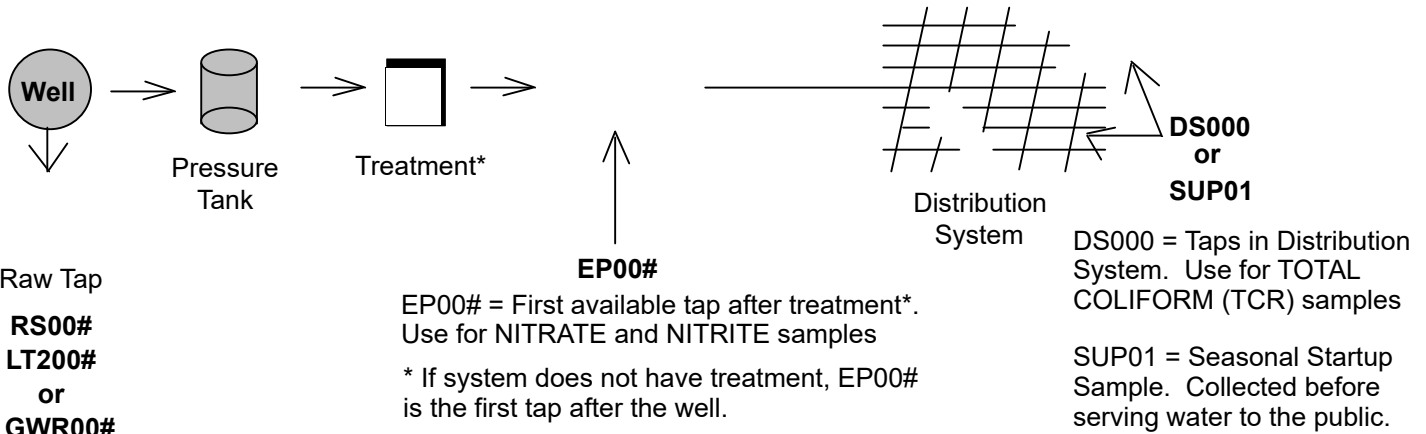

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6254712 BENCHMORE FARMS AMLC 1

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BENCHMORE FARMS AMLC 1 DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 8/21/2020 and 8/31/2020 1 Sample(s) Required between 9/1/2020 and 9/30/2020

Where to Collect Samples For a Small Public Water System

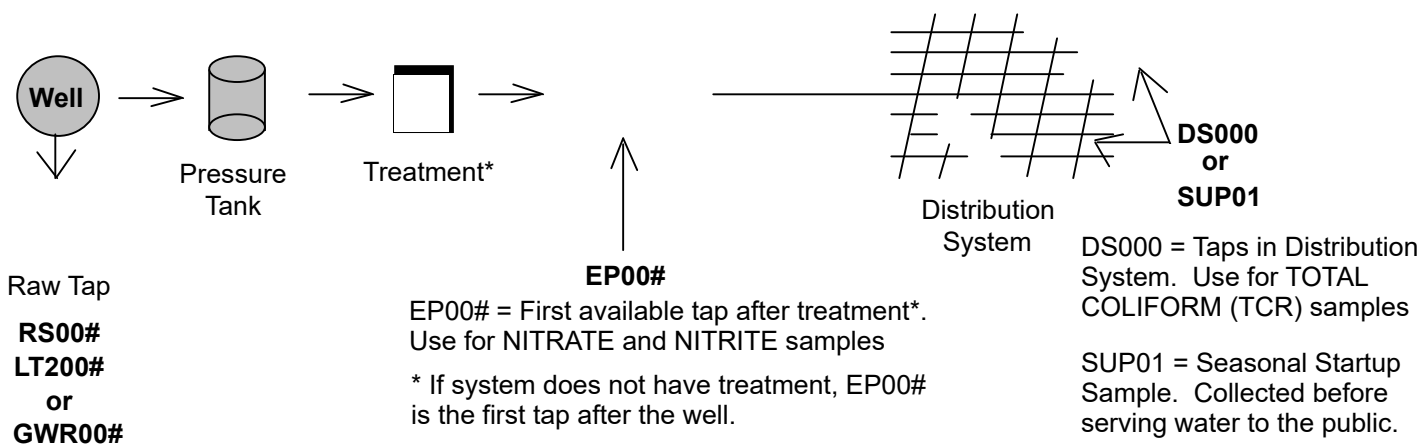

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 08/14/2020

OH6254712 BENCHMORE FARMS AMLC 1

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6257063 Facility Name: BENCHMORE FARMS AMLC NO 1

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

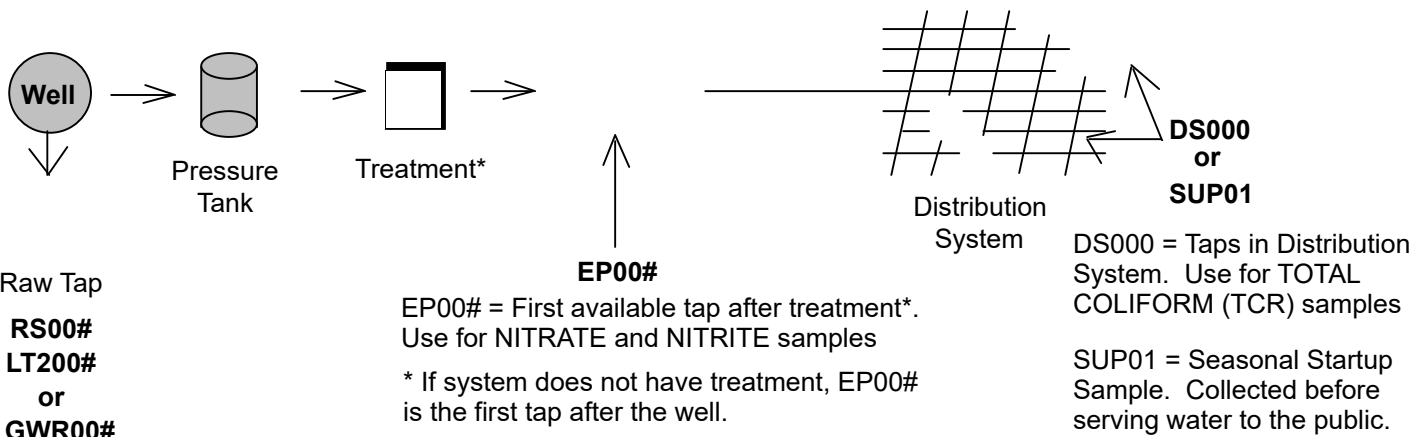

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6256812 BENCH-DICKINSON AMLC PWS

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: BENCH-DICKINSON AMLC DISTRIBUTION
Location SMP ID: SUP01 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

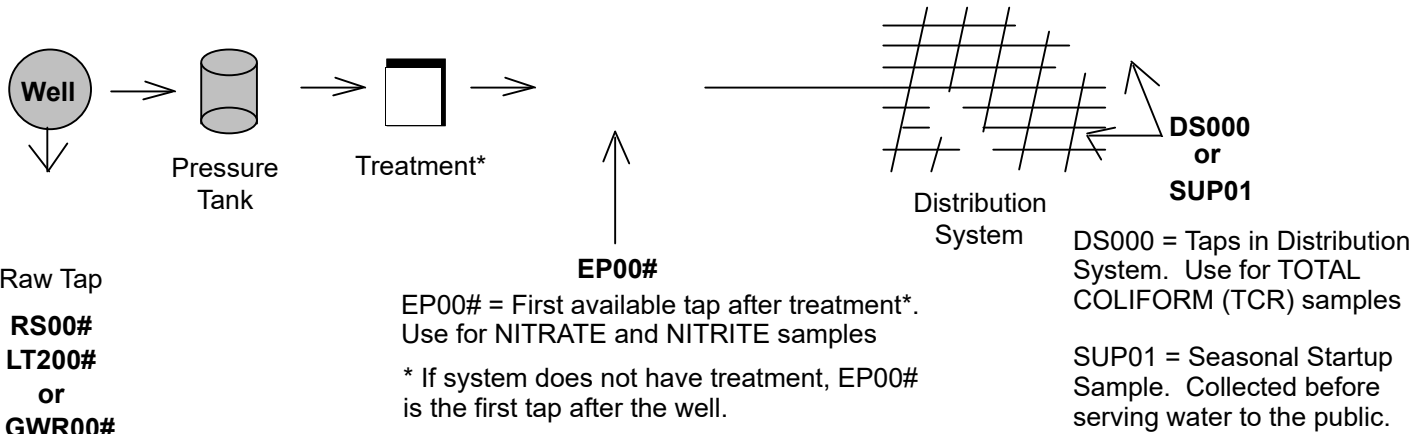

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6256812 BENCH-DICKINSON AMLC PWS

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BENCH-DICKINSON AMLC DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 6/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 7/31/2020
	1 Sample(s) Required between 8/1/2020 and 8/31/2020
	1 Sample(s) Required between 9/1/2020 and 9/30/2020

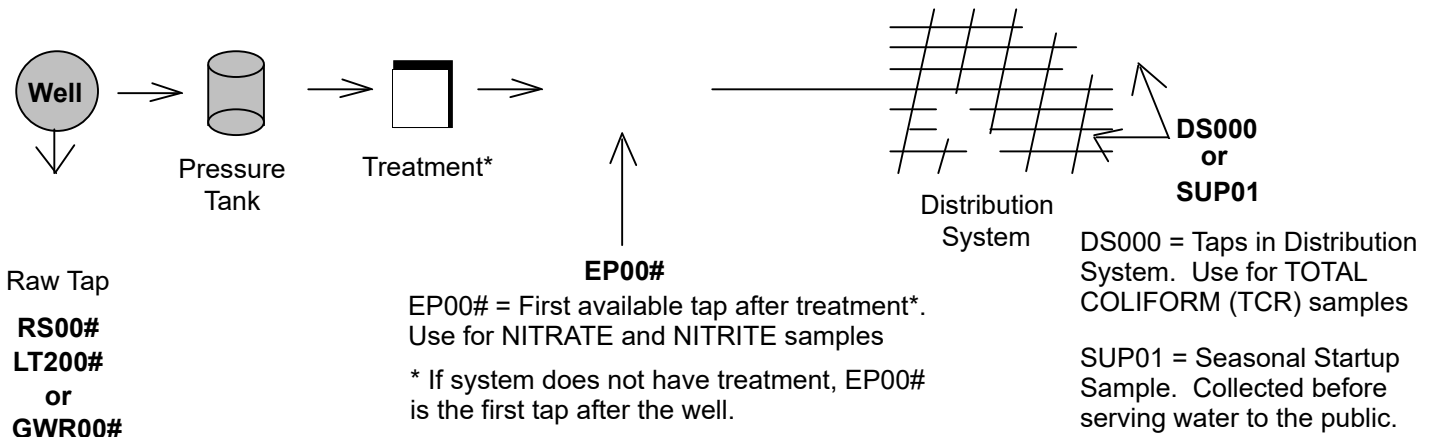Where to Collect Samples For a Small Public Water System

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6256812 BENCH-DICKINSON AMLC PWS

System Type: Transient Noncommunity

Operating Period: 6/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6257079 Facility Name: DICKINSON AMLC

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

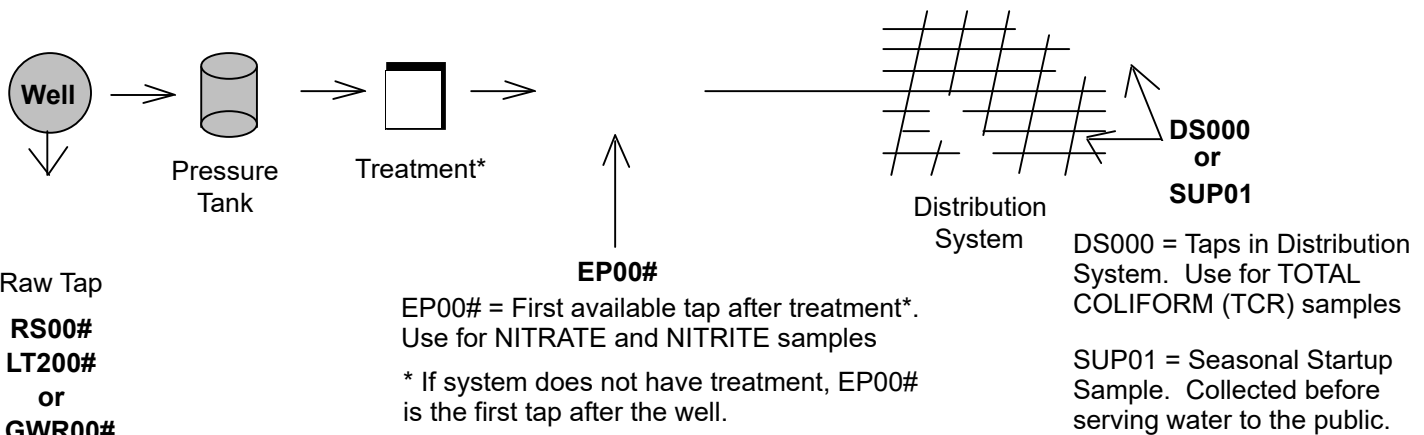

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6256912 BENCH, ROBERT AMLC PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **BENCH, ROBERT AMLC DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

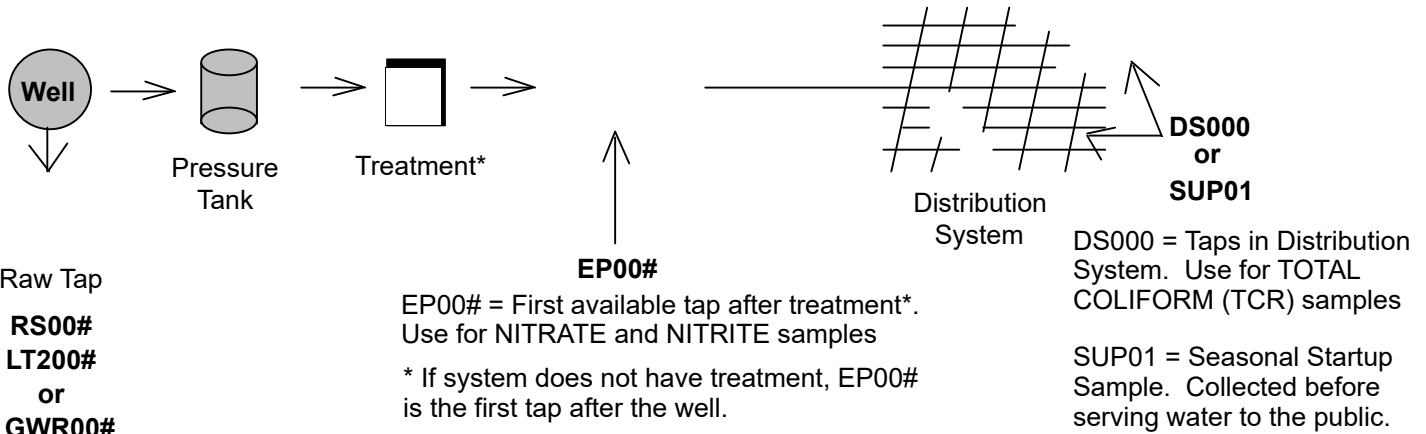

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6256912 BENCH, ROBERT AMLC PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BENCH, ROBERT AMLC DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2020 and 5/31/2020
	1 Sample(s) Required between 6/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 7/31/2020
	1 Sample(s) Required between 8/1/2020 and 8/31/2020
	1 Sample(s) Required between 9/1/2020 and 9/30/2020

Where to Collect Samples For a Small Public Water System

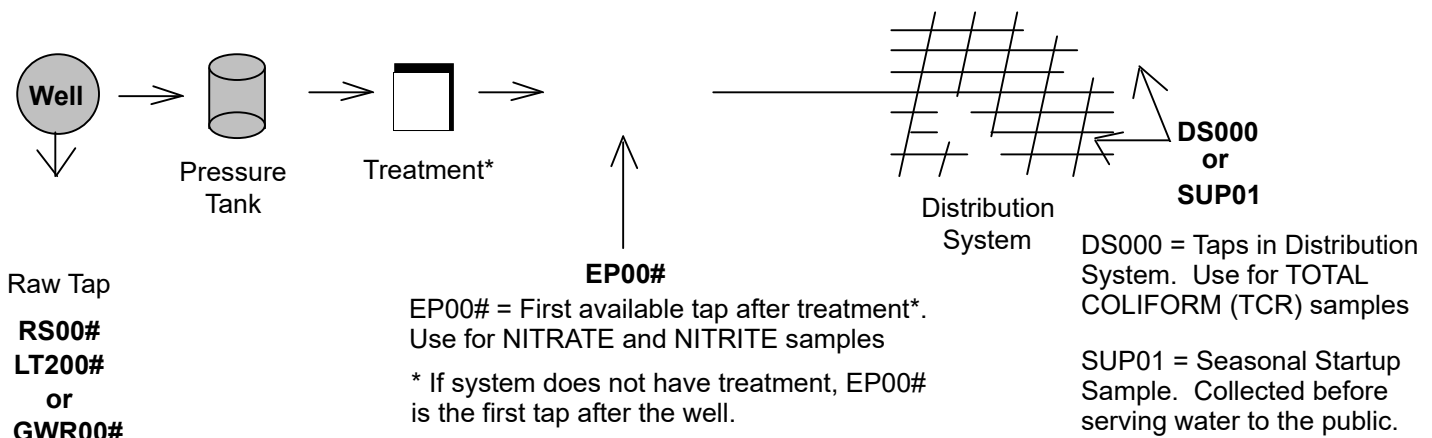

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6256912 BENCH, ROBERT AMLC PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **6257080** Facility Name: **BENCH ROBERT AMLC**

Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

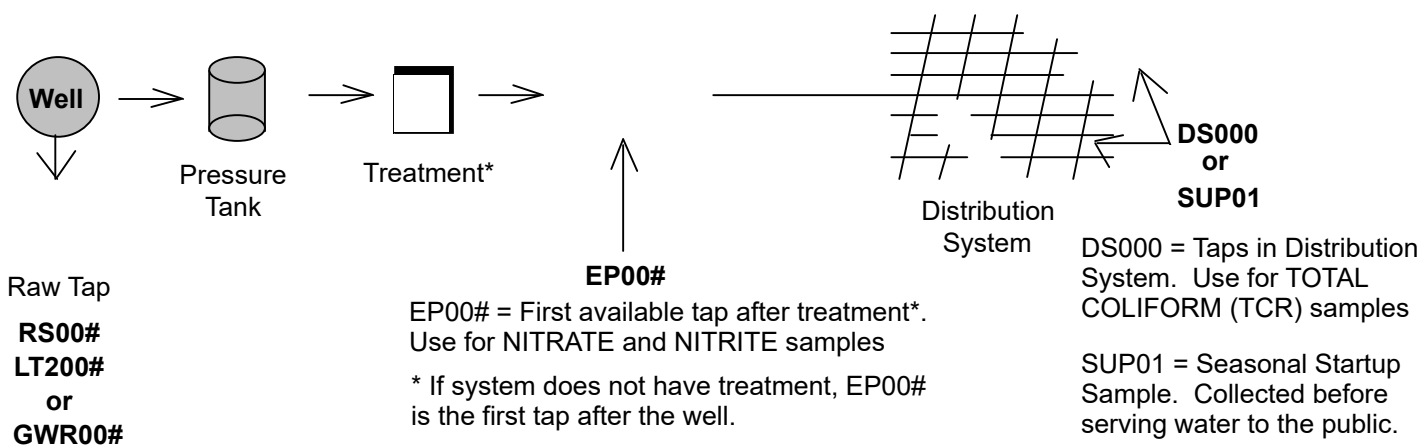

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6258112 ST HAZARDS

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **ST. HAZARDS DISTRIBUTION**
Location SMP ID: **SUP01** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

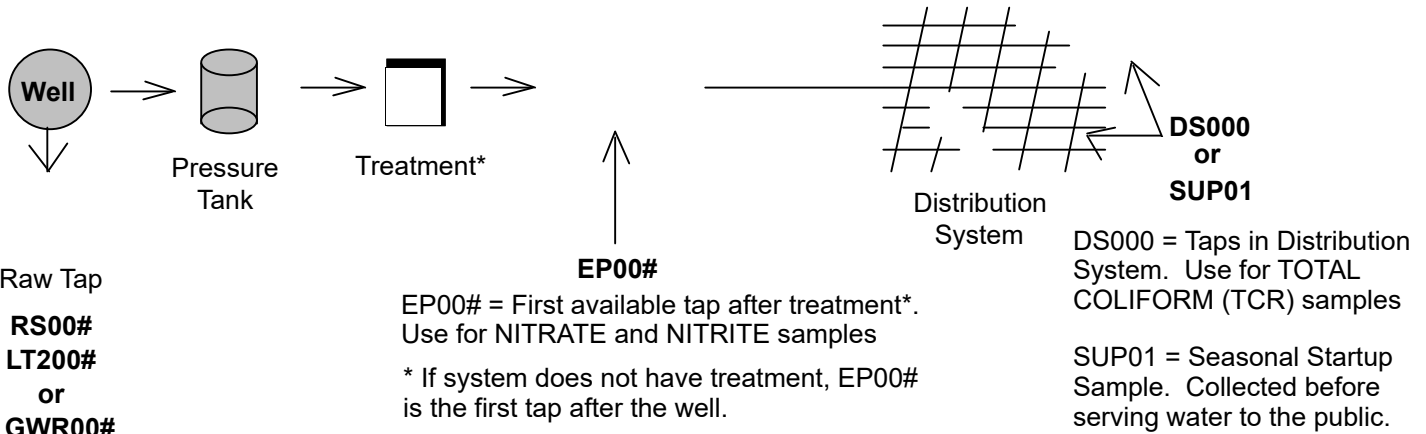

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6258112 ST HAZARDS

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.


Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ST. HAZARDS DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/3/2020 and 4/30/2020
	1 Sample(s) Required between 5/1/2020 and 5/31/2020
	1 Sample(s) Required between 6/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 7/31/2020
	1 Sample(s) Required between 8/1/2020 and 8/31/2020
	1 Sample(s) Required between 9/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 10/31/2020
	1 Sample(s) Required between 11/1/2020 and 11/30/2020

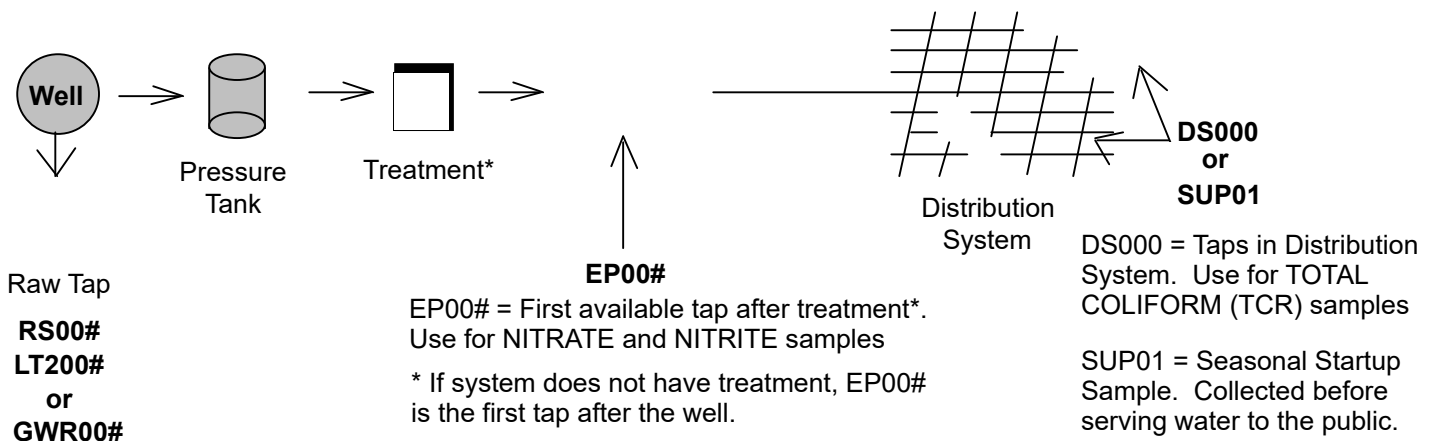Where to Collect Samples For a Small Public Water System

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6258112 ST HAZARDS

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Ground Water Rule Substantial System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6257089	Facility Name: ST HAZARDS	
Location SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

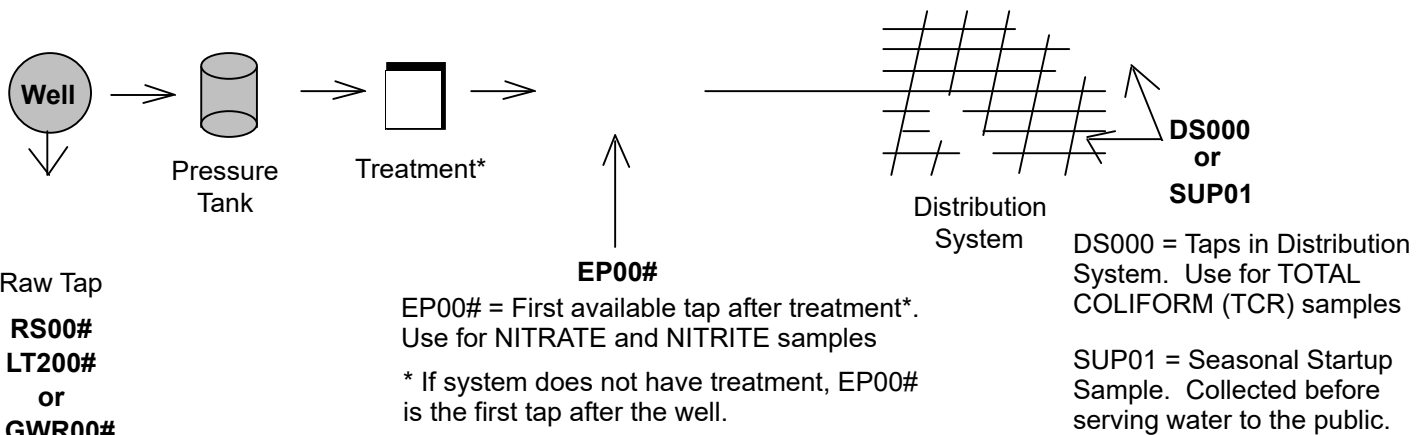

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6258712 J F WALLEYE

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: J.F. WALLEYE MICRO-BREWE DISTRIBUTION
Location SMP ID: SUP01 Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM - SEASONAL STARTUP	At least 1 negative Total Coliform Bacteria sample prior to serving water to the public

*** Seasonal start-up sample does not count for routine compliance requirements. Collect at least one special purpose (SP) sample for total coliform (TC) analysis at the service connection considered to be most susceptible to contamination. The sample must be TC negative before the system may serve water to the public. If the sample is positive, contact your Ohio EPA District Representative for additional requirements. If your start date is different from last year, please contact your Ohio EPA District Representative.***

Where to Collect Samples For a Small Public Water System

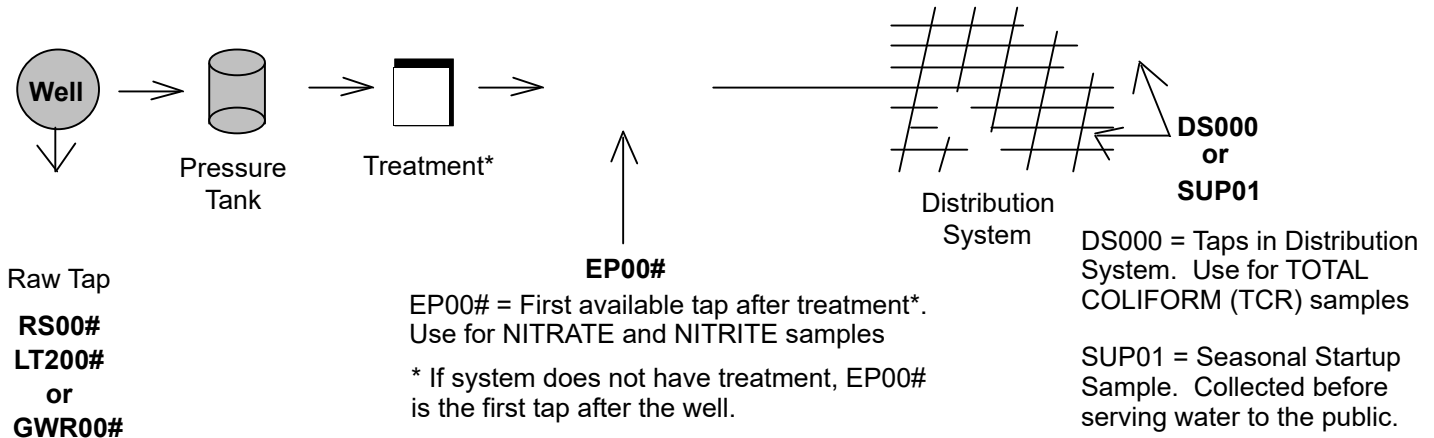

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6258712 J F WALLEYE

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: J.F. WALLEYE MICRO-BREWE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 5/1/2020 and 5/31/2020
	1 Sample(s) Required between 6/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 7/31/2020
	1 Sample(s) Required between 8/1/2020 and 8/31/2020
	1 Sample(s) Required between 9/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 10/4/2020

Where to Collect Samples For a Small Public Water System

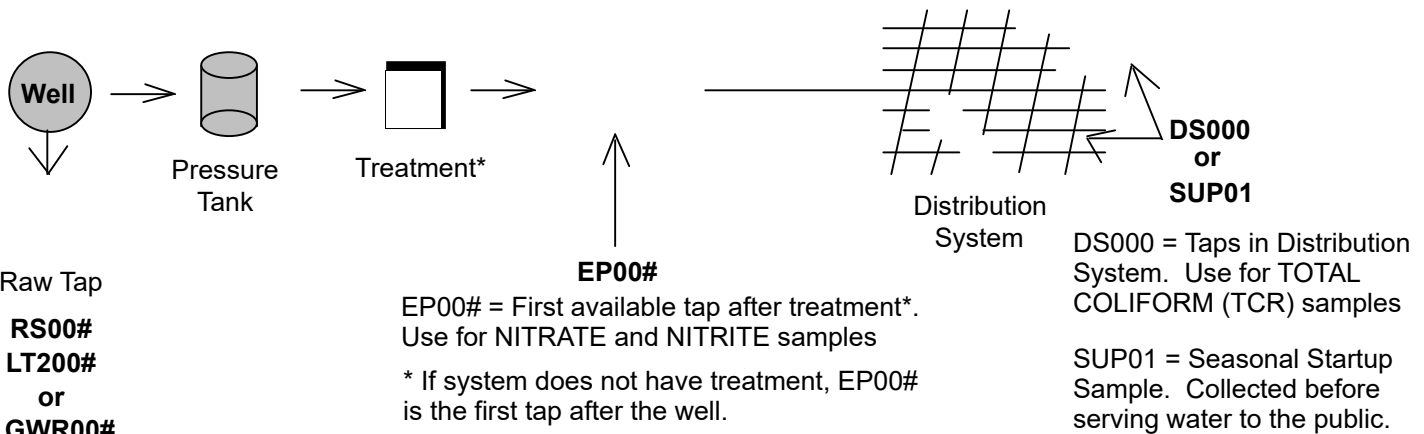

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6258712 J F WALLEYE

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6257094	Facility Name: JF WALLEYE MICRO BREWERY
Location SMP ID: EP001	Facility Source: Ground Water
	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

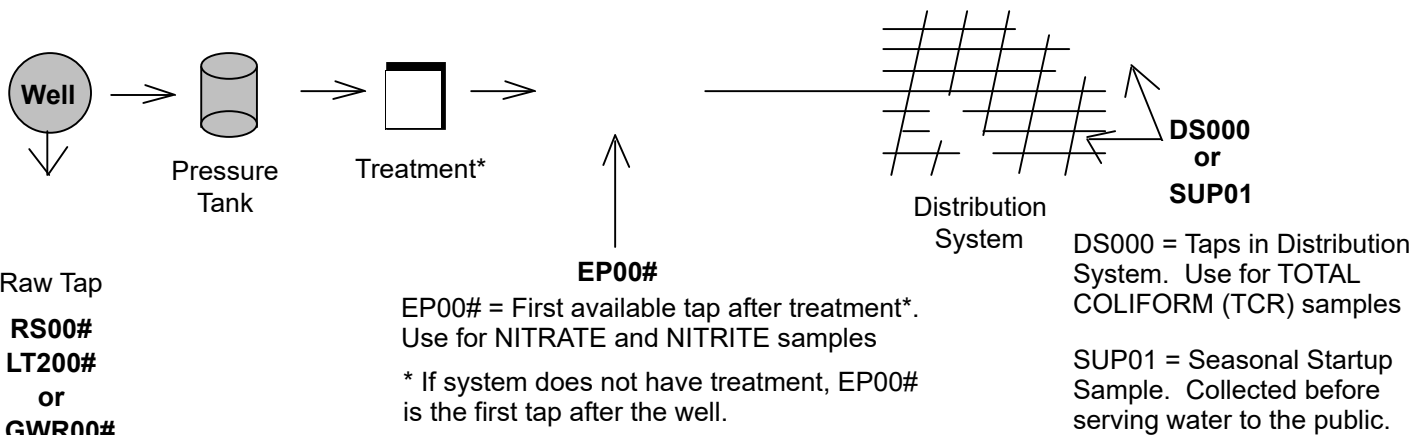

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/17/2020

OH6259112 ELLISTON ZION UMC- GRAYTOWN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. Also, monitoring schedules may be revised during the year based on sampling results.


For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **ZION UNITED METHODIST CH GRAYTOWN DIST**
Location SMP ID: **DS000** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2020 and 3/31/2020
	1 Sample(s) Required between 4/1/2020 and 6/30/2020
	1 Sample(s) Required between 7/1/2020 and 9/30/2020
	1 Sample(s) Required between 10/1/2020 and 12/31/2020

Where to Collect Samples For a Small Public Water System

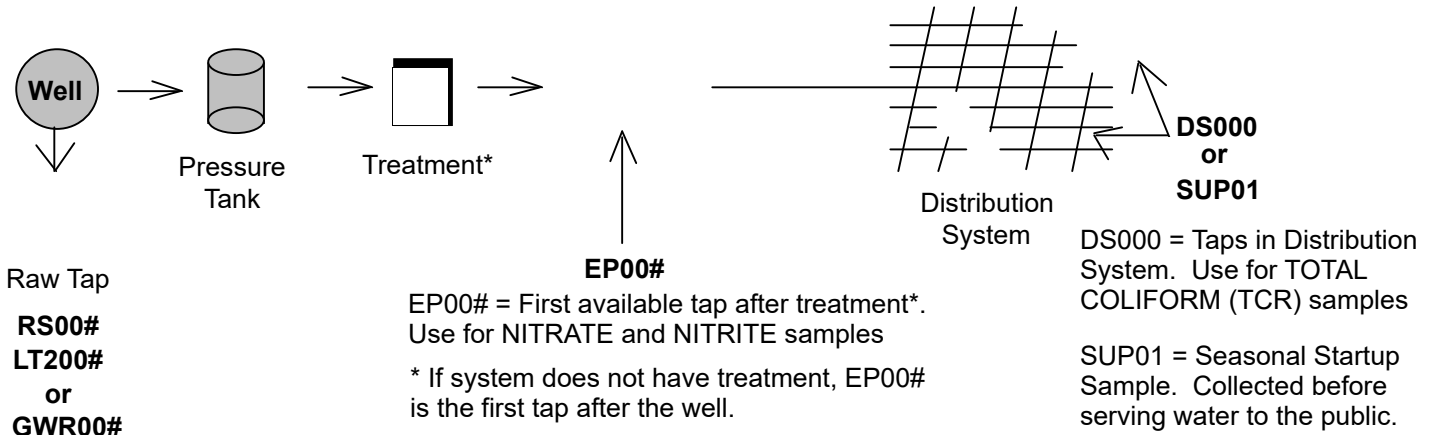

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

Effective Date: 01/01/2020

OH6259112 ELLISTON ZION UMC- GRAYTOWN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Ground Water Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule.

Also, monitoring schedules may be revised during the year based on sampling results.

For water emergencies that occur after hours, please call 800-282-9378


ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 6260732 Facility Name: ZION UNITED METHODIST CHURCH GRAYTOWN

Location SMP ID: EP001 Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2020 and 10/31/2020

Where to Collect Samples For a Small Public Water System

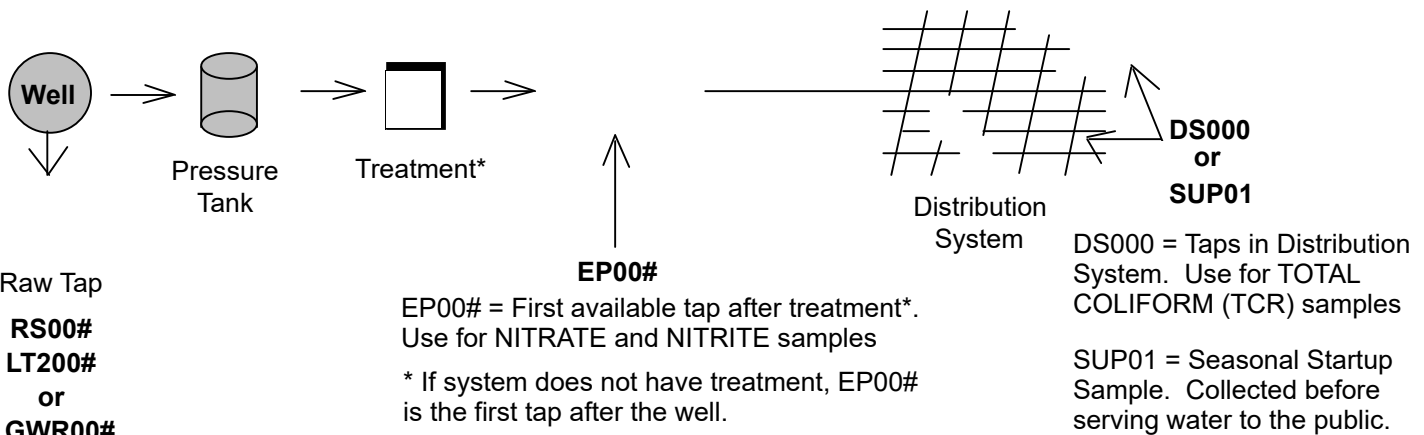

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!